


CENTLEC (Pty) Ltd

DESCRIPTION

1	FEEDER CABLE FROM SUBSTATION
2	NEUTRAL
3	TERMINALS IN METER BOX
4	SINGLE PHASE CONVENTIONAL METER
5	CIRCUIT BREAKER - 80 AMP SINGLE POLE
6	PT FUSE AND BASE - 5 AMP
7	METER BOX
8	RIPLLE RELAY
9	NEUTRAL BUSBAR
10	SERVICE CONNECTION CABLE
11	CONSUMERS EARTH TERMINAL
12	MAINS CIRCUIT BREAKER
13	Nr. 6 BARE COPPER EARTH CONTINUITY CONDUCTOR
14	CONSUMERS DISTRIBUTION BOARD
15	EARTH CONNECTION TERMINAL

NOTES

- NEUTRAL AND EARTH MUST NOT BE BRIDGED INSIDE THE METER BOX
- FEEDER CABLE AND SERVICE CONNECTION CABLE ARMOURING MUST BE BONDED TOGETHER BY CLAMP TO THE METER BOX EARTH TERMINAL

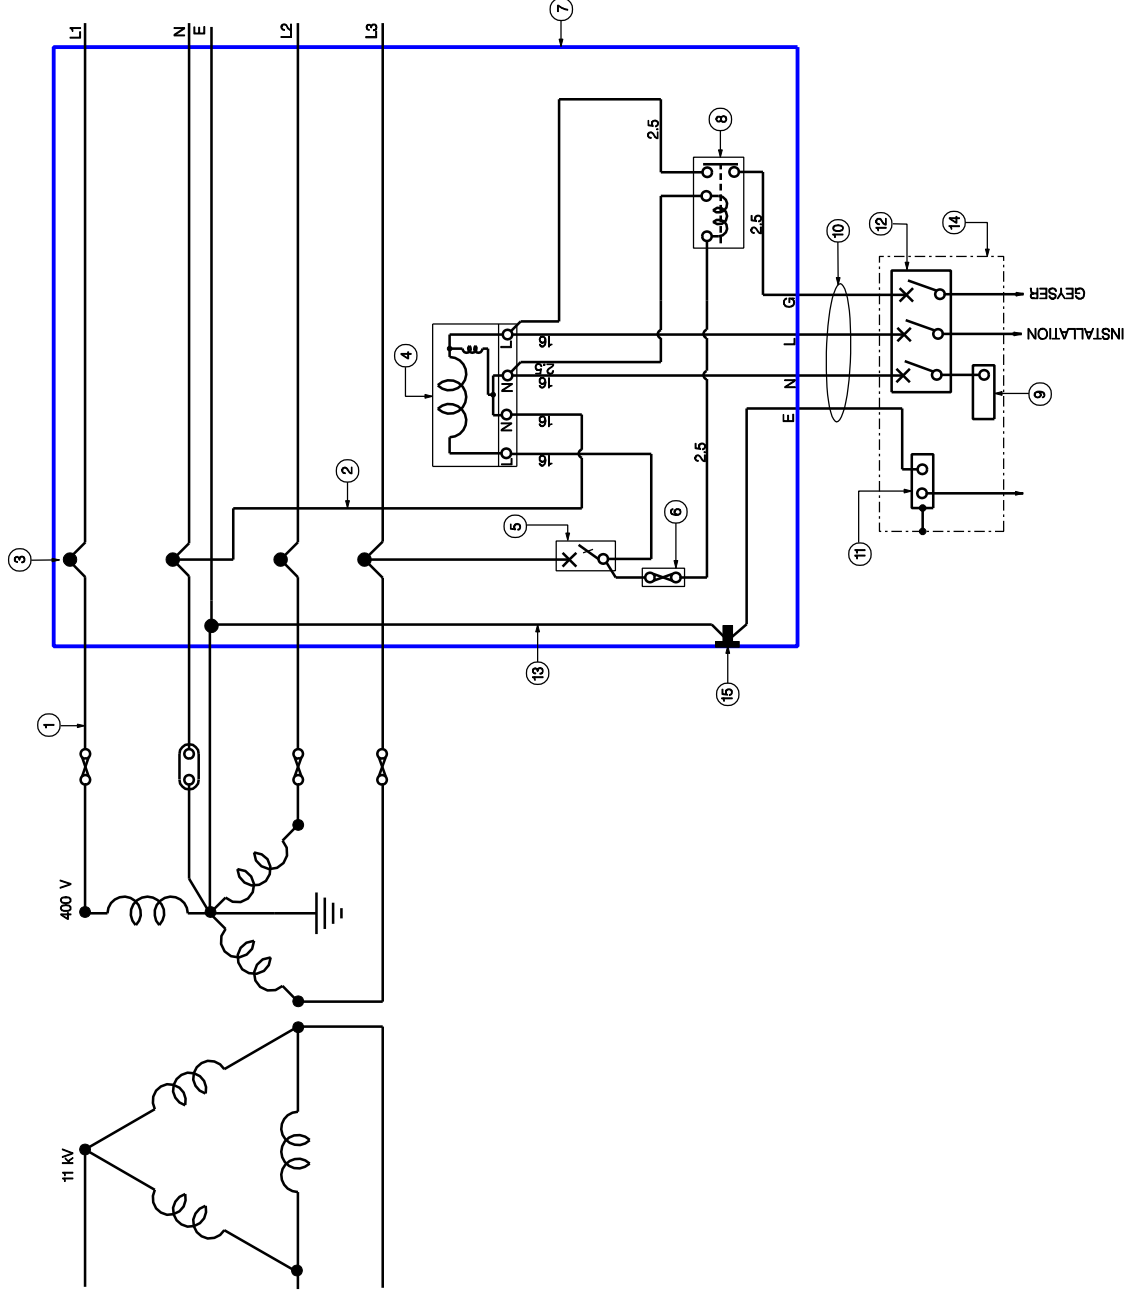

CENTLEC (Pty) Ltd
Reg No 2037062/07

PRIVATE BAG X14, BRANDVOR 924
Tel: 051 - 402228 Fax: 051 - 402288

DESIGNED B. S. TSHABALALA DRAWN	ONTWERP/DATE GETEKEN/SCALE N T S	DATUM/FIRST DRG. MAN A. C. DE WET CHECKED SKAAL	EERSTE TEKENAAR NAGESIEN/DESIGN & DEVELOPMENT AMGOQI	NAGESIEN UTILIZATION ONTWERP & ONTWIKKELING K V/D BERG	BENUTTING REGIONAL SERVICES X.FAKU KLENTEDIENS/EXECUTIVE MANAGER ENGINEERING REST/ORDER INGENIEURSWES	STREEKS- TITEL DIENSTE	TITLE TN-S DISTRIBUTION NETWORK SINGLE PHASE CONVENTIONAL METER INSIDE THE METER BOX	DRAWING Nr., TEKENING No. REV., VERWYS. TS - 5 - 24	Ø
---------------------------------------	--	---	--	--	--	------------------------------	---	--	---

THE C.A.D. REFERENCE NUMBER IS: TS-5-24