

| No. | DATE | AMENDMENT | |
|-----|------------|-------------------|----|
| A | 2021/08/24 | ISSUED FOR TENDER | DA |
| | | | |

Copyright vests in the
Department of Public Works

as built drawings

certified as built drawings as per Council of Building
Archives AS-BUILT DRAWING REQUIREMENTS

name: _____

date: _____

professional registration no.: _____

LEGEND:

CIRCUIT BREAKER

AIR CIRCUIT BREAKER OR M.V. CIRCUIT BREAKER

ISOLATOR

FUSE SWITCH

SPACE SPACE

TIME SWITCH

FIREMANS SWITCH

FIRE INTERFACE

PHOTOCELL

KEY SWITCH

MASTER SWITCH

STOP/START SWITCH

MAXIMUM DEMAND METER/KVA METER

CONTACTOR

RELAY

BYPASS SWITCH

EARTH LEAKAGE

GENERATOR

TRANSFORMER 11kV / 400V

DEMAND INDICATING AMMETERS

DEMAND INDICATING AMMETERS

PREFITTED SPACE

KWH METER



cad file name
E6(1)(F)

page type
A 1


discipline
ELECTRICAL

service

TROMPSBURG
SPECIAL NEEDS SCHOOL
ELECTRICAL AND ELECTRONIC

| | |
|--------------------|---|
| WCS number | EDIT |
| drawing title | SCHOOL OVERALL RETTICULATION SCHEMATIC |
| ref.no. EDIT | designed K.NEL |
| scale 1:100 | drawn D.ALBIN |
| date 2018.11.02 | checked K.NEL |
| DPW drawing number | |

E6(1)(F)

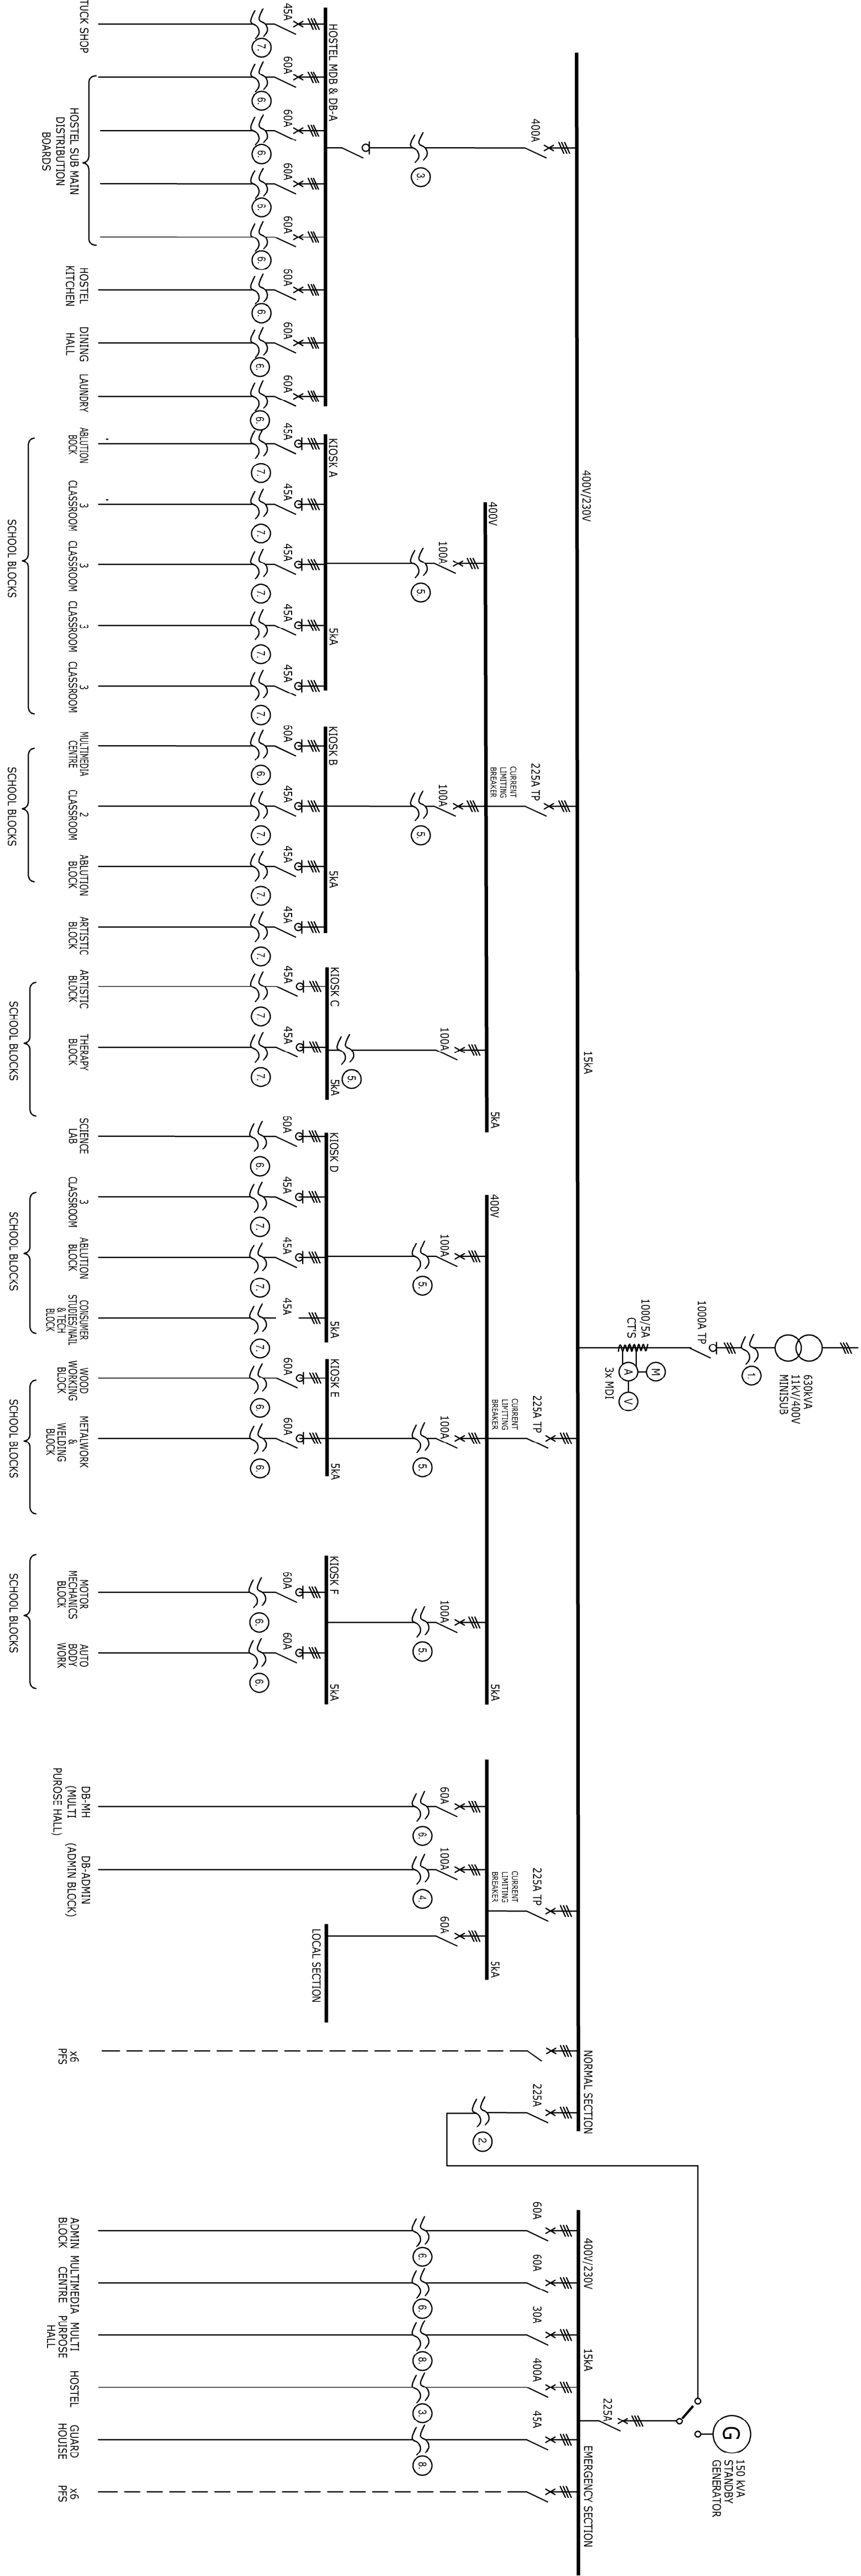

- CABLE SCHEDULE:
- 4x 120mm² x 4c PVC SWA Cu CABLES + 70mm² BCEW
 - 1x 120mm² x 4c PVC SWA Cu CABLES + 70mm² BCEW
 - 2x 95mm² x 4c PVC SWA Cu CABLES + 50mm² BCEW
 - 1x 95mm² x 4c PVC SWA Cu CABLES + 50mm² BCEW
 - 1x 35mm² x 4c PVC SWA Cu CABLES + 25mm² BCEW
 - 1x 25mm² x 4c PVC SWA Cu CABLES + 16mm² BCEW
 - 1x 16mm² x 4c PVC SWA Cu CABLES + 10mm² BCEW
 - 1x 10mm² x 4c PVC SWA Cu CABLES + 6mm² BCEW

TENDER

RS