




Parking Lot

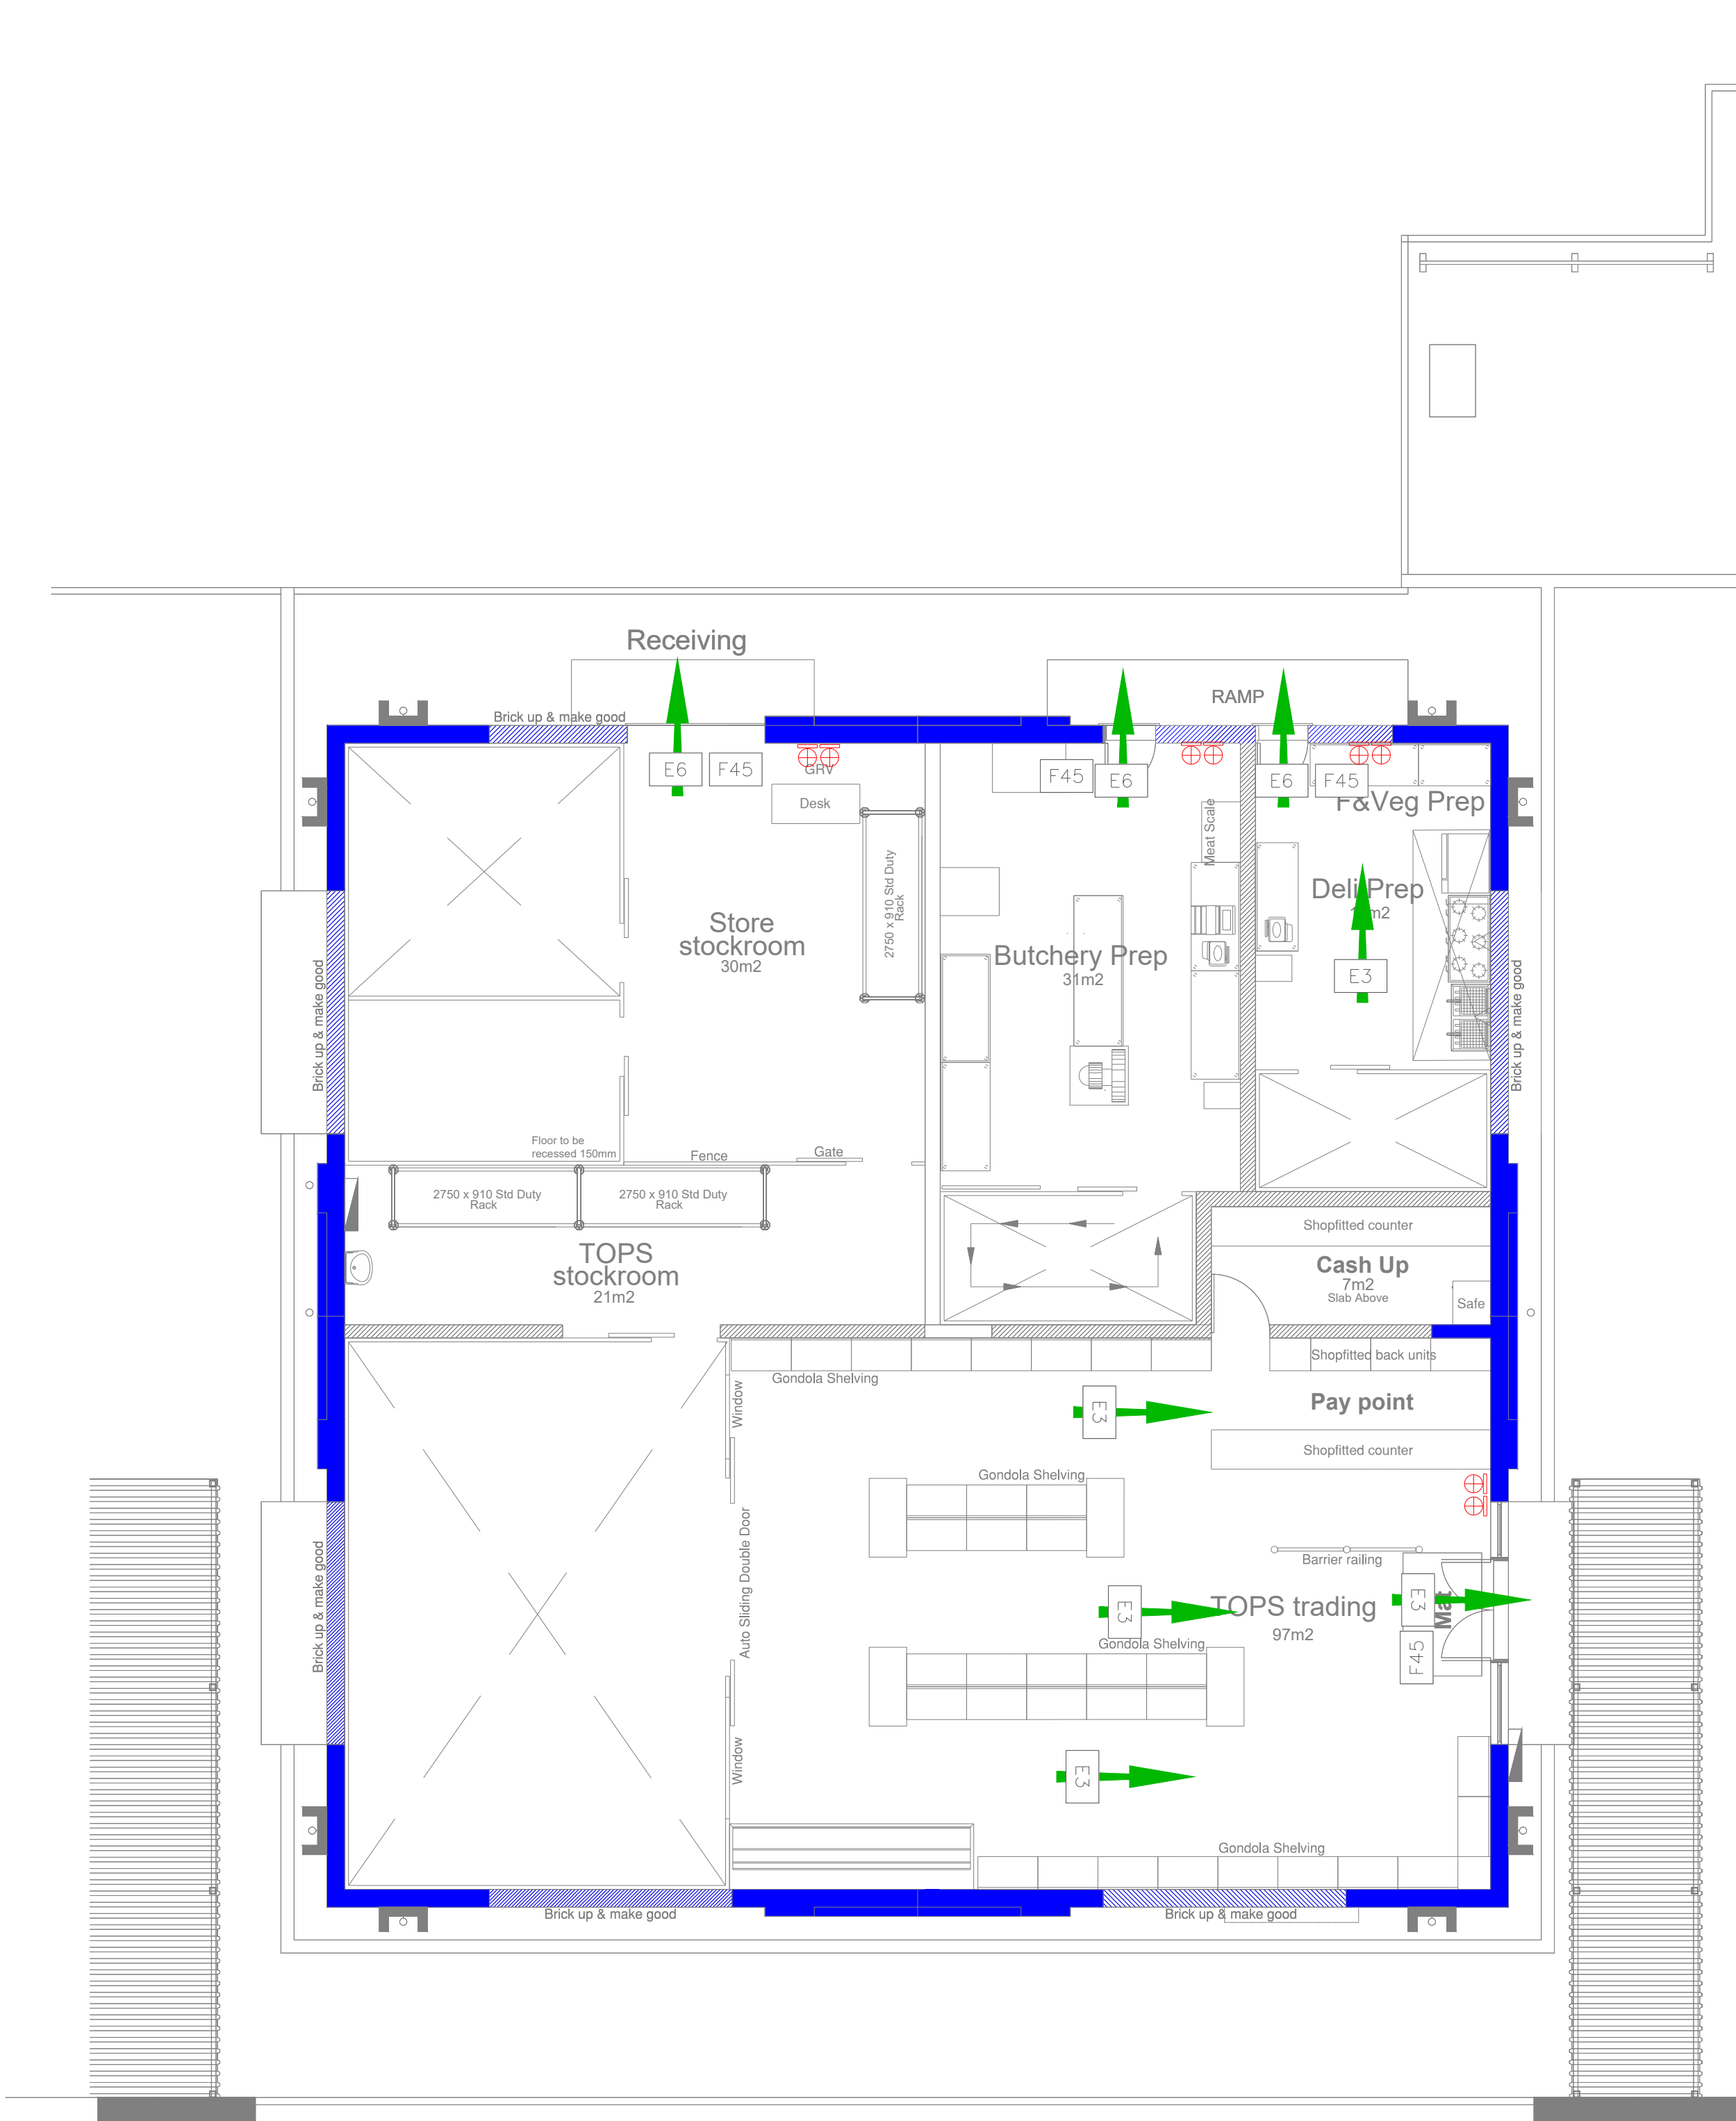

BUILDING 2
Ground Floor

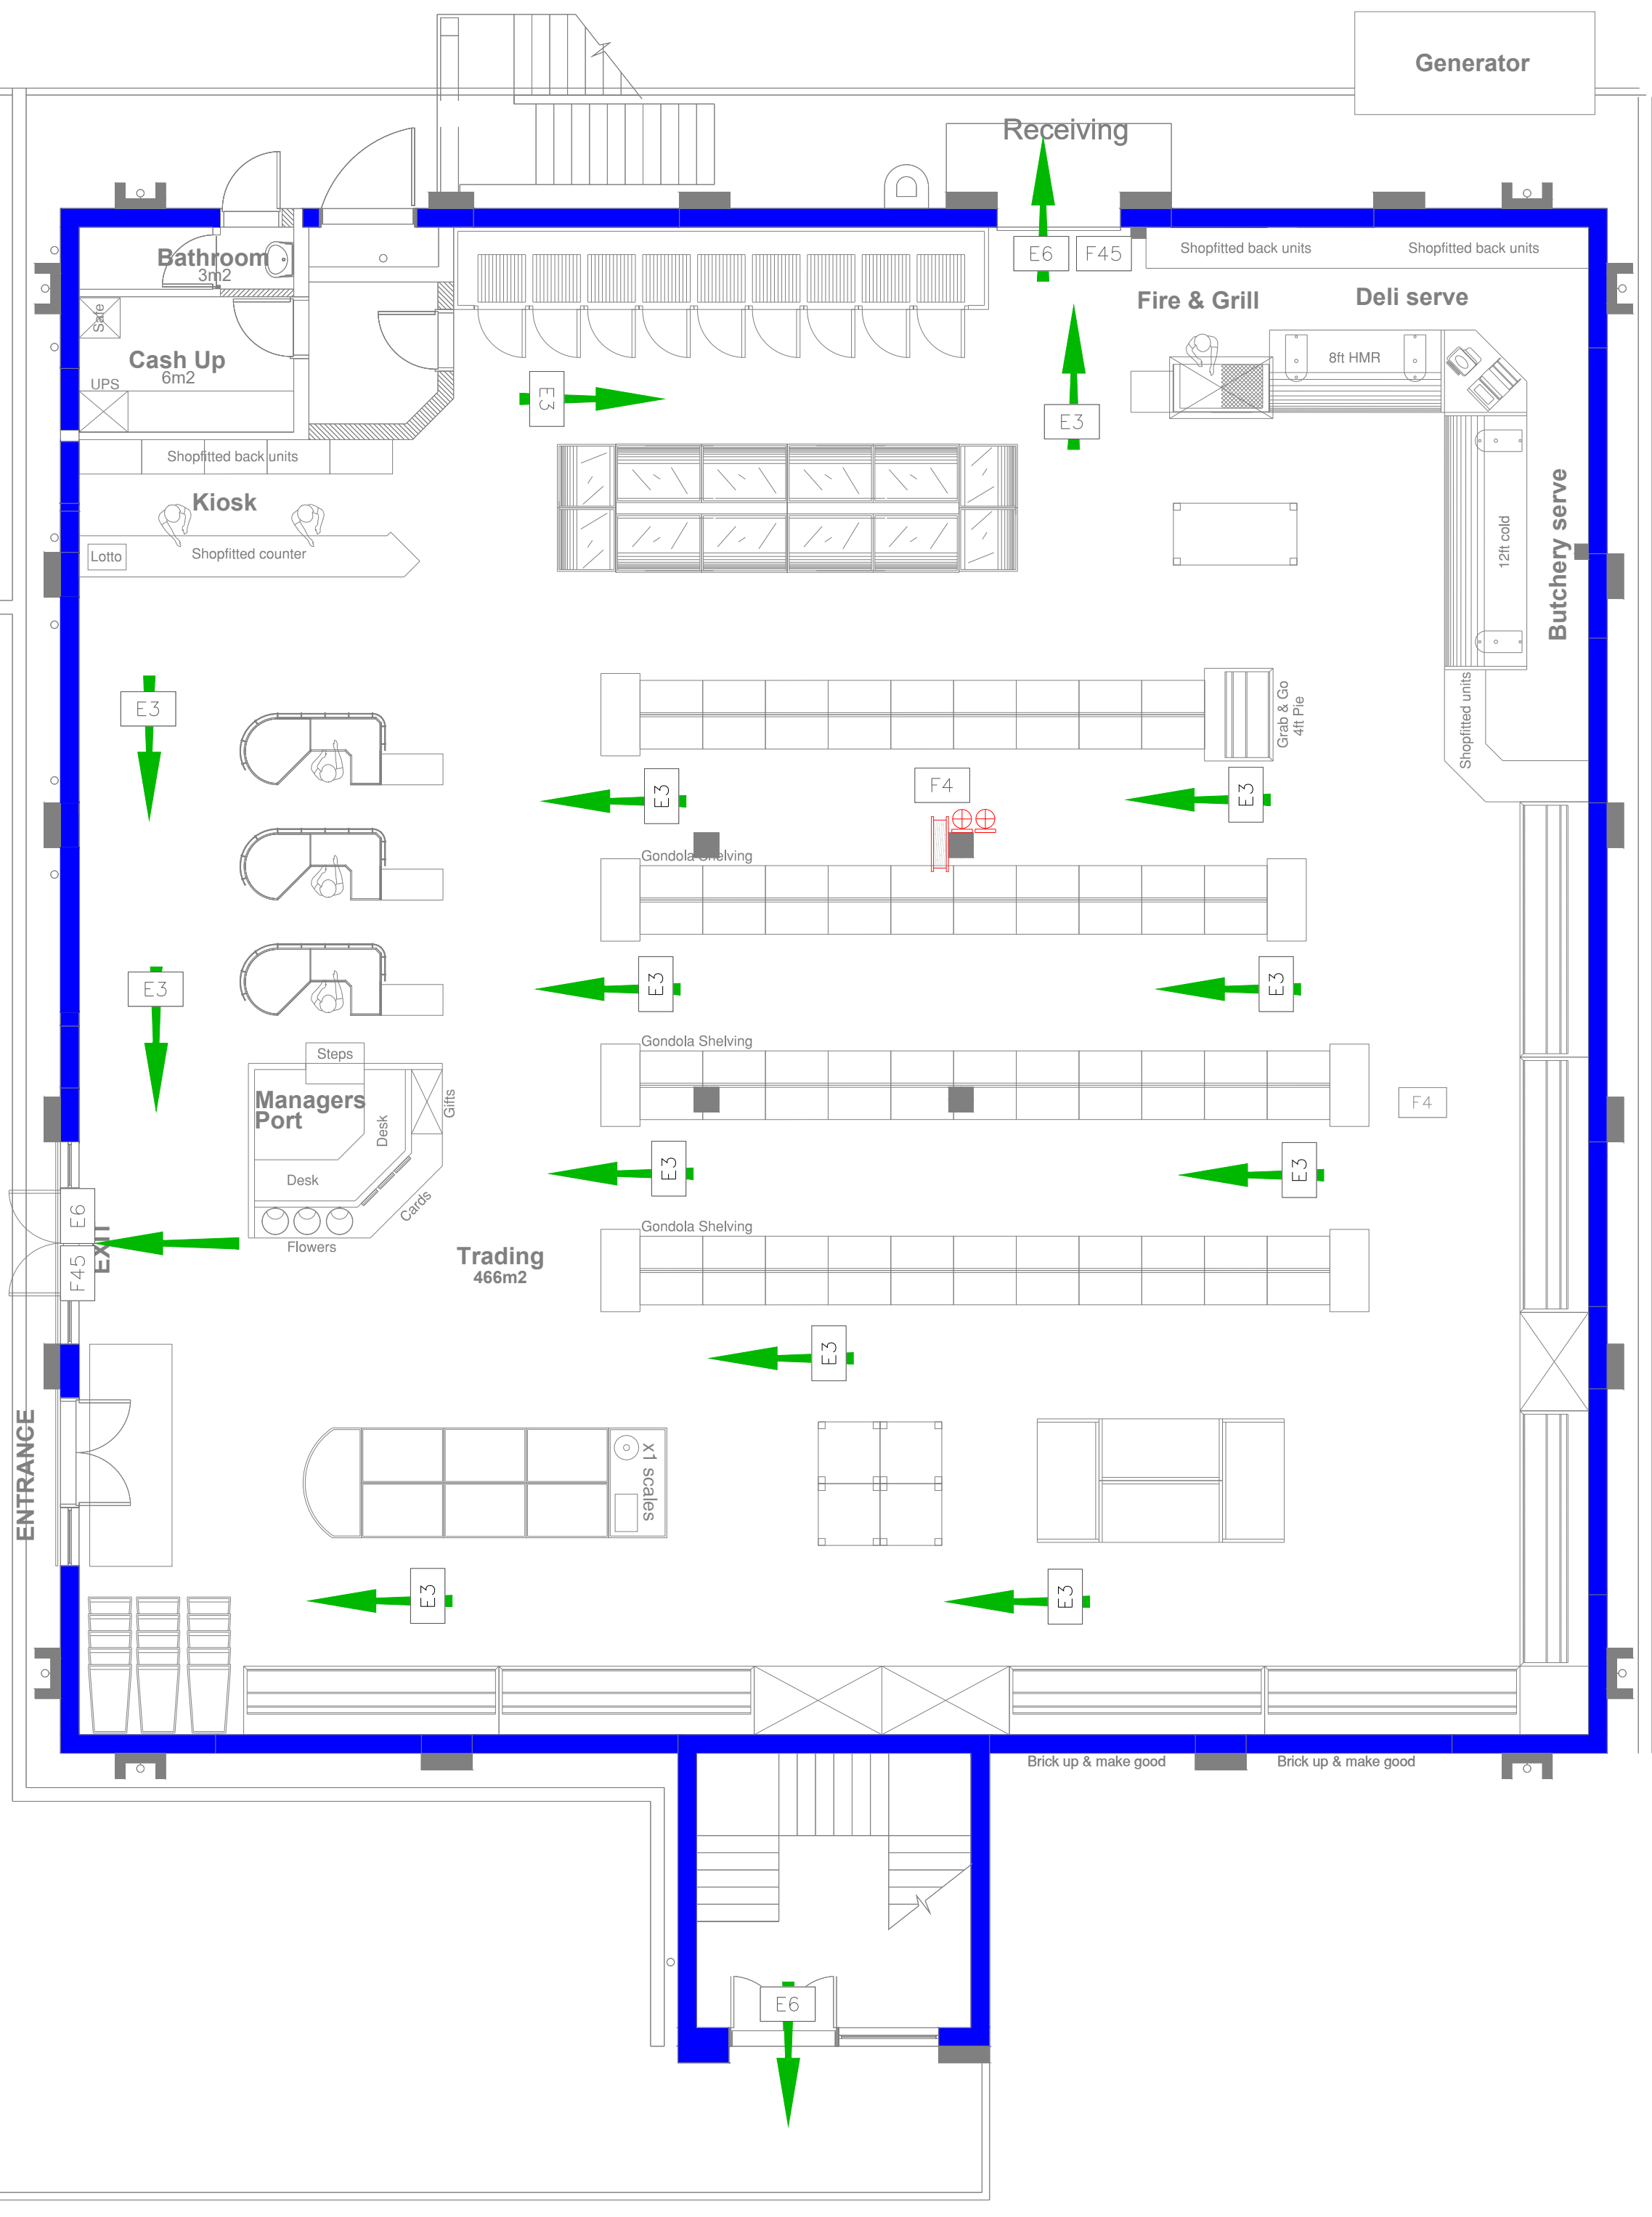

BUILDING 3
Ground Floor

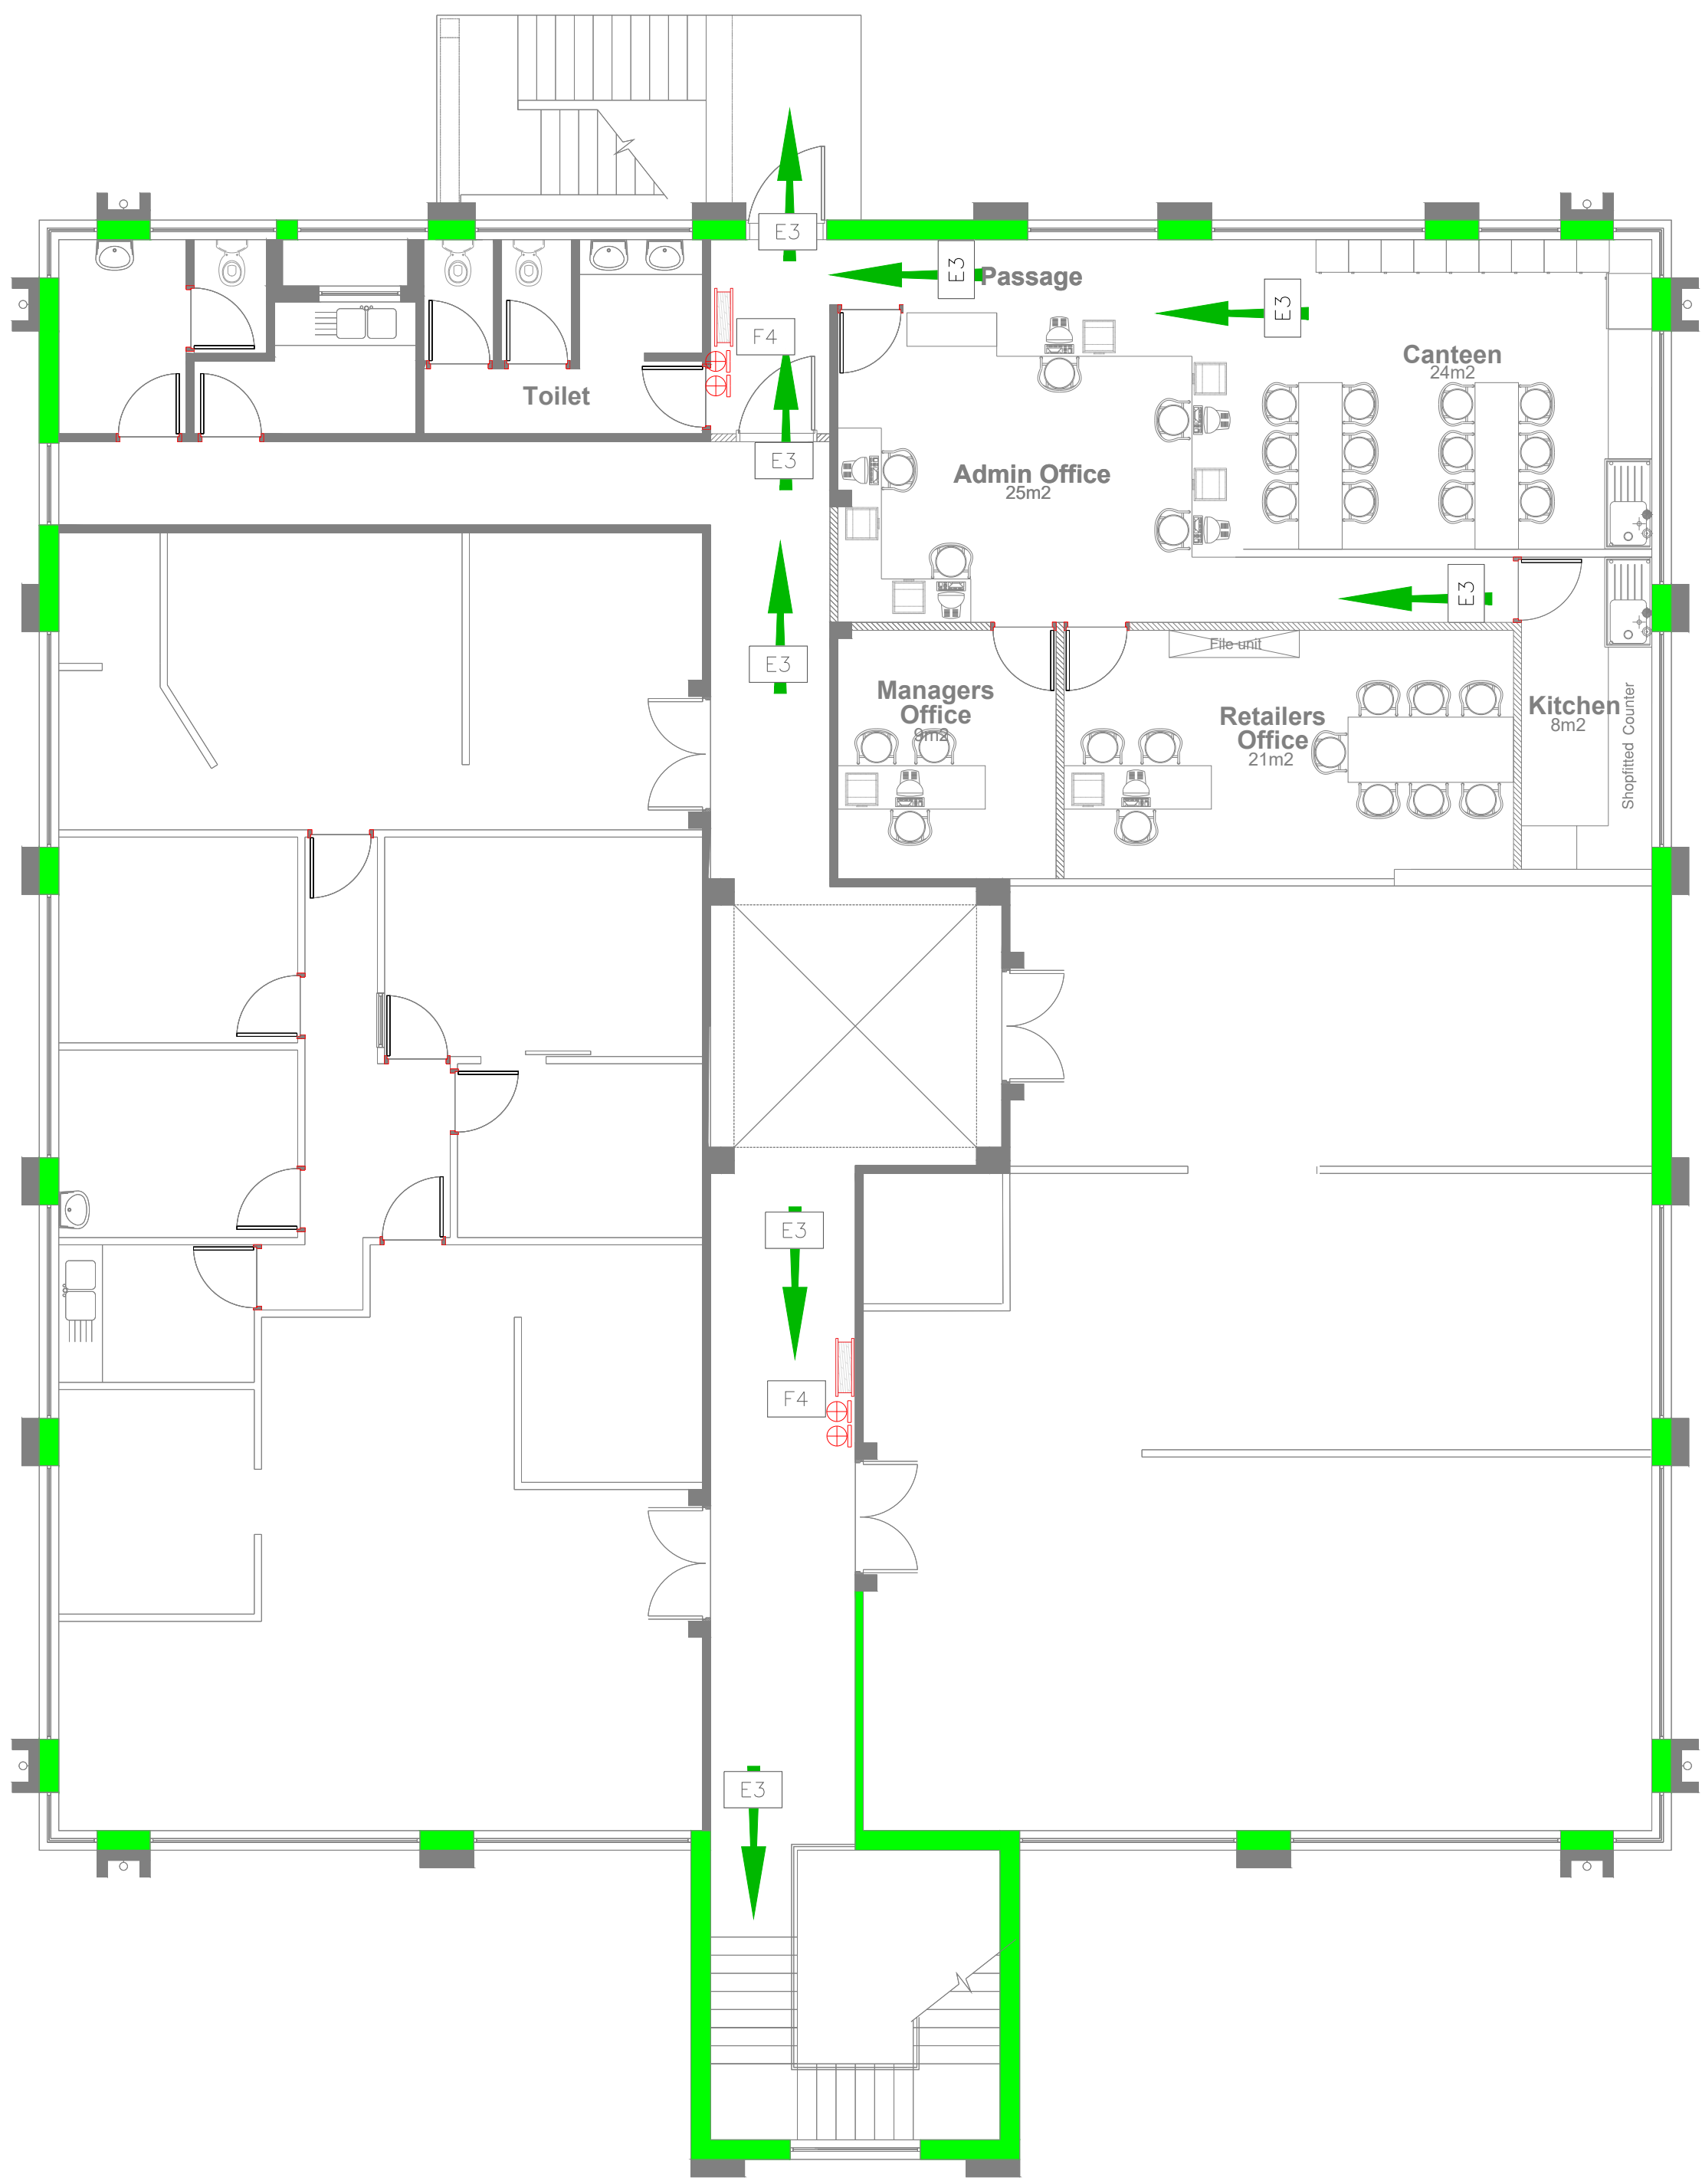

BUILDING 3
First Floor

FIRE LEGEND		
Symbol	QTY	Description
	·	FIRE EXTINGUISHER 4.5kg (DCP).
	·	FIRE EXTINGUISHER 5kg (CO ₂).
	·	FIRE HOSE REEL.
	·	#65 HYDRANT
	·	Break Glass
SIGNAGE REFERENCE	SIGNAGE PREVIEW	QUANTITY
E1		
E2		
E3		
E6		
F4		
F13		
E16		
E17		

REVISIONS		
DATE	INITIALS	DESCRIPTION

APPROVED / ACCEPTED BY:

RESPONSIBLE PERSON:

SIGNATURE:

DATE:

CLIENT:



Small Enterprise Finance Agency

ARCHITECT:

DRAWING NUMBER:

DRAWING REVISION: 0

CONSULTING ENGINEERS:

DFR ENGINEERS (PTY) LTD

141 GENERAL BEYERS ST
PRETORIA NORTH
SOUTH AFRICA

TEL: +27 12 546 7574
FAX: +27 12 546 7573
EMAIL: reception@dfreng.co.za



DFR ENGINEERS

ELECTRICAL, ELECTRONIC & MECHANICAL CONSULTING ENGINEERS

This drawing is the property of DFR Engineers.
Copyright.
The contents of this drawing is the property of the owner
and is confidential. It shall not in any manner be
reproduced, destroyed, lent or given away without the
permission of the owner.

PROJECT:

KWIKSPAR KWAMAGWAKI

DISCIPLINE:

MECHANICAL ENGINEERING SERVICES

DRAWING TITLE:

FIRE PROTECTION SYSTEM

APPROVED DFR:

SCALE:	1:100	DESIGNED:	KK
PAPER SIZE:	A1	DRAWN:	KK
DATE:	08/08/2022	CHECKED:	DR

CAD FILE:

DWG NO:

10317M001

REVISION

00