

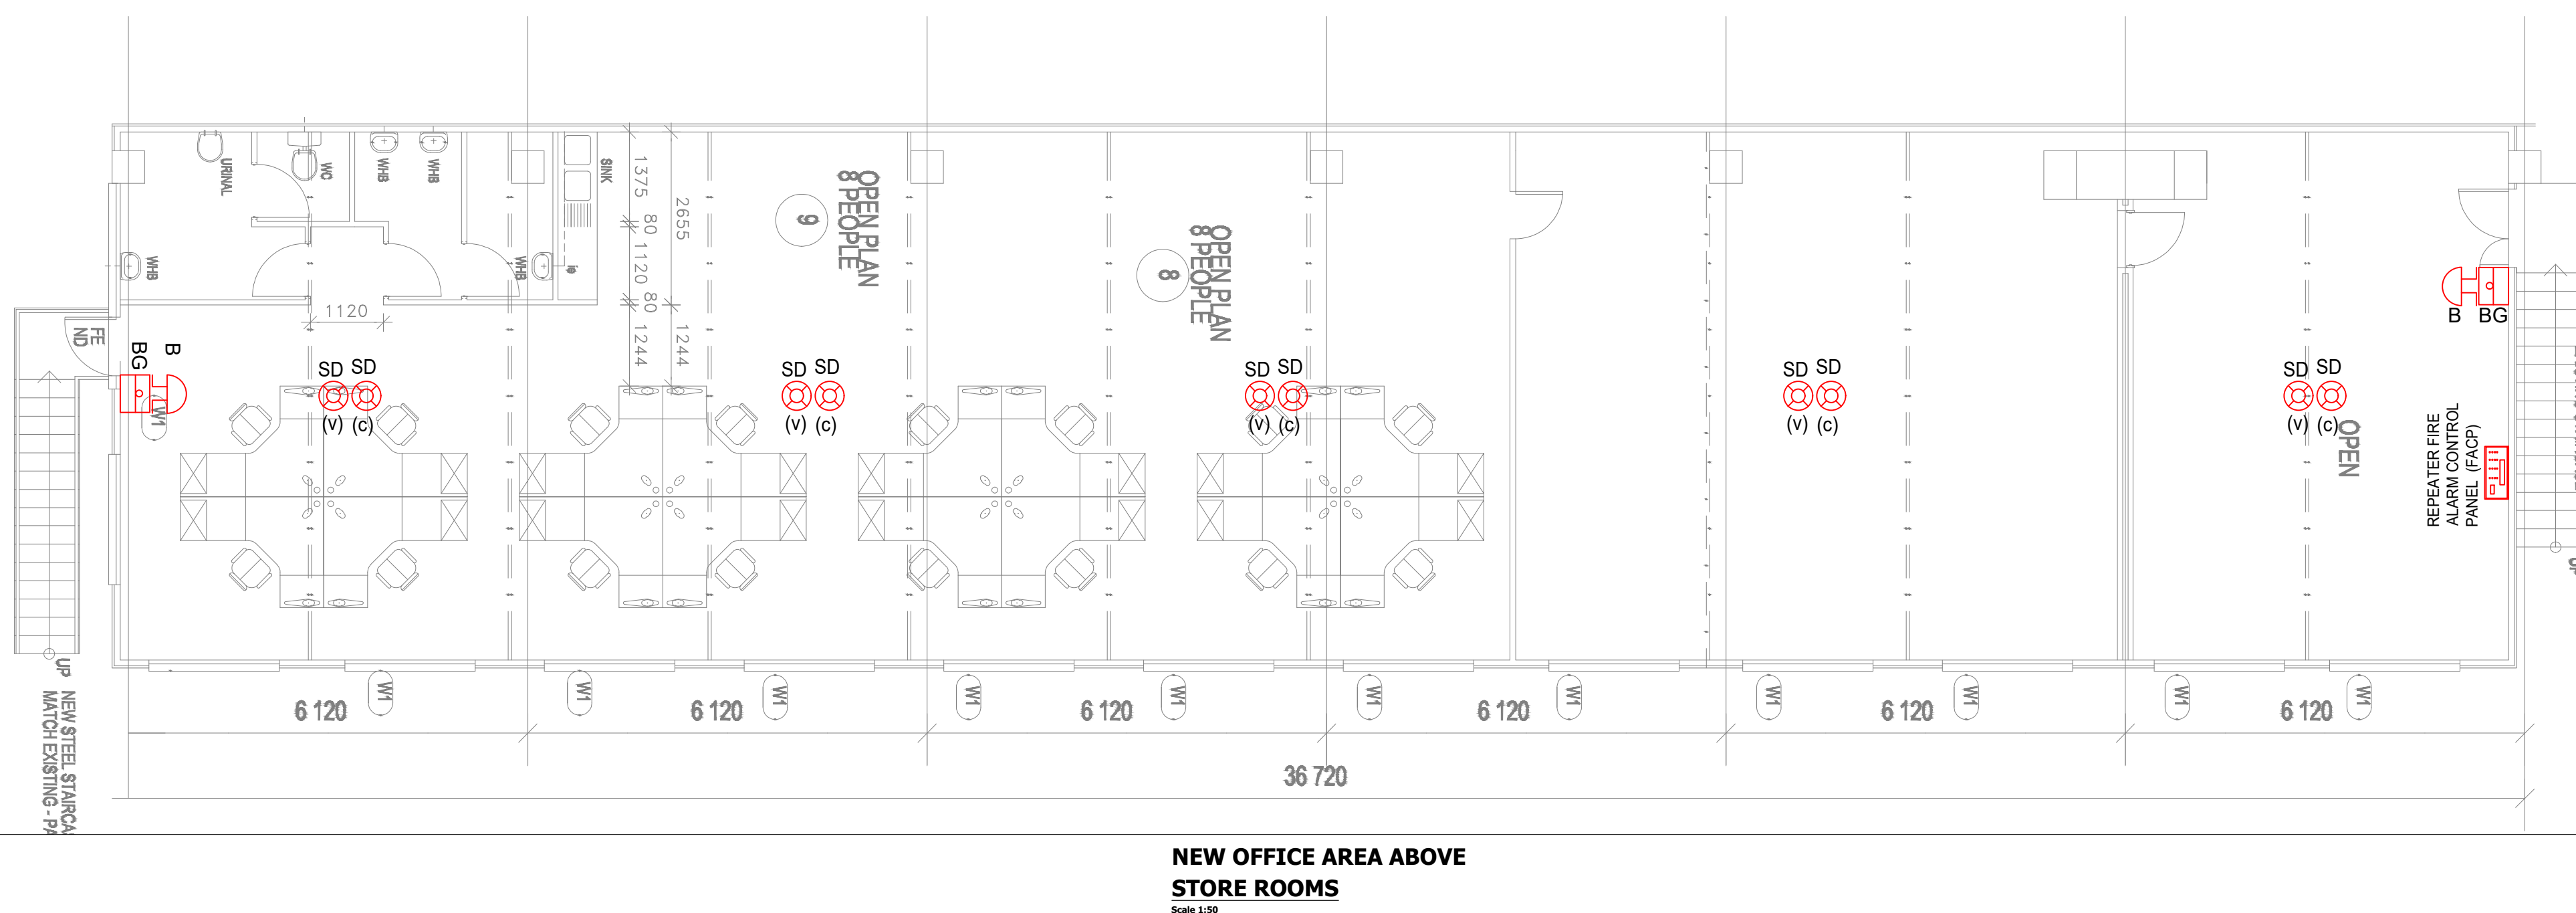
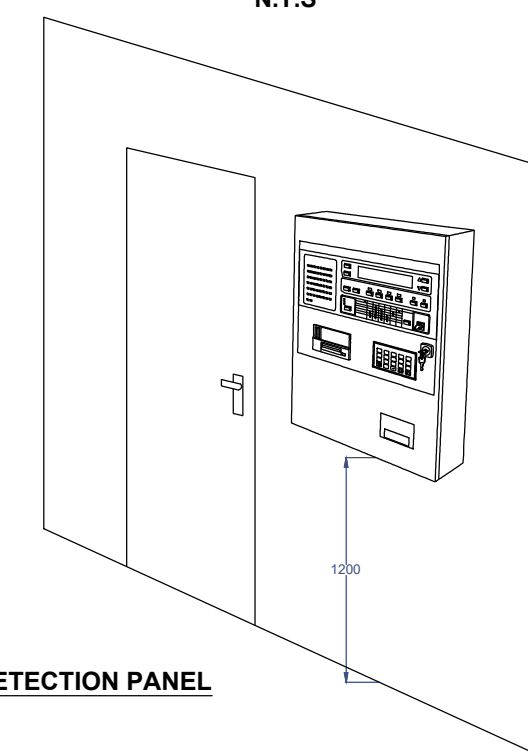


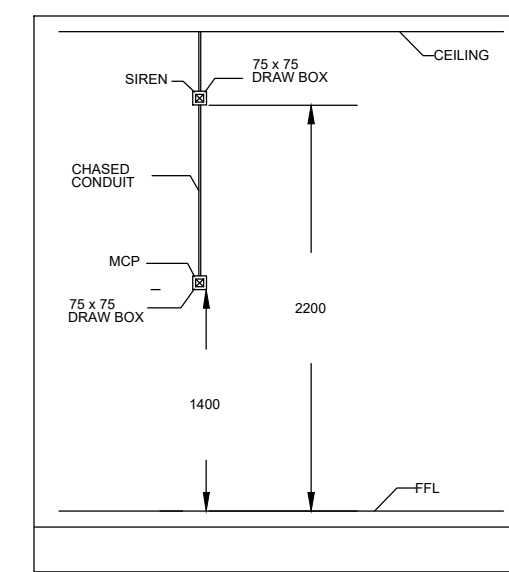

- | LEGEND | |
|--|--|
| SD
 | ADDRESSABLE OPTICAL FIRE ALARM SMOKE DETECTOR
(c) denotes -----under ceiling/soffit
(f) denotes -----within access/raised floor
(v) denotes -----within ceiling/roof void |
| HD
 | ADDRESSABLE FIRE ALARM HEAT DETECTOR |
| BG
 | ADDRESSABLE FIRE ALARM MANUAL CALL POINT (RED BREAKGLASS UNIT) |
| B
 | FIRE ALARM ELECTRONIC SOUNDER/BELL WITH INTEGRAL STROBE LIGHT |
| GBG
 | ADDRESSABLE FIRE ALARM MANUAL CALL POINT (GREEN BREAKGLASS UNIT) TO OVERRIDE ACCESS CONTROLLED DOORS |
|  | BEAM DETECTOR (TRANSMITTER) INSTALLED 1200mm ABOVE THE TOP OF THE CRANE. |
|  | REFLECTOR (RECEIVER) INSTALLED 1200mm ABOVE THE TOP OF THE CRANE. |



01		ISSUED FOR INFORMATION				I.S.		S.M.		07/09/23			
REV		REVISION DESCRIPTION				BY		CHKD		AUTH DATE			
DRAWN BY		SIGN		DATE		PROJECT NAME:				 			
ENGINEER		N.P.		19/06/2024		JOB NAME:				SCALE: 1:50 SIZE: A0			
CHECKED		M.S.		Drawing Description:				FIRE DETECTION SYSTEM				REV:	
APPROVED		M.S.		TAP DRAWING No:				WH-ESKM-FD-002				REV: 01	
		CLIENT DRAWING No:										SHEET:	
												OF:	
						CONTACT INFORMATION:				CLIENT:			
						ADDRESS: BLOCK C2, ESKOM MEGAWATT PARK, 1 MAXWELL DRIVE, SUNNINGHILL, 2196 TEL: 021-258-4600 EMAIL: Engineering@transprojects.co.za URL: www.transprojects.co.za							
Copyright Warning This document/drawing has been prepared by TransAfrica Projects (Pty) Ltd ("TAP") and consequently TAP is the bearer of all intellectual property rights thereto. This document/drawing may not in whole or in part be sold, copied, reproduced stored in a retrieval system or transmitted in any form or by any means be electronic, mechanical any photocopy, recording or otherwise without the written permission of TAP. Indemnity Warning Any party using this document/drawing in whole or in part, use same as it be on risk and indemnifies and holds TAP harmless from and against any liability arising out of claims or suits asserted against TAP even though such claims may be based on allegations of negligence of TAP, should this document/drawing be used for any purpose other than the purpose for which the document/drawing is intended as agreed to in writing by TAP.													