




1. ALL PIPES 25NB-150NB (SANS 62 HEAVY WALL) SUITABLE FOR FLANGED CONNECTIONS (SANS 1123-4000/3 R/F U.O.N) AND PIPES 25NB AND BELOW SHALL BE SCREWED TO SANS 1109
2. PIPE FITTINGS TO BE TIGHTENED BY HEMP OR APPROVED PRODUCT BY ENGINEER. LEAK TEST ON COMPLETION - REFER TO PCS.
3. ALL DIMENSIONS TO BE CHECKED ON SITE BEFORE ANY WORK
4. COMMENCES, ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER

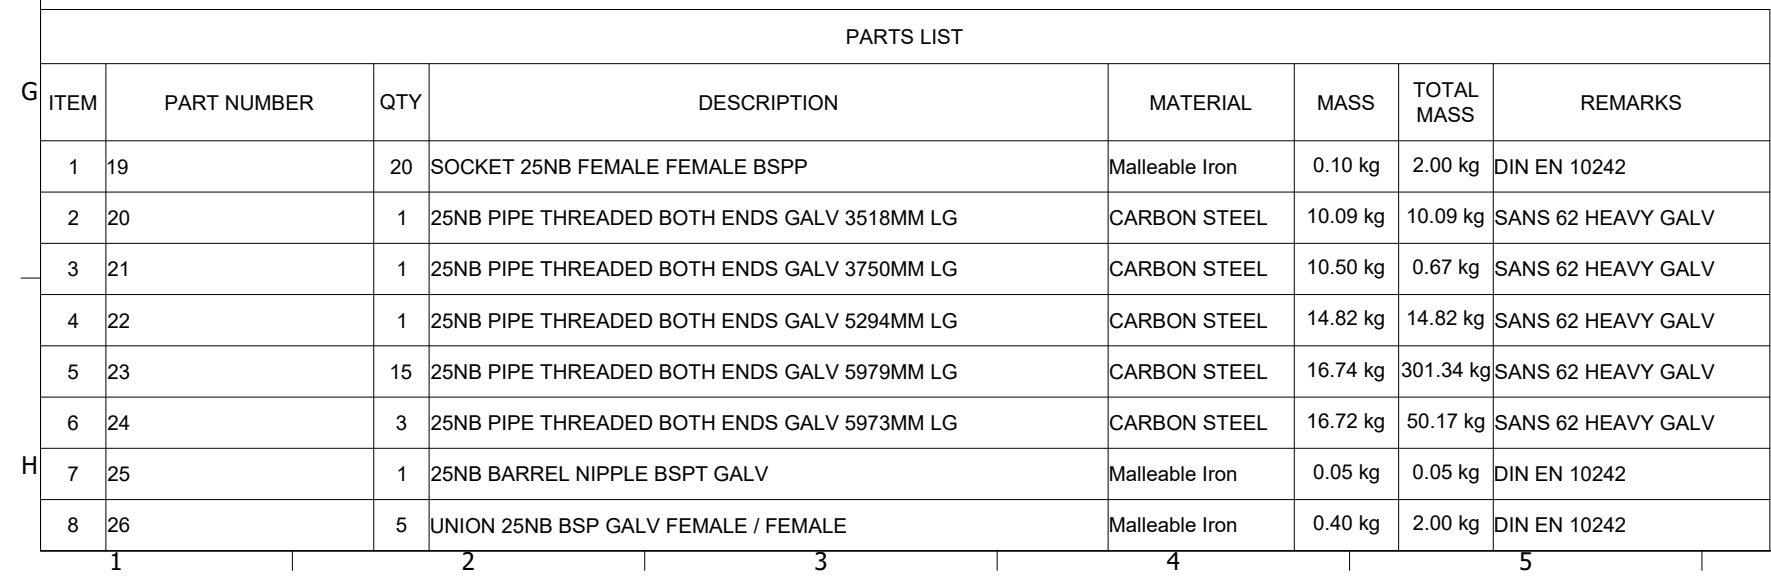