



NOTES

1. GENERAL
- 1.1 ALL DIMENSIONS TO BE VERIFIED ON SITE PRIOR TO THE COMMENCEMENT OF ANY WORKS. ANY DISCREPANCIES TO BE REPORTED TO THE ENGINEER. DRAWINGS NOT TO BE SCALED. FIGURED DIMENSIONS ONLY TO BE ADOPTED.
2. MATERIALS
- 2.1 PRECAST CONCRETE (45MPa):
3. REINFORCEMENT
- 3.1 MILD STEEL BARS (R): 250MPa
- 3.2 HIGH YIELD BARS (Y): 450MPa
4. COVER 60mm MINIMUM CONCRETE COVER TO REINFORCEMENT UNLESS OTHERWISE NOTED

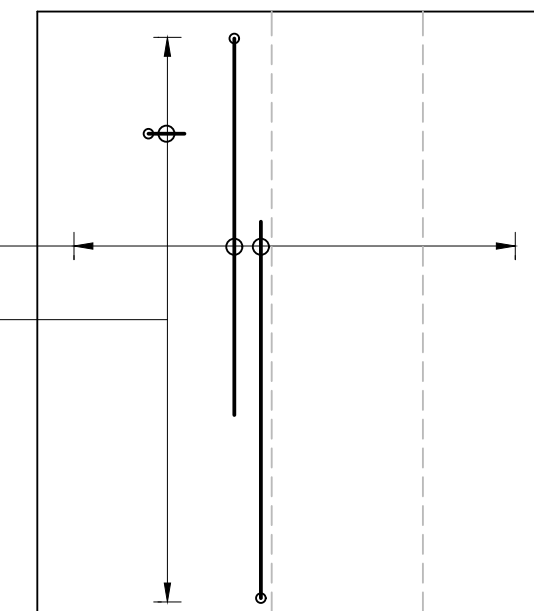


ELEVATION-WALL 4

1:25

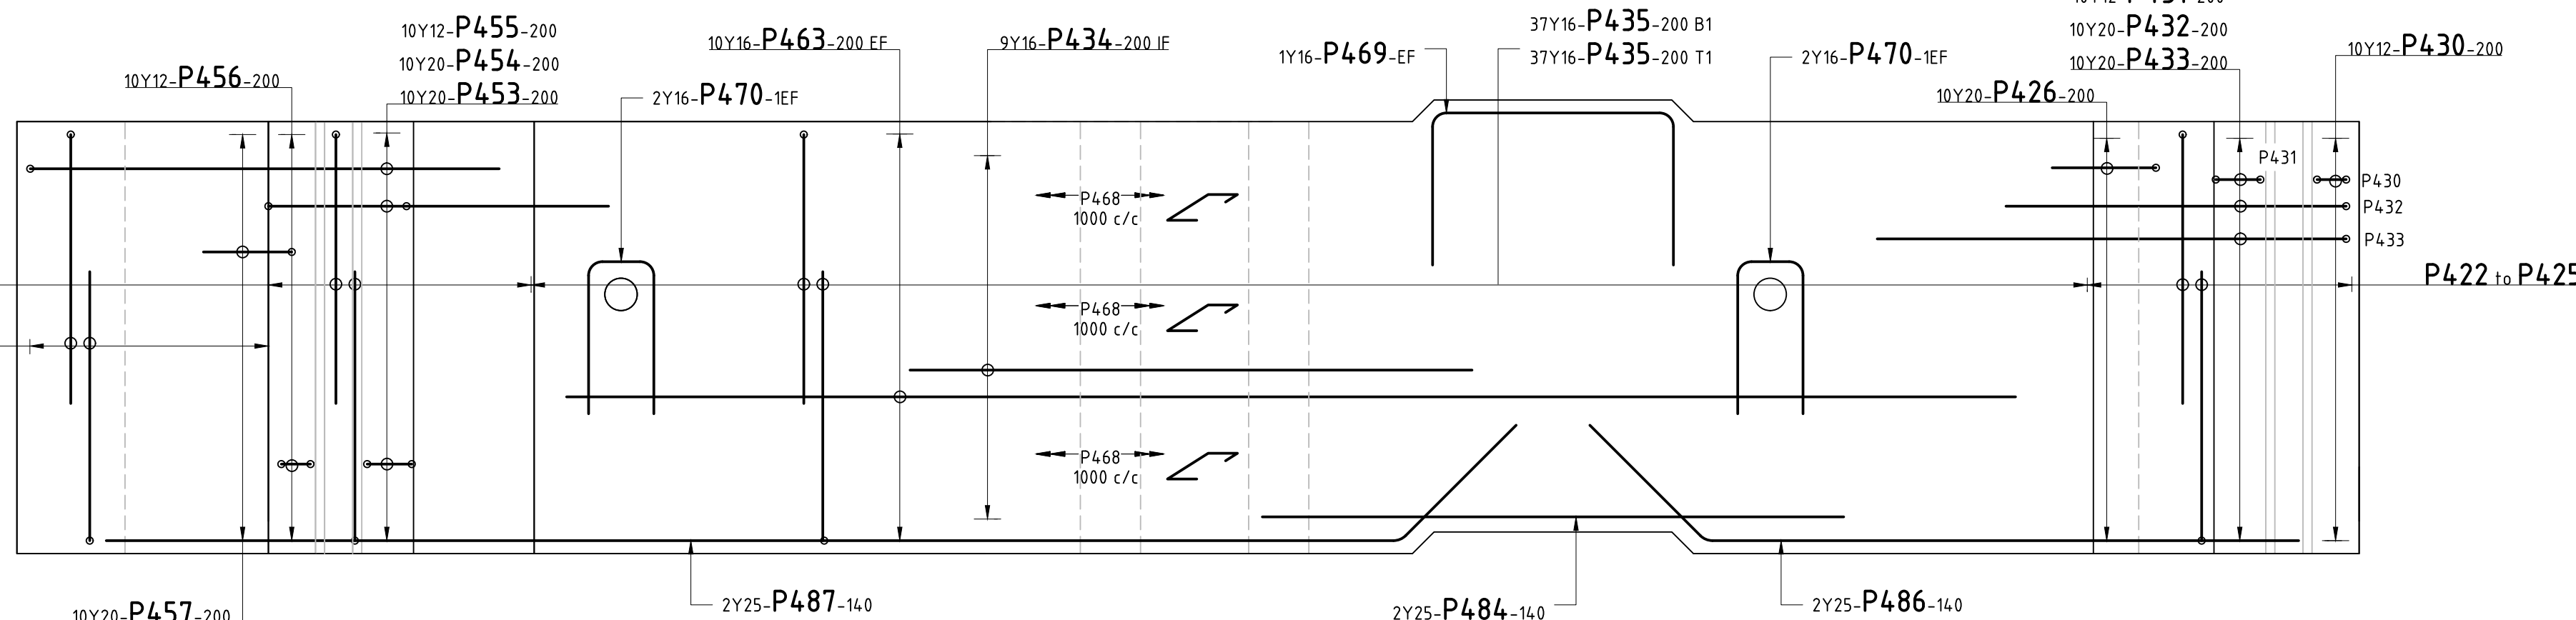


ELEVATION-WALL 1

1:25

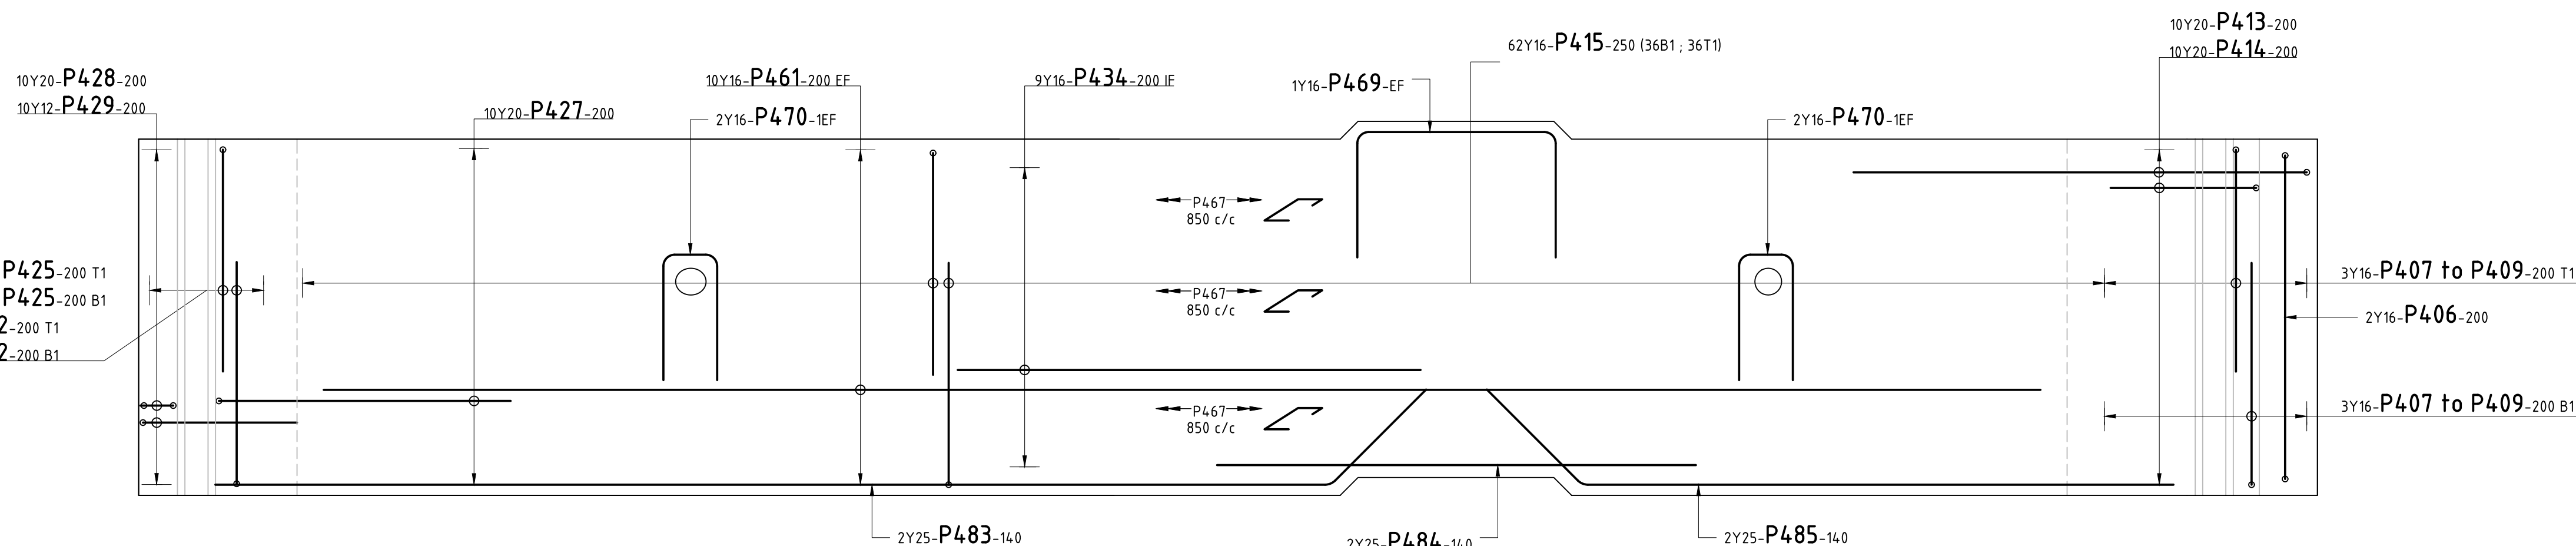


ELEVATION-WALL 3

1:25

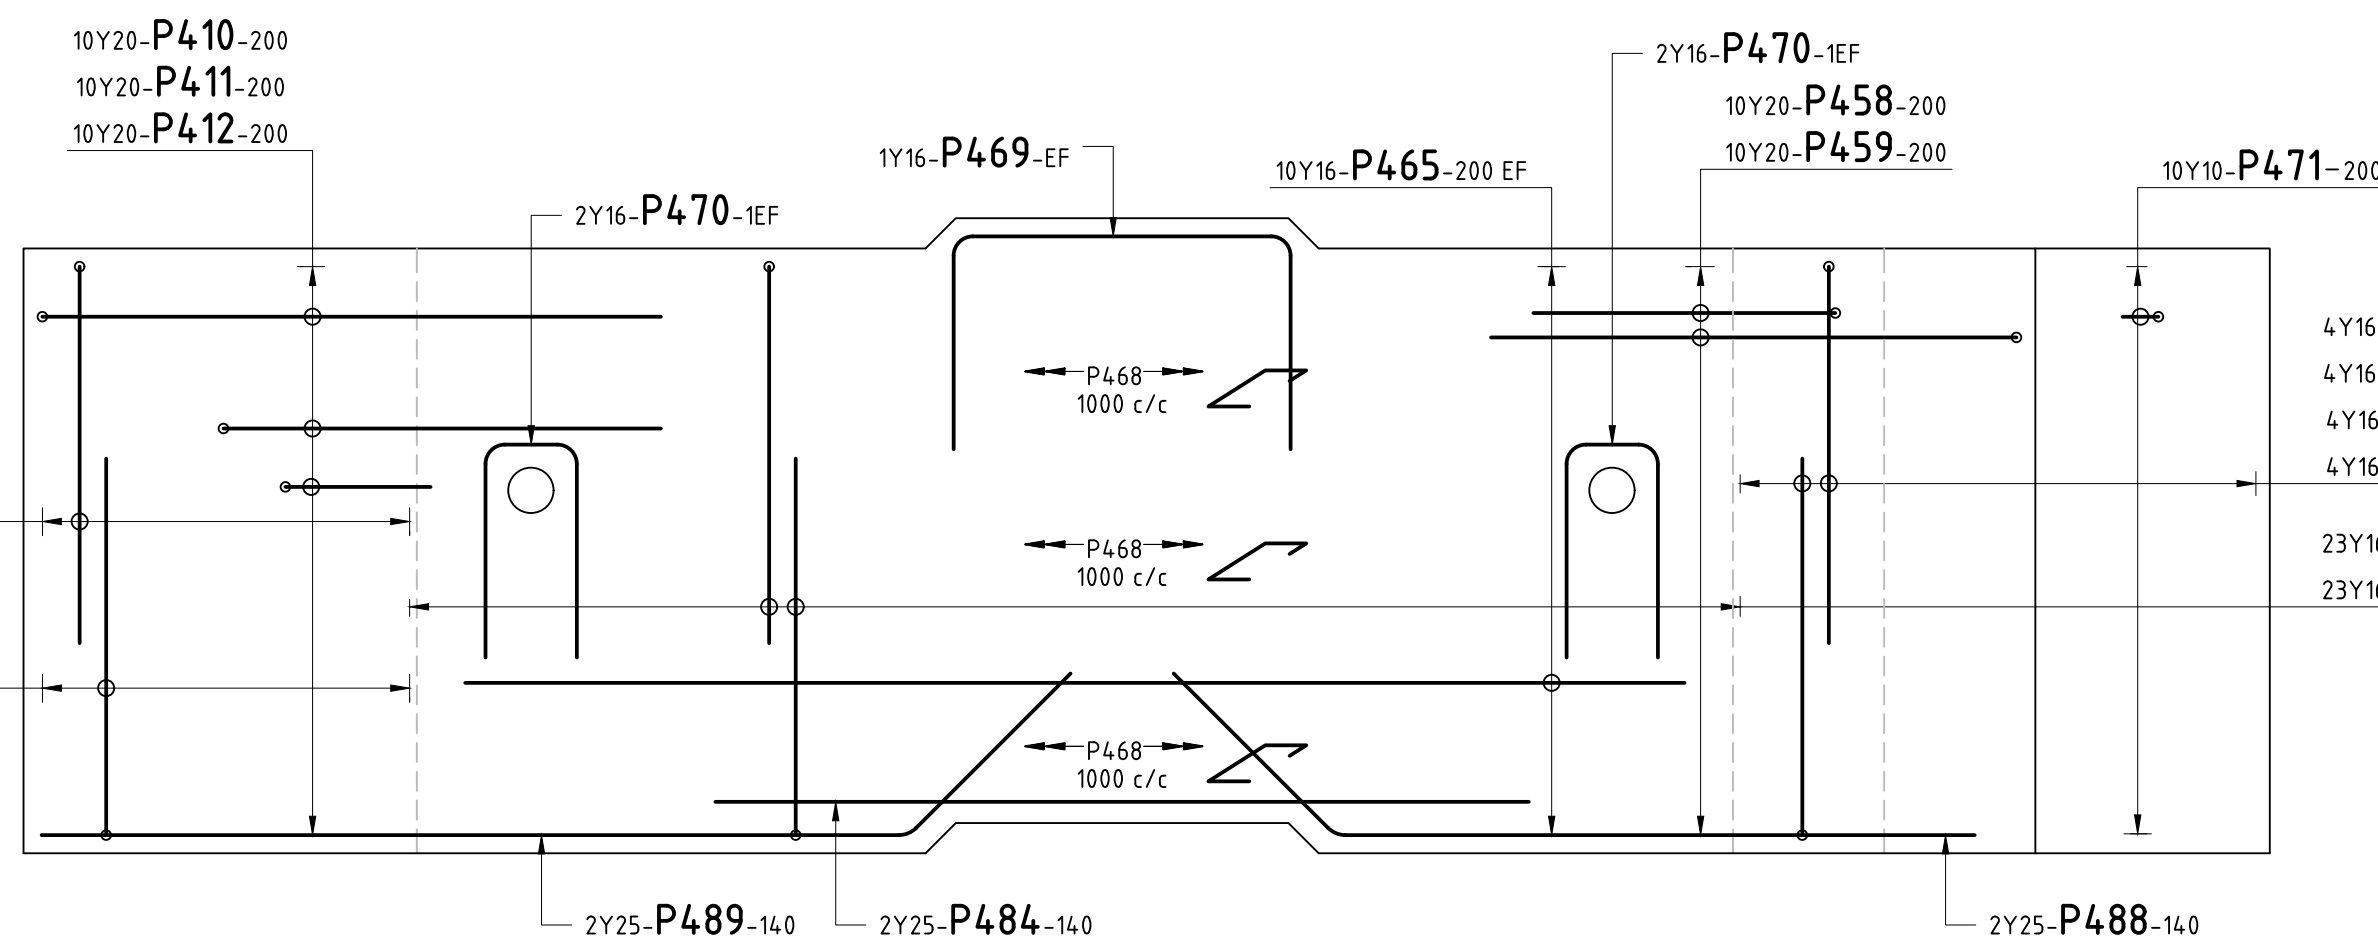

ELEVATION-WALL 2

1:25

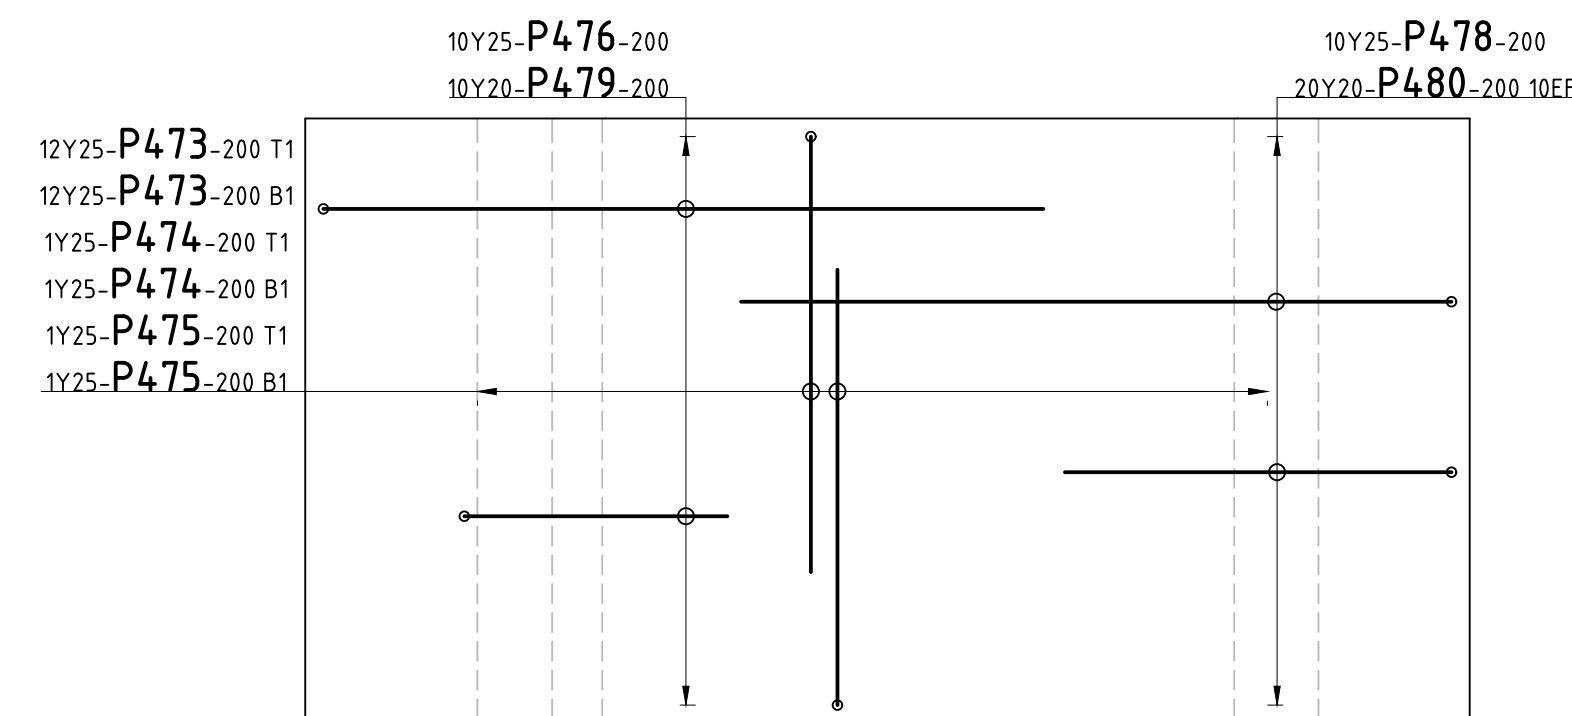

ELEVATION-WALL 5

1:25

[illegible]