




SINGLE VEE OVERHANG FOR THE END OF SECURITY SLIDING GATE.
(FOR NO. OFF REQ'D - SEE FENCE LAYOUT ON DRG 0.54/7470 SHT.1)

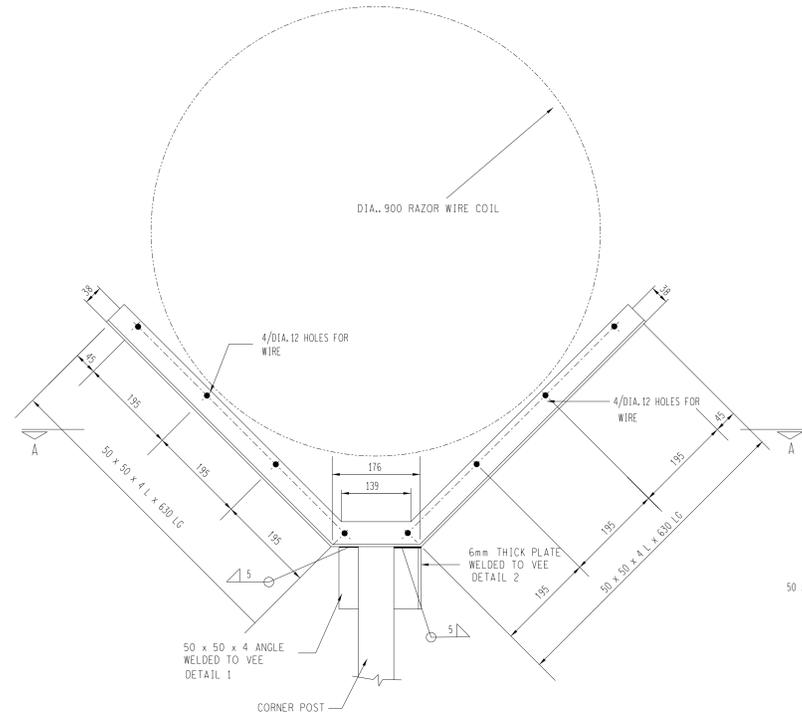


VEE OVERHANG FOR CORNER POST

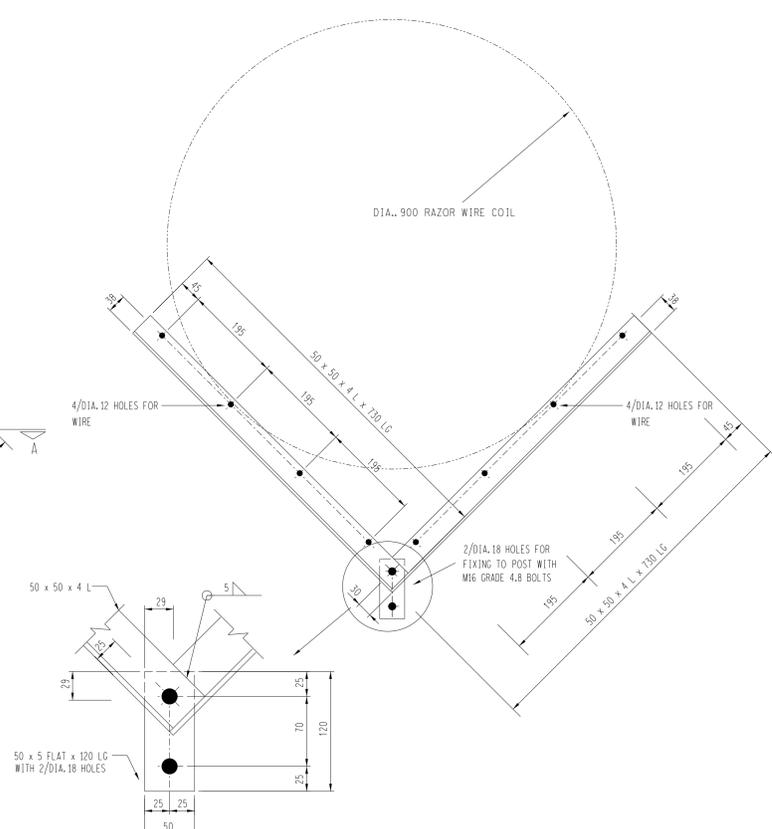


VEE OVERHANG FOR FENCE.
(FOR NO. OFF REQ'D - SEE FENCE LAYOUT)

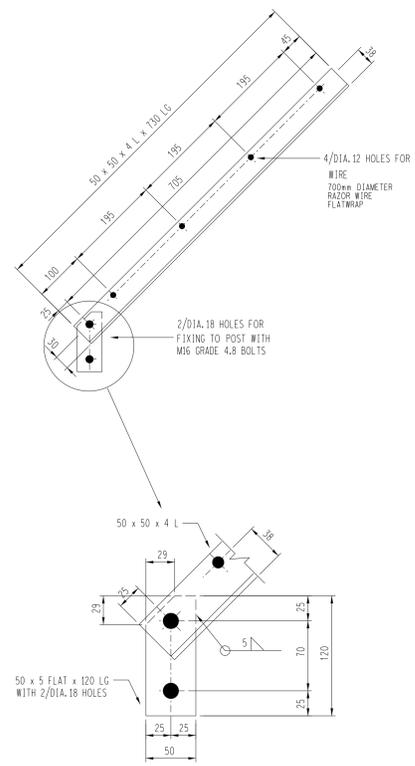


SINGLE OVERHANG FOR FENCE.
(FOR NO. OFF REQ'D - SEE FENCE LAYOUT)

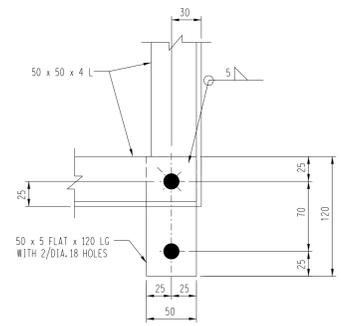


SINGLE VEE OVERHANG FOR FENCE.
(FOR NO. OFF REQ'D - SEE FENCE LAYOUT)

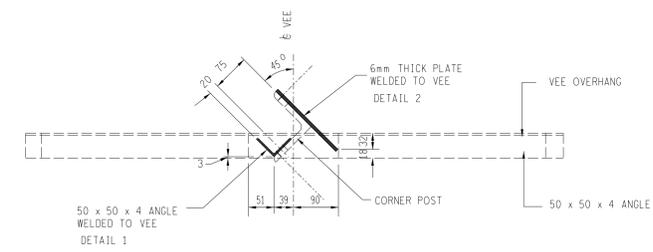


SECTION A - A



DETAIL 2

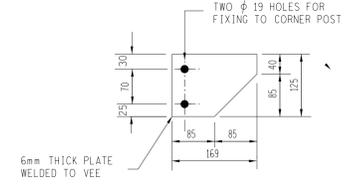

DETAIL 1

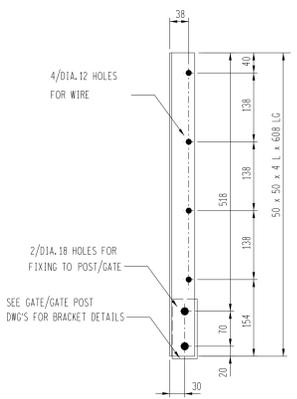

OVERHANG FOR GATE/GATE POSTS.
(10 OFF REQ'D PER GATE/GATE POSTS)

- NOTES WIRE:**
- 2mm FULLY GALVANIZED SINGLE STRAND OVAL 3.15x2.5mm, BARB DIAMETER 1.8mm 4-OFF OVERHANG MEMBER
 - 2mm FULLY GALVANIZED BLINDING WIRE
 - 700mm DIAMETER GALVANIZED FLATRAP RAZOR

- NOTES:**
- ALL BOLTS, NUTS, WASHERS ETC. REQUIRED FOR ERECTION TO BE SUPPLIED BY THE CONTRACTOR.
 - ALL STEEL TO BE GRADE S355JR, TO SANS 1431 AND HOT DIP GALVANIZED TO SANS 121 WITH AN APPROVED ZINC-METAL SPRAY OR INORGANIC ZINC-RICH PAINT COMPLYING WITH SABS 929. APPLICATION TO SUPPLIERS SPECIFICATIONS.

REV	REVISION DESCRIPTION	BY	CHKD	DATE	REFERENCE DRAWINGS
7	UPDATED AND NOTE WIRE ADDED	PHD	DBN	AM	25.02.19
6	DRG TITLE, SHT & SINGLE VEE OVERHANG REV.	PHD	DBN	DJCS	07.06.16
5	TITLE REVISED	PHD	DJCS	DJCS	27.09.12
4	VEE OVERHANG FOR SLIDING GATE ADDED	PHD	DBN	DBN	03.03.12
3	VEE OVERHANG FOR CORNER POSTS ADDED	PVG	DJCS	DBN	18.11.11
2	VEE OVERHANG HOLES AND COIL ADDED	DJCS	DBN	DBN	01.06.09
1	VEE OVERHANG BRACKET ADDED	DJCS	DBN	DJCS	05.07.06

APPROVED BY		ESKOM HOLDINGS LIMITED
DJCS Senekal		REG NO. 2002/015527/06
DATE 10.02.2000		
CHECKED BY	DBN	
DATE 02.2000		
DRAWN BY	DJCS	
DATE 02.2000		
SCALE AS SHOWN	0.54/5633	SHT 3 OF 7