

1 2 3 4 5 6 7 8 9 10 11 12

A

B

C

D

E

F

G

H

A

B

C


D

E

F

G

H

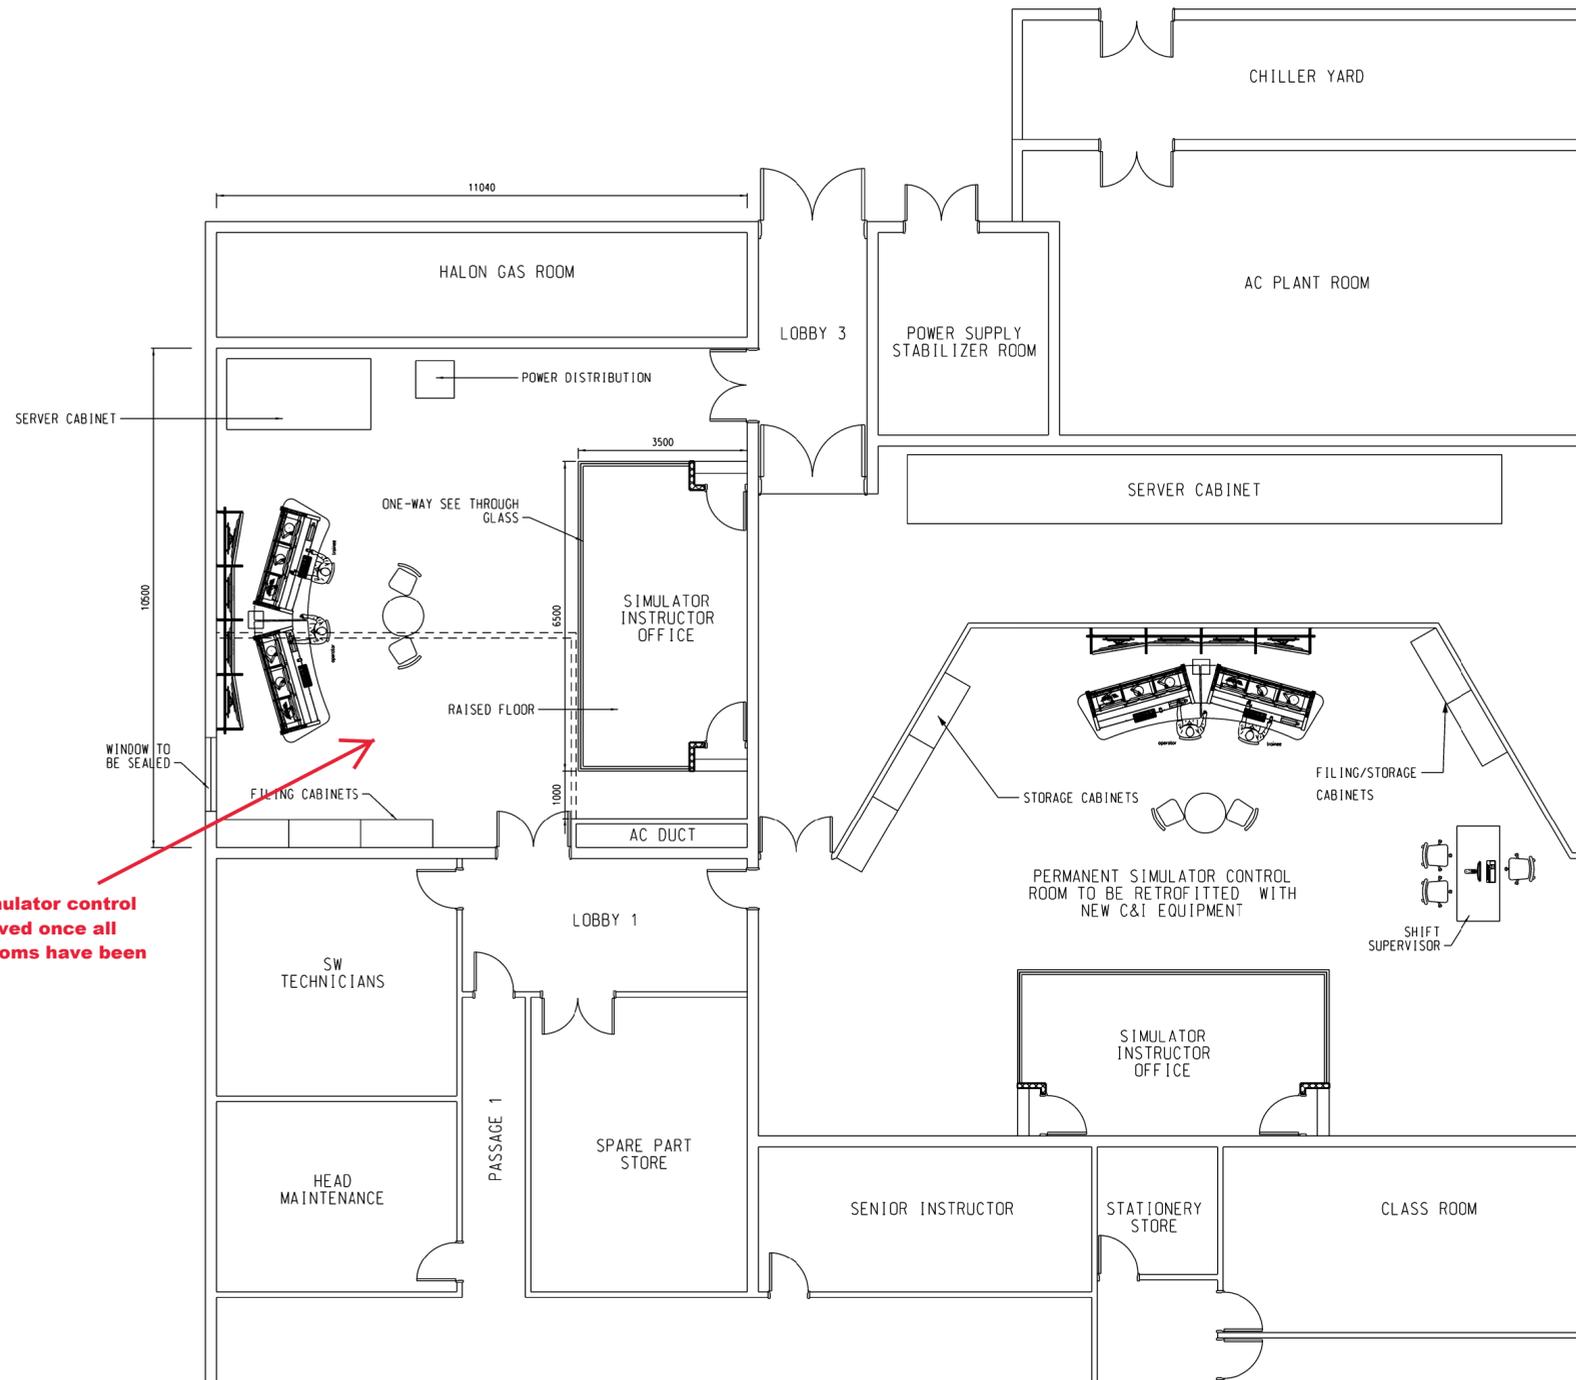

Temporary simulator control room to be moved once all Unit control rooms have been refurbished

D.O.	REV	DATE	REVISION	REV BY	CHKD BY	APP BY	AUTH BY	KKS APP	REFERENCE DRAWINGS
AUTHORISED FOR ESKOM BY:			CLASSIFICATION	<p style="text-align: center;"><b>MATIMBA POWER STATION</b>  <b>TRAINING SIMULATOR ROOM</b>  <b>OPTION 1</b></p>					
CODIFICATION BY:			PBS PATH						
APPROVED BY:									
CHECKED BY:									
CREATED BY:			<p><b>Eskom</b>  <small>Eskom Holdings SOC Ltd  REG No 2002/015527/30</small></p>	SHT		REV			
SCALE				1:100	01	00			