


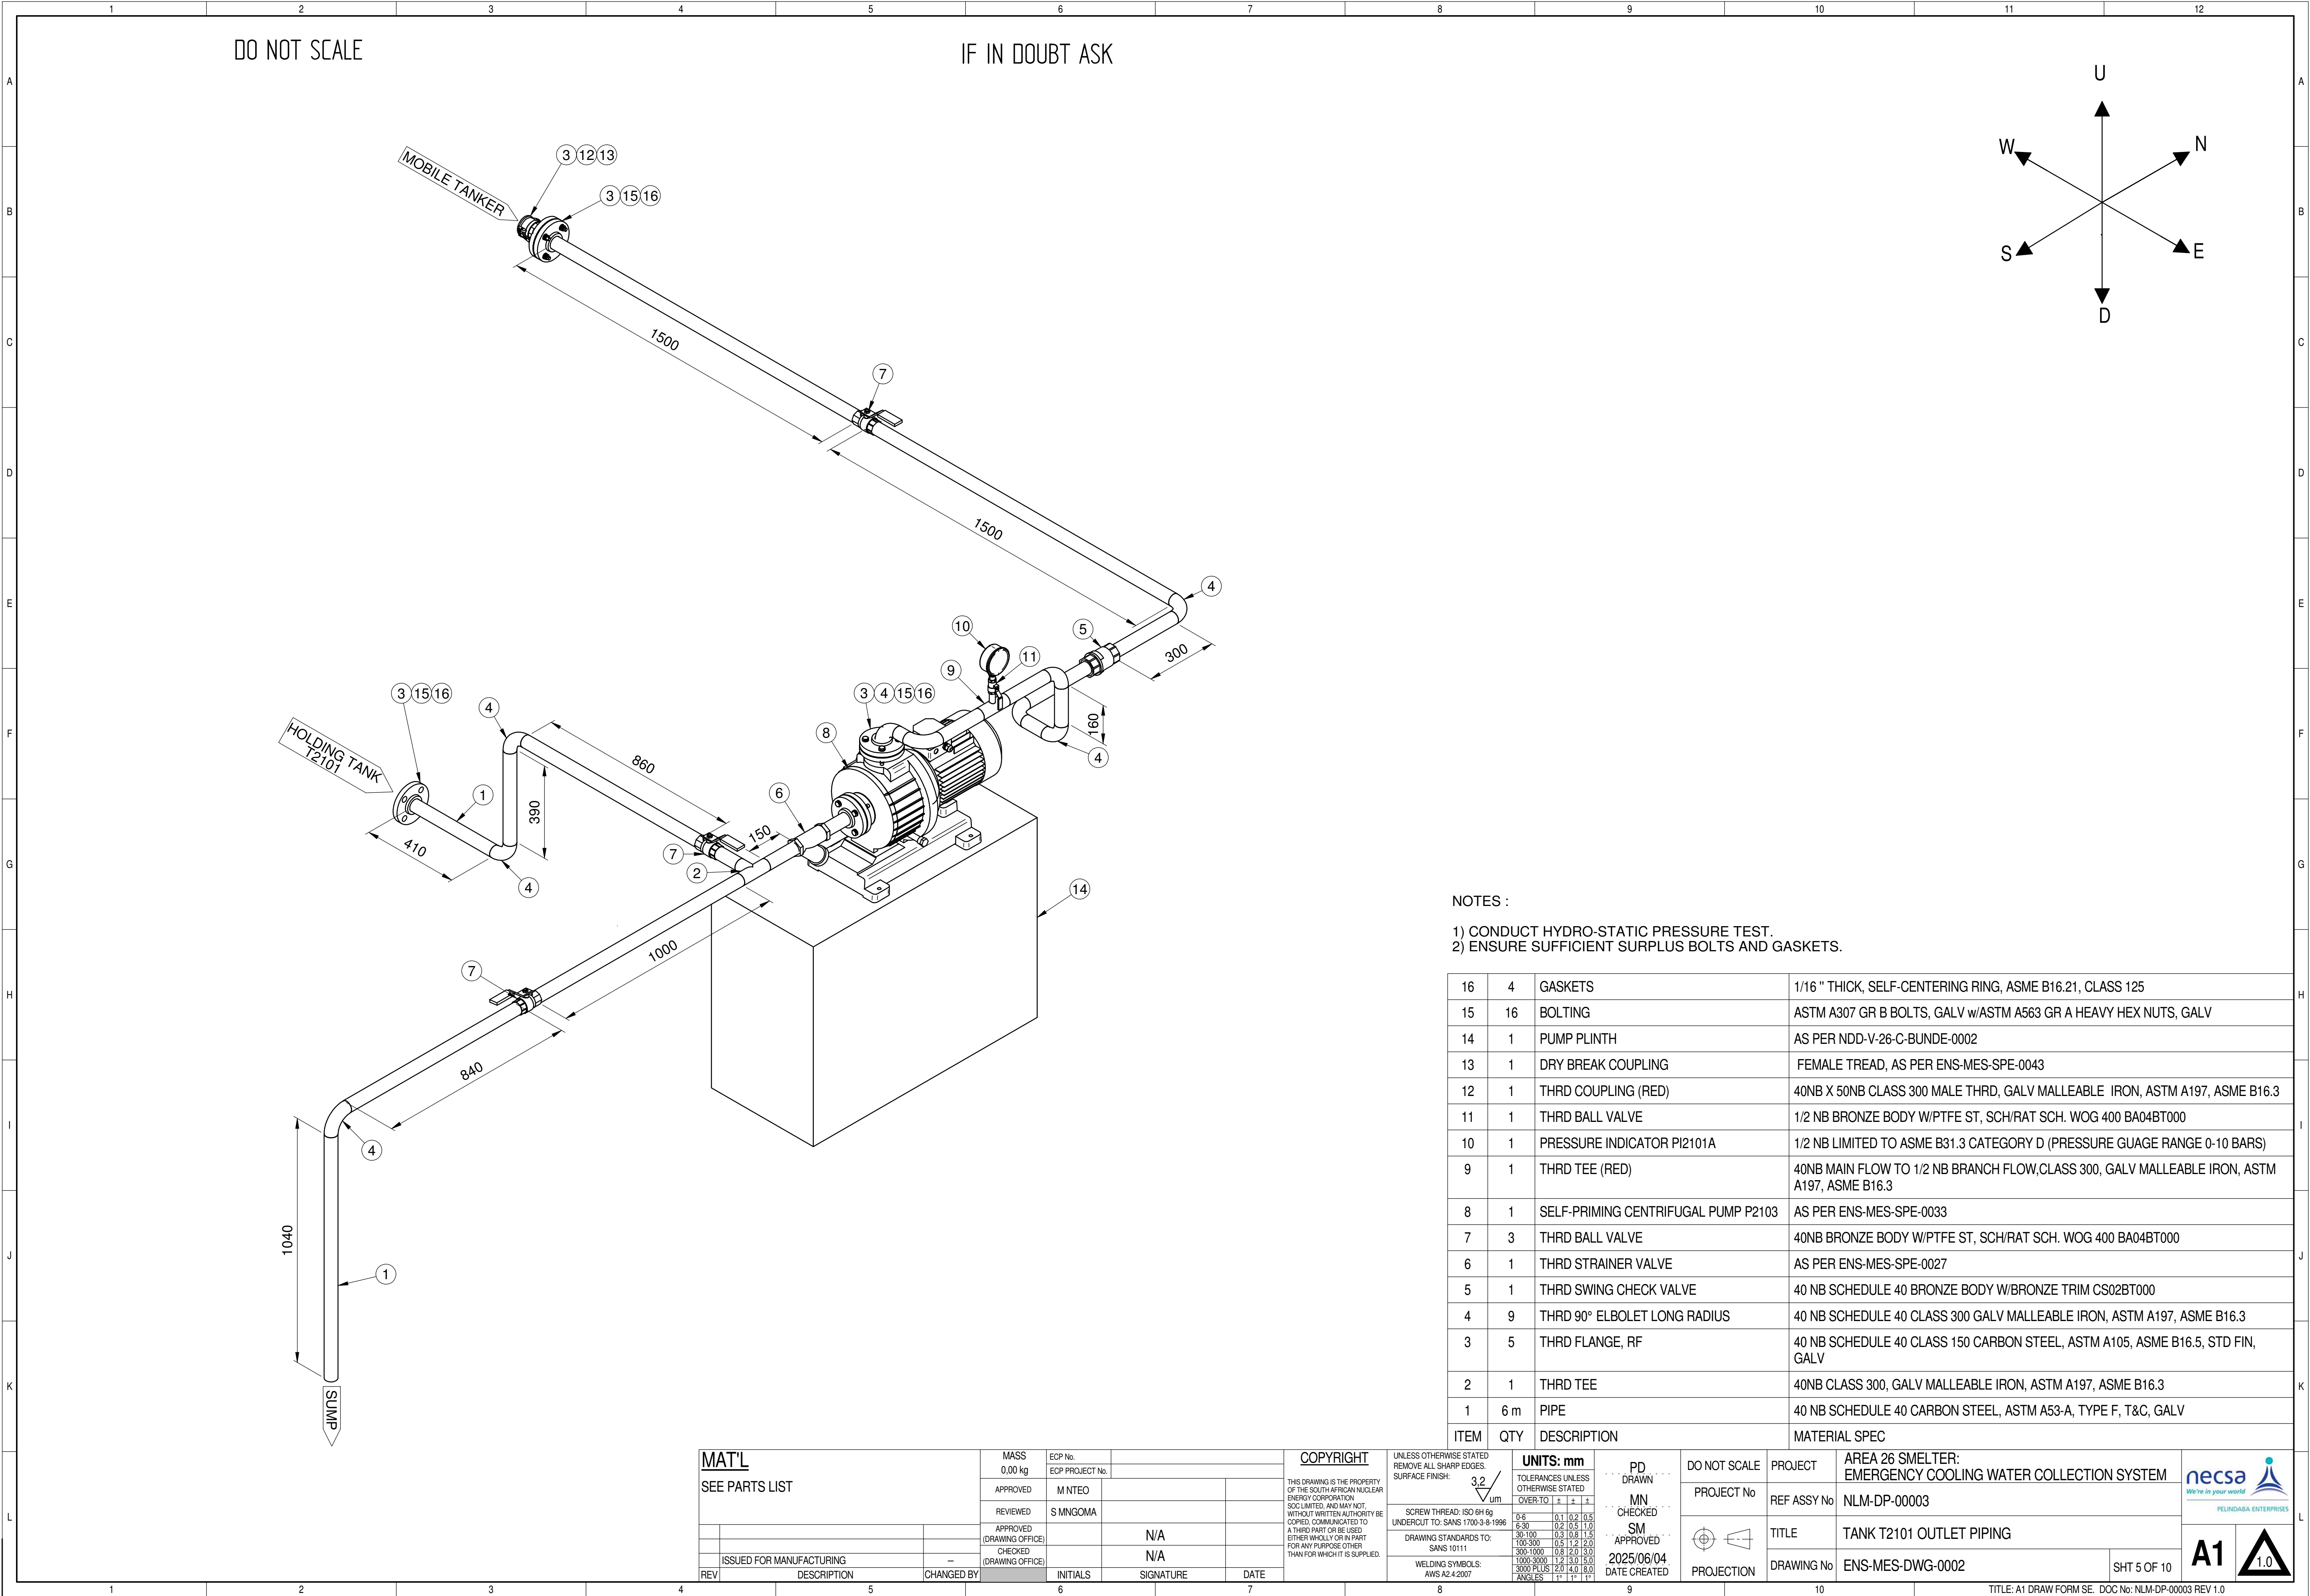


NOTES :

- 1) CONDUCT HYDRO-STATIC PRESSURE TEST.
2) ENSURE SUFFICIENT SURPLUS BOLTS AND GASKETS.


16	4	GASKETS	1/16 " THICK, SELF-CENTERING RING, ASME B16.21, CLASS 125
15	16	BOLTING	ASTM A307 GR B BOLTS, GALV w/ASTM A563 GR A HEAVY HEX NUTS, GALV
14	1	PUMP PLINTH	AS PER NDD-V-26-C-BUNDE-0002
13	1	DRY BREAK COUPLING	FEMALE TREAD, AS PER ENS-MES-SPE-0043
12	1	THRD COUPLING (RED)	40NB X 50NB CLASS 300 MALE THRD, GALV MALLEABLE IRON, ASTM A197, ASME B16.3
11	1	THRD BALL VALVE	1/2 NB BRONZE BODY W/PTFE ST, SCH/RAT SCH. WOG 400 BA04BT000
10	1	PRESSURE INDICATOR PI2101A	1/2 NB LIMITED TO ASME B31.3 CATEGORY D (PRESSURE GUAGE RANGE 0-10 BARS)
9	1	THRD TEE (RED)	40NB MAIN FLOW TO 1/2 NB BRANCH FLOW,CLASS 300, GALV MALLEABLE IRON, ASTM A197, ASME B16.3
8	1	SELF-PRIMING CENTRIFUGAL PUMP P2103	AS PER ENS-MES-SPE-0033
7	3	THRD BALL VALVE	40NB BRONZE BODY W/PTFE ST, SCH/RAT SCH. WOG 400 BA04BT000
6	1	THRD STRAINER VALVE	AS PER ENS-MES-SPE-0027
5	1	THRD SWING CHECK VALVE	40 NB SCHEDULE 40 BRONZE BODY W/BRONZE TRIM CS02BT000
4	9	THRD 90° ELBOLET LONG RADIUS	40 NB SCHEDULE 40 CLASS 300 GALV MALLEABLE IRON, ASTM A197, ASME B16.3
3	5	THRD FLANGE, RF	40 NB SCHEDULE 40 CLASS 150 CARBON STEEL, ASTM A105, ASME B16.5, STD FIN, GALV
2	1	THRD TEE	40NB CLASS 300, GALV MALLEABLE IRON, ASTM A197, ASME B16.3
1	6 m	PIPE	40 NB SCHEDULE 40 CARBON STEEL, ASTM A53-A, TYPE F, T&C, GALV
ITEM	QTY	DESCRIPTION	MATERIAL SPEC

MAT'L SEE PARTS LIST		MASS 0.00 kg	ECP No.	COPYRIGHT UNLESS OTHERWISE STATED REMOVE ALL SHARP EDGES. SURFACE FINISH: 3.2 μ m		UNITS: mm TOLERANCES UNLESS OTHERWISE STATED OVER: TO $\pm$ 1	PD DRAWN MN CHECKED SM APPROVED	DO NOT SCALE	PROJECT	AREA 26 SMELTER: EMERGENCY COOLING WATER COLLECTION SYSTEM		 We're in your world FELINDABA ENTERPRISES
		APPROVED (DRAWING OFFICE)	M NTEO	THIS DRAWING IS THE PROPERTY OF THE SOUTH AFRICAN NUCLEAR ENERGY CORPORATION SNC LIMITED. AND MAY NOT BE COPIED, COMMUNICATED TO A THIRD PARTY OR BE USED EITHER WHOLLY OR IN PART FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED.		SCREW THREAD: ISO 6H/8g UNDERCUT TO: SANS 1700-3-8:1996 DRAWING STANDARDS TO: SANS 10111 WELDING SYMBOLS: AWS A2.4:2007	2025/06/04 DATE CREATED	PROJECT No	REF ASSY No	NLM-DP-00003		
		REVIEWED (DRAWING OFFICE)	S MNGOMA	N/A					TITLE	TANK T2101 OUTLET PIPING		
ISSUED FOR MANUFACTURING		—		N/A					DRAWING No	ENS-MES-DWG-0002		SHT 5 OF 10
REV	DESCRIPTION	CHANGED BY	INITIALS	SIGNATURE	DATE	TITLE: A1 DRAW FORM SE. DOC No: NLM-DP-00003 REV 1.0						

ENS-MES-DWG-0002

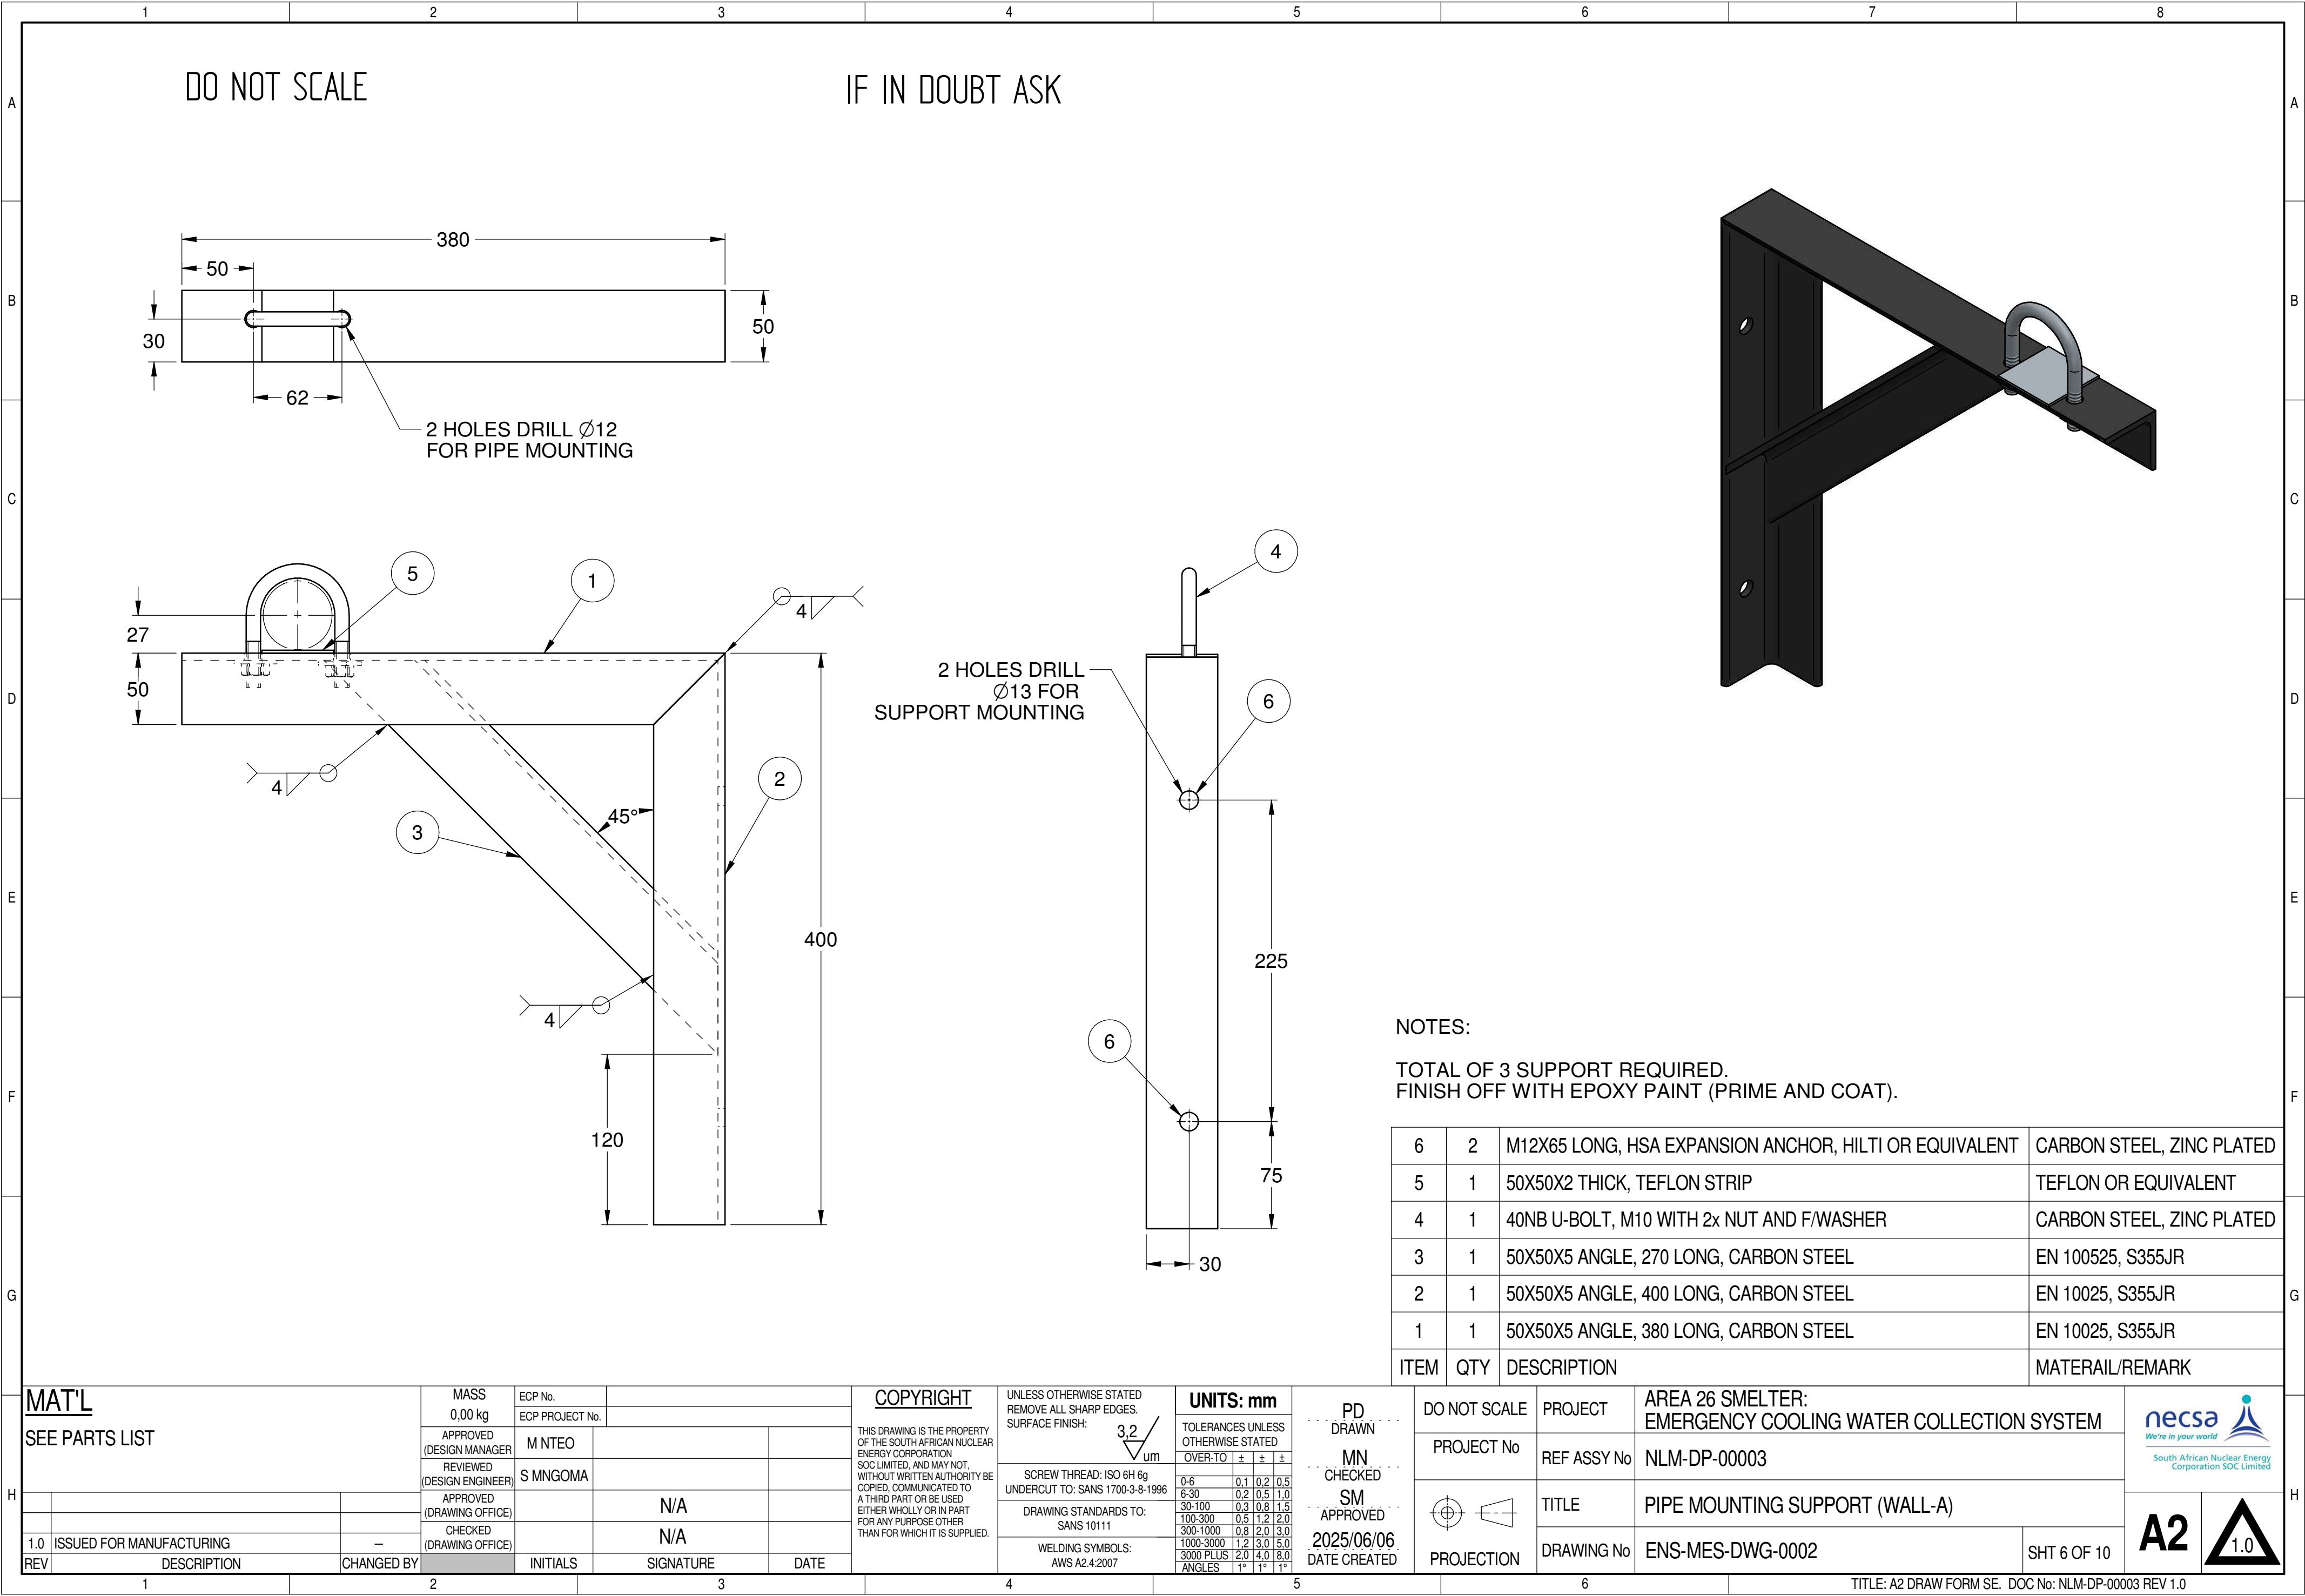


ENS-MES-DWG-0002

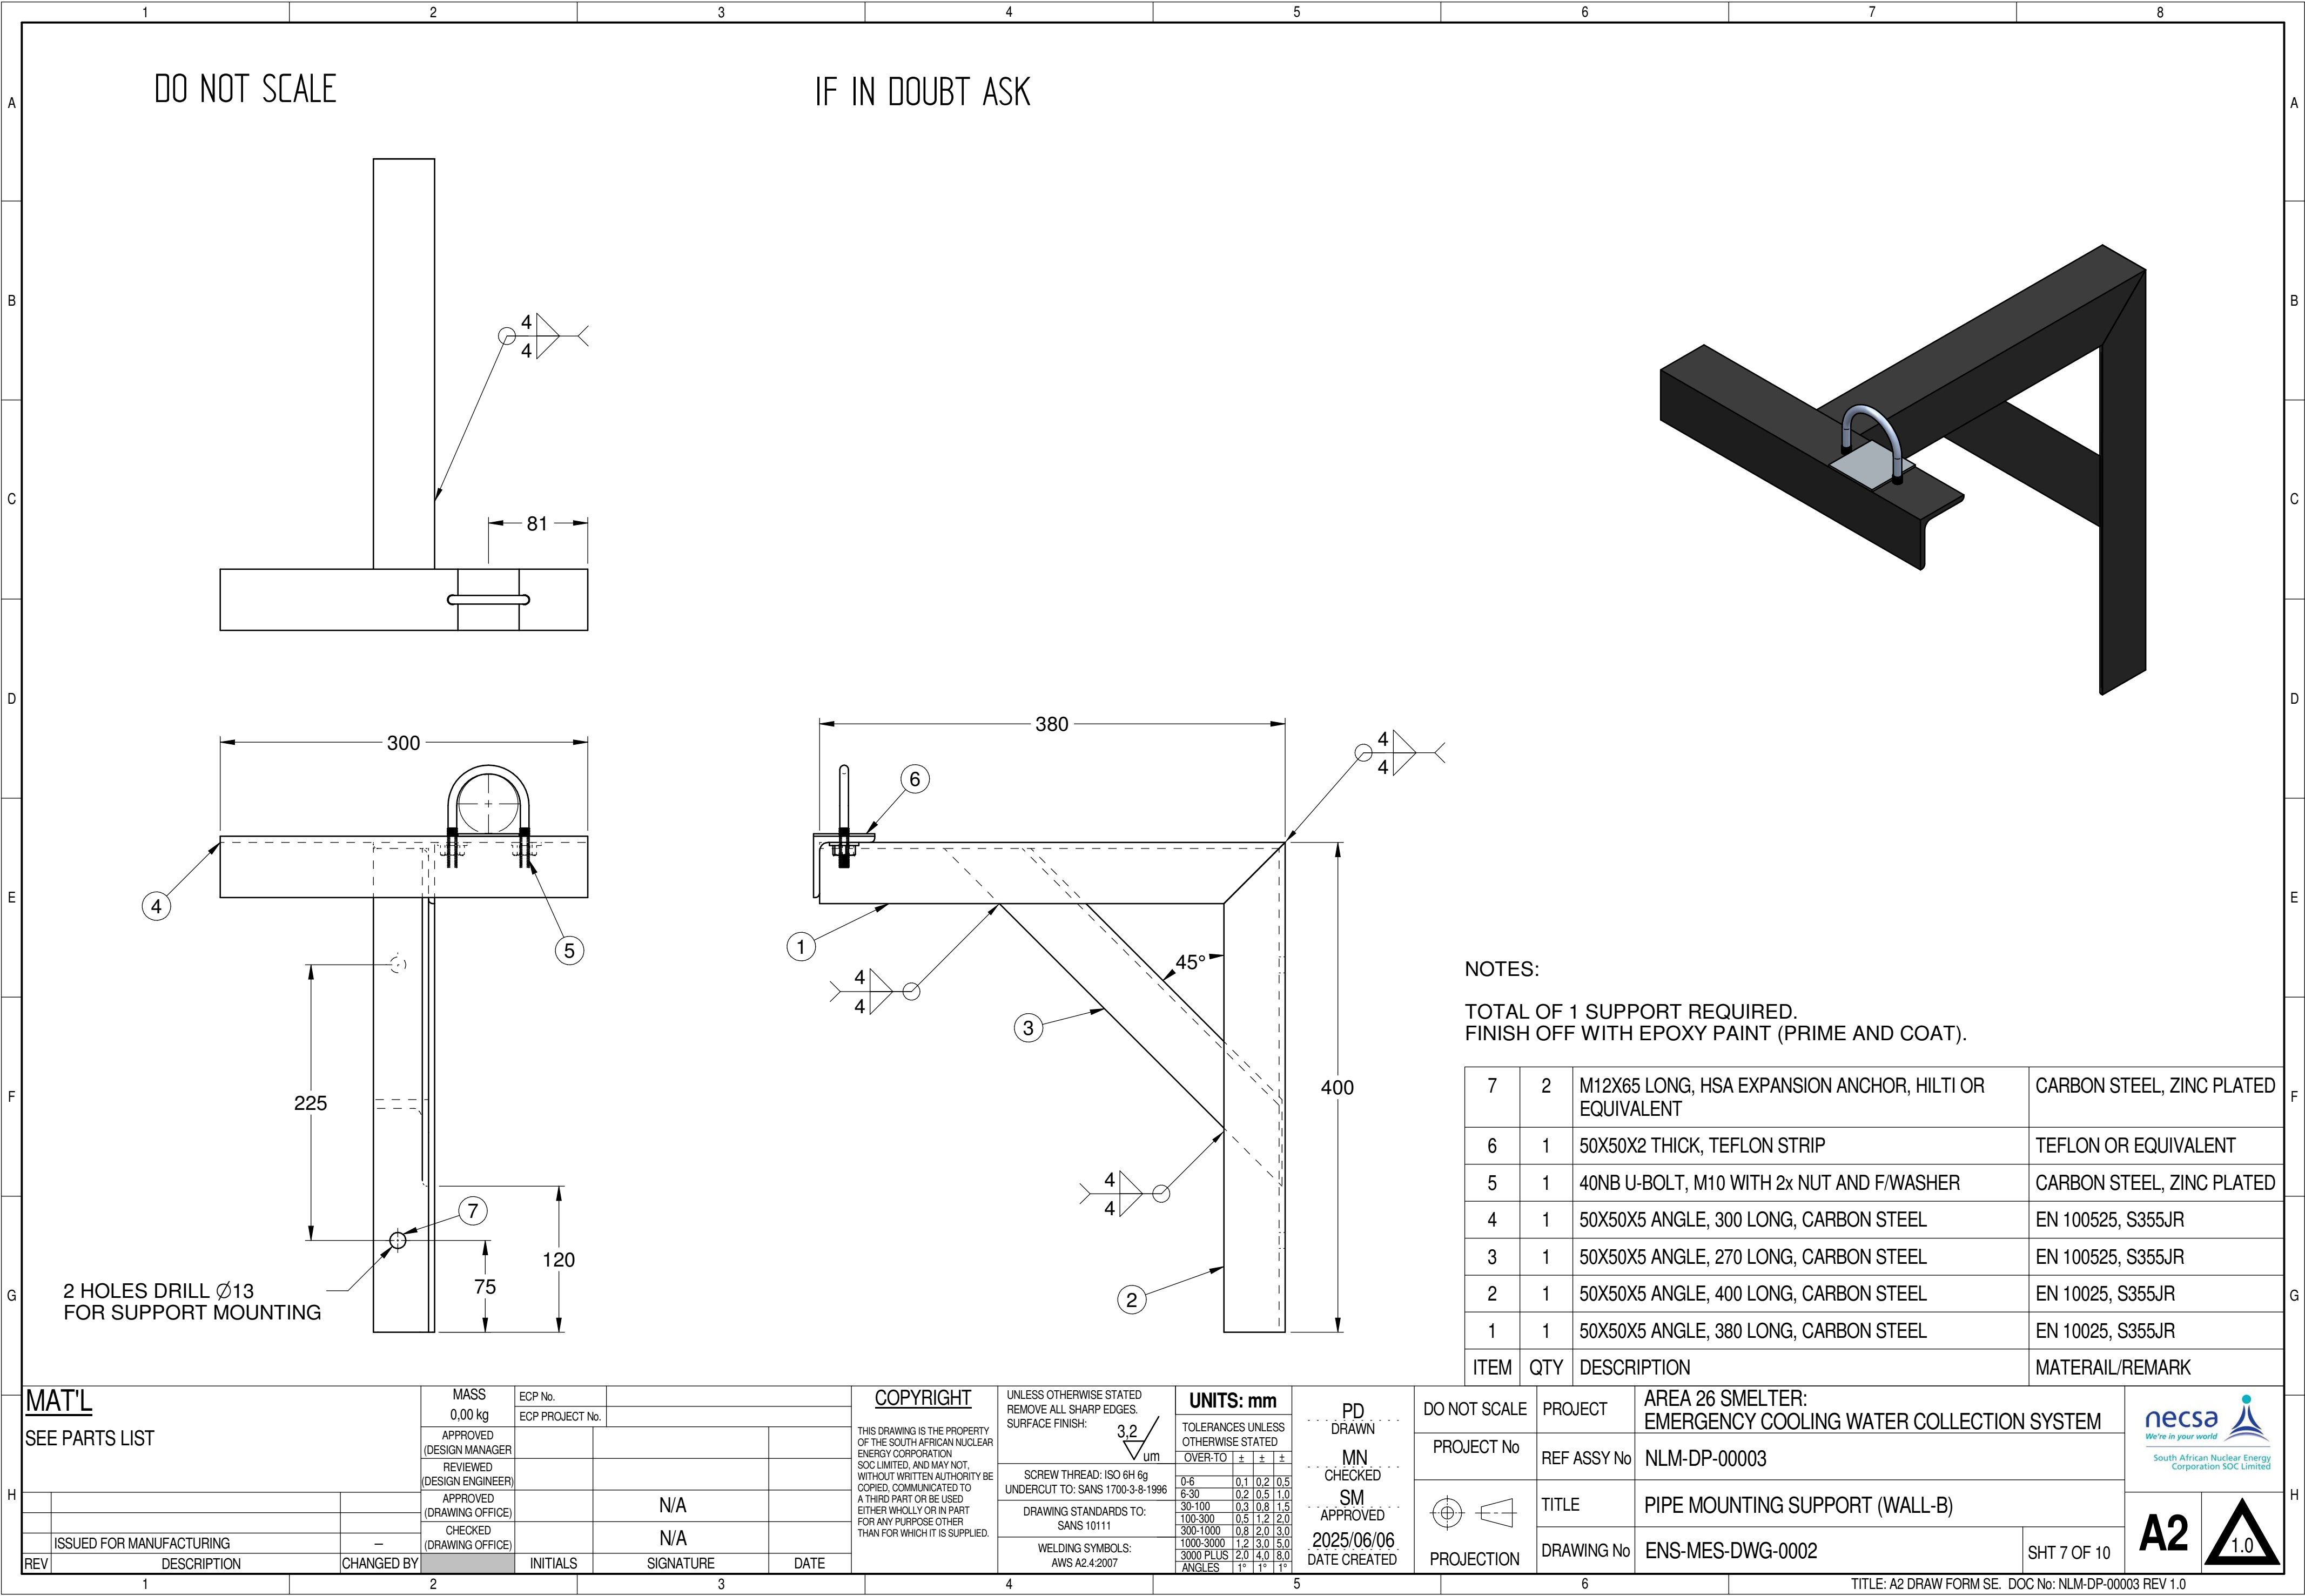

NOTES:
TOTAL OF 1 SUPPORT REQUIRED.
FINISH OFF WITH EPOXY PAINT (PRIME AND COAT).

7	2	M12X65 LONG, HSA EXPANSION ANCHOR, HILTI OR EQUIVALENT	CARBON STEEL, ZINC PLATED
6	1	50X50X2 THICK, TEFLON STRIP	TEFLON OR EQUIVALENT
5	1	40NB U-BOLT, M10 WITH 2x NUT AND F/WASHER	CARBON STEEL, ZINC PLATED
4	1	50X50X5 ANGLE, 300 LONG, CARBON STEEL	EN 100525, S355JR
3	1	50X50X5 ANGLE, 270 LONG, CARBON STEEL	EN 100525, S355JR
2	1	50X50X5 ANGLE, 400 LONG, CARBON STEEL	EN 10025, S355JR
1	1	50X50X5 ANGLE, 380 LONG, CARBON STEEL	EN 10025, S355JR
ITEM	QTY	DESCRIPTION	MATERAIL/REMARK

ENS-MES-DWG-0002



DO NOT SCALE

IF IN DOUBT ASK

128

2 HOLES DRILL Ø13
FOR ANGLE SUPPORT MOUNTING

150

90

62

5

2 HOLES DRILL Ø12
FOR PIPE MOUNTING

3

3

3

3

3

4

1080

2

1

3

3

3

3

3

3

5

4

M12X65 LONG, HSA EXPANSION ANCHOR, HILTI OR EQUIVALENT

CARBON STEEL, ZINC PLATED

4

1

50X50X2 THICK, TEFLON STRIP

TEFLON OR EQUIVALENT

3

1

40NB U-BOLT, M10 WITH 2x NUT AND F/WASHER

CARBON STEEL, ZINC PLATED

2

1

38X38X3.5 THICK, 1080 LONG SQ.TUBE, CARBON STEEL

EN 10025, S355JR

1

3

45X45X3 ANGLE, 150 LONG, CARBON STEEL

EN 10025, S355JR

ITEM

QTY

DESCRIPTION

MATERAIL/REMARK

MAT'L

SEE PARTS LIST

MASS
0,00 kg

ECP No.
ECP PROJECT No.

APPROVED
(DESIGN MANAGER)

REVIEWED
(DESIGN ENGINEER)

APPROVED
(DRAWING OFFICE)

CHECKED
(DRAWING OFFICE)

M NTEO

S MNGOMA

N/A

N/A

ISSUED FOR MANUFACTURING

—

REV

DESCRIPTION

CHANGED BY

COPYRIGHT

THIS DRAWING IS THE PROPERTY
OF THE SOUTH AFRICAN NUCLEAR
ENERGY CORPORATION
SOC LIMITED, AND MAY NOT,
WITHOUT WRITTEN AUTHORITY BE
COPIED, COMMUNICATED TO
A THIRD PART OR BE USED
EITHER WHOLLY OR IN PART
FOR ANY PURPOSE OTHER
THAN FOR WHICH IT IS SUPPLIED.

UNLESS OTHERWISE STATED
REMOVE ALL SHARP EDGES.
SURFACE FINISH:

3.2

um

SCREW THREAD: ISO 6H 6g
UNDERCUT TO: SANS 1700-3-8-1996

30-100

100-300

300-1000

1000-3000

3000 PLUS

0.1

0.2

0.5

1.0

1.2

2.0

3.0

5.0

8.0

DRAWING STANDARDS TO:
SANS 10111

WELDING SYMBOLS:
AWS A2.4:2007

UNITS: mm

TOLERANCES UNLESS
OTHERWISE STATED

OVER-TO

±

±

±

PD
DRAWN

MN
CHECKED

SM
APPROVED

2025/06/06
DATE CREATED

DO NOT SCALE

PROJECT No

PROJECT

REF ASSY No

TITLE

DRAWING No

AREA 26 SMELTER:
EMERGENCY COOLING WATER COLLECTION SYSTEM

NLM-DP-00003

PIPE MOUNTING SUPPORT (BASE-A)

ENS-MES-DWG-0002

SHT 8 OF 10

necsa

We're in your world


South African Nuclear Energy
Corporation SOC Limited

A2

1.0

TITLE: A2 DRAW FORM SE. DOC No: NLM-DP-00003 REV 1.0

ENS-MES-DWG-0002

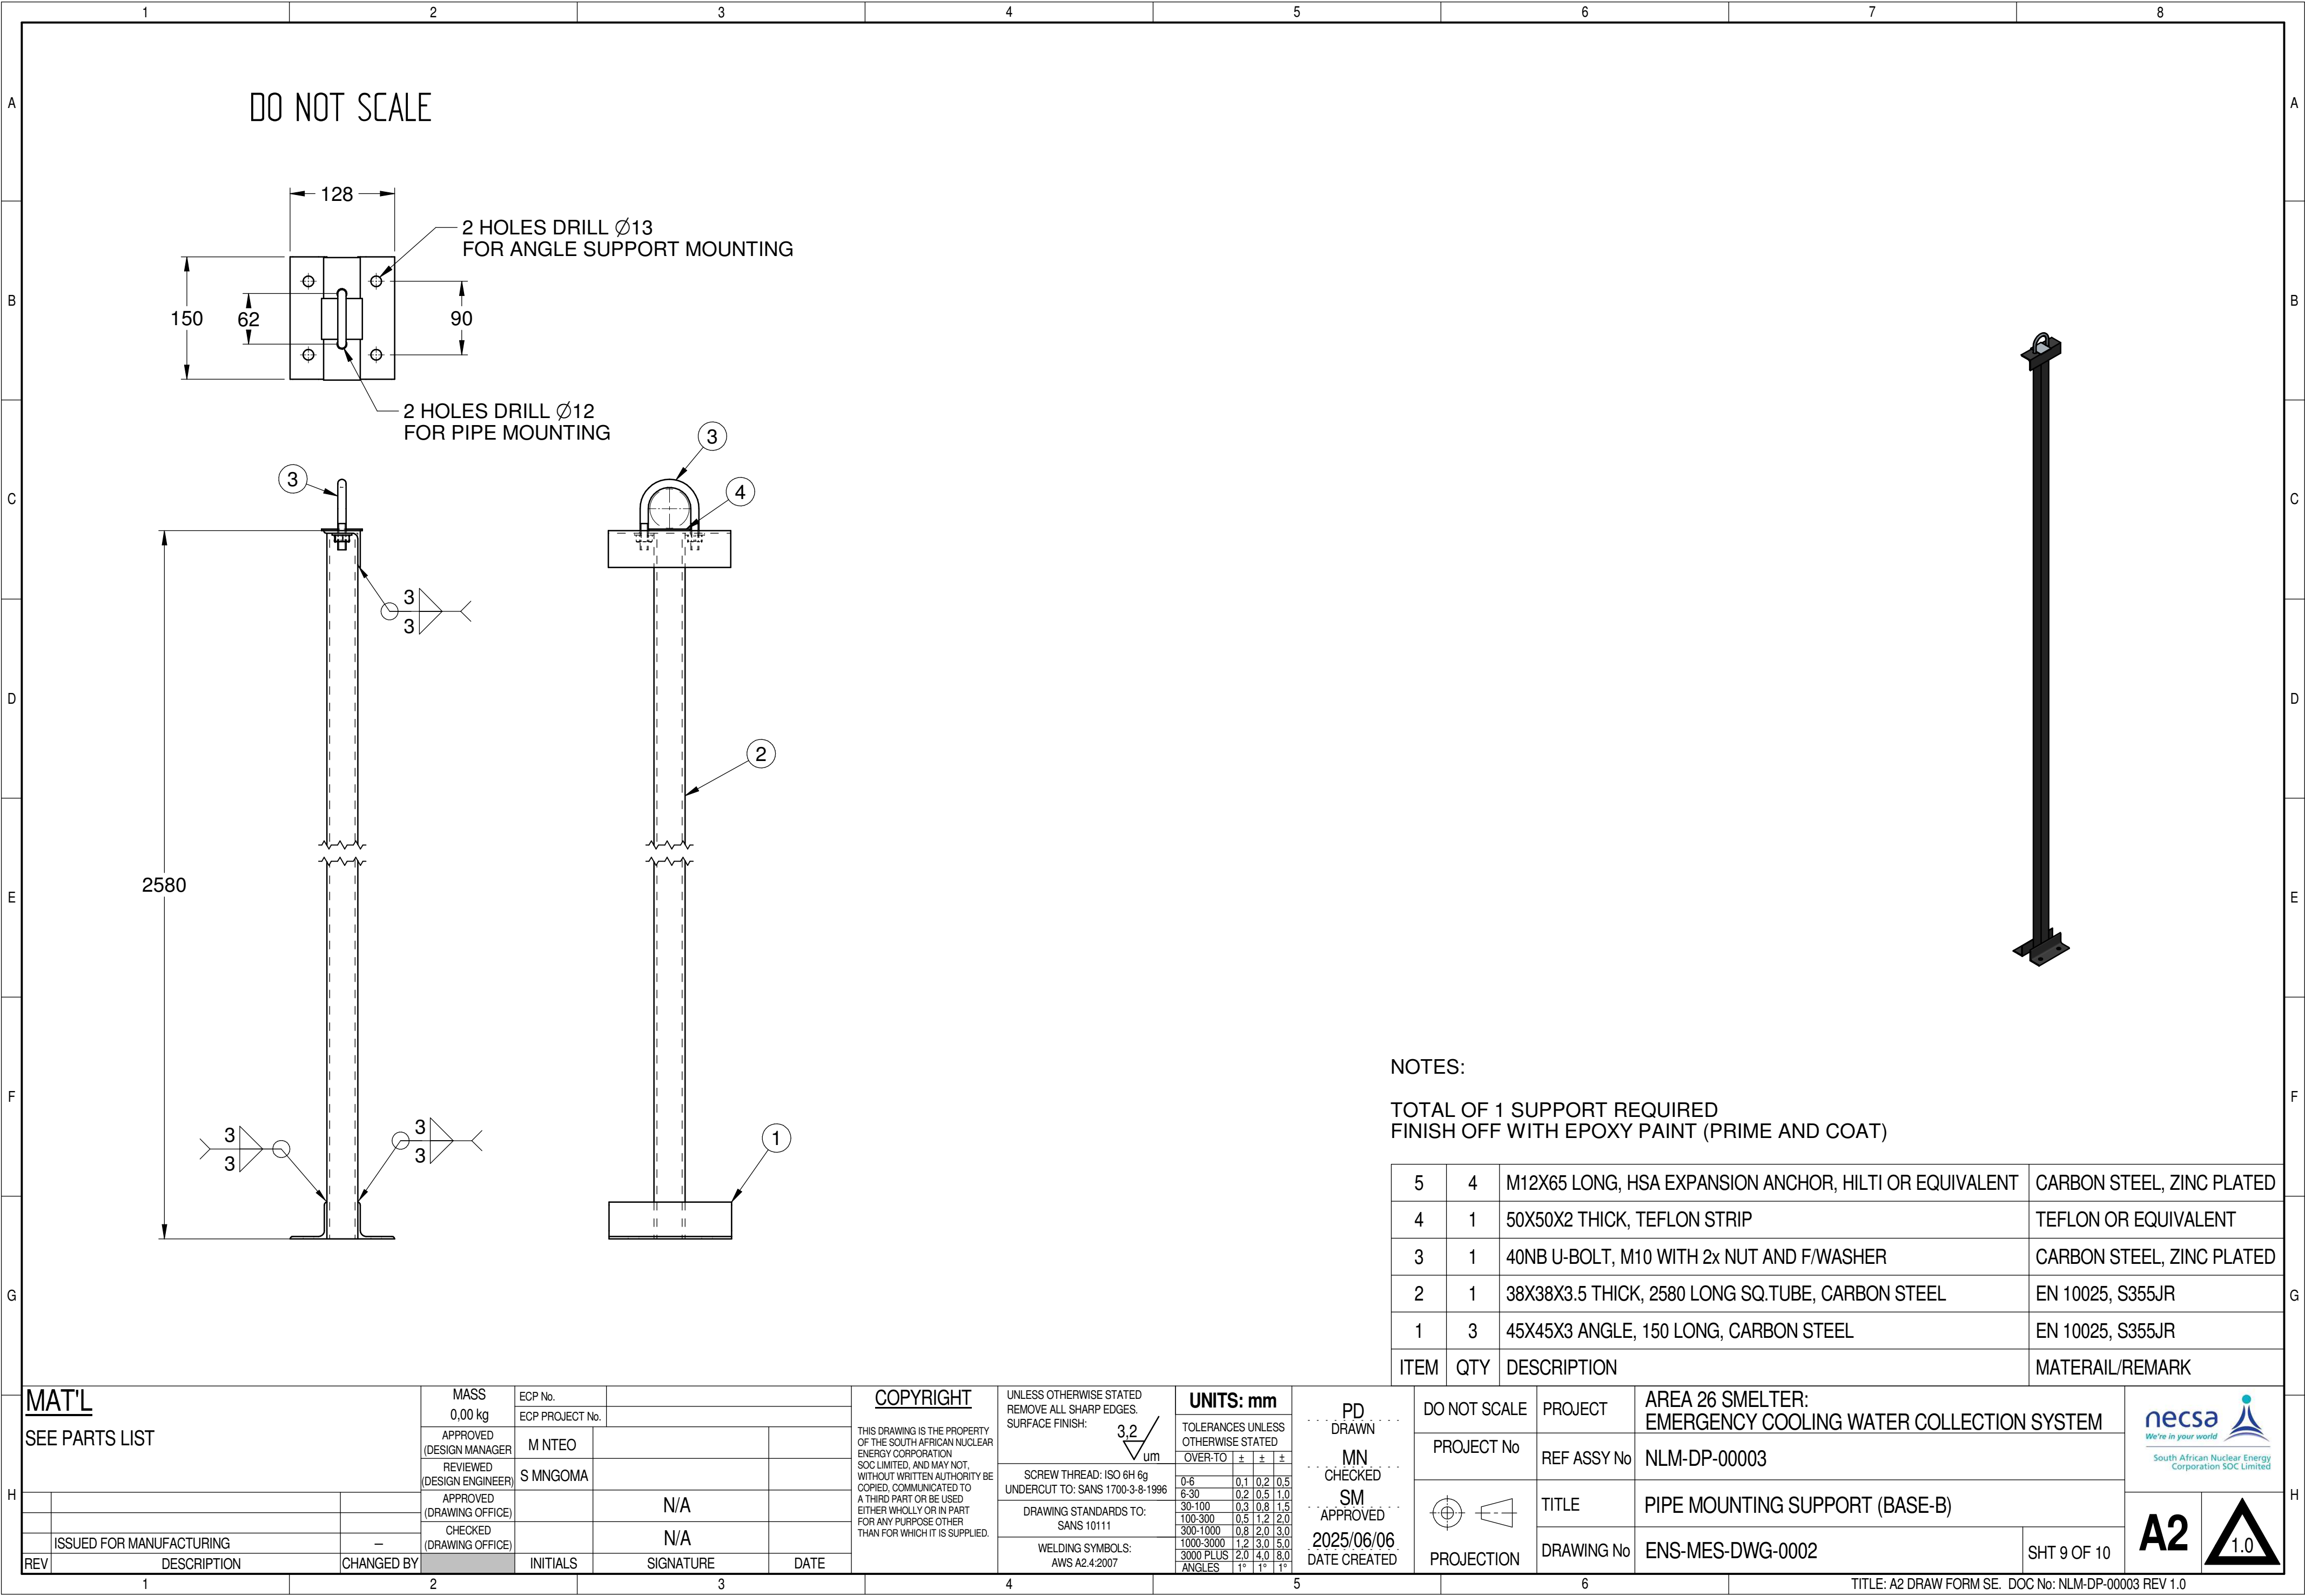


NOTES:

TOTAL OF 1 SUPPORT REQUIRED
FINISH OFF WITH EPOXY PAINT (PRIME AND COAT)

5	4	M12X65 LONG, HSA EXPANSION ANCHOR, HILTI OR EQUIVALENT	CARBON STEEL, ZINC PLATED
4	1	50X50X2 THICK, TEFLON STRIP	TEFLON OR EQUIVALENT
3	1	40NB U-BOLT, M10 WITH 2x NUT AND F/WASHER	CARBON STEEL, ZINC PLATED
2	1	38X38X3.5 THICK, 2580 LONG SQ.TUBE, CARBON STEEL	EN 10025, S355JR
1	3	45X45X3 ANGLE, 150 LONG, CARBON STEEL	EN 10025, S355JR
ITEM	QTY	DESCRIPTION	MATERAIL/REMARK

H	MAT'L			MASS	ECP No.	COPYRIGHT			UNLESS OTHERWISE STATED REMOVE ALL SHARP EDGES. SURFACE FINISH: 3.2 um	UNITS: mm	PD DRAWN MN CHECKED SM APPROVED 2025/06/06 DATE CREATED	DO NOT SCALE	PROJECT	AREA 26 SMELTER: EMERGENCY COOLING WATER COLLECTION SYSTEM			necsa We're in your world South African Nuclear Energy Corporation SOC Limited							
	SEE PARTS LIST			0,00 kg	ECP PROJECT No.									TOLERANCES UNLESS OTHERWISE STATED	OVER-TO	±			±	±	PROJECT No	REF ASSY No	NLM-DP-00003	
				APPROVED (DESIGN MANAGER)	M NTEO																		TITLE	PIPE MOUNTING SUPPORT (BASE-B)
				REVIEWED (DESIGN ENGINEER)	S MNGOMA									SCREW THREAD: ISO 6H 6g UNDERCUT TO: SANS 1700-3-8-1996	0-6	0.1	0.2	0.5	DRAWING No		ENS-MES-DWG-0002	SHT 9 OF 10		
				APPROVED (DRAWING OFFICE)		N/A								DRAWING STANDARDS TO: SANS 10111	6-30	0.2	0.5	1.0		WELDING SYMBOLS: AWS A2.4:2007			1°	1°
				CHECKED (DRAWING OFFICE)		N/A									30-100	0.3	0.8	1.5						
	REV	DESCRIPTION	CHANGED BY		INITIALS	SIGNATURE	DATE	THIS DRAWING IS THE PROPERTY OF THE SOUTH AFRICAN NUCLEAR ENERGY CORPORATION SOC LIMITED, AND MAY NOT, WITHOUT WRITTEN AUTHORITY BE COPIED, COMMUNICATED TO A THIRD PARTY OR BE USED EITHER WHOLLY OR IN PART FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED.							100-300	0.5	1.2	2.0						
			ISSUED FOR MANUFACTURING						300-1000	0.8	2.0	3.0												
									1000-3000	1.2	3.0	5.0												
									3000 PLUS	2.0	4.0	8.0												
									ANGLES	1°	1°	1°												

ENS-MES-DWG-0002

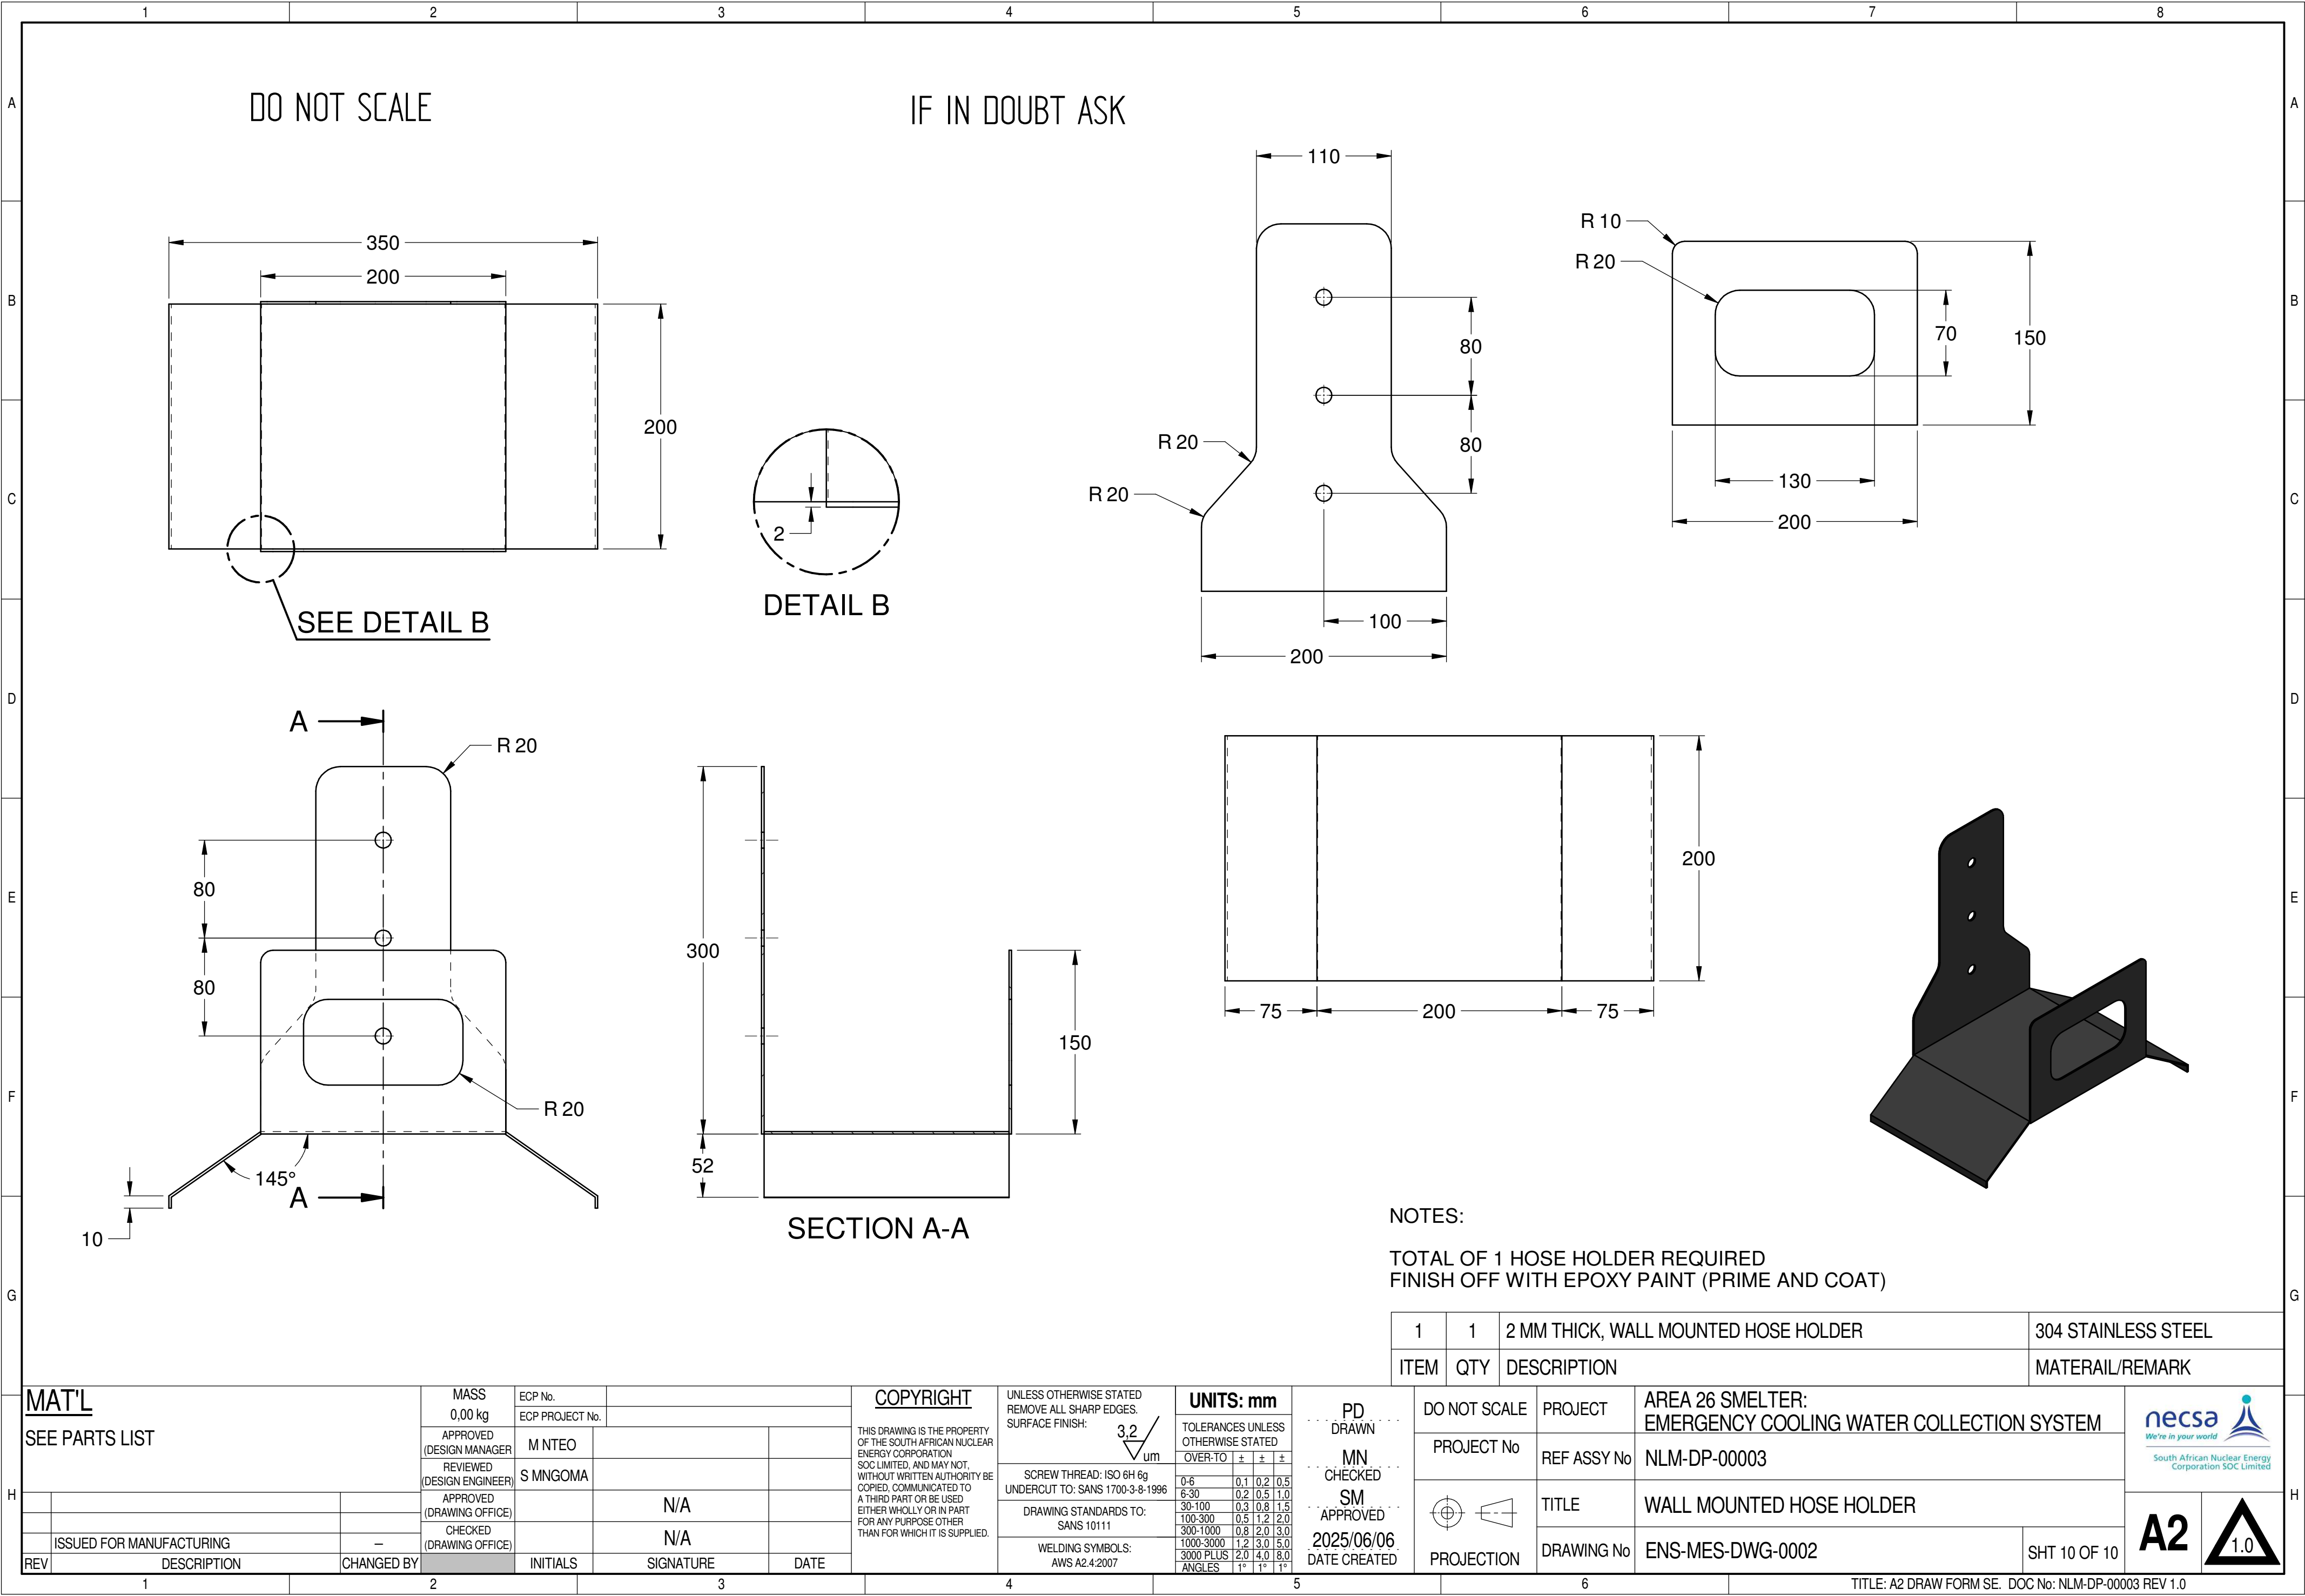

MAT'L

SEE PARTS LIST

				DESIGN ENGINEER		
				APPROVED (DRAWING OFFICE)	N/A	
				CHECKED (DRAWING OFFICE)	N/A	
ISSUED FOR MANUFACTURING		—				
REV	DESCRIPTION	CHANGED BY		INITIALS	SIGNATURE	DATE

COPYRIGHT

THIS DRAWING IS THE PROPERTY
OF THE SOUTH AFRICAN NUCLEAR
ENERGY CORPORATION
SOC LIMITED, AND MAY NOT,
WITHOUT WRITTEN AUTHORITY BE
COPIED, COMMUNICATED TO
A THIRD PARTY OR BE USED
EITHER WHOLLY OR IN PART
FOR ANY PURPOSE OTHER
THAN FOR WHICH IT IS SUPPLIED.

UNLESS OTHERWISE STATED
REMOVE ALL SHARP EDGES.
SURFACE FINISH:

3.2
um

SCREW THREAD: ISO 6H 6g
UNDERCUT TO: SANS 1700-3-8-1996

DRAWING STANDARDS TO:
SANS 10111

WELDING SYMBOLS:
AWS A2.4:2007

UNITS: mm

TOLERANCES UNLESS
OTHERWISE STATED

OVER-TO	±	±	±
0-6	0.1	0.2	0.5
6-30	0.2	0.5	1.0
30-100	0.3	0.8	1.5
100-300	0.5	1.2	2.0
300-1000	0.8	2.0	3.0
1000-3000	1.2	3.0	5.0
3000 PLUS	2.0	4.0	8.0
ANGLES	1°	1°	1°

PD
DRAWN
MN
CHECKED
SM
APPROVED
2025/06/06
DATE CREATED

DO NOT SCALE

PROJECT

PROJECT No

TITLE

DRAWING No

PROJECT

REF ASSY No

TITLE

DRAWING No

AREA 26 SMELTER:

EMERGENCY COOLING WATER COLLECTION SYSTEM

NLM-DP-00003

WALL MOUNTED HOSE HOLDER

ENS-MES-DWG-0002


304 STAINLESS STEEL

MATERAIL/REMARK

SHT 10 OF 10


A2

1.0

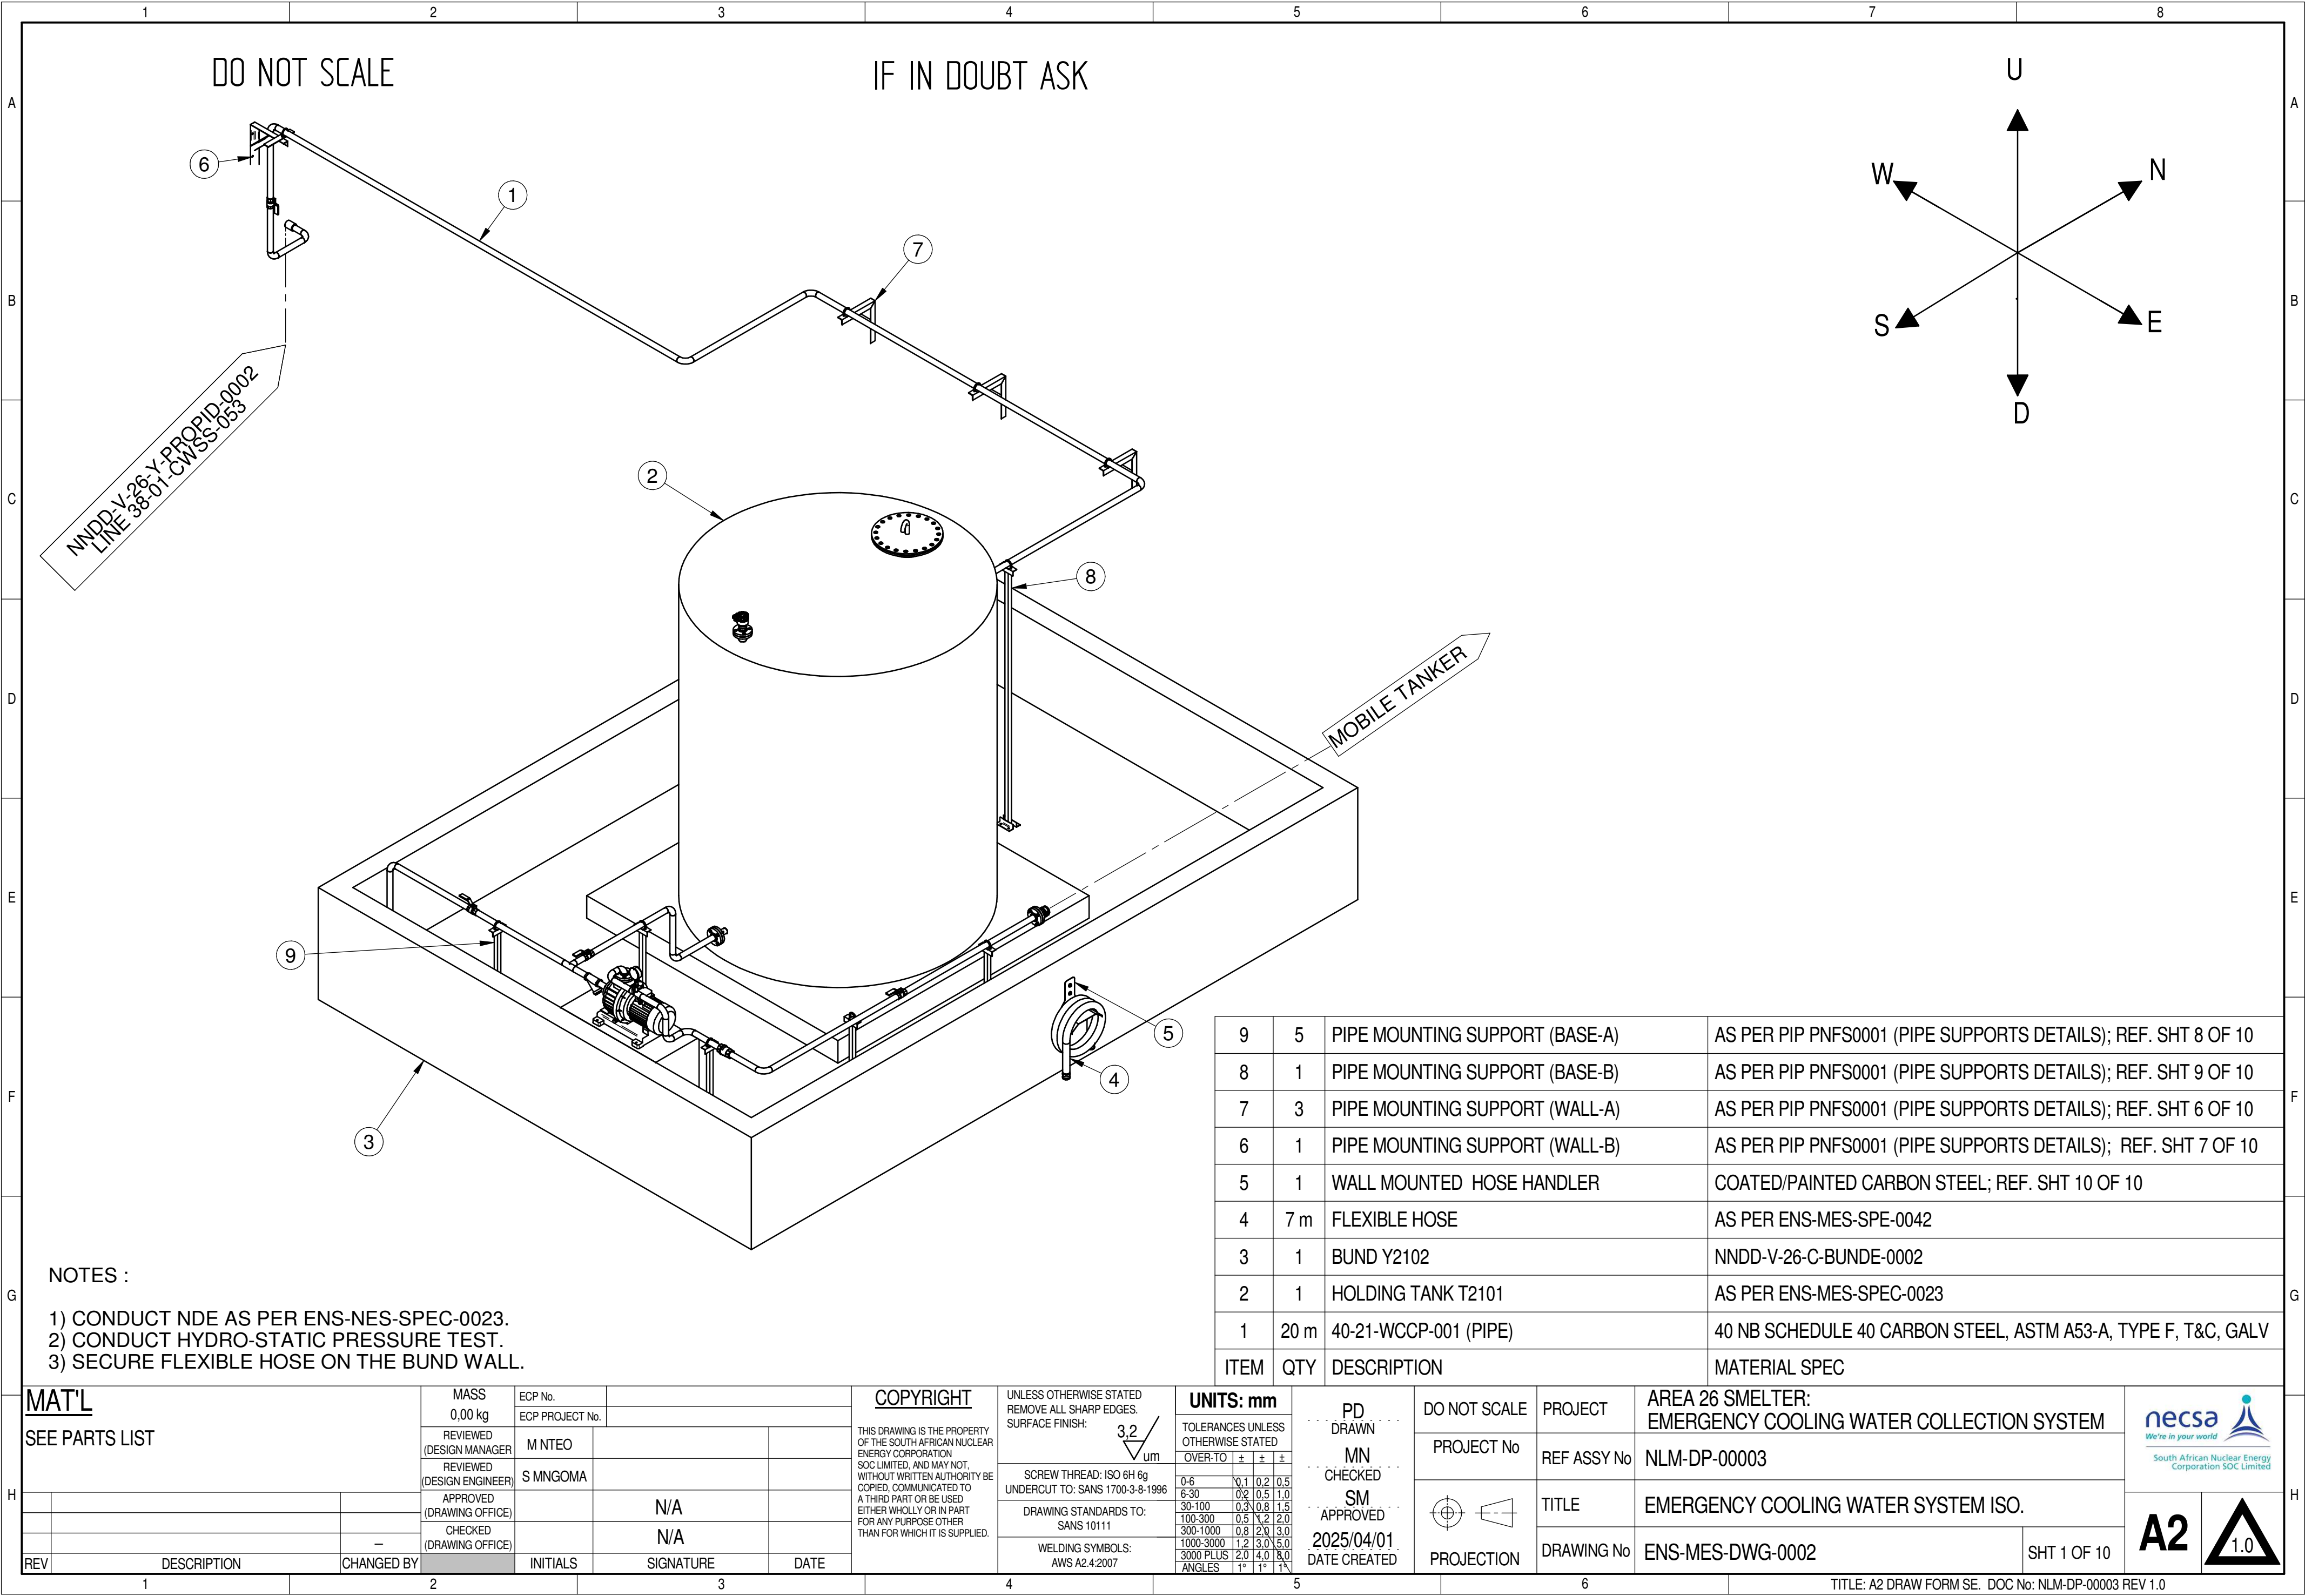

DO NOT SCALE

IF IN DOUBT ASK

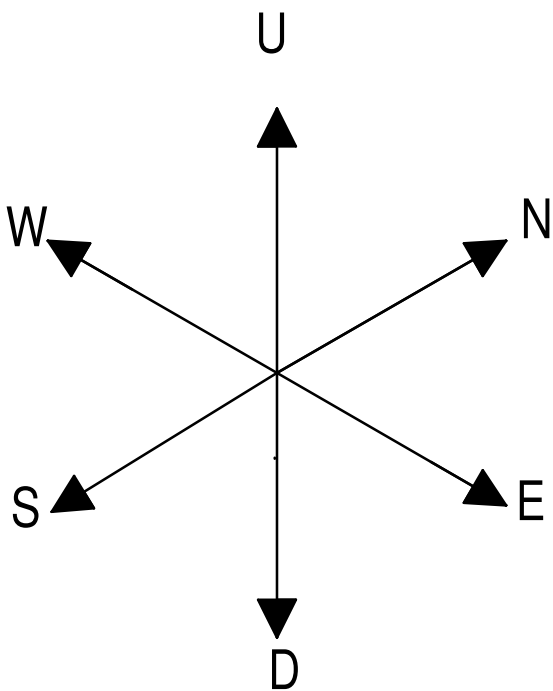

NND-V-26-Y-PROP-ID-0002
LINE 38-01-CWSS-053

MOBILE TANKER

- NOTES :
- 1) CONDUCT NDE AS PER ENS-NES-SPEC-0023.
 - 2) CONDUCT HYDRO-STATIC PRESSURE TEST.
 - 3) SECURE FLEXIBLE HOSE ON THE BUND WALL.

9	5	PIPE MOUNTING SUPPORT (BASE-A)	AS PER PIP PNFS0001 (PIPE SUPPORTS DETAILS); REF. SHT 8 OF 10
8	1	PIPE MOUNTING SUPPORT (BASE-B)	AS PER PIP PNFS0001 (PIPE SUPPORTS DETAILS); REF. SHT 9 OF 10
7	3	PIPE MOUNTING SUPPORT (WALL-A)	AS PER PIP PNFS0001 (PIPE SUPPORTS DETAILS); REF. SHT 6 OF 10
6	1	PIPE MOUNTING SUPPORT (WALL-B)	AS PER PIP PNFS0001 (PIPE SUPPORTS DETAILS); REF. SHT 7 OF 10
5	1	WALL MOUNTED HOSE HANDLER	COATED/PAINTED CARBON STEEL; REF. SHT 10 OF 10
4	7 m	FLEXIBLE HOSE	AS PER ENS-MES-SPE-0042
3	1	BUND Y2102	NNDD-V-26-C-BUNDE-0002
2	1	HOLDING TANK T2101	AS PER ENS-MES-SPEC-0023
1	20 m	40-21-WCCP-001 (PIPE)	40 NB SCHEDULE 40 CARBON STEEL, ASTM A53-A, TYPE F, T&C, GALV
ITEM	QTY	DESCRIPTION	MATERIAL SPEC

MAT'L SEE PARTS LIST		MASS 0,00 kg	ECP No. ECP PROJECT No.	COPYRIGHT THIS DRAWING IS THE PROPERTY OF THE SOUTH AFRICAN NUCLEAR ENERGY CORPORATION SOC LIMITED, AND MAY NOT, WITHOUT WRITTEN AUTHORITY BE COPIED, COMMUNICATED TO A THIRD PART OR BE USED EITHER WHOLLY OR IN PART FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED.		UNLESS OTHERWISE STATED REMOVE ALL SHARP EDGES. SURFACE FINISH: 3.2 SCREW THREAD: ISO 6H 6g UNDERCUT TO: SANS 1700-3-8-1996 DRAWING STANDARDS TO: SANS 10111 WELDING SYMBOLS: AWS A2.4:2007	UNITS: mm TOLERANCES UNLESS OTHERWISE STATED OVER-TO ± ± ± <table><tr><td>0-6</td><td>0.1</td><td>0.2</td><td>0.5</td></tr><tr><td>6-30</td><td>0.2</td><td>0.5</td><td>1.0</td></tr><tr><td>30-100</td><td>0.3</td><td>0.8</td><td>1.5</td></tr><tr><td>100-300</td><td>0.5</td><td>1.2</td><td>2.0</td></tr><tr><td>300-1000</td><td>0.8</td><td>2.0</td><td>3.0</td></tr><tr><td>1000-3000</td><td>1.2</td><td>3.0</td><td>5.0</td></tr><tr><td>3000 PLUS</td><td>2.0</td><td>4.0</td><td>8.0</td></tr></table> ANGLES 1° 1° 1°	0-6	0.1	0.2	0.5	6-30	0.2	0.5	1.0	30-100	0.3	0.8	1.5	100-300	0.5	1.2	2.0	300-1000	0.8	2.0	3.0	1000-3000	1.2	3.0	5.0	3000 PLUS	2.0	4.0	8.0	PD DRAWN MN CHECKED SM APPROVED 2025/04/01 DATE CREATED	DO NOT SCALE PROJECT PROJECT No REF ASSY No TITLE DRAWING No PROJECTION	AREA 26 SMELTER: EMERGENCY COOLING WATER COLLECTION SYSTEM NLM-DP-00003 EMERGENCY COOLING WATER SYSTEM ISO. ENS-MES-DWG-0002 SHT 1 OF 10	 We're in your world South African Nuclear Energy Corporation SOC Limited A2
0-6	0.1	0.2	0.5																																				
6-30	0.2	0.5	1.0																																				
30-100	0.3	0.8	1.5																																				
100-300	0.5	1.2	2.0																																				
300-1000	0.8	2.0	3.0																																				
1000-3000	1.2	3.0	5.0																																				
3000 PLUS	2.0	4.0	8.0																																				
REV	DESCRIPTION	CHANGED BY	INITIALS	SIGNATURE	DATE	TITLE: A2 DRAW FORM SE. DOC No: NLM-DP-00003 REV 1.0																																	

ENS-MES-DWG-0002

TOP VIEW



FRONT VIEW

SIDE VIEW

MAT'L			MASS 0,00 kg	ECP No.	COPYRIGHT			UNLESS OTHERWISE STATED REMOVE ALL SHARP EDGES SURFACE FINISH:		UNITS: mm		PD DRAWN	DO NOT SCALE	PROJECT	AREA 26 SMELTER: EMERGENCY COOLING WATER COLLECTION SYSTEM		necsa We're in your world South African Nuclear Energy Corporation SOC Limited	
SEE PARTS LIST			APPROVED (DESIGN MANAGER)	M NTEO	THIS DRAWING IS THE PROPERTY OF THE SOUTH AFRICAN NUCLEAR ENERGY CORPORATION SOC LIMITED, AND MAY NOT, WITHOUT IT WRITTEN AUTHORITY BE COPIED, COMMUNICATED TO A THIRD PARTY OR BE USED EITHER WHOLLY OR IN PART FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED.			3/2 UM		TOLERANCES UNLESS OTHERWISE STATED OVER-TO + - - - +		MN CHECKED	PROJECT No	REF ASSY No	NLM-DP-00003			
			REVIEWED (DESIGN ENGINEER)	S MNGOMA				SCREW THREAD: ISO 6H 6g UNDERCUT TO: SANS 1700 3-8-1996		0-8 0,1 0,2 0,5 6-30 0,2 0,5 1,0 30-100 0,3 0,8 1,5 100-300 0,5 1,2 2,0 300-1000 0,8 2,0 3,0 1000-2000 1,2 3,0 5,0 3000 PLUS 2,0 4,0 8,0 ANGLES 1° 1' 10'		SM APPROVED		TITLE	EMERGENCY COOLING WATER SYSTEM (THREE VIEWS)			
			APPROVED (DRAWING OFFICE)	N/A				DRAWING STANDARDS TO: SANS 10111				2025/06/04 DATE CREATED			DRAWING No	ENS-MES-DWG-0002		
			CHECKED (DRAWING OFFICE)	N/A				WELDING SYMBOLS: AWS A2.4:2007								SHT 2 OF 10		A1 1.0
REV	DESCRIPTION	CHANGED BY	INITIALS	SIGNATURE	DATE													


TITLE: A1 DRAW FORM SE. DOC No: NLM-DP-00003 REV 1.0

IF IN DOUBT ASK

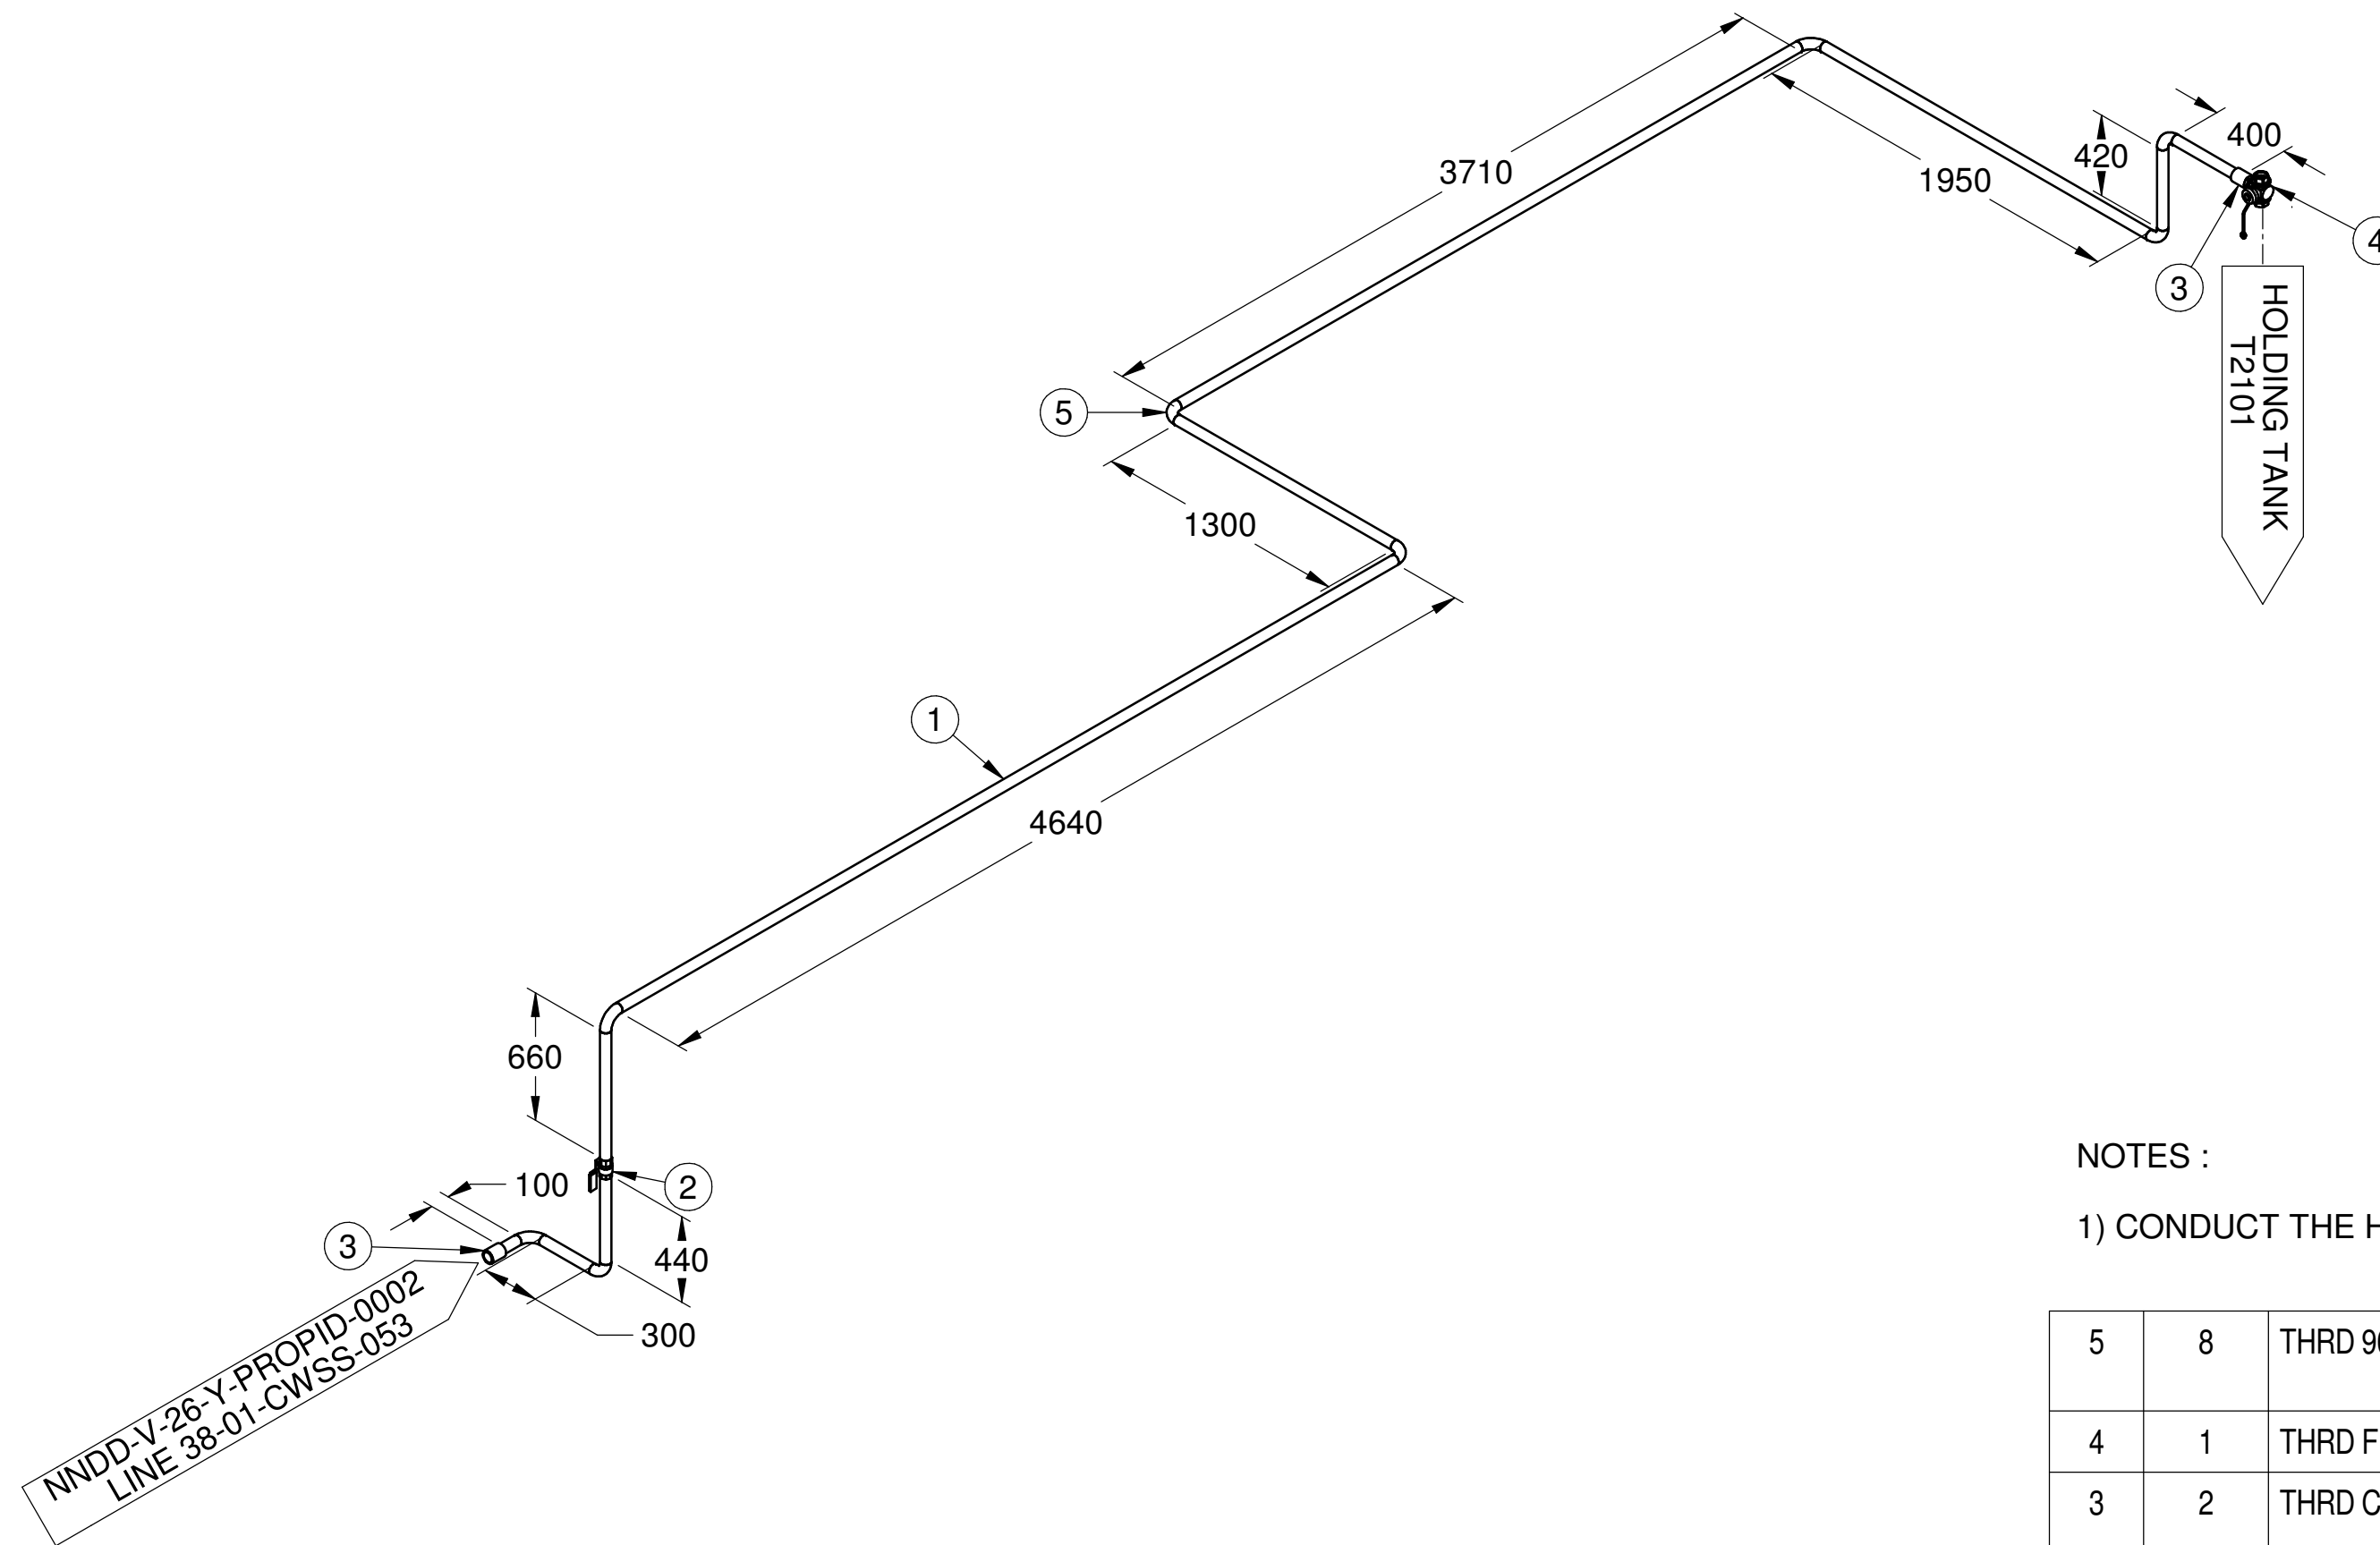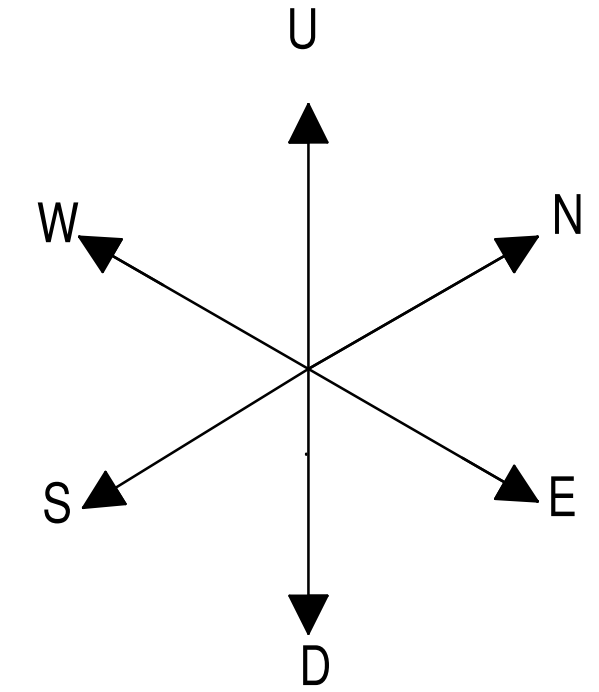


1) CONDUCT THE HYDRO-STATIC PRESSURE TEST.

5	8	THRD 90° ELBOLET LONG RADIUS	40 NB SCHEDULE 40 CLASS 300 GALV MALLEABLE IRON, ASTM A197 ASME B16.3
4	1	THRD FLOAT VALVE	AS PER ENS-MES-SPE-0024
3	2	THRD COUPLING	40NB CLASS 300 GALV MALLEABLE IRON, ASTM A197, ASME B16.3
2	1	THRD BALL VALVE	40NB WOG 400, BRONZE BODY W/PTFE ST, USER CODE BA04BT000
1	14 m	40-21-WCCP-001 (PIPE)	40 NB SCHEDULE 40 CARBON STEEL, ASTM A53-A, TYPE F, T&C, GALV
ITEM	QTY	DESCRIPTION	MATERIAL SPEC

MAT'L SEE PARTS LIST			MASS 0,00 kg		ECP No. ECP PROJECT No.		COPYRIGHT THIS DRAWING IS THE PROPERTY OF THE SOUTH AFRICAN NUCLEAR ENERGY CORPORATION SOC LIMITED, AND MAY NOT, WITHOUT WRITTEN AUTHORITY BE COPIED, COMMUNICATED TO A THIRD PARTY OR BE USED EITHER WHOLLY OR IN PART FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED.		UNLESS OTHERWISE STATED REMOVE ALL SHARP EDGES. SURFACE FINISH: $3.2 \sqrt{\text{um}}$		UNITS: mm TOLERANCES UNLESS OTHERWISE STATED OVER-TO ± ± ± 0-6 0.1 0.2 0.5 6-30 0.2 0.5 1.0 30-100 0.3 0.8 1.5 100-300 0.5 1.2 2.0 300-1000 0.8 2.0 3.0 1000-3000 1.2 3.0 5.0 3000 PLUS 2.0 4.0 8.0 ANGLES 1° 1° 1°		PD DRAWN MN CHECKED SM APPROVED 2025/06/04 DATE CREATED		DO NOT SCALE PROJECT No REF ASSY No TITLE DRAWING No PROJECTION		AREA 26 SMELTER: EMERGENCY COOLING WATER COLLECTION SYSTEM NLM-DP-00003 TANK T2101 INLET PIPING ENS-MES-DWG-0002 SHT 3 OF 10		 South African Nuclear Energy Corporation SOC Limited 	
APPROVED (DESIGN MANAGER) REVIEWED (DESIGN ENGINEER) APPROVED (DRAWING OFFICE) CHECKED (DRAWING OFFICE)			M NTEO S MNGOMA N/A N/A		N/A N/A		N/A N/A		N/A N/A		N/A N/A		N/A N/A		N/A N/A		N/A N/A		N/A N/A	
REV	DESCRIPTION		CHANGED BY	INITIALS	SIGNATURE	DATE													TITLE: A2 DRAW FORM SE. DOC No: NLM-DP-00003 REV 1.0	


ENS-MES-DWG-0002

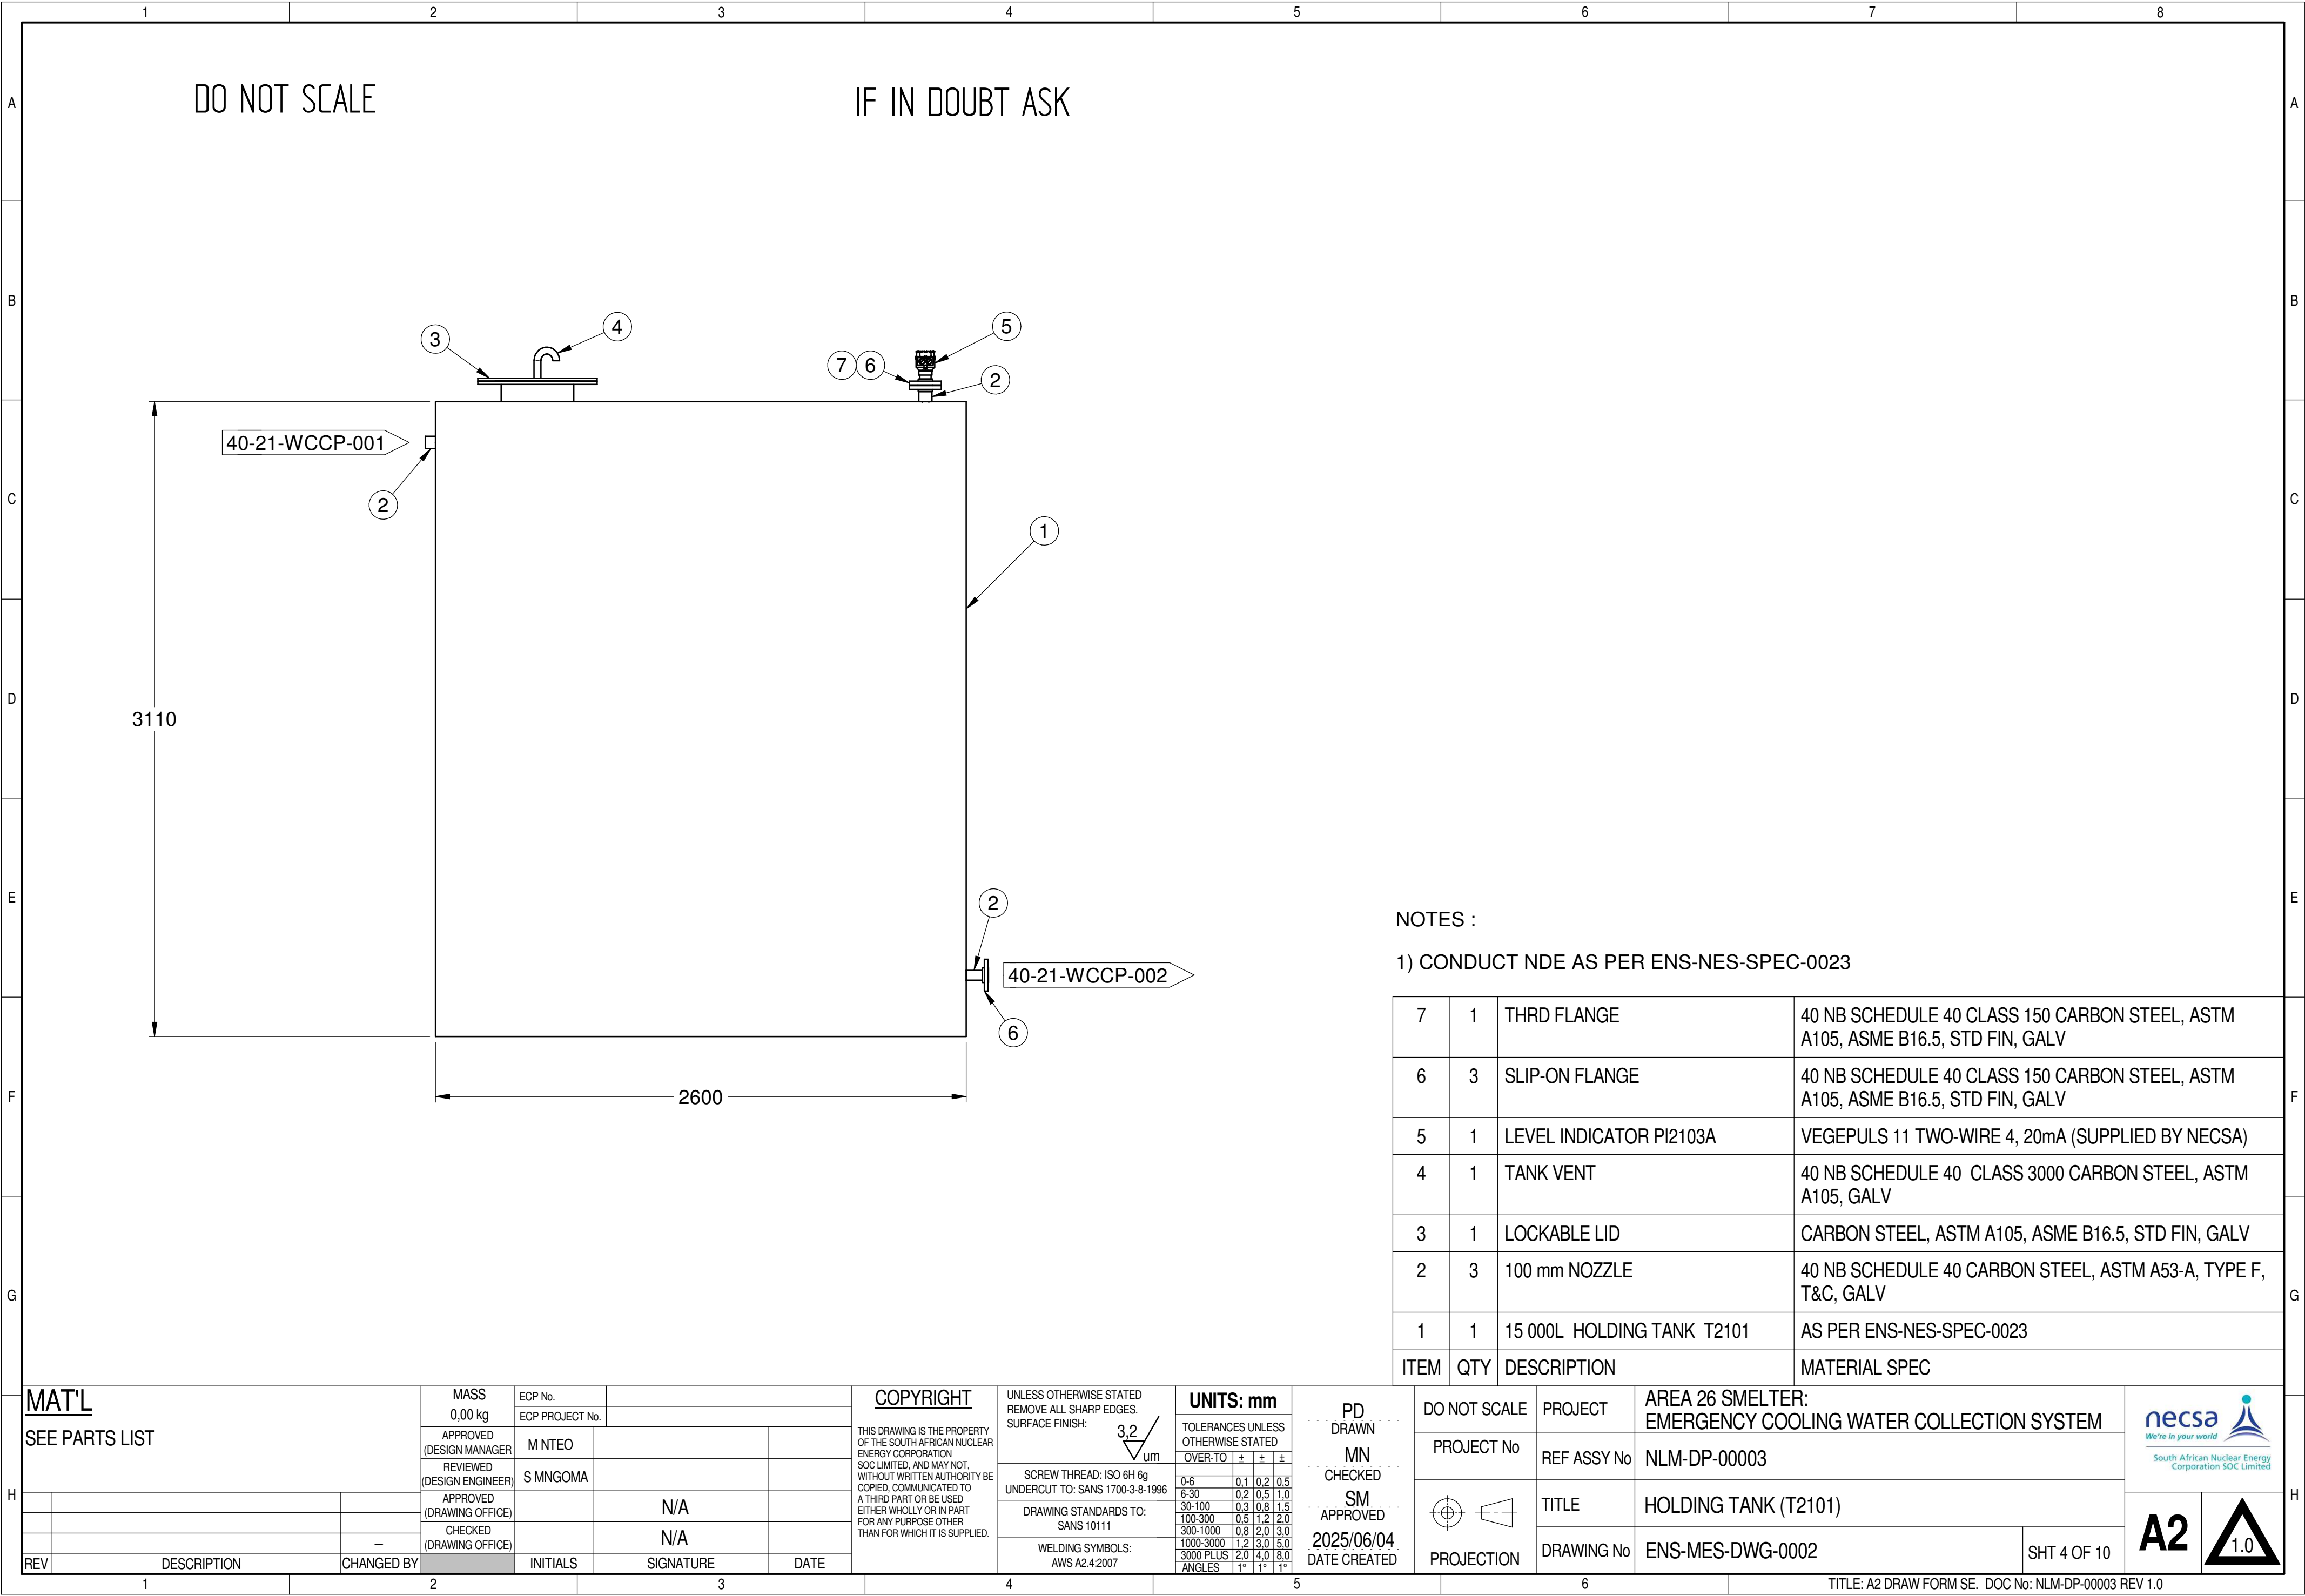

NOTES :

1) CONDUCT NDE AS PER ENS-NES-SPEC-0023

7	1	THRD FLANGE	40 NB SCHEDULE 40 CLASS 150 CARBON STEEL, ASTM A105, ASME B16.5, STD FIN, GALV
6	3	SLIP-ON FLANGE	40 NB SCHEDULE 40 CLASS 150 CARBON STEEL, ASTM A105, ASME B16.5, STD FIN, GALV
5	1	LEVEL INDICATOR PI2103A	VEGEPULS 11 TWO-WIRE 4, 20mA (SUPPLIED BY NECSA)
4	1	TANK VENT	40 NB SCHEDULE 40 CLASS 3000 CARBON STEEL, ASTM A105, GALV
3	1	LOCKABLE LID	CARBON STEEL, ASTM A105, ASME B16.5, STD FIN, GALV
2	3	100 mm NOZZLE	40 NB SCHEDULE 40 CARBON STEEL, ASTM A53-A, TYPE F, T&C, GALV
1	1	15 000L HOLDING TANK T2101	AS PER ENS-NES-SPEC-0023
ITEM	QTY	DESCRIPTION	MATERIAL SPEC

MAT'L SEE PARTS LIST		MASS 0,00 kg	ECP No.	COPYRIGHT THIS DRAWING IS THE PROPERTY OF THE SOUTH AFRICAN NUCLEAR ENERGY CORPORATION SOC LIMITED, AND MAY NOT, WITHOUT WRITTEN AUTHORITY BE COPIED, COMMUNICATED TO A THIRD PART OR BE USED EITHER WHOLLY OR IN PART FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED.		UNLESS OTHERWISE STATED REMOVE ALL SHARP EDGES. SURFACE FINISH: 3,2  um	UNITS: mm TOLERANCES UNLESS OTHERWISE STATED OVER-TO ± ± ± 0-6 0,1 0,2 0,5 6-30 0,2 0,5 1,0 30-100 0,3 0,8 1,5 100-300 0,5 1,2 2,0 300-1000 0,8 2,0 3,0 1000-3000 1,2 3,0 5,0 3000 PLUS 2,0 4,0 8,0 ANGLES 1° 1° 1°	PD DRAWN MN CHECKED SM APPROVED 2025/06/04 DATE CREATED	DO NOT SCALE	PROJECT	AREA 26 SMELTER: EMERGENCY COOLING WATER COLLECTION SYSTEM		
		PROJECT No	REF ASSY No						NLM-DP-00003				
			TITLE						HOLDING TANK (T2101)				
			DRAWING No						ENS-MES-DWG-0002				
REV	DESCRIPTION	CHANGED BY	INITIALS	SIGNATURE	DATE					SHT 4 OF 10		A2 	
TITLE: A2 DRAW FORM SE. DOC No: NLM-DP-00003 REV 1.0													

ENS-MES-DWG-0002