


500 liter WATER TROUGH DETAIL

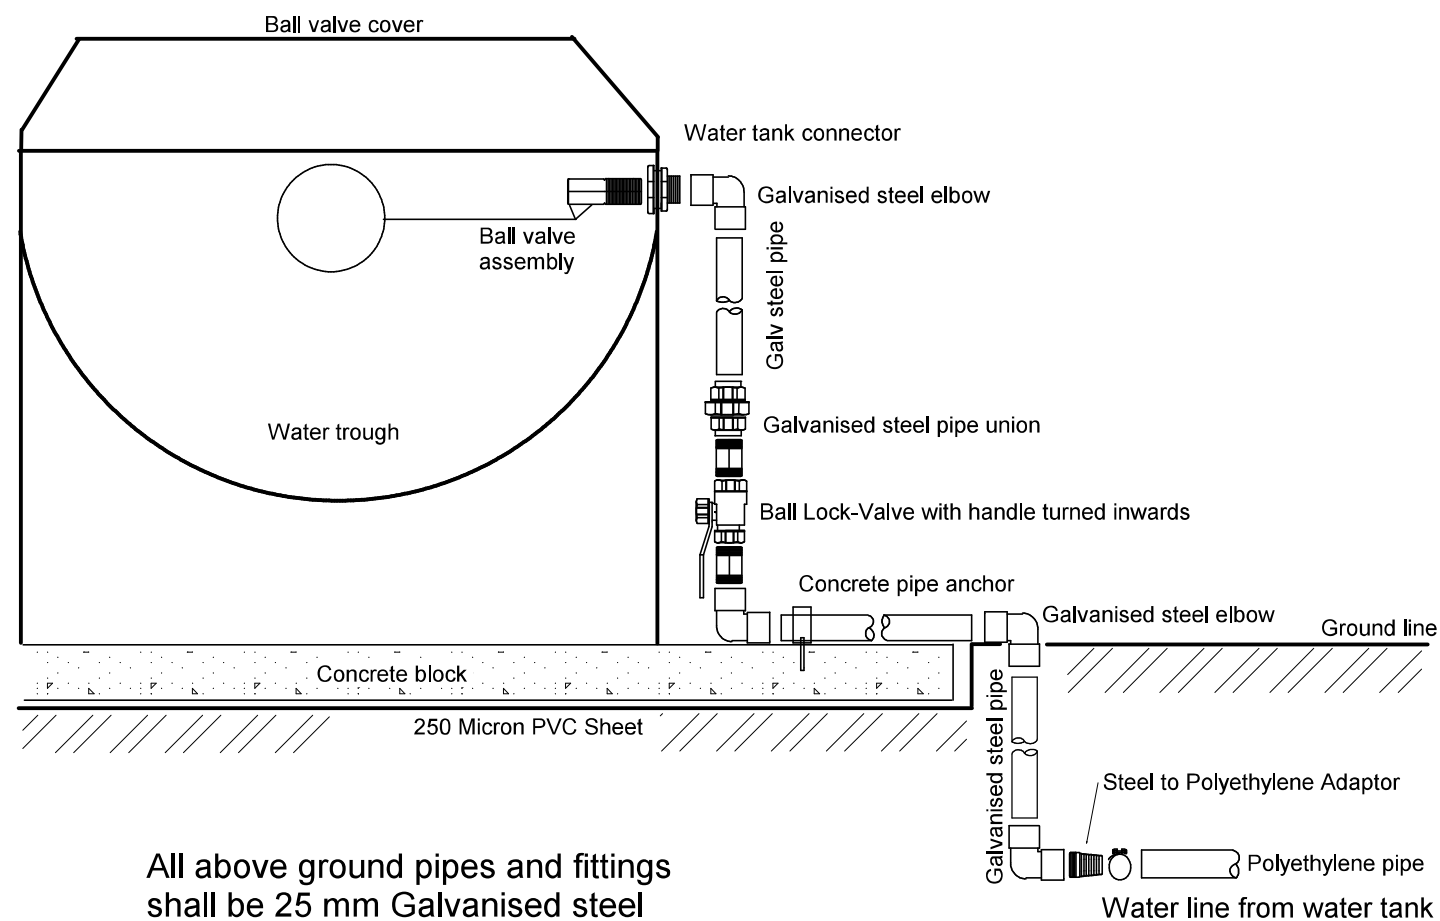

All above ground pipes and fittings shall be 25 mm Galvanised steel

## WATER TROUGH CONNECTIONS

NO.	SPECIAL NOTES:		DEPARTMENT OF RURAL DEVELOPMENT AND AGRARIAN REFORM PROVINCE OF THE EASTERN CAPE	STOCK WATER SYSTEM	SCALE	INDEX NO.
		JPJ KOCH (CHIEF ENGINEER)			NTS	SCMM001/21/04
		DECEMBER 2020 (DATE APPROVED)	ENGINEERING SERVICES PRIVATE BAG X015 DOHNE ADI STUTTERHEIM 4930	WATER THROUGHS	A3 ORIGINAL	PLAN NO. SHEET 4 OF 5