HRS3

HRS2

HRS1

EXISTING PIPELINES FROM EMERGENCY DAMS AND HAUL ROAD SUMPS TO BE REROUTED AROUND AD1 OUTSIDE WORKING AREA TO DISCHARGE INTO HARDSTAND AREA CANAL

NEW TEMPORARY Ø200mm HDPE PIPES PE100, PN10, SDR17

AD1

REROUTED PIPES TO DISCHARGE INTO HARDSTAND AREA CANAL

FOR INFORMATION

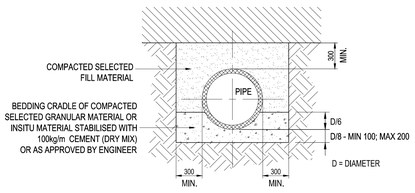

CLASS "C" BEDDING
1:25

D.O.	REV	DATE	** REVISION **	REV BY	CHKD BY	AUTH BY	KKS APP		REFERENCE DRAWINGS
.	.	.	.	.	.	.	.	.	.
.	.	.	.	.	.	.	.	.	.
.	.	.	.	.	.	.	.	.	.
00	0	11.01.22	ISSUED FOR INFORMATION	JW	PS	AVDM	.	B700-C-AD1EW-01	POLLUTION CONTROL DAMS ASH DAM 1 - ENABLING WORKS - TEMPORARY PIPE WORKS

INDEX REFERENCE : .

DRG REGISTR	.	.	AUTHORISED FOR ESKOM BY: .
DSGN APPRV(D	.	.	DATE: .
KKS APP	.	.	-
D.O. AUTH	.	.	-
CHKD BY	PS	11.01.22	
DRAWN BY	JW	11.01.22	
SCALE	1:1 000		

BEAL
BEAL AFRICA (PTY) LTD
PRETORIA OFFICE
Tygervalley office park
Building 1B, ground floor
Silverlakes st
Hazeldean
Pretoria
http://www.beal.co.za

Eskom

B700-C-AD1EW-02
MAJUBA POWER STATION
EXTENSION OF ASH DISPOSAL FACILITY
POLLUTION CONTROL DAMS
ASH DAM 1 - ENABLING WORKS - PERMANENT PIPE WORKS

B700- C -AD1EW-02

SPF CODE	SHEET	REV
.	1	0

SIZE GROOTTE A0L