



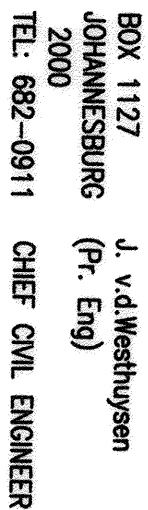
1. ALL STEEL SECTIONS SHALL BE GRADE 300MA STEEL AND SHALL COMPLY WITH THE REQUIREMENTS OF THE CANADIAN STEEL INSTITUTE (CSTEEL).
2. ALL STEELWORK TO BE OF WELDED CONSTRUCTION.
3. ALL WELDING TO BE METAL ARC WELDING EXECUTED BY QUALIFIED WELDERS IN ACCORDANCE WITH SABC CODE 1793/1/4.
4. ALL CONNECTIONS OF LAPPED CHANNEL TO BE WELDED.
5. SHOP DETAIL DRAWINGS OF ALL STEELWORK TO BE SUBMITTED TO RAIND WATER ENGINEERING PRIOR TO FABRICATION.
6. ALL STEELWORK SHALL BE GALVANNEAL.
7. PAINTING SPEC: -BARRICADE BLAST CLEAN TO SA-2 1/2.
8. ALL STEELWORK -APPLY WITHIN 4 HOURS OF CLEANING
9. ONE COAT OF CHEMISTONE COAT OVER OIL AND COATING
10. ONE COAT OF CHEMISTONE COAT OVER CHEMISTONE COAT
11. TO A DFT OF 75-100 MICRONS
12. THE STEELWORK SHALL HAVE TWO COATS OF ALPHATIC
13. PAINT TO A DFT OF 30-50 MICRONS PER COAT
14. PAINTING COLOUR: SANDSTONE BEDE C98 SCS CODE A.044



- ## NOTES

REVISIONS:

REFERENCE DRAWING

DATE: 16/11/2009

WORKS AREA

**WASHBAY, CHANGE ROOMS
& CARPORTS (X3 DOUBLES)**
SECTION A-A & B-B & WASHBAY ELEVATIONS

002 / 0