


M3

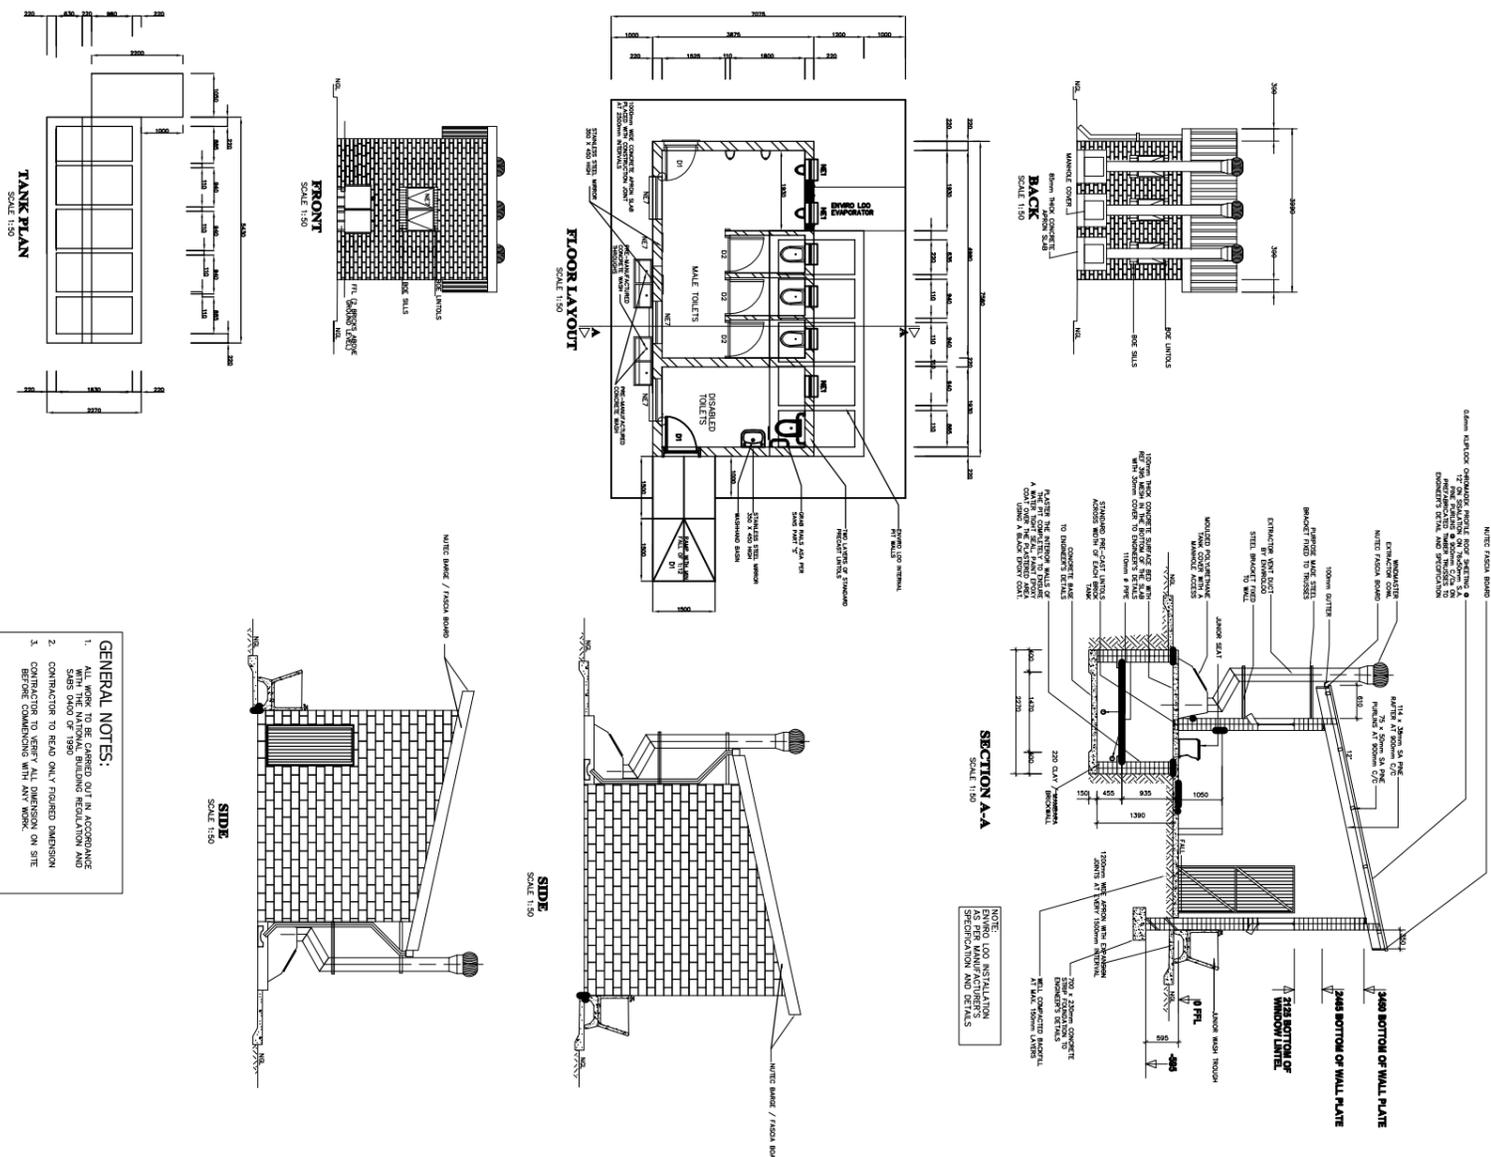

GENERAL NOTES:

1. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH THE NATIONAL BUILDING REGULATION AND STANDARDS.
2. CONTRACTOR TO READ ONLY FINISHED DIMENSION BEFORE COMMENCING WITH ANY WORK.
3. CONTRACTOR TO READ ONLY FINISHED DIMENSION BEFORE COMMENCING WITH ANY WORK.

WINDOW NO.	NO.	DESCRIPTION
1	1	2.0m x 1.5m WINDOW
2	2	2.0m x 1.5m WINDOW

WINDOW NO.	NO.	DESCRIPTION
1	1	2.0m x 1.5m WINDOW
2	2	2.0m x 1.5m WINDOW

NOTES AND SPECIFICATIONS:

GENERAL

1. Use dimensions provided and do not scale drawing.
2. All work to comply with SANS, PW371 and SABS.
3. All dimensions, levels and positions to be verified on site prior to construction.
4. All concrete work to be as per Engineer's details and specifications.
5. All pits to face North.

PIT EXCAVATION

1. All stoges of pit excavation to be inspected and approved by Engineer and signed off.
2. All pit lining to be inspected by Enviroloo Services before slab casting.

COMPACTION OF SURFACES

All ground surfaces receiving concrete floors / slab should be compacted to 150mm layers 93% ModASH10 density before casting concrete.

CONCRETE WORKS

1. All concrete to be as per Engineer's details and specifications.
2. 25 MPa strength concrete to be used throughout construction.

TRIAL Concrete Mixes: Proportions

Concrete Strength at 28 Days 25MPa:

- 1 : 2 : 2 (mix proportion by volume)
- 1 bag cement : 0,08m³ Sand : 0,09m³ Stone (Volume/Bog)
- 385 kg cement : 820 kg sand : 960 kg stone (Mass/m³)

Pre-cast concrete lintels to be used as support under top slab of pit.

4. All concrete aprons to be 1000mm wide.

MORTAR

Mixed proportions to be:

1. cement : 3 sand (i.e.1 bag cement : 3 wheelbarrows (37 litres) sand)

BRICKWORK

Sub-structure

1. All pit lining / foundation brickwork to be solid NFP clay brick.
2. All internal surface of pit lining to be pointed with two coats block epoxy paint installing Enviro-Loo units.

Super-structure

1. All external walls / partitions to be of clay face brick to SABS quality.
2. All cubicle partition walls to be 3 courses above door height.
3. All brickwork above door openings should have brickforce on every course at least 3 courses.
4. Air bricks: Standard 230X152mm terra-cotta vermin proofed louvered air grating to be used all window openings.

ROOF SHEETING

1. 0,6mm kiplock chromadek roof sheeting.

ROOF TIMBER / CEILING

1. All roof timbers to be machined SABS treated wood with three coats of approved wood preservative.
2. Timber connections (Hurricane Clips) are required all interconnections between timber rafters and purlins.
3. Sisalation is to be applied interval under all roof surfaces.

METALWORK

1. All metalwork should be primed before installation.
2. All steel window should have 6x20mm flat bar burglar proofing.

PLUMBING

1. Double concrete wash trough to be used.
2. All wash troughs should be connected to the school's water supply system and the waste water should be piped to a soakaway.
3. The soakaway should be as per Engineer's detail and position to be determined on site.
4. Only 20mm and galvanised pipework should be used as connection from wall to the discharge points.

GLAZING

1. 6,28mm obscure safety glass

PAINTING

1. All paintwork to comply with SABS and PW371 specification.
2. All steel window and door frames including doors and fascia / borge boards to be discharge points.

NO	DATE	REVISION	DRAWN

ARCHITECT

CONSULTANTS

IMPLEMENTED BY

MAPOXE Consulting Engineers

MAPOXE CONSULTING ENGINEERS
PO BOX 100
POLYMANNE
TEL: 015 291 2905 FAX: 015 291 2906

THE MVELA TRUST
A leading developmental NGO

THE MVELA TRUST
POLYMANNE BANE STREET
GEB 015 291 2405 FAX: 015 291 1270

SPONSOR

LIMPOPO
PROVINCIAL GOVERNMENT
REPUBLIC OF SOUTH AFRICA

DEPARTMENT OF
EDUCATION

PROJECT
TSHENDELLA PRIMARY SCHOOL

PROVINCE: LIMPOPO

DRAWING TITLE
GRADE R 3 SEATS, 1 DISABLED, 4 URINAL ENVIROLOO M3 - BOYS

DRAWING NO.	STATUS	REVISION

DRAWING NO.	DATE	BY	STATUS	REVISION