


STABILITY CURVE

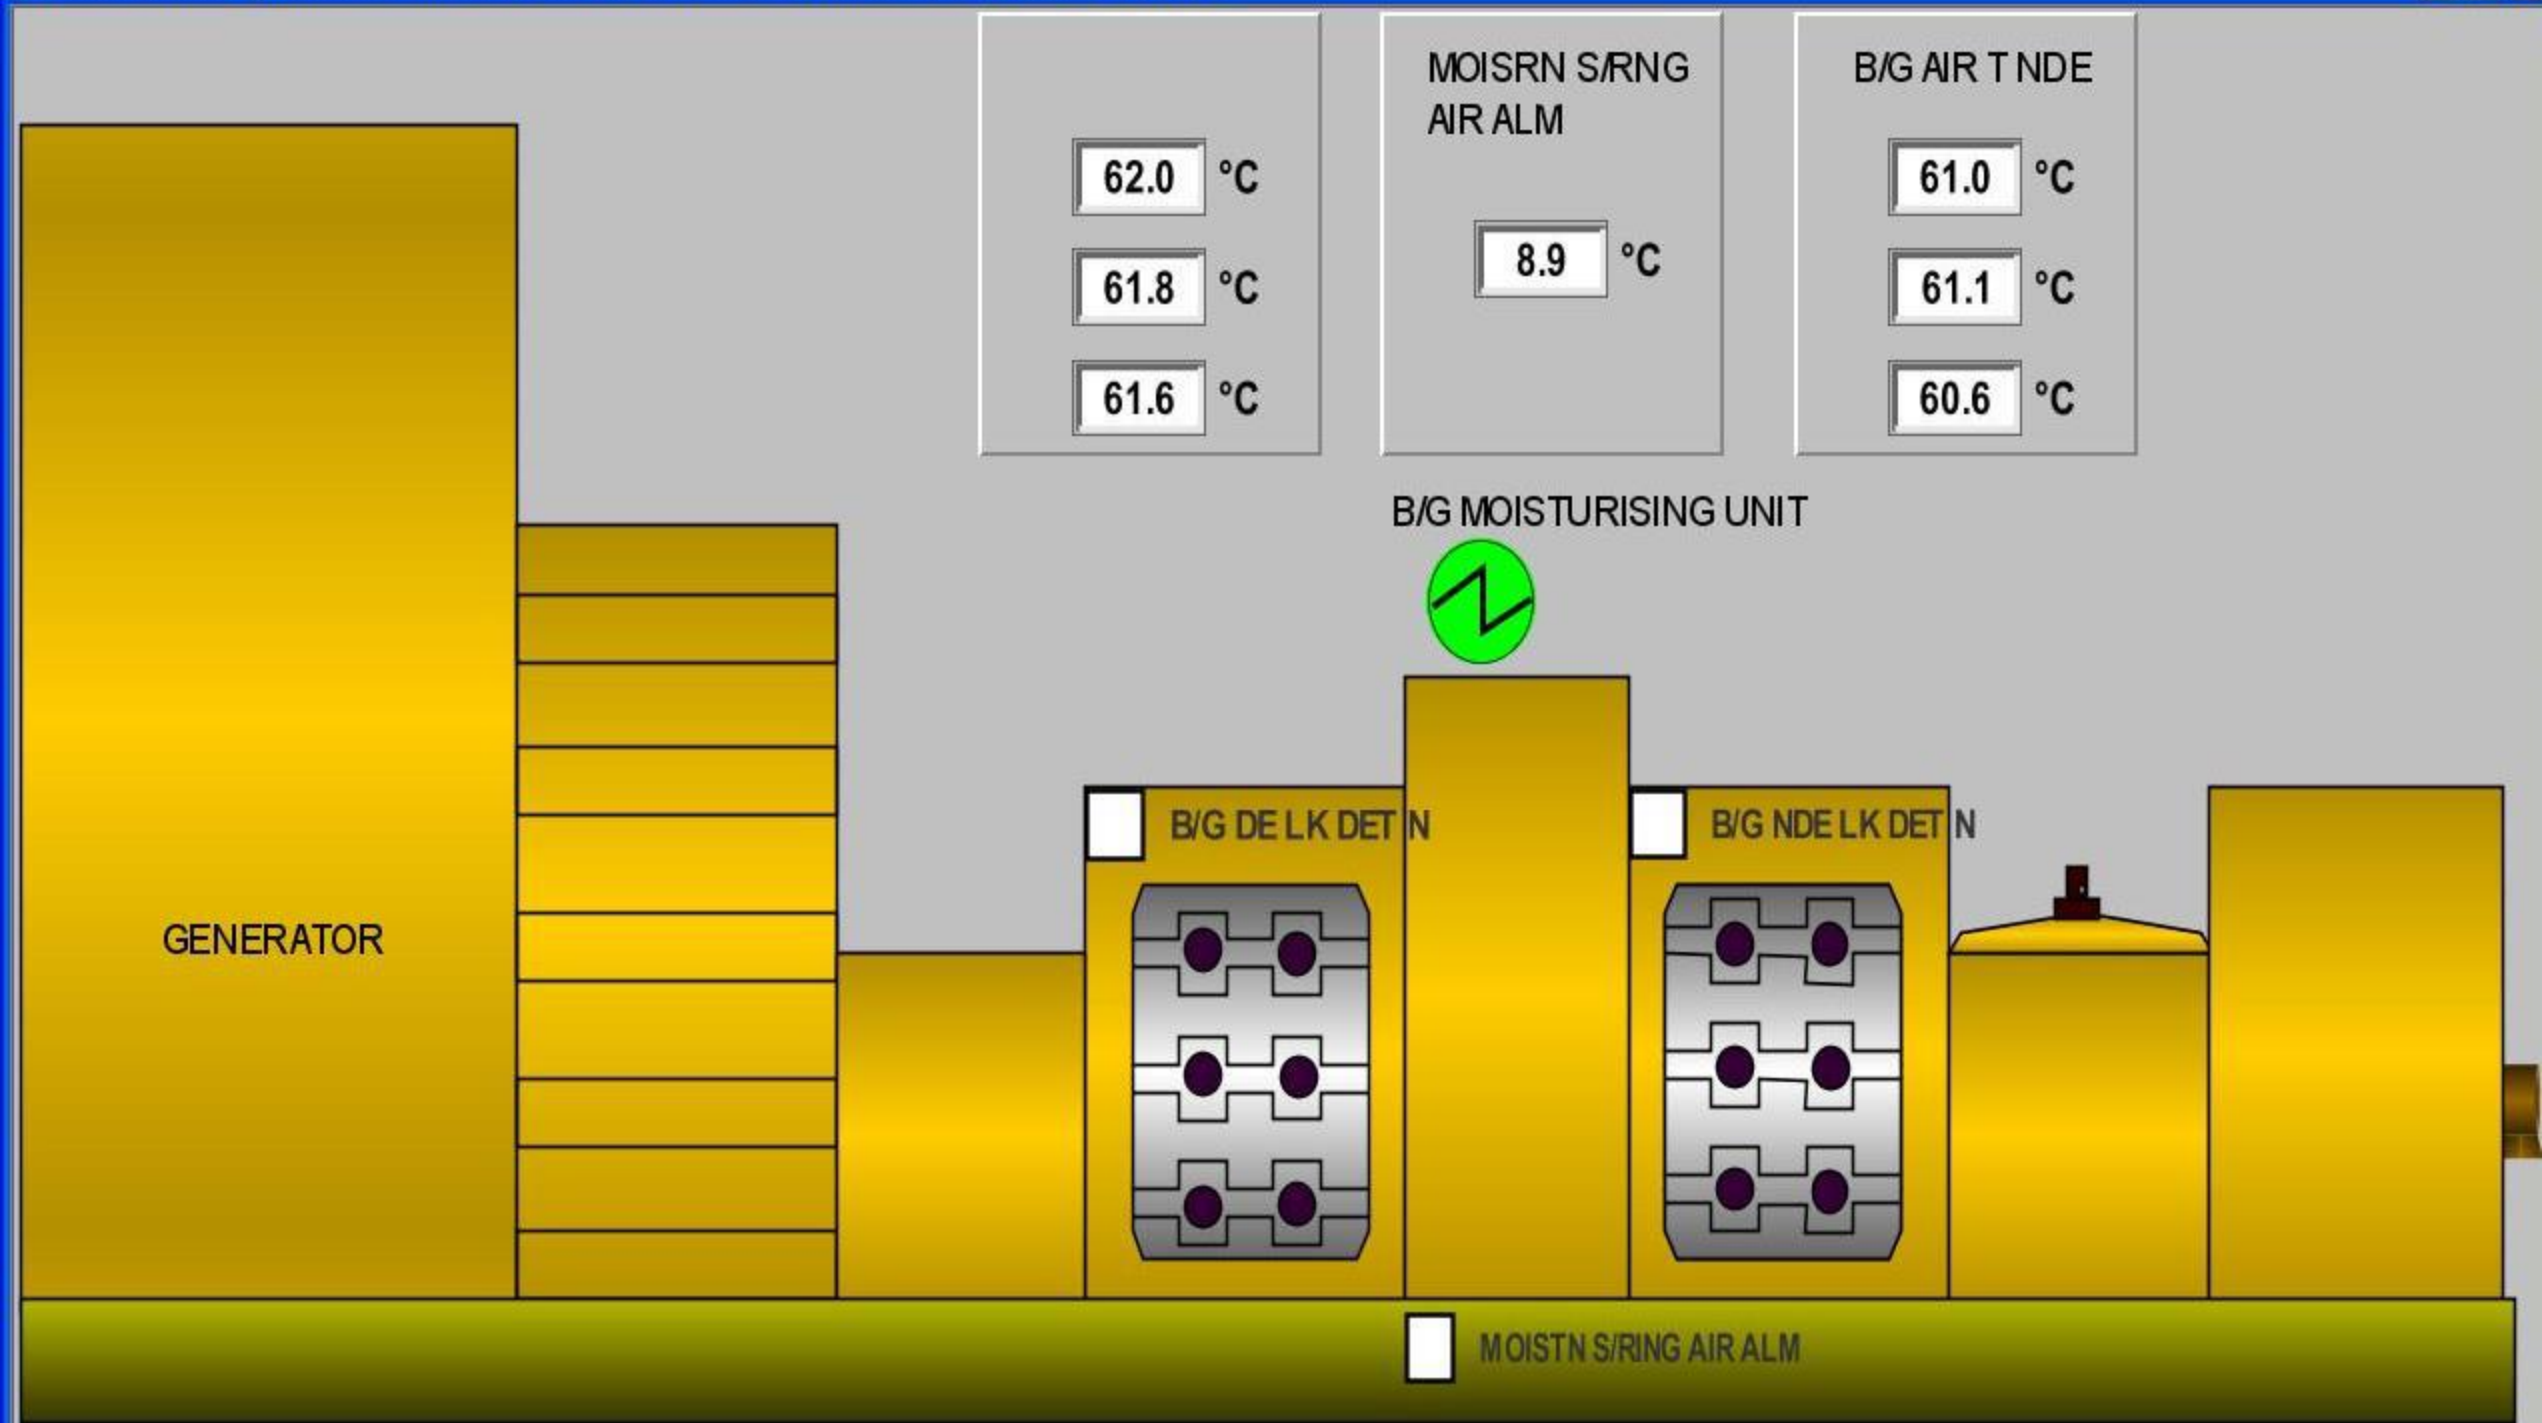

62.0 °C

61.8 °C

61.6 °C

MOISRN S/RNG
AIR ALM

8.9 °C

B/G AIR T NDE

61.0 °C

61.1 °C

60.6 °C

B/G MOISTURISING UNIT

B/G AIR DIFF PRESS DE

1.8 mBAR

B/G AIR DIFF PRESS NDE


1.4 mBAR

SEAL OIL, GASSY OIL AND DEGASSY OIL SYSTEMS



SEAL OIL PUMP A OR B SELECTION




SEAL OIL SGC





DC SEAL OIL SLC

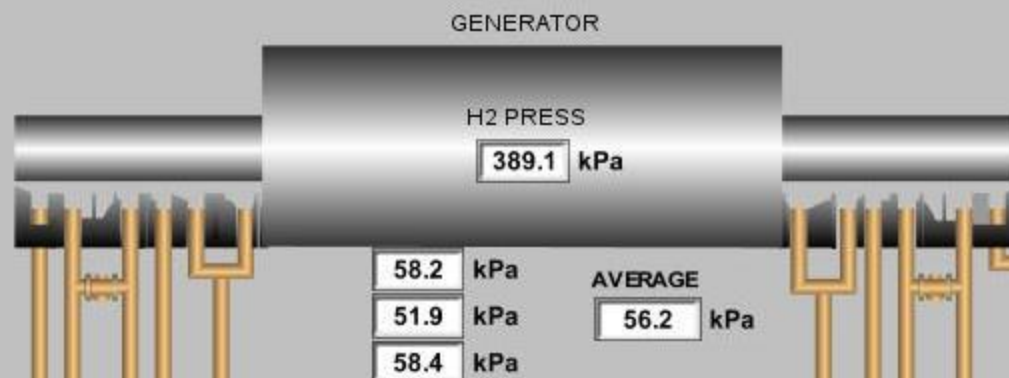


Gassy Seal Oil lvl High
☐ OK


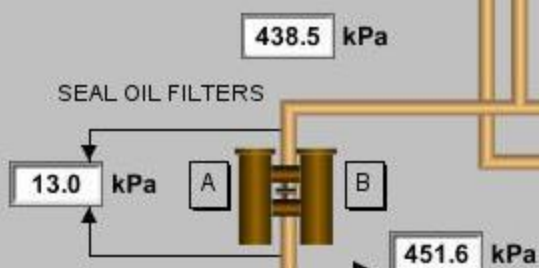



SEAL OIL PUMPS

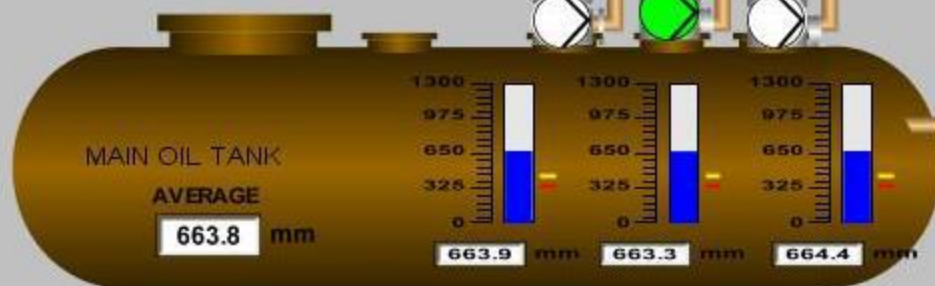



TO ATMOSPHERE

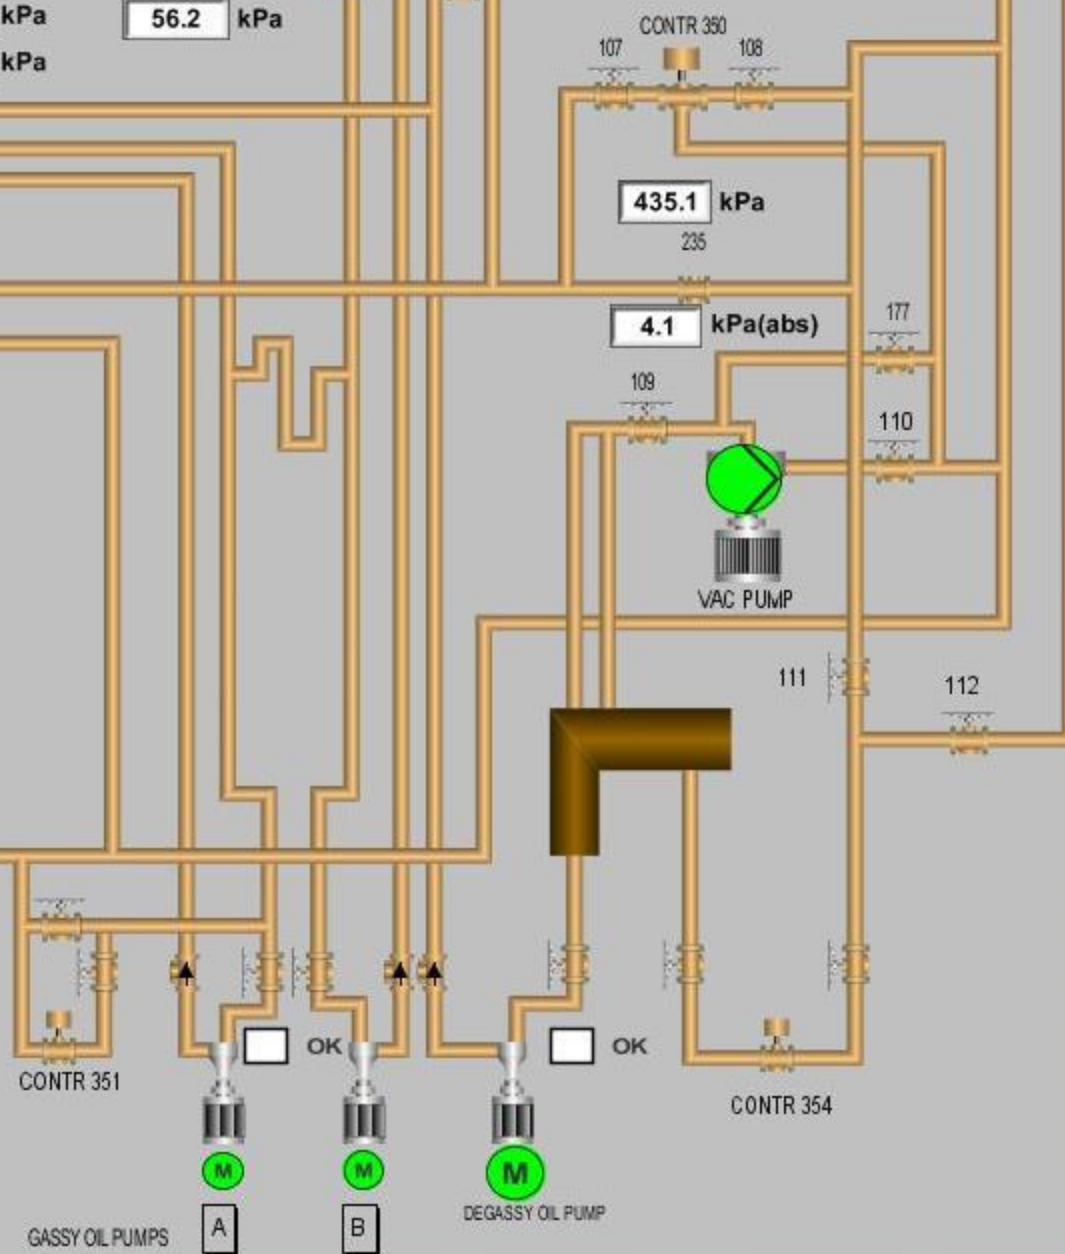

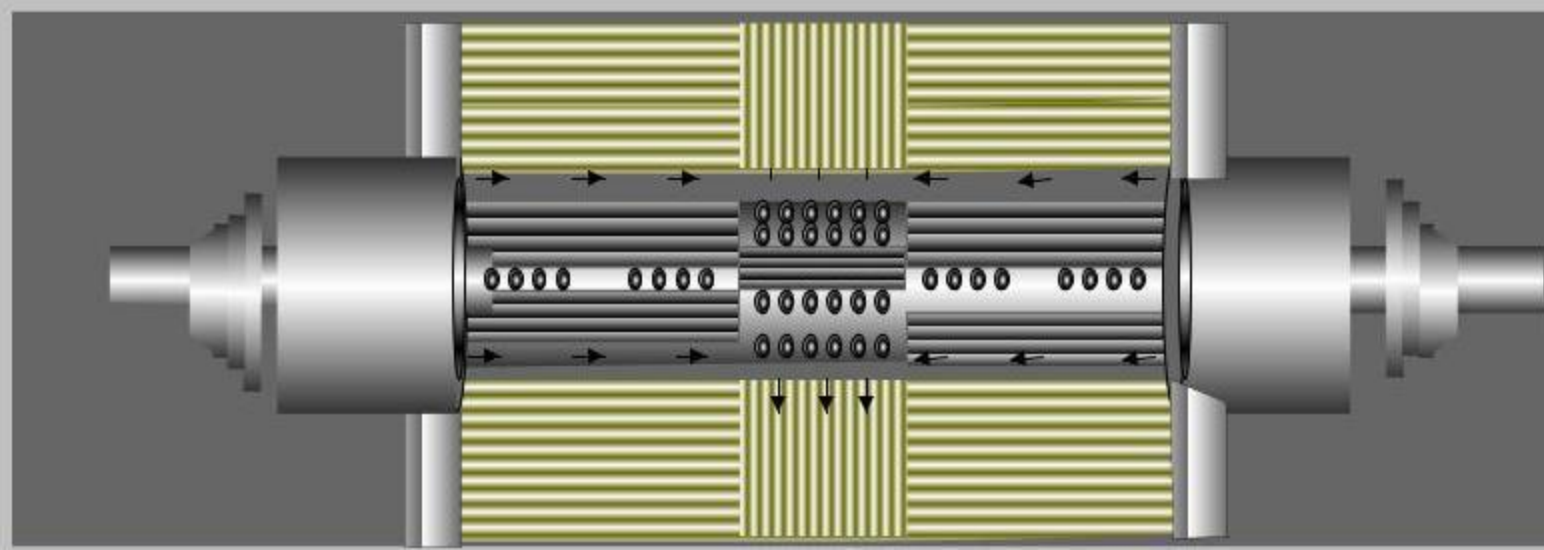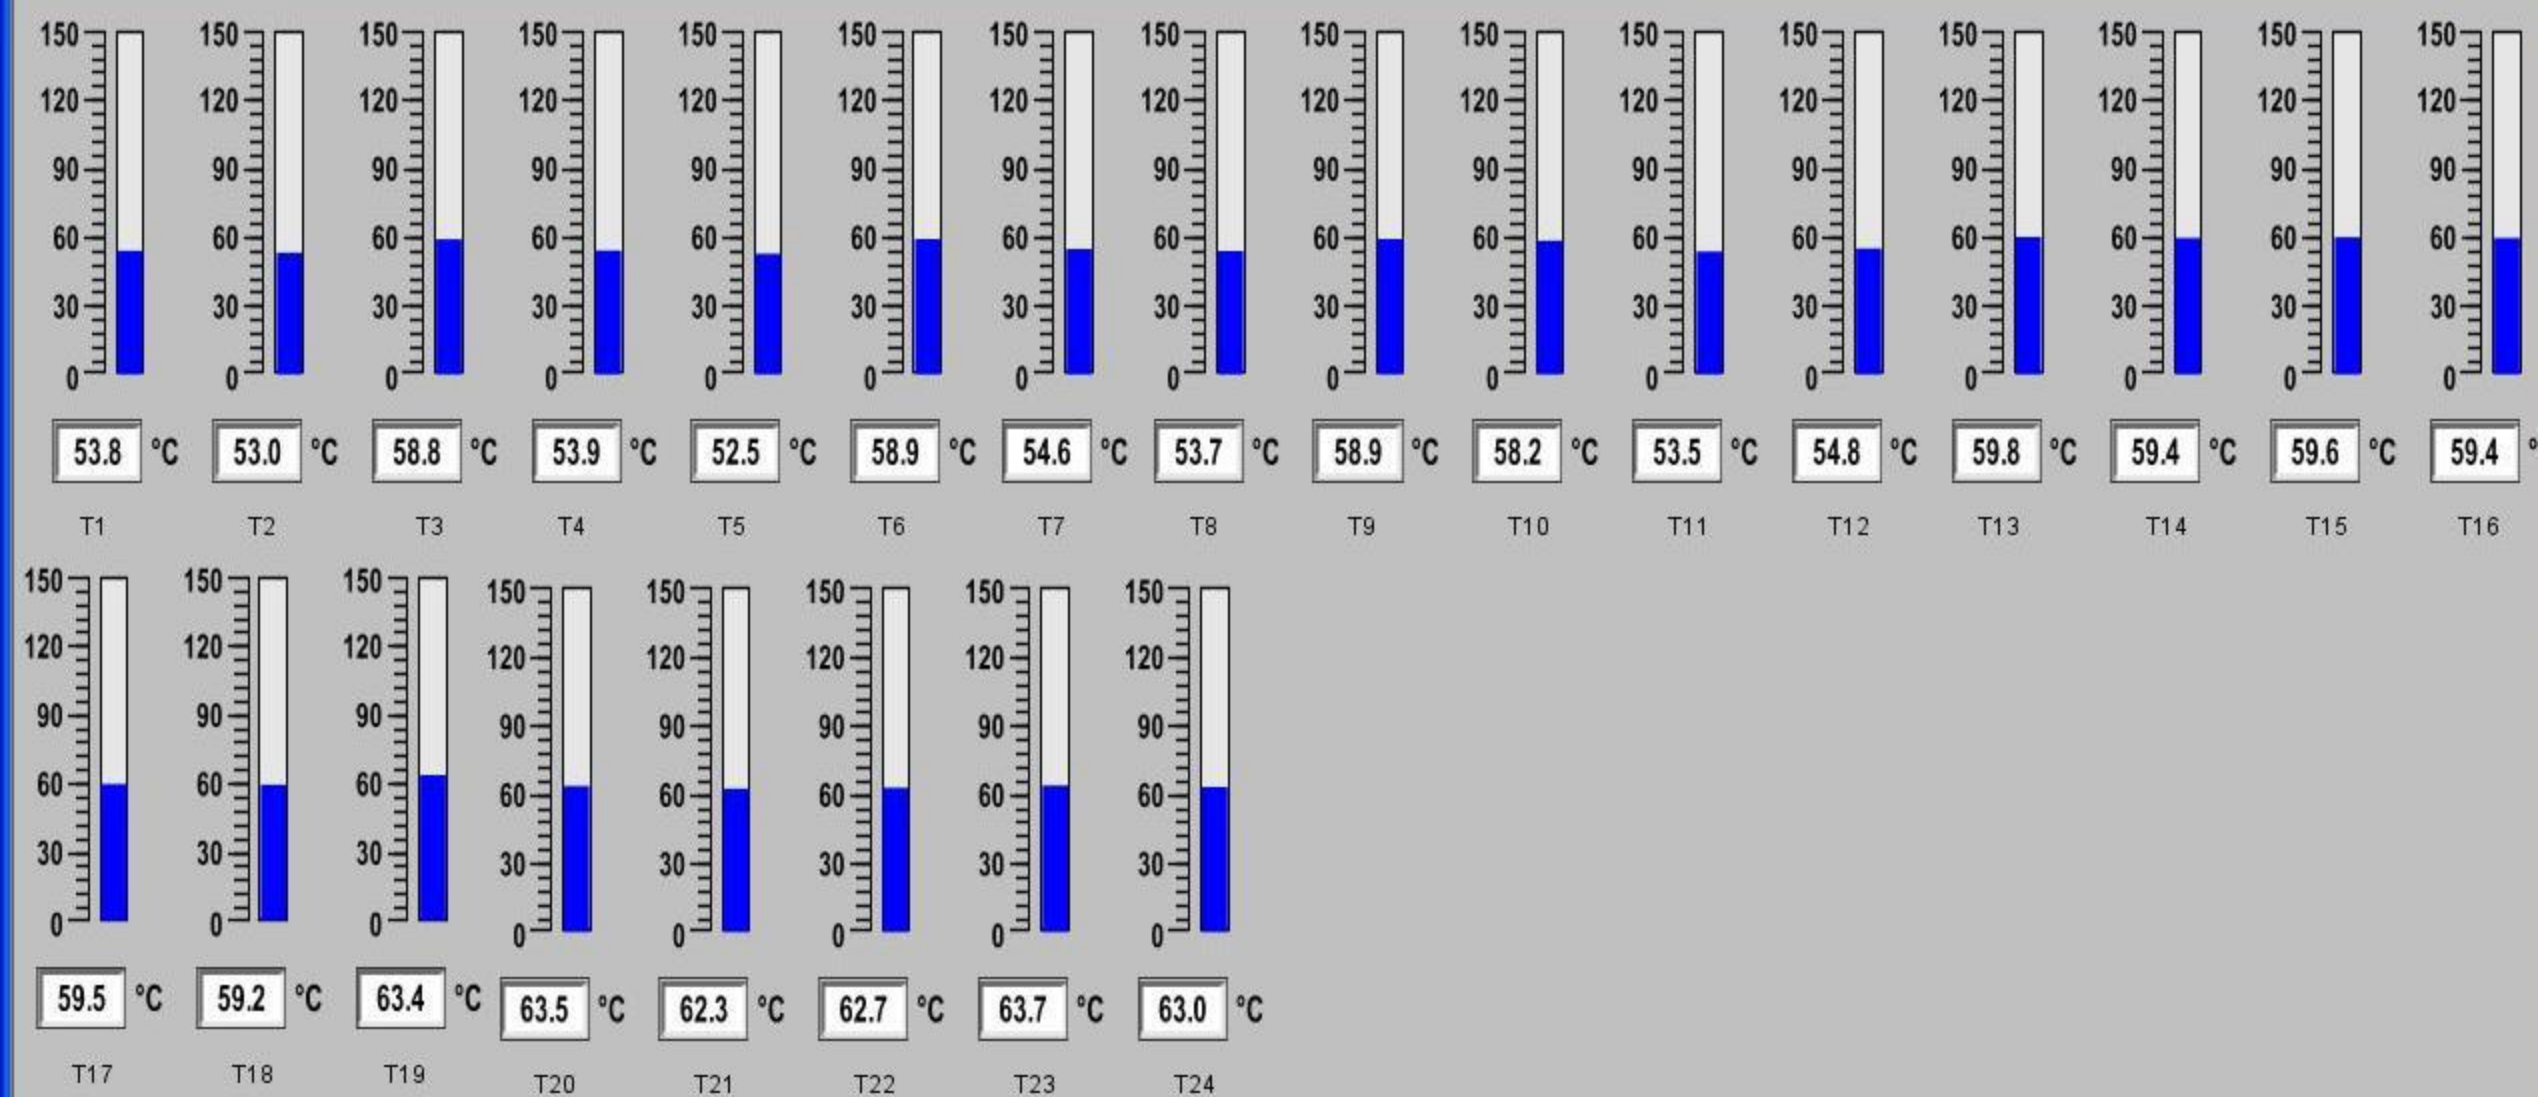

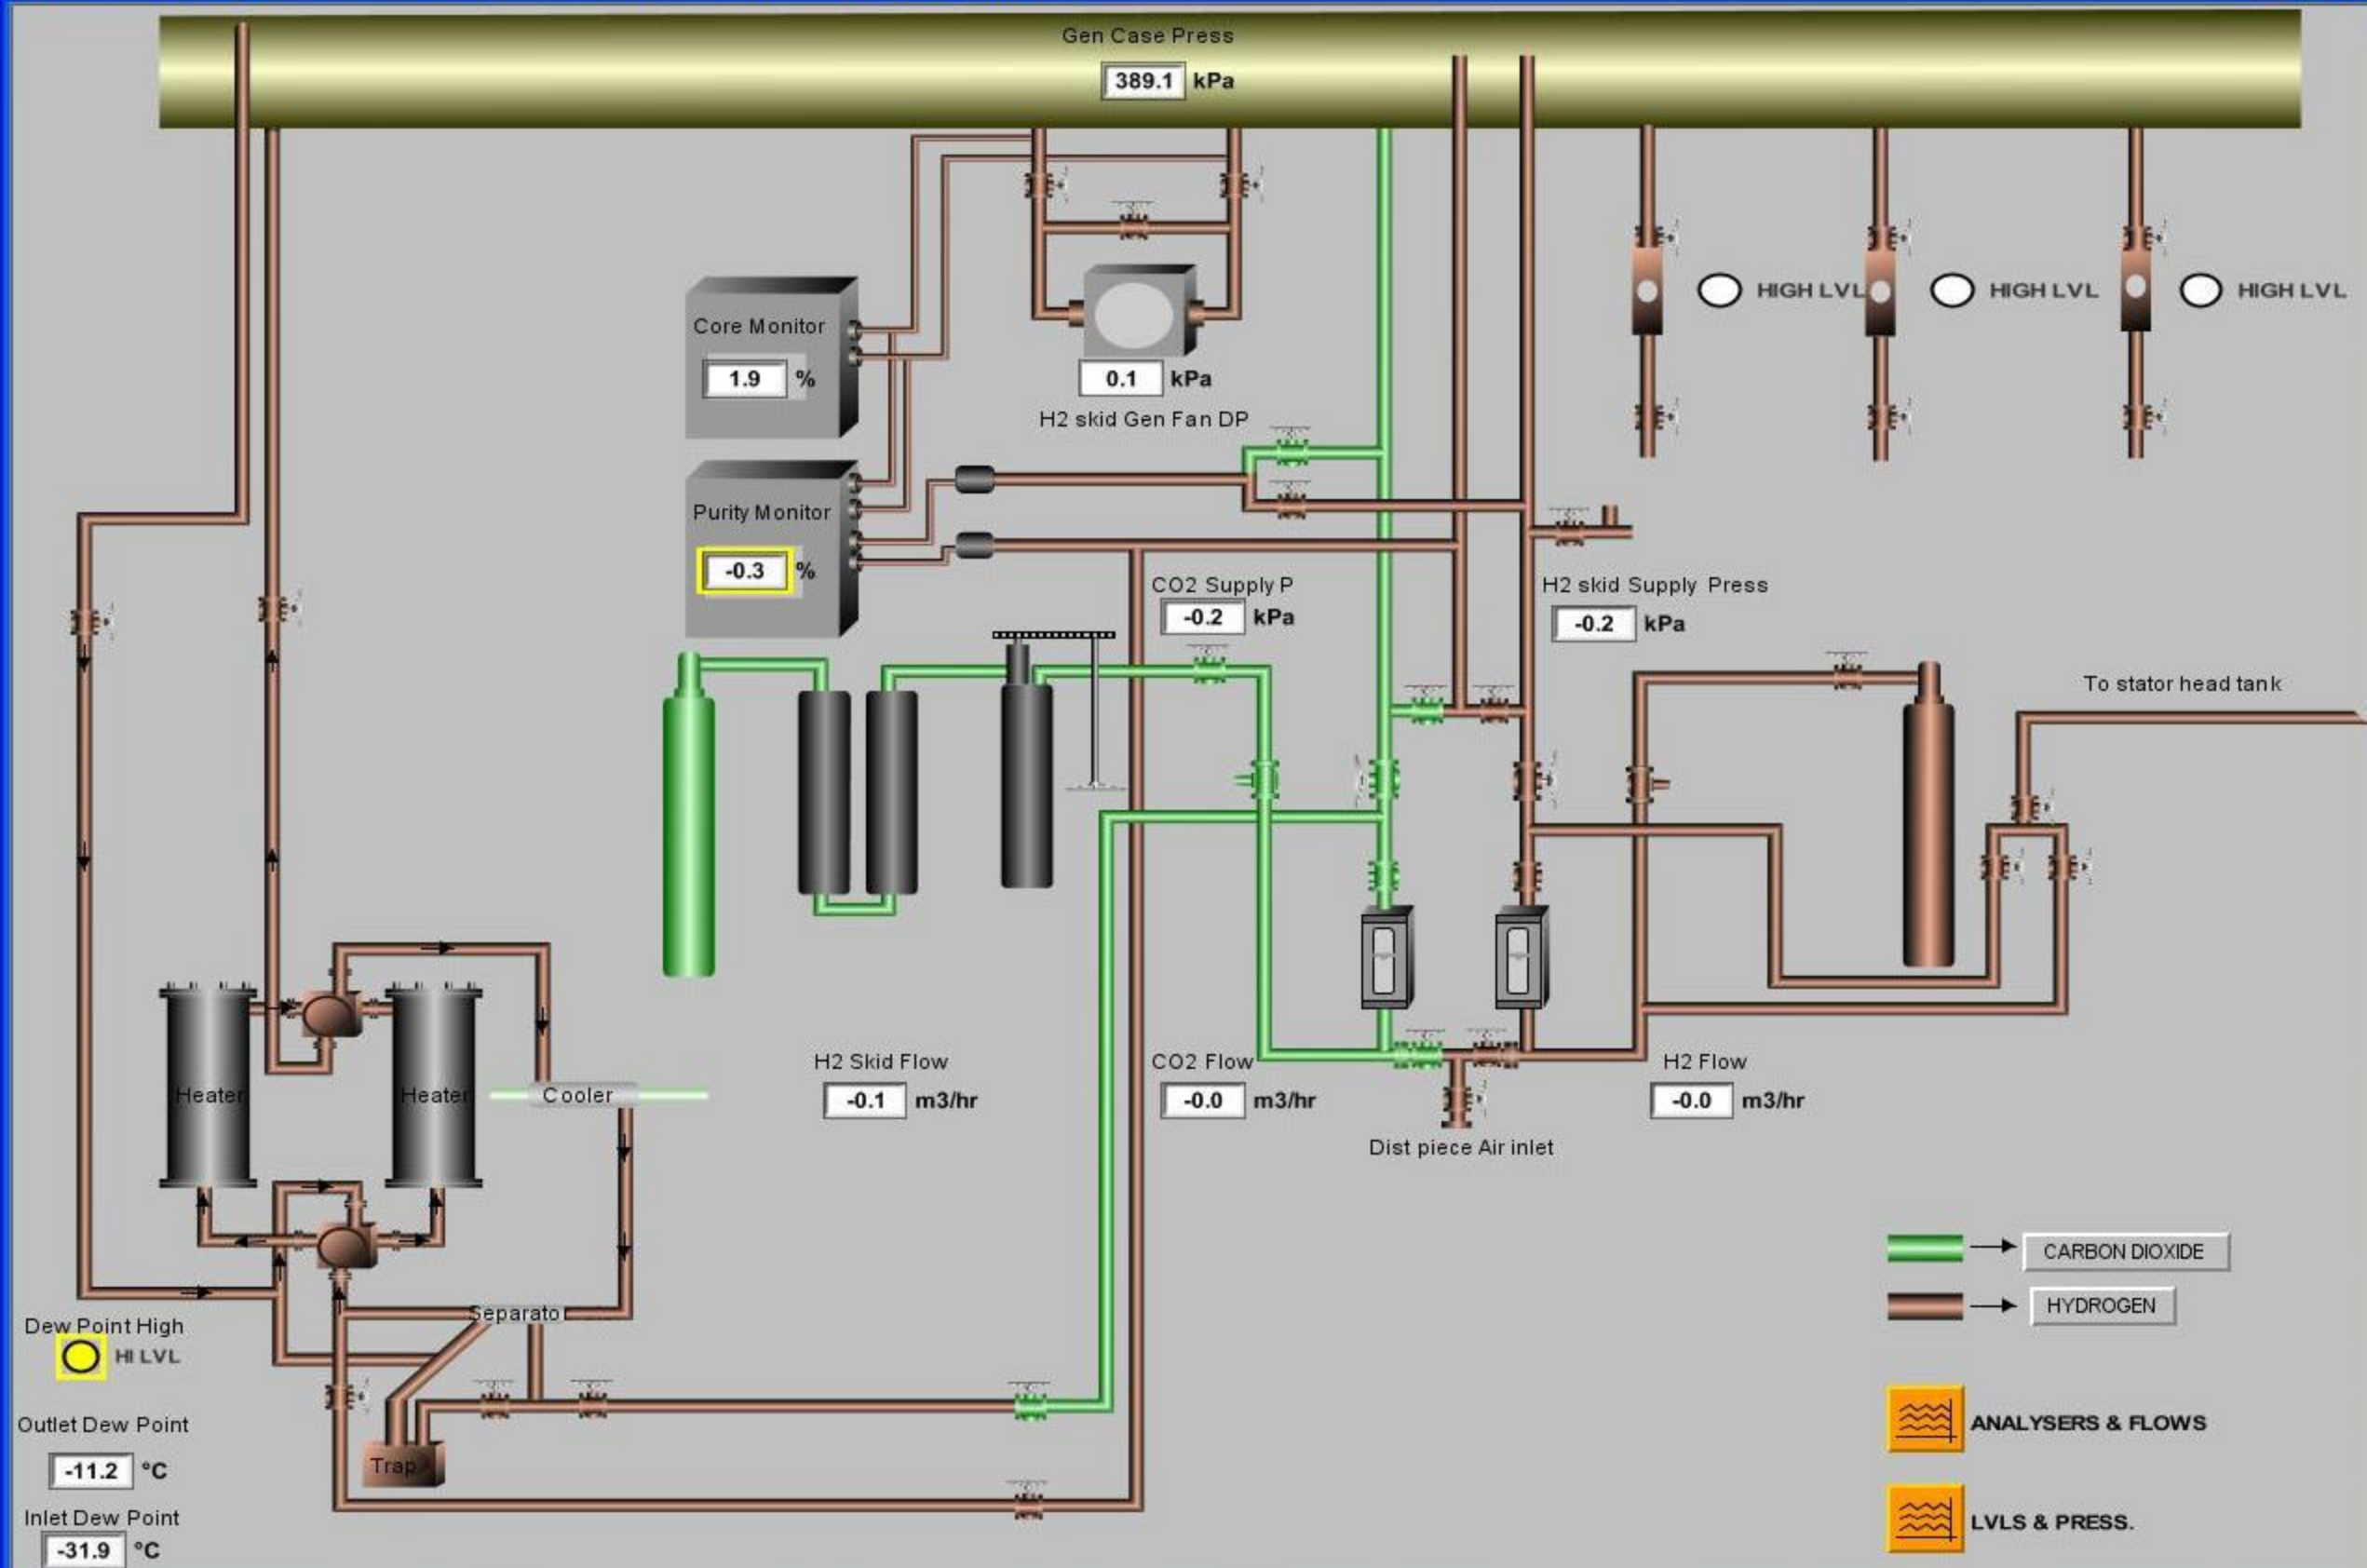

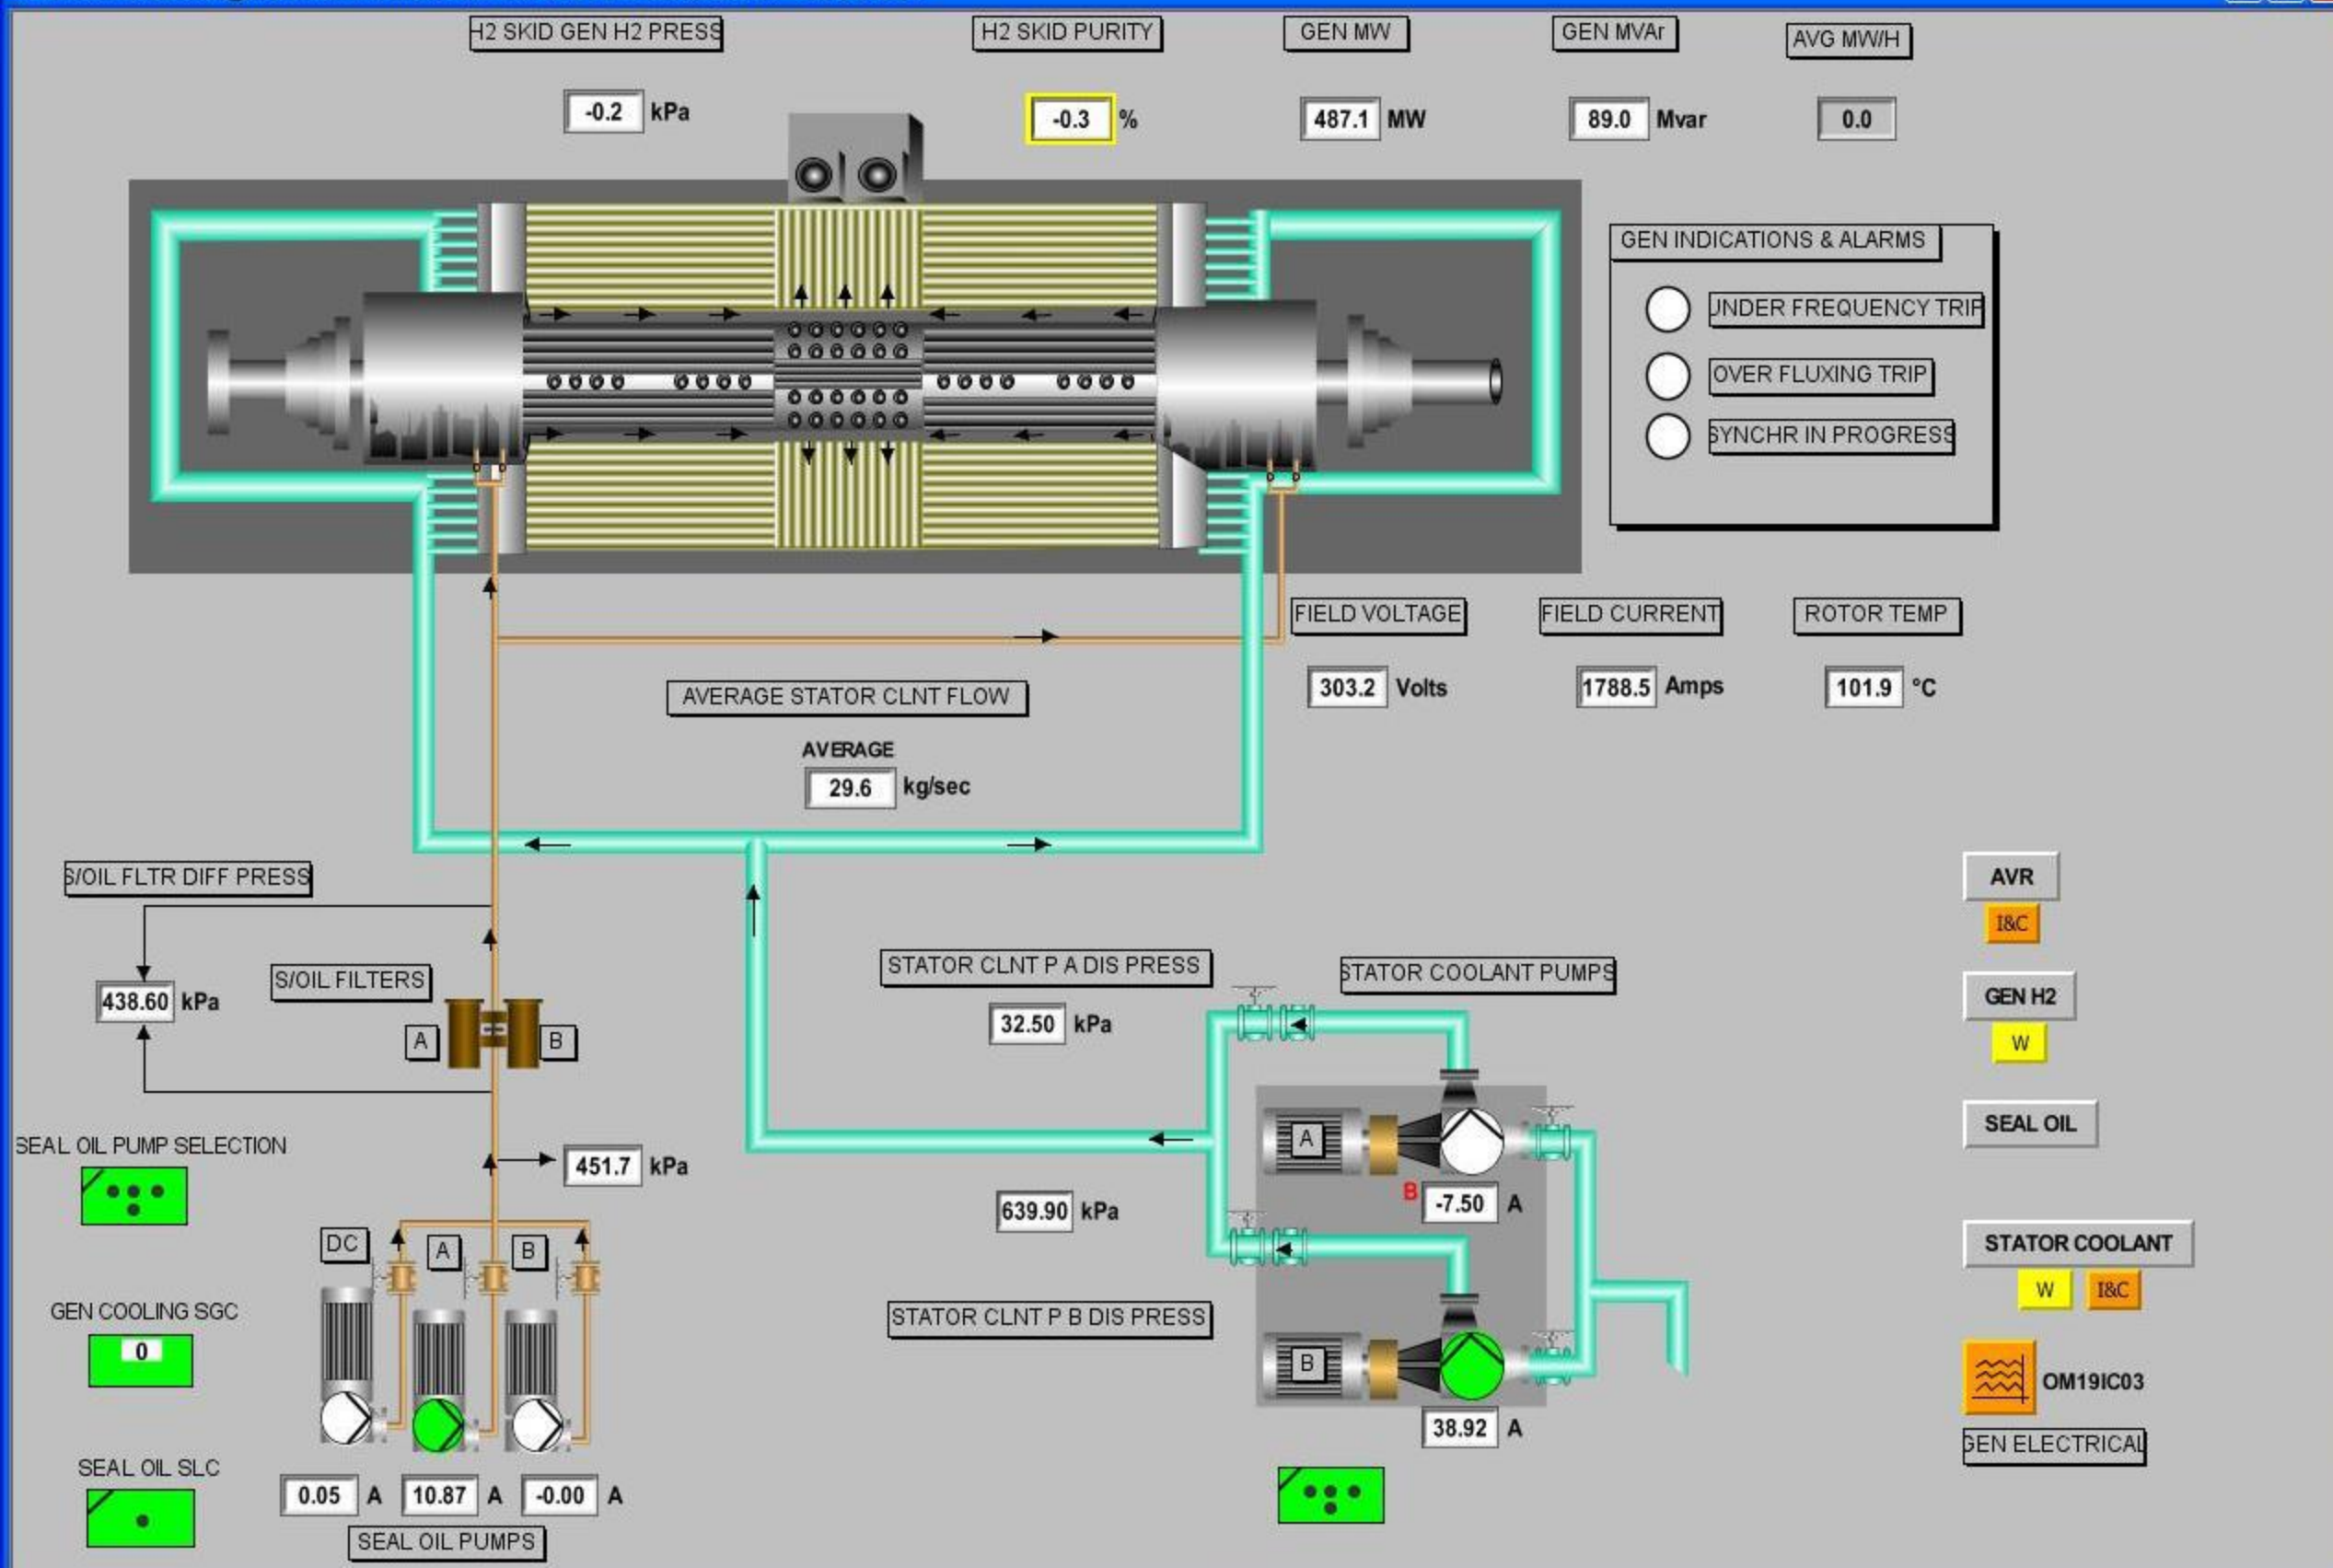

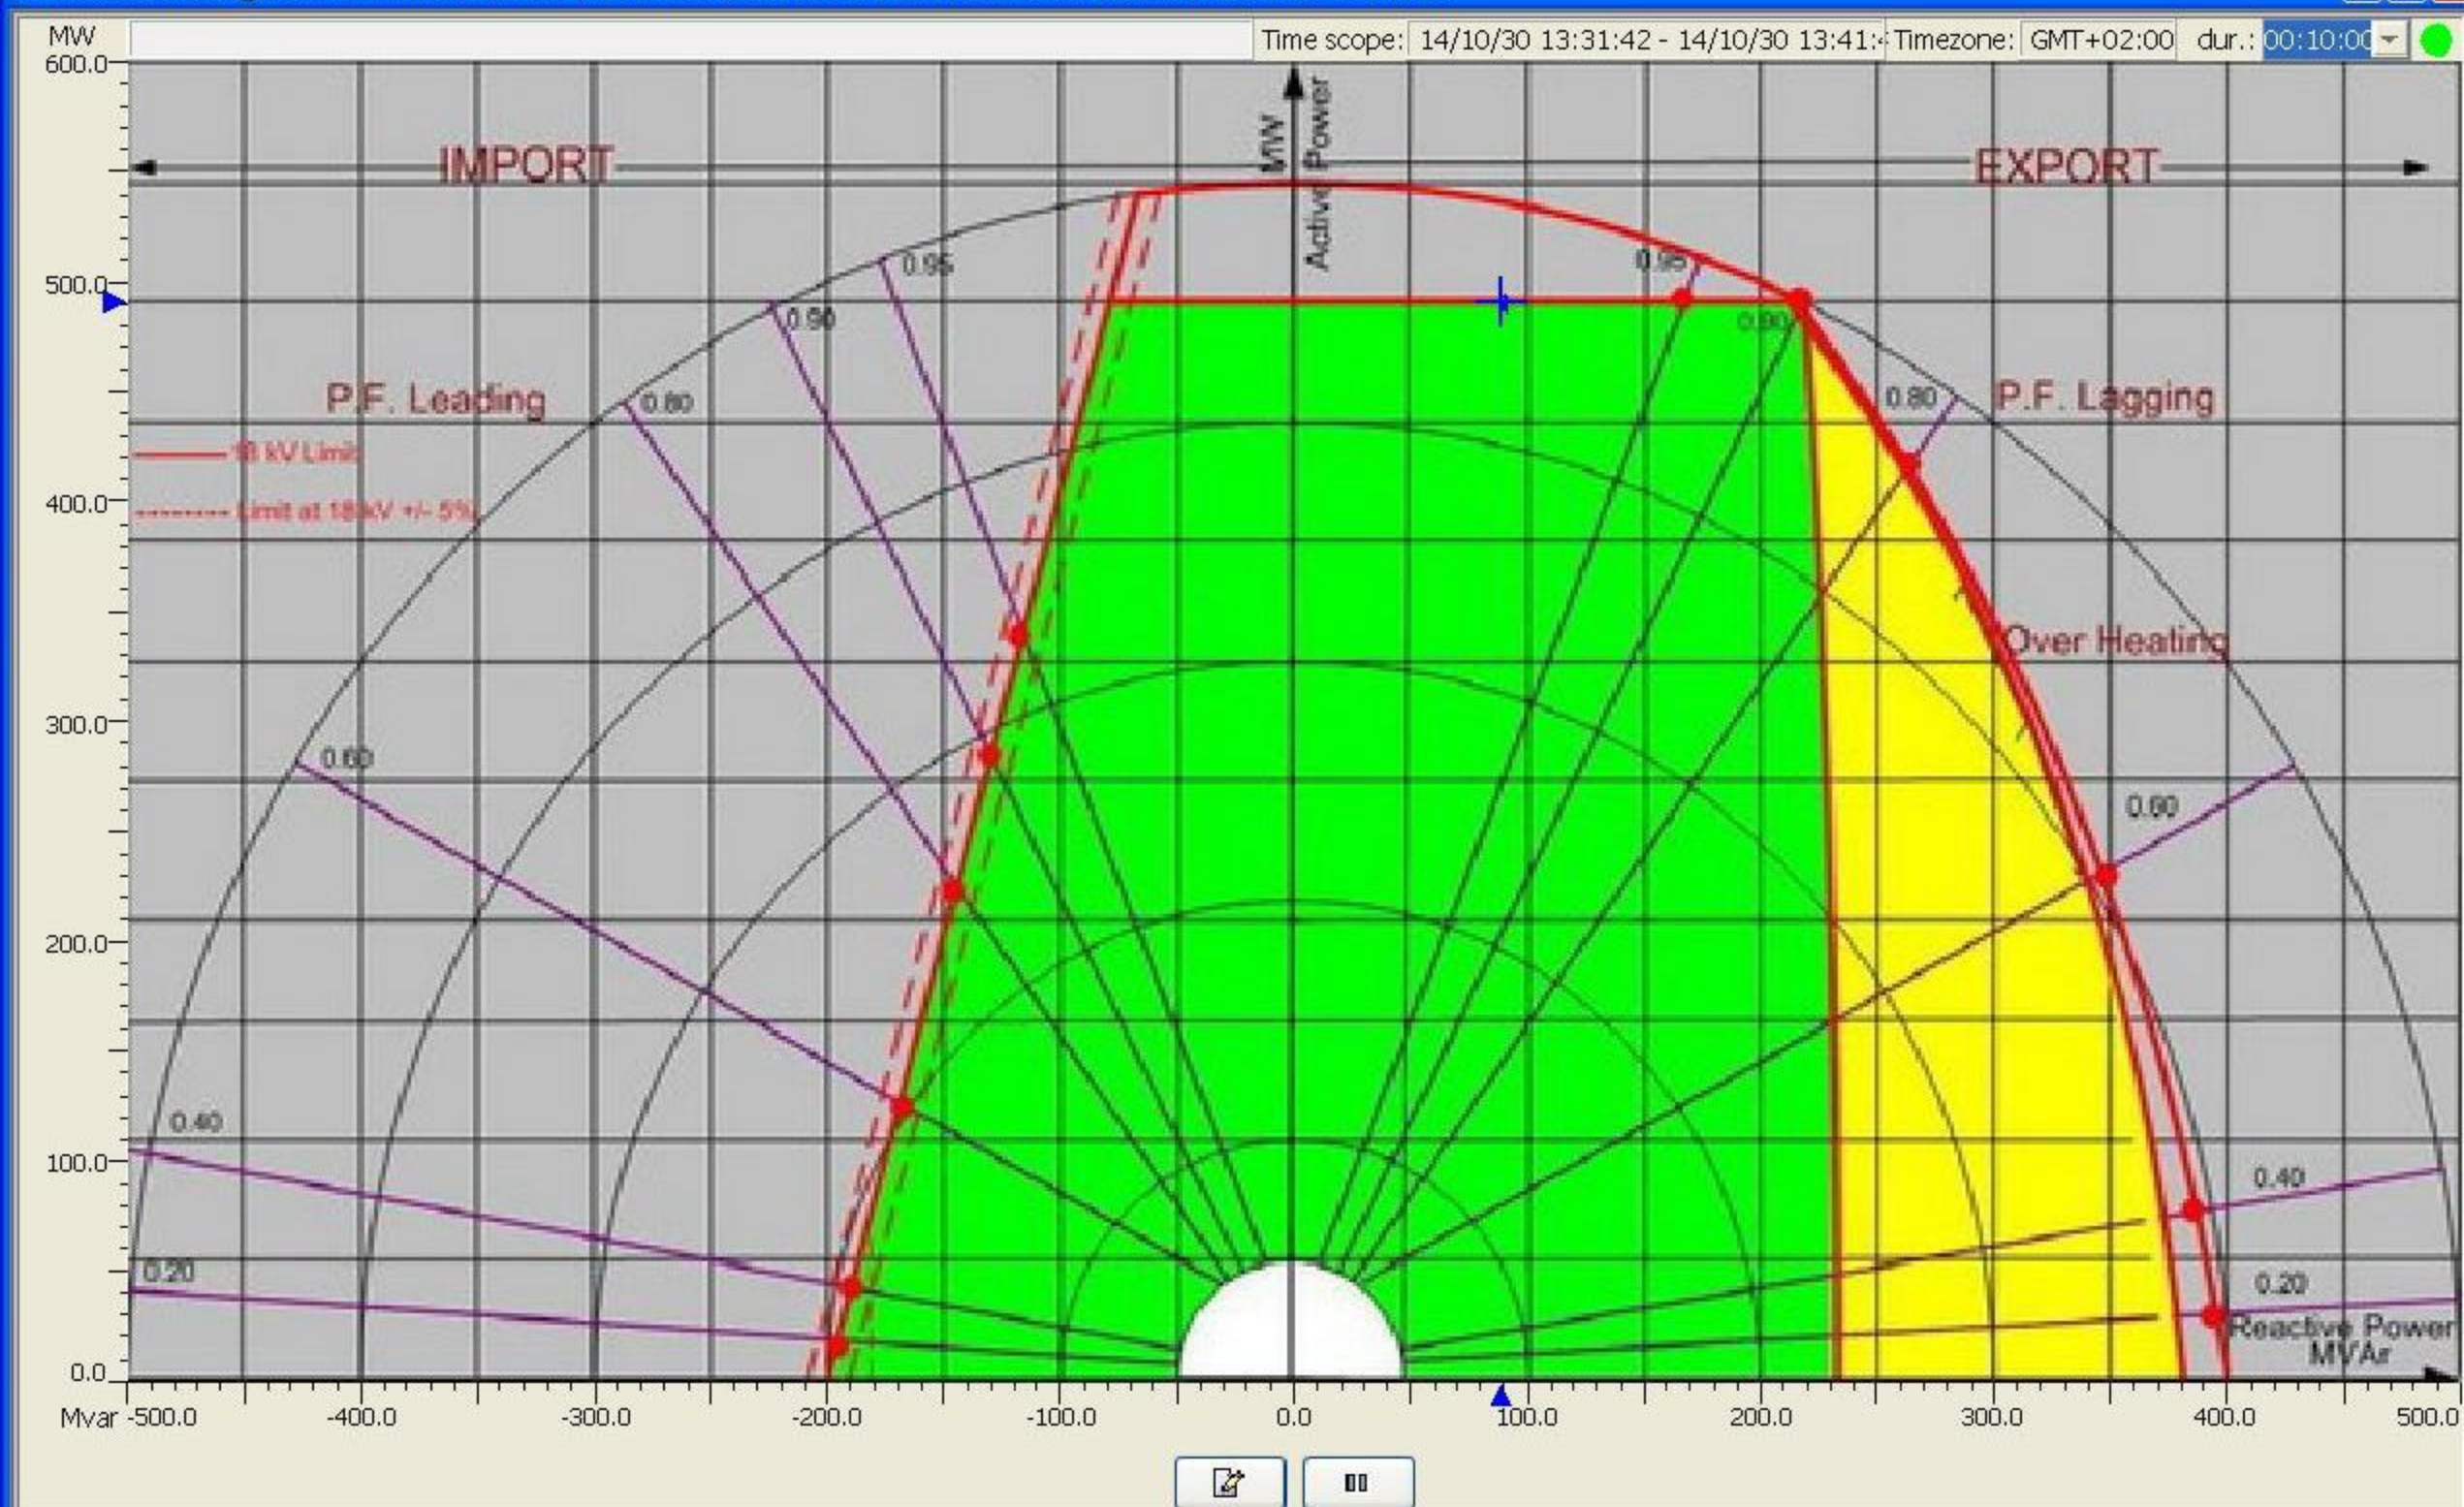

	SIGNAL TAG	DESIGNATION	RANGE LOW	RANGE HI	UNIT	LAST
	03HM01KA03_02B XQ01 OUT	GENERATOR MVAR	-500.0000	500.0000	Mvar	88.5600
	03HM01KA03_01B XQ01 OUT	GENERATOR MW	0.0000	600.0000	MW	490.8600