


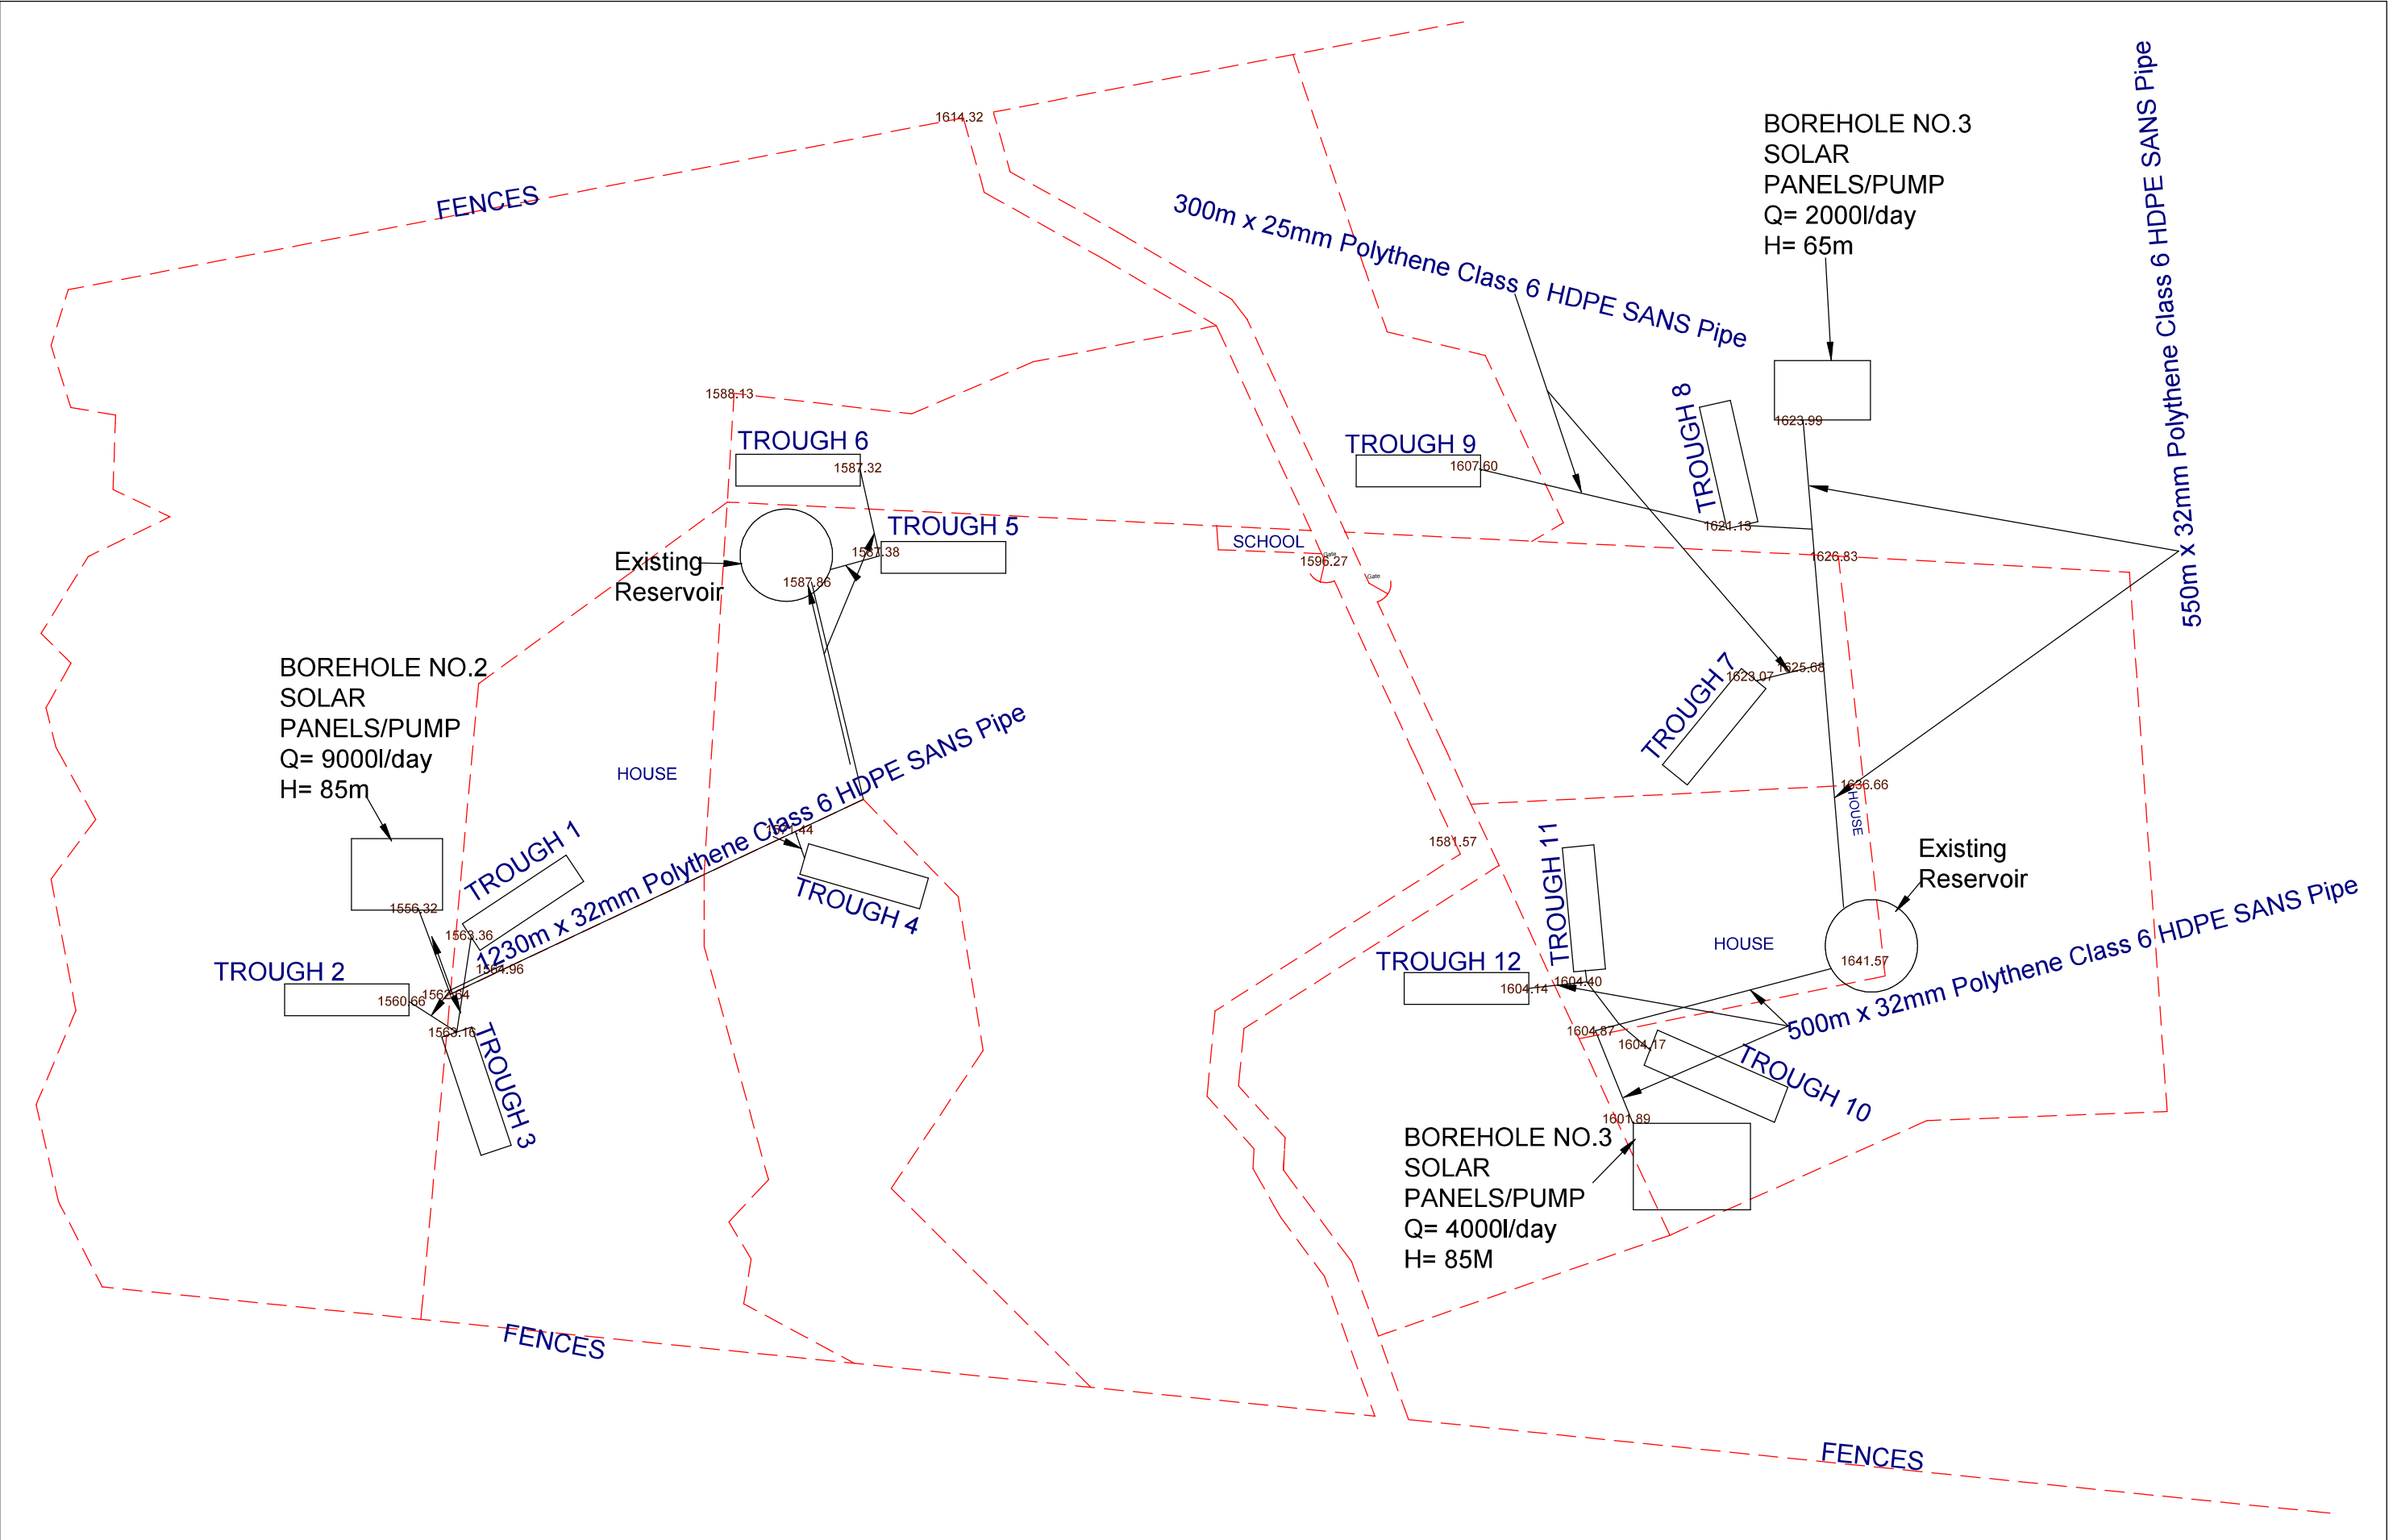

SPECIAL NOTES: -All pipesabove ground to be galvanized steel. -HDPE Pipes to carry an SABS Mark -Pipes to be buried 300mm below gound -Concrete for trough slab to be of 20 Mpa -Trough to be fabricated poly plastics	JUNE 2023	ENGINEERING SERVICES Private Bag X1006 ALIWAL NORTH 9750	RURAL DEVELOPMENT AND AGRARIAN REFORM PROVINCE OF THE EASTERN CAPE	STOCK WATER SYSTEMS	SCALE 1 : 6000	DRAWING 1 OF 2
				PELGRIMSRUS SITE LAYOUT		