



CWType A Crealco Facade 60 or eq. approved aluminium pressure glazed drained facade system, incl top hung casement insert window, per layout.
Casement sash 1500 x 1200mm max capacity
Fixing lugs suitable for fixing to plastered brickwork reveals. Mullions in xxxmm depth section, code W54454 with Lx 71.5
AAAMSA exposure category: A3. SANS1613 - 2000Pa wind load capacity
Class 2 powder coated to SANS 10322:2014. Coatings in accordance with SANS 1576 using powders in accordance with SANS 1578.
TBC. Provisionally Mat Black
to top hung casement inserts - 500mm Stays, 13mm stack, capacity 28Kg. Crealco code STF-TH600S-304 or equal app
Handles - Per manufacturers specification to suite operation indicated.
Glazing throughout to be 6.38mm thick normal strength PVB laminated Low E safety glass
Req. 0.57 per PG Glass E-Range Solarvue Neutral SHG (or equal approved)
Req. 5.8 W/m² K (system) Glazing - 3.7 W/m² K
Curtains: Polycotton Twil 80/20 curtain drapes, code HT/BS1900W. Drop 1815mm length on HSR4001 Hospi-alu single racer track, per Hospitrack.

QUANTITY:	Incl Curtains
1	CB1

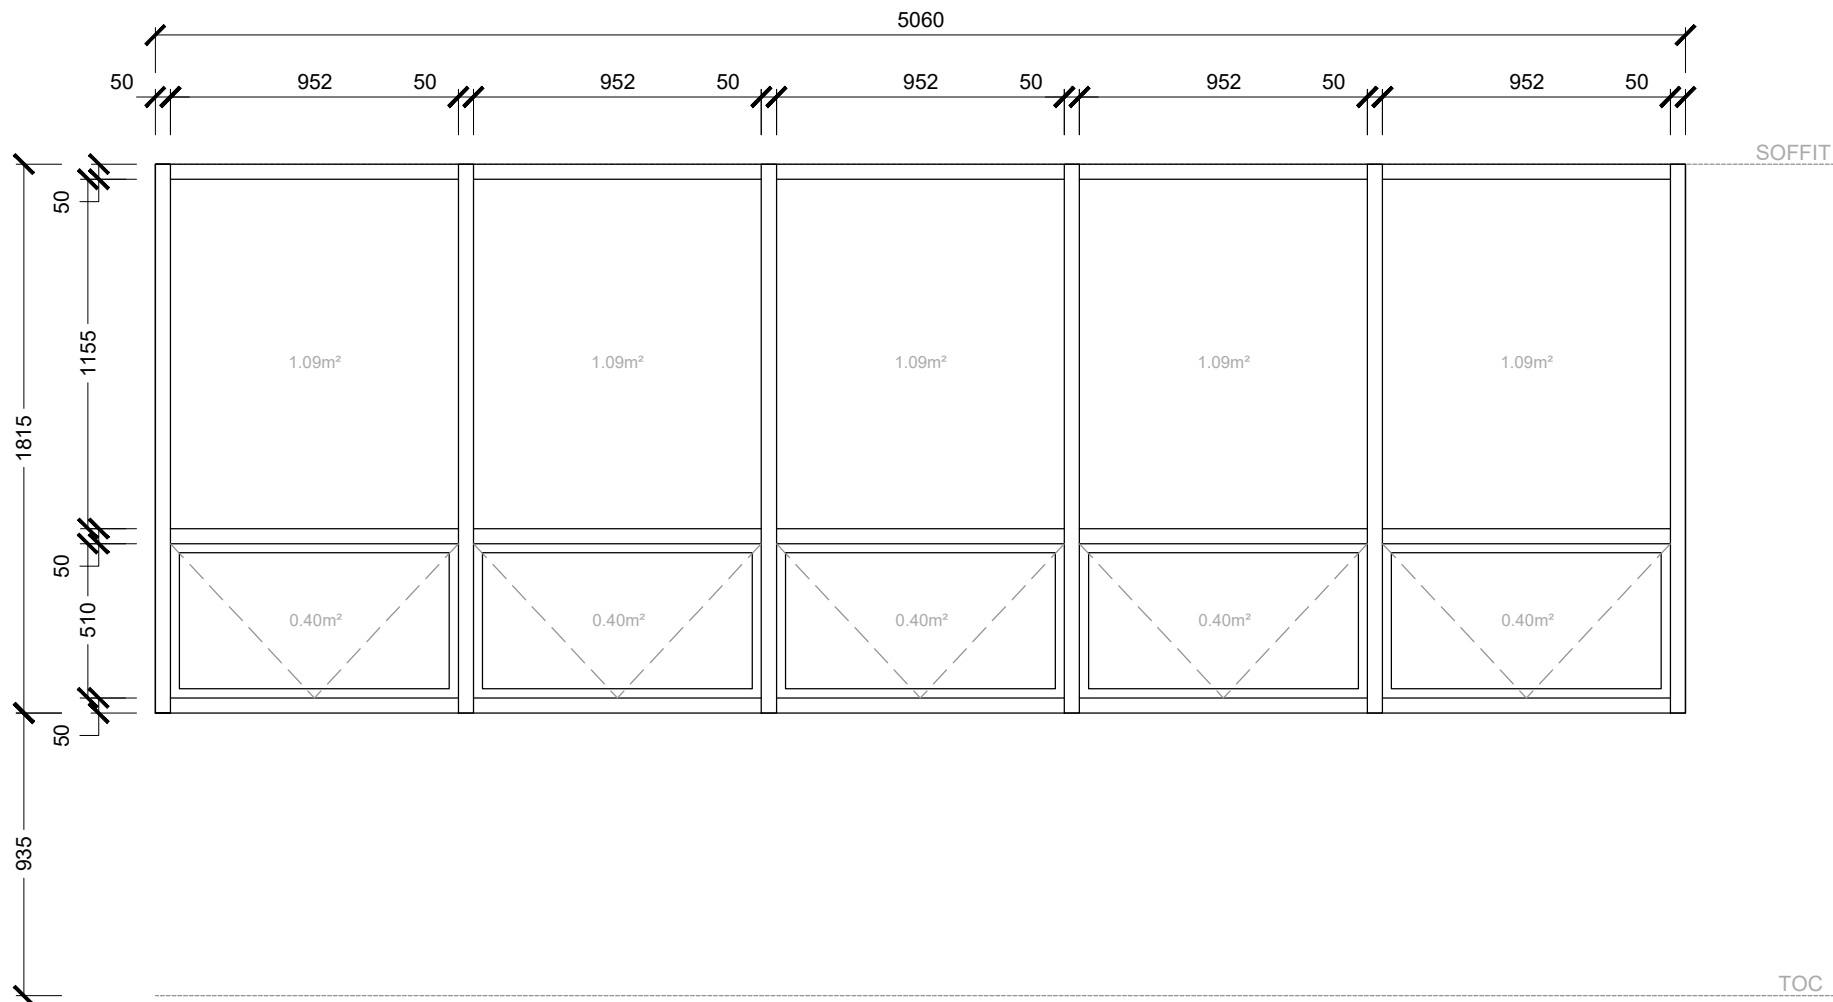


CWType B Crealco Facade 60 or eq. approved aluminium pressure glazed drained facade system, incl top hung casement insert window, per layout.
Casement sash 1500 x 1200mm max capacity
Fixing lugs suitable for fixing to plastered brickwork reveals. Mullions in xxxmm depth section, code W54454 with Lx 71.5
AAAMSA exposure category: A3. SANS1613 - 2000Pa wind load capacity
Class 2 powder coated to SANS 10322:2014. Coatings in accordance with SANS 1576 using powders in accordance with SANS 1578.
TBC. Provisionally Mat Black
to top hung casement inserts - 500mm Stays, 13mm stack, capacity 28Kg. Crealco code STF-TH600S-304 or equal app
Handles - Per manufacturers specification to suite operation indicated.
Glazing throughout to be 6.38mm thick normal strength PVB laminated Low E safety glass
Req. 0.57 per PG Glass E-Range Solarvue Neutral SHG (or equal approved)
Req. 5.8 W/m² K (system) Glazing - 3.7 W/m² K
Curtains: Polycotton Twil 80/20 curtain drapes, code HT/BS1900W. Drop 1815mm length on HSR4001 Hospi-alu single racer track, per Hospitrack.

QUANTITY:	Incl Curtains
1	CB2

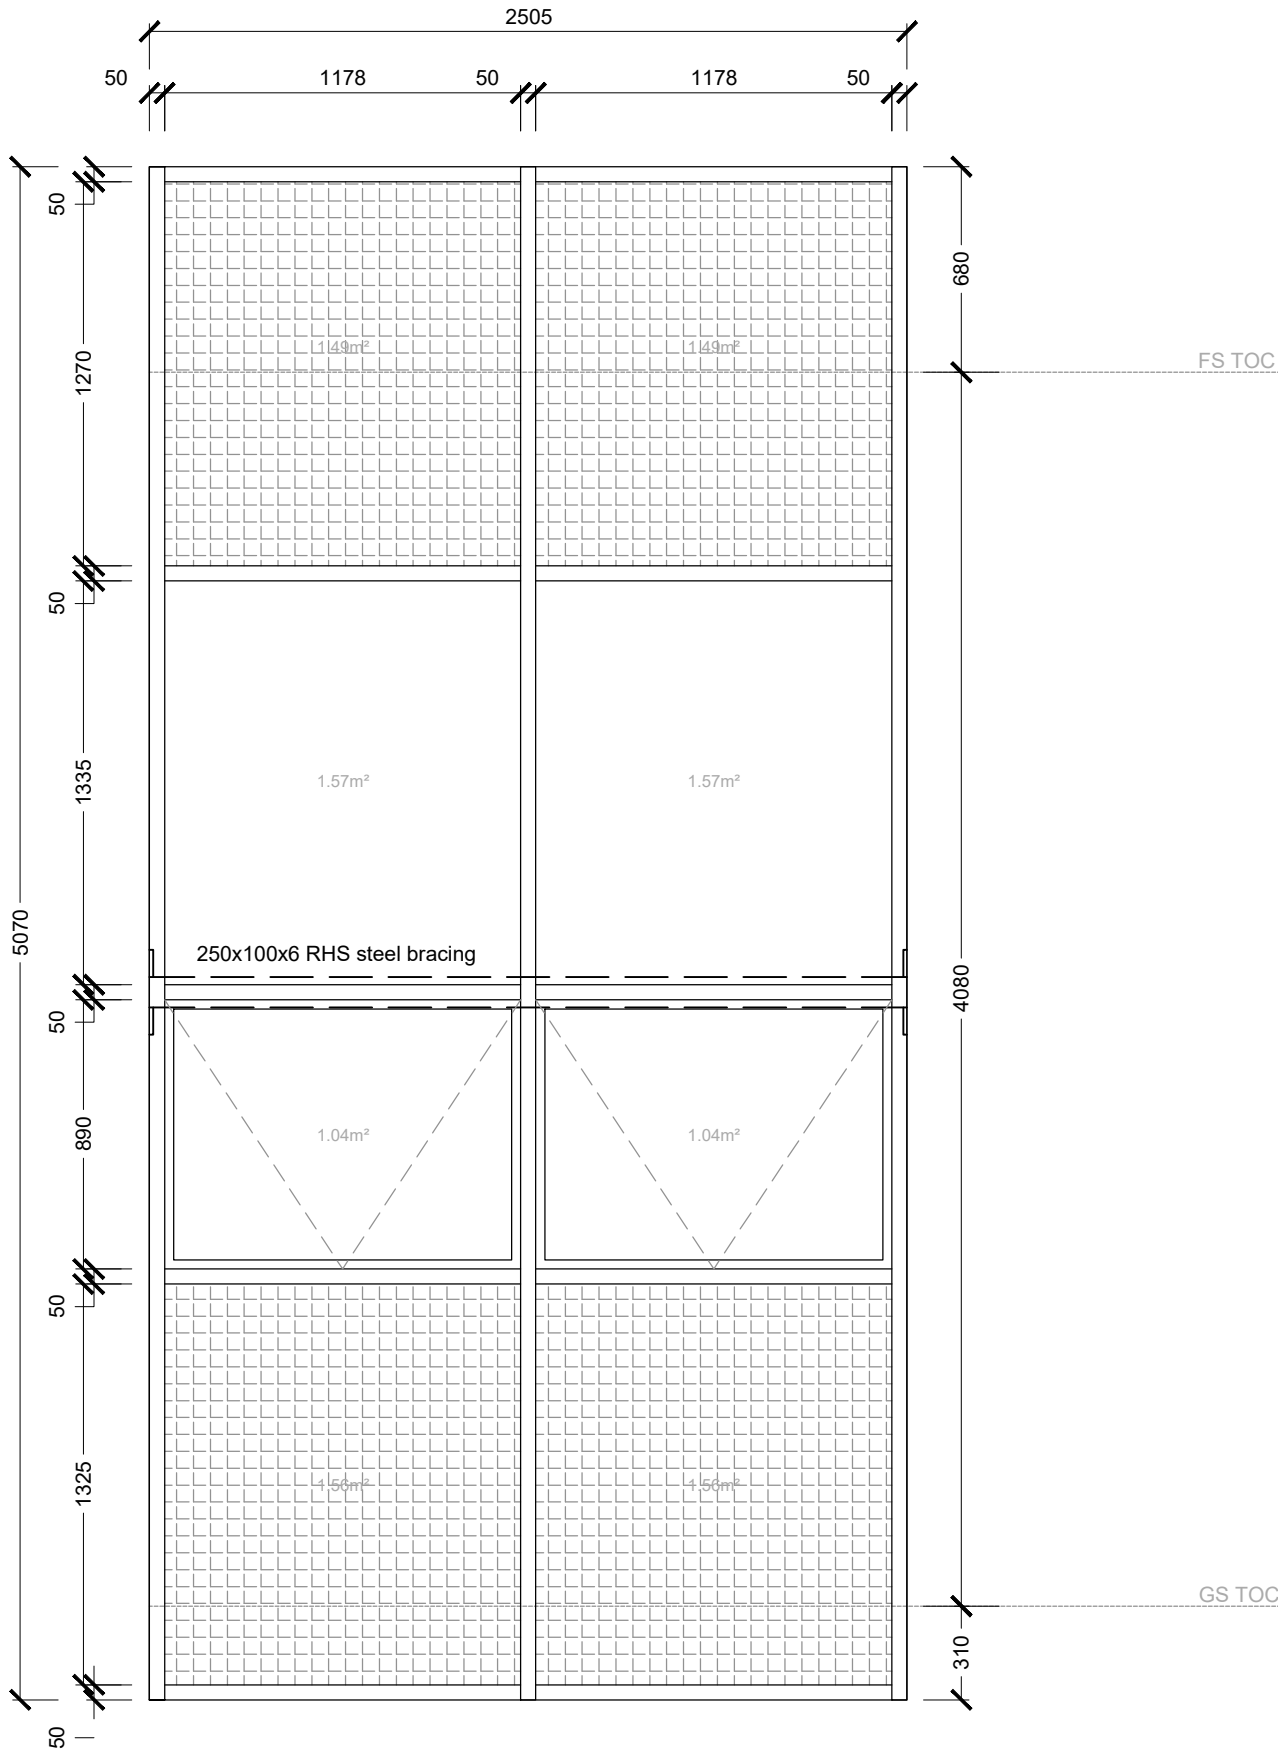


CWType C Crealco Facade 60 or eq. approved aluminium pressure glazed drained facade system, incl top hung casement insert window, per layout.
Casement sash 1500 x 1200mm max capacity. Mullions in 160mm depth section, code W58433 with Lx 484
Fixing suitable for fixing to concrete / brickwork reveals.
AAAMSA exposure category: A3. SANS1613 - 2000Pa wind load capacity
Class 2 powder coated to SANS 10322:2014. Coatings in accordance with SANS 1576 using powders in accordance with SANS 1578.
TBC. Provisionally Mat Black
to top hung casement inserts - 500mm Stays, 13mm stack, capacity 28Kg. Crealco code STF-TH600S-304 or equal app
Handles - Per manufacturers specification to suite operation indicated.
Spandrel panels in 4mm Huiabond pre-coated aluminium faced panel, with fire retardant foam core.
Glazing throughout to be 6.38mm thick normal strength PVB laminated Low E safety glass
Req. 0.57 per PG Glass E-Range Solarvue Neutral SHG (or equal approved)
Req. 5.8 W/m² K (system) Glazing - 3.7 W/m² K
Curtains: Polycotton Twil 80/20 curtain drapes, code HT/BS1900W. Drop 2250mm length on HSR4001 Hospi-alu single racer track, per Hospitrack.

QUANTITY:	Incl Curtains
1	CG1

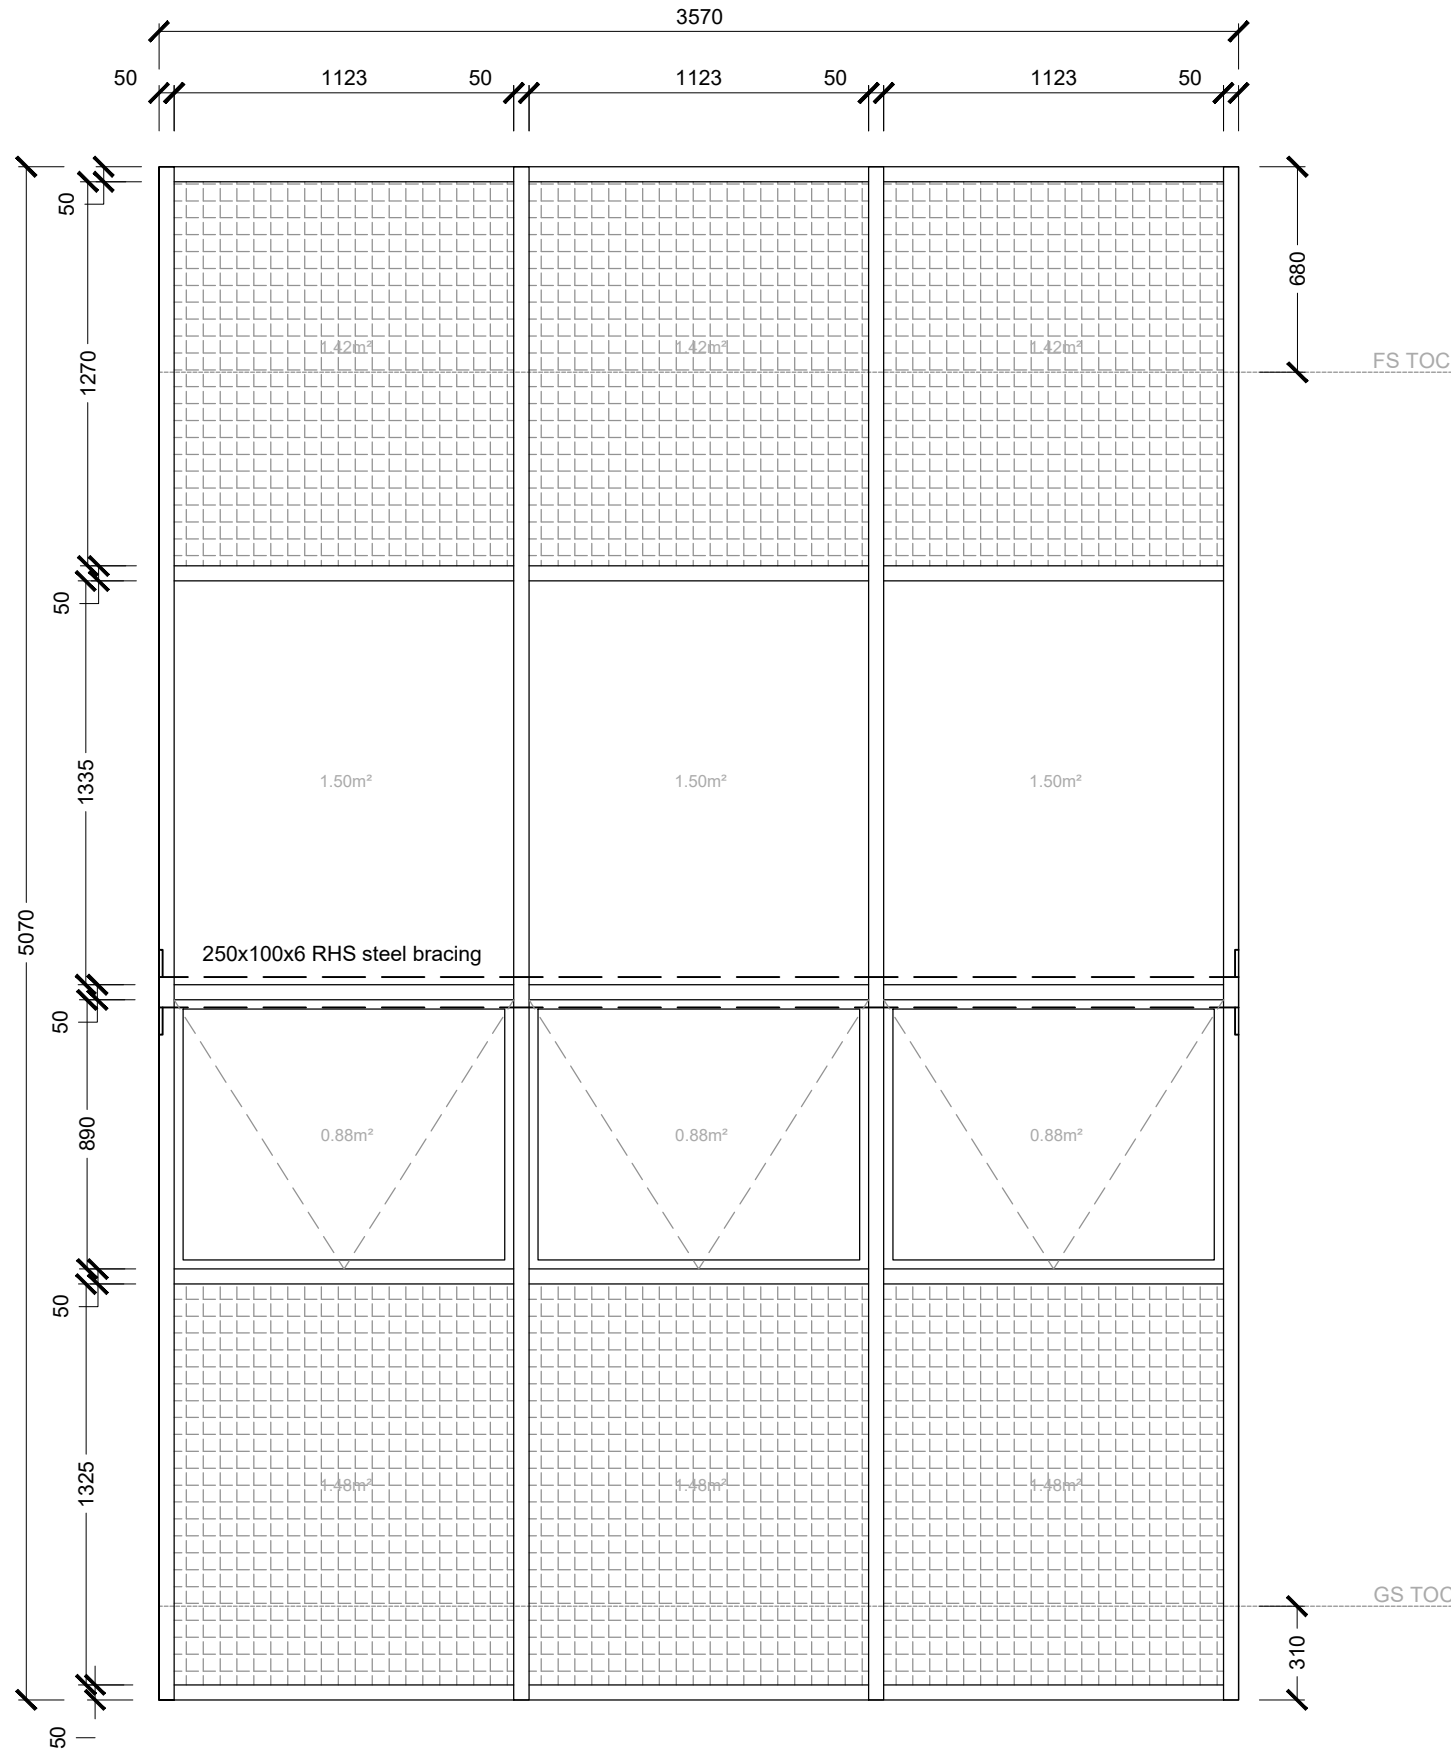

CWType D Crealco Facade 60 or eq. approved aluminium pressure glazed drained facade system, incl top hung casement insert window, per layout.
Casement sash 1500 x 1200mm max capacity. Mullions in 160mm depth section, code W58433 with Lx 484
Fixing suitable for fixing to concrete / brickwork reveals.
AAAMSA exposure category: A3. SANS1613 - 2000Pa wind load capacity
Class 2 powder coated to SANS 10322:2014. Coatings in accordance with SANS 1576 using powders in accordance with SANS 1578.
TBC. Provisionally Mat Black
to top hung casement inserts - 500mm Stays, 13mm stack, capacity 28Kg. Crealco code STF-TH600S-304 or equal app
Handles - Per manufacturers specification to suite operation indicated.
Spandrel panels in 4mm Huiabond pre-coated aluminium faced panel, with fire retardant foam core.
Glazing throughout to be 6.38mm thick normal strength PVB laminated Low E safety glass
Req. 0.57 per PG Glass E-Range Solarvue Neutral SHG (or equal approved)
Req. 5.8 W/m² K (system) Glazing - 3.7 W/m² K
Curtains: Polycotton Twil 80/20 curtain drapes, code HT/BS1900W. Drop 2250mm length on HSR4001 Hospi-alu single racer track, per Hospitrack.

QUANTITY:	Incl Curtains
8	CG2 CG5 CG8 CG3 CG6 CG10 CG4 CG7

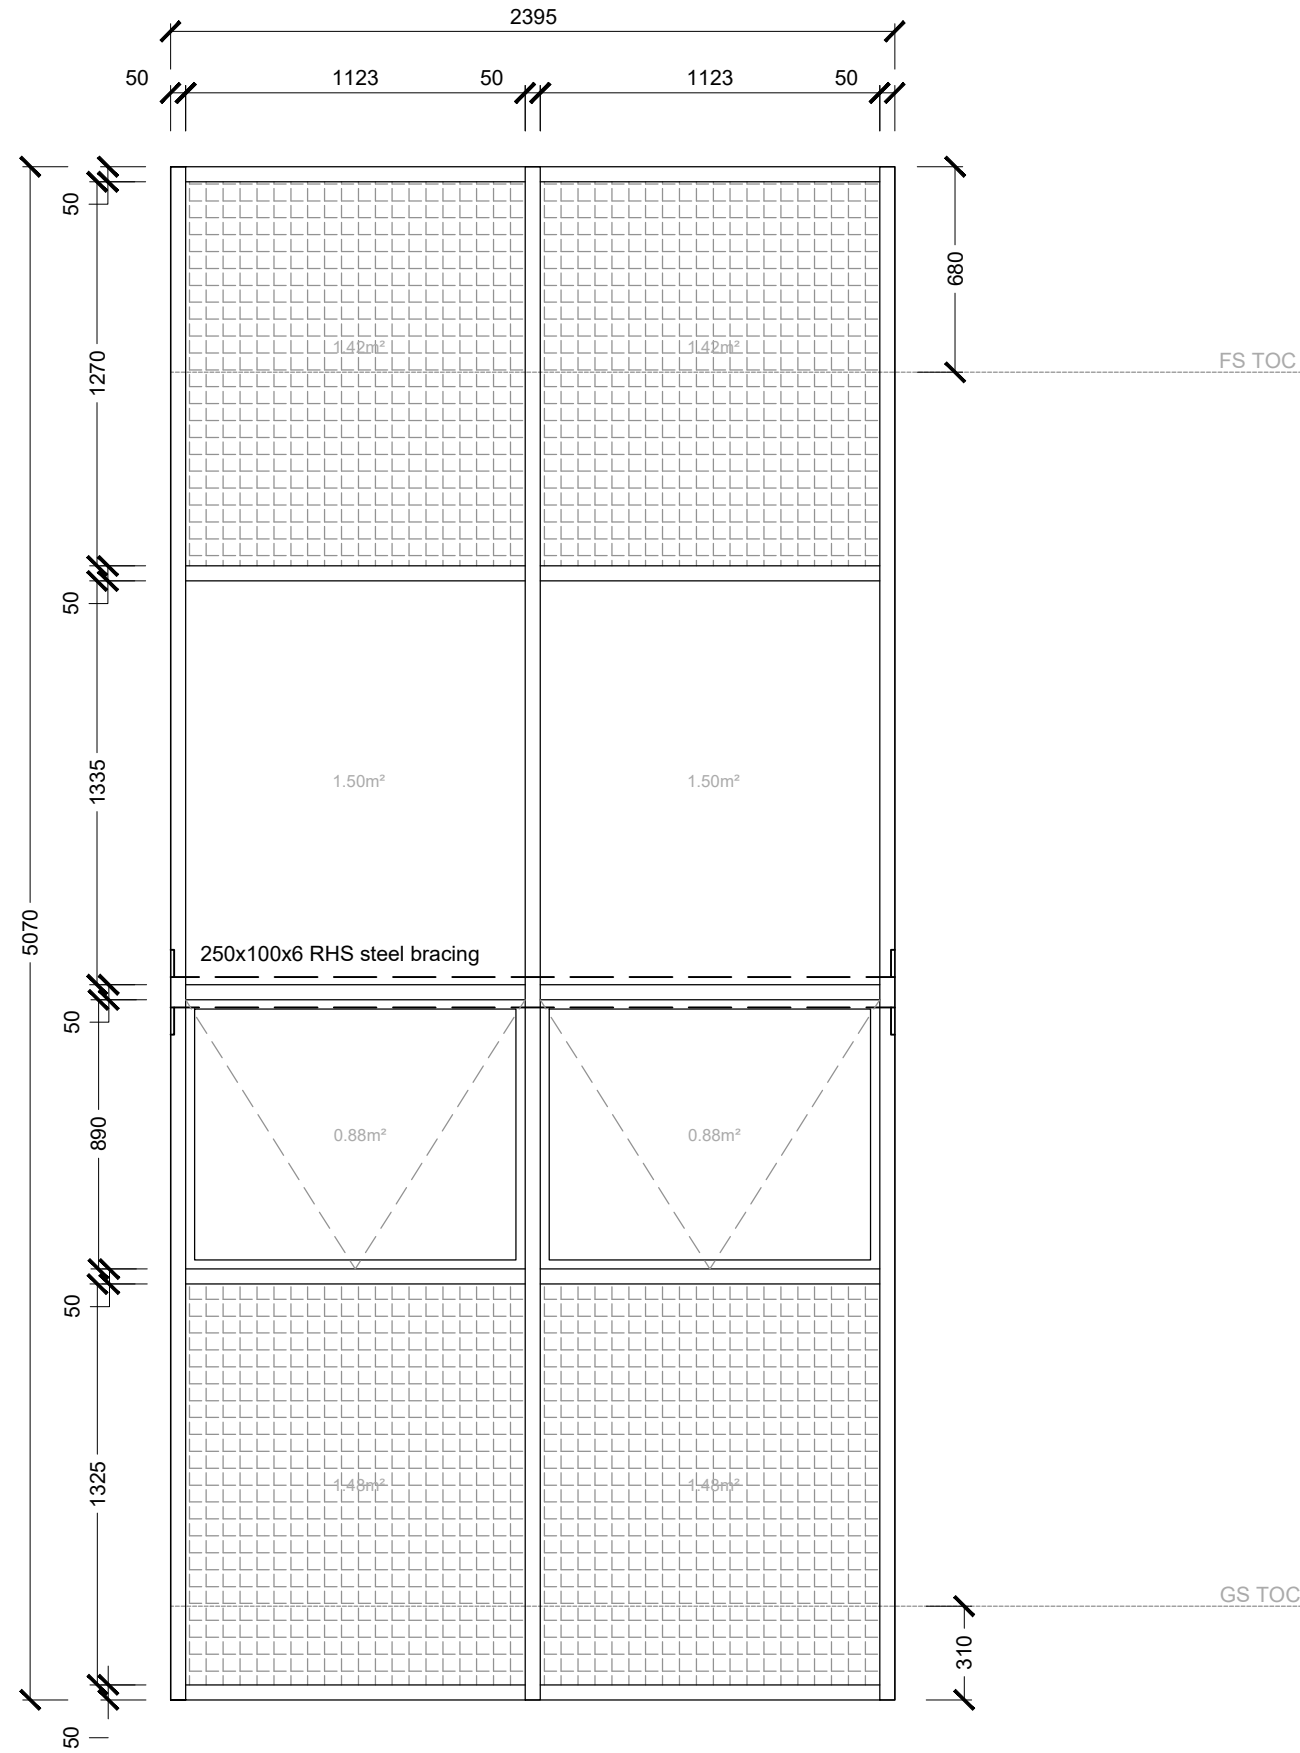

CWType E Crealco Facade 60 or eq. approved aluminium pressure glazed drained facade system, incl top hung casement insert window, per layout.
Casement sash 1500 x 1200mm max capacity. Mullions in 160mm depth section, code W58433 with Lx 484
Fixing suitable for fixing to concrete / brickwork reveals.
AAAMSA exposure category: A3. SANS1613 - 2000Pa wind load capacity
Class 2 powder coated to SANS 10322:2014. Coatings in accordance with SANS 1576 using powders in accordance with SANS 1578.
TBC. Provisionally Mat Black
to top hung casement inserts - 500mm Stays, 13mm stack, capacity 28Kg. Crealco code STF-TH600S-304 or equal app
Handles - Per manufacturers specification to suite operation indicated.
Spandrel panels in 4mm Huiabond pre-coated aluminium faced panel, with fire retardant foam core.
Glazing throughout to be 6.38mm thick normal strength PVB laminated Low E safety glass
Req. 0.57 per PG Glass E-Range Solarvue Neutral SHG (or equal approved)
Req. 5.8 W/m² K (system) Glazing - 3.7 W/m² K
Curtains: Polycotton Twil 80/20 curtain drapes, code HT/BS1900W. Drop 2250mm length on HSR4001 Hospi-alu single racer track, per Hospitrack.

QUANTITY:	Incl Curtains
1	CG9

No.	Description	Date	By
	Information only	17.02.2016	SG
A	For purpose of discussion	23.02.2016	SG
B	Glazing updated	18.10.2018	WP
C	Types updated	19.03.2019	WP
D	Type D added & updated.	03.07.2019	WP
E	All glazing types updated	12.10.2023	WP
F	Curtain wall & description updated.	08.08.2024	PD

Window Specification:

PRIOR TO COMMENCEMENT OF WORK ON SITE THE FOLLOWING CERTIFICATES ARE TO BE PROVIDED:

- Copy of the relevant AAAMSA Performance certificate from the manufacturer/contractor supplying the architectural aluminum product.
- A Certificate of conformance certifying that all anodizing or powder coating has been processed in strict accordance with SABS 999/1998 and SABS 1796/2001 respectively.
- A powder guarantee of no less than 15 years issued by the powder manufacturer. The specific conditions contained in this guarantee shall form part of the process and may only be applied by an approved powder applicator.
- A Certificate of conformance that the glazing has been installed in accordance with SABS137 ensuring that safety glazing materials have been installed in the mandatory areas & that each individual pane of safety glazing material has been permanently marked.
- A warranty from the manufacture of the laminated safety glass and / or hermetically sealed glazing units warranting the products against delamination for a period of not less than 5 years.

HEALTH DEPARTMENT SIGNATURES

DEPUTY DIRECTOR GENERAL _____

HEAD OFFICE PROGRAMME / SERVICE _____

DISTRICT MANAGER _____

CEO / MANAGER OF THE FACILITY _____

DOH PROJECT MANAGER _____

IMPLEMENTING AGENT PROJECT MANAGER _____

PROFESSIONAL SERVICE PROVIDER

NAME _____

SIGNATURE _____ DATE _____

ARCHITECT:

ARTEK 4 ARCHITECTS (KZN) CC
Durban: 46 Lena Ahrens Road, Glenwood, Durban 4000
tel: 031 201 0445 fax: 031 201 6609 email: admin@artek4.co.za
Port Shepstone: 19 Tradewinds, Marine Drive, Shelly Beach
tel: 039 682 2447 fax: 039 682 2446 email: adminps@artek4.co.za



SOUTHERN REGION

Project

WIMS No. 044044: SOUTHERN REGION: PORT SHEPSTONE: DEPARTMENT OF HEALTH: PORT SHEPSTONE: PORT SHEPSTONE HOSPITAL: NEW PSYCHIATRIC WARD

Drawing Description

CURTAIN WALL SCHEDULE
TYPE A-E

Scale	Drawn	Date
1:25	WP	17/01/2022

Consultant Project No.	Drawing No.	Rev
1518	402-01	F

DOW Drawing number	Rev
	-

Stamped by Plans Approval Committee