


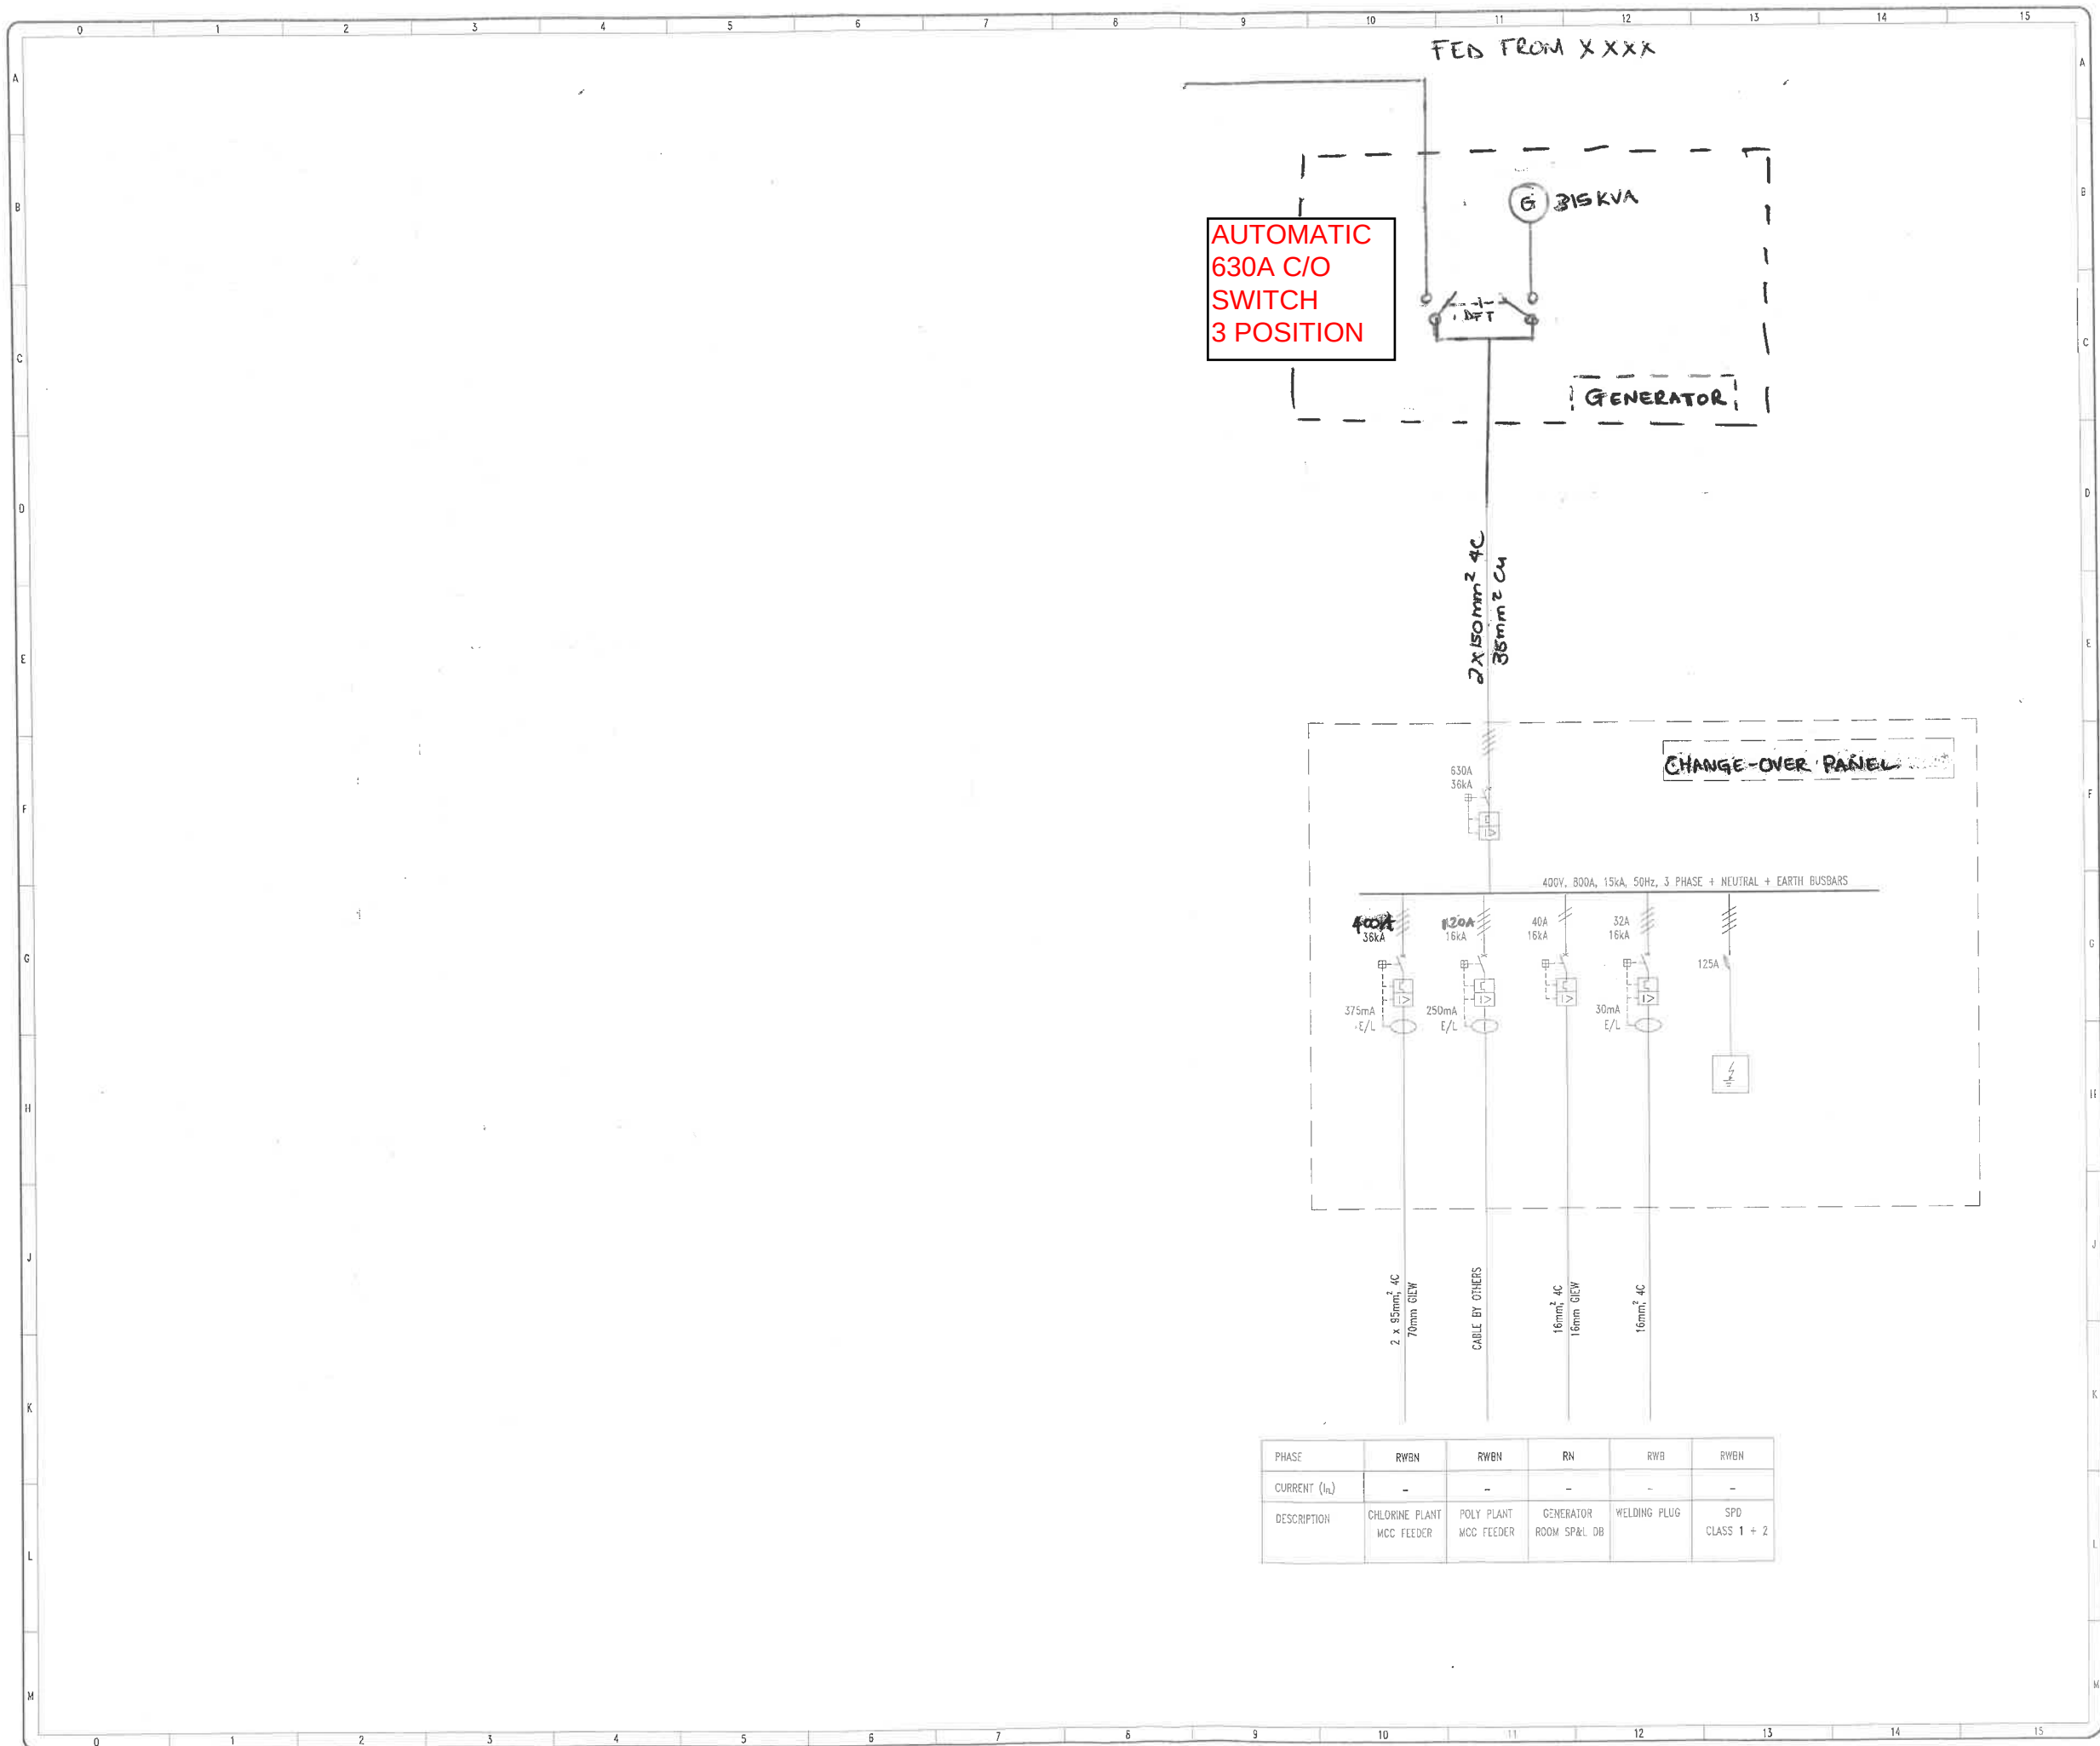

RO XXXXX

NOTES:
1. ALL WORK SHALL BE IN COMPLIANCE WITH SANS 10142 WIRING CODE.

 **RAND WATER**
BOX 1127
JOHANNESBURG
2000
TEL: +27 11 682-0911
© RAND WATER 2004 All Rights Reserved

SAP PROJECT No.:	P.03753	CHECKED BY:	
NETWORK ID No.:	4048072	ACCEPTED BY:	
CONTRACT:	RWD1197/15	DATE:	

RAND WATER DISCLAIMER:
RAND WATER APPROVES THE DESIGN REQUIREMENTS ONLY.
THE CONTRACTOR IS FULLY RESPONSIBLE FOR THE DESIGN.

VEREENIGING PUMPING STATION
DISINFECTION PLANT
CHLORINE PLANT 2/POLY PLANT
PRELIMINARY
SINGLE LINE DIAGRAM

STATION	WKS	DOC. TYPE	S
X V G	X X X X X X	X X X	X

SCALE

RO XXXXX

REVISION
A