
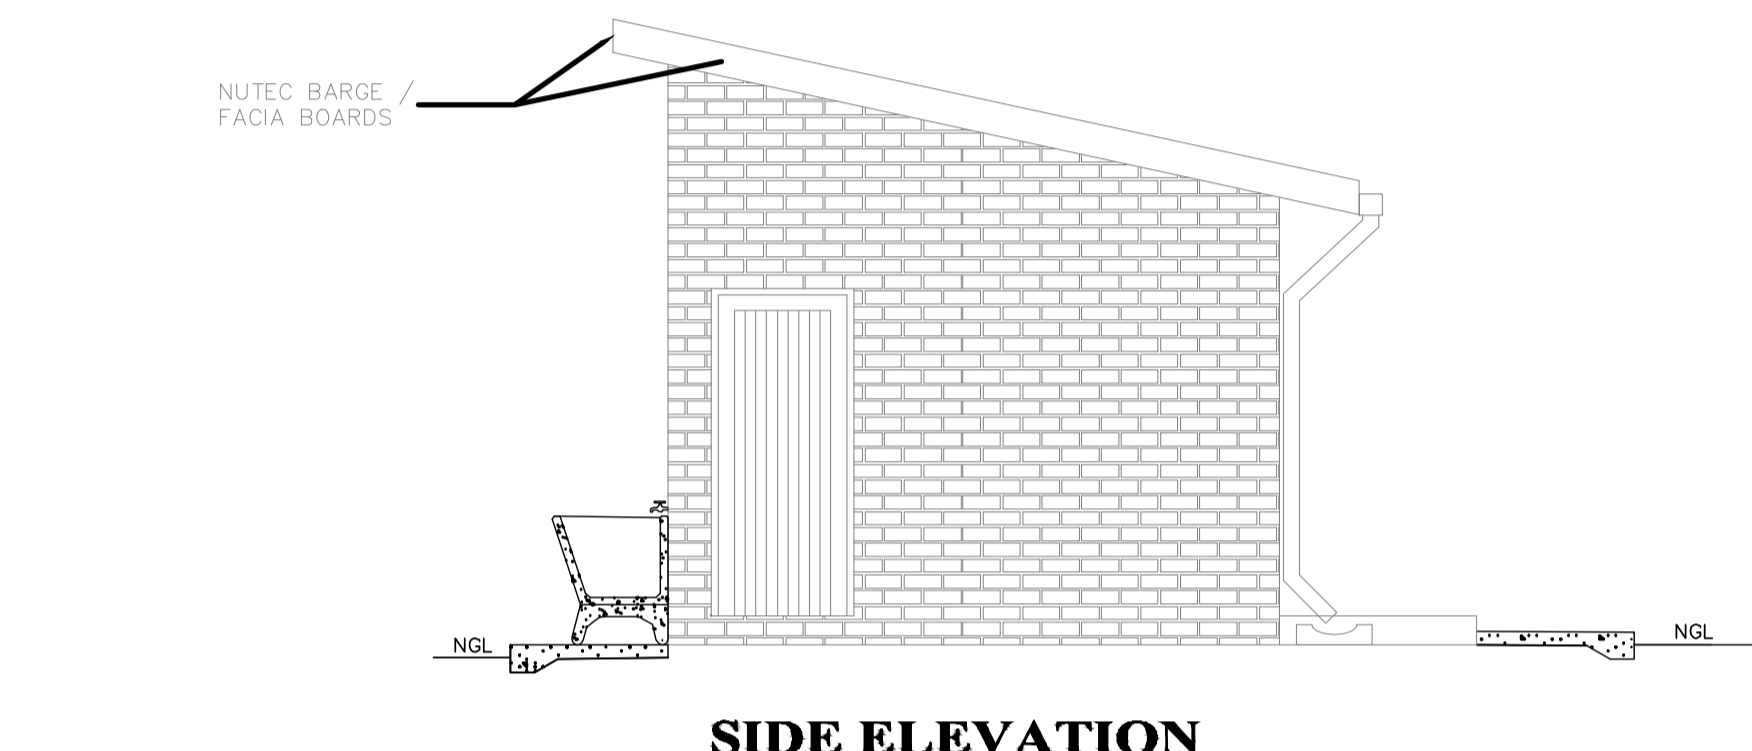
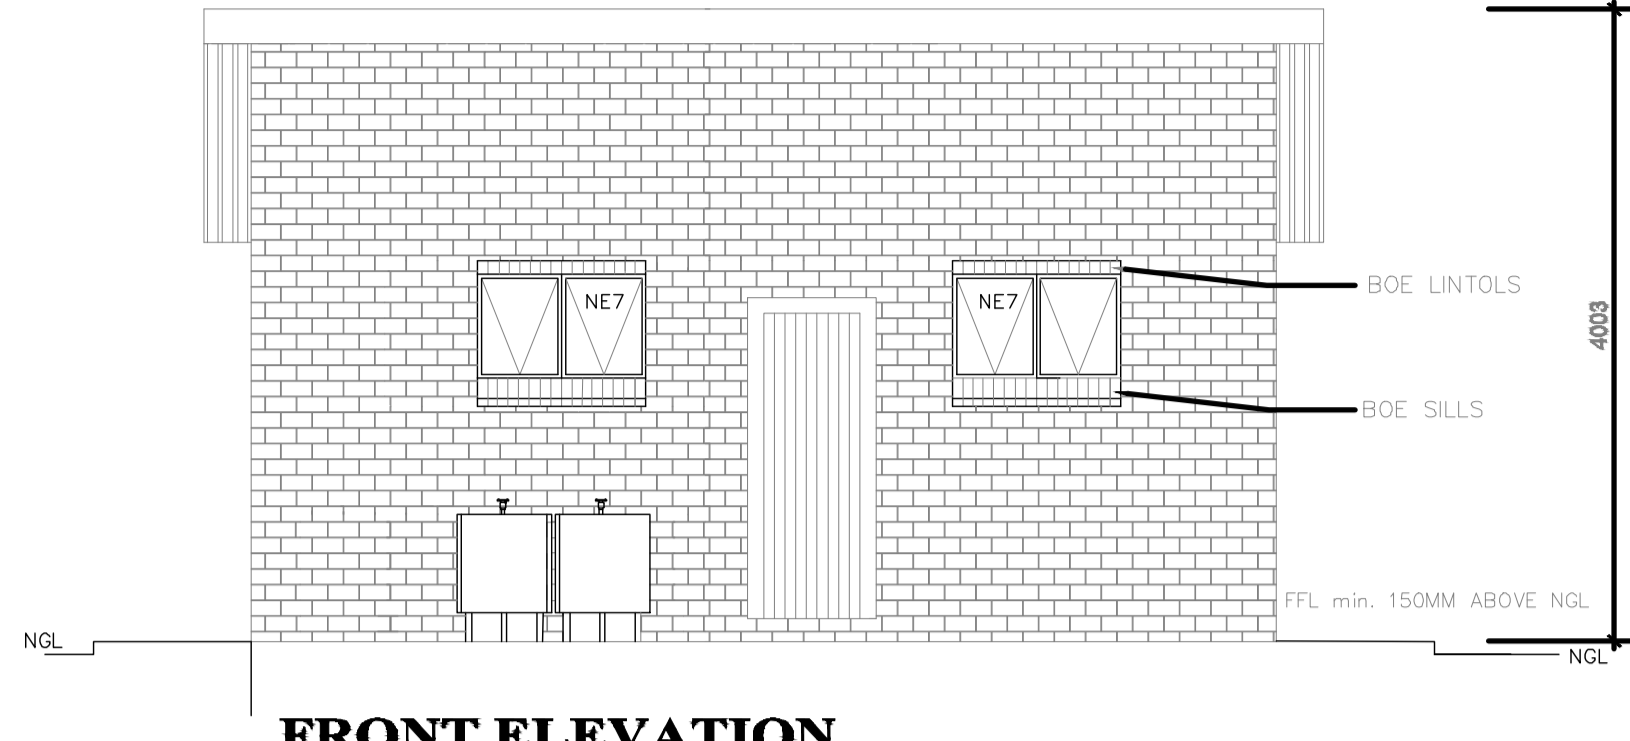



NOTE:
ENVIRO LOO INSTALLATION
AS PER MANUFACTURER'S
SPECIFICATION AND DETAILS

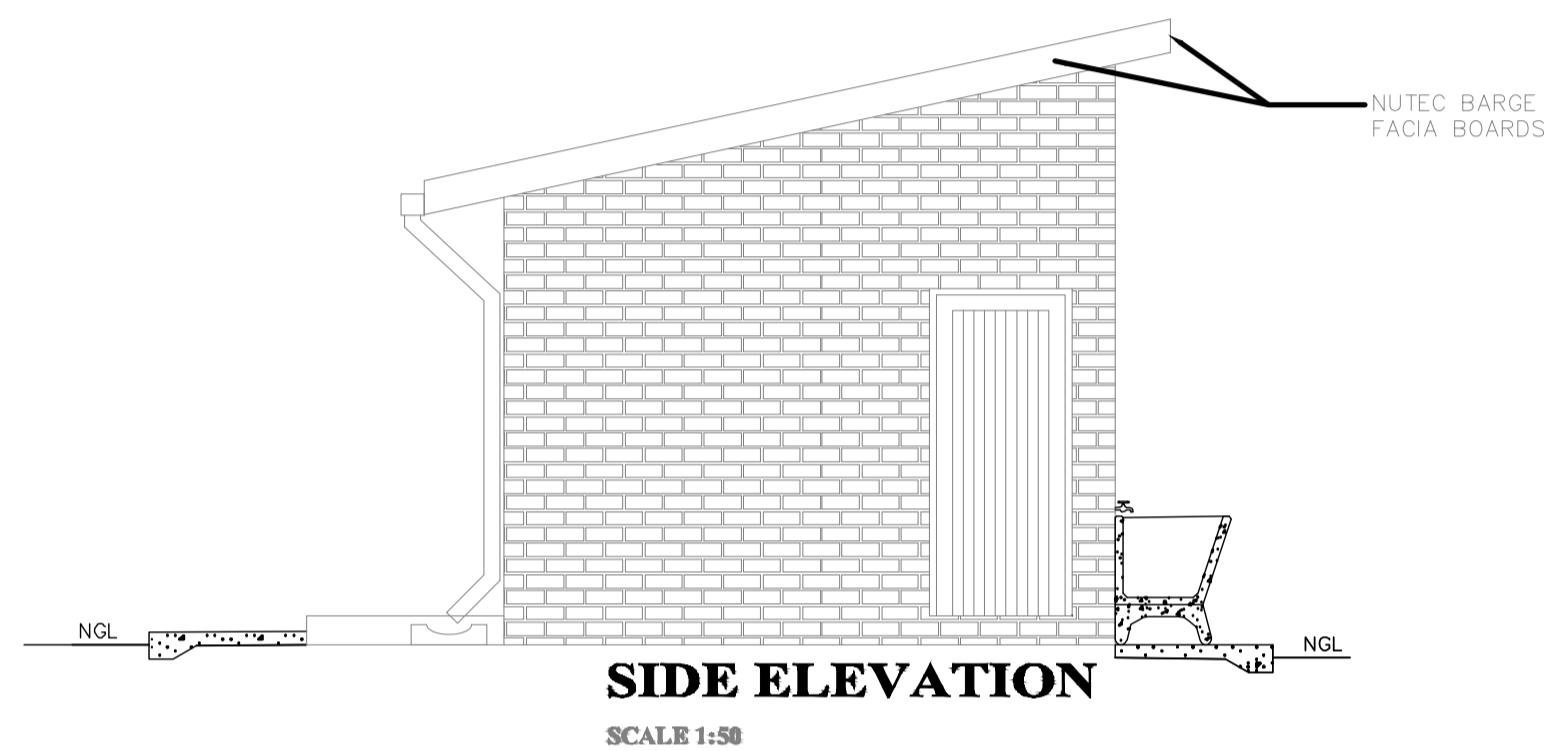

WINDOW SCHEDULE

The diagram shows a cross-section of a window frame. The width is labeled as 1022 and the height as 504. The frame is labeled NE7. The drawing shows a double-pane window with a central mullion and a bottom rail. The frame is shown in a perspective view.



WINDOW NO.	T-2
CATALOGUE	NE7
FRAME	1022 x 504mm HIGH STANDARD STEEL WINDOW FRAME
FRAME FINISH	SPOT PRIMING, DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
GLAZING	6.38mm DISCURE SAFETY GLASS
NO. REQUIRED	2

WINDOW SCHEDULE	
	
WINDOW NO.	N1
CATALOGUE	NE1
FRAME	3.55 x 854mm HIGH STANDARD STEEL WINDOW FRAME
FRAME FINISH	SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPDM GLOSS GLOSS ENAMEL PAINT ON STEEL
GLAZING	8.28mm OBBSCURE SAFETY GLASS
NO. REQUIRED	4

BUGLAR DOOR	
TYPE G1	2 OFF
POSITION	INTERNAL INLET DOOR
DOOR TYPE	INTERNAL GLASS INSIDE FOLLOW FRAME, MILD STEEL SECURITY GATE
DOOR FINISH	1)COAT ZINC CHROMATE PRIMER MINIMUM 2 x COATS GLASS ENAMEL (EXTERNAL QUALITY)
FRAME	30x30x1.6mm MS RECTANGULAR HOLLOW SECTION FRAME
FRAME FINISH	1)COAT ZINC CHROMATE PRIMER MINIMUM 2 x COATS GLASS ENAMEL (EXTERIOR QUALITY)
DOOR	30x30x1.6mm RECTANGULAR HOLLOW SECTION FRAME WITH 20x20x1.6 INTERLOCATING AT 108 DEGREES AT 45° ANGLE DOOR CUT
IRONMONGERY	SECURITY DOUBLE THROW DEAD LOCK (NO LATCH)

ENTRANCE DOOR	
FRAME TYPE	SINGLE REBATE STEEL FRAME TO FIT 220mm WALL (D1)
FRAME FINISH	PRIME AND PAINT UNDERCOAT AND 2co. FINISHING COATS IN GLOSS ENAMEL COLOUR TBC
DOOR LEAF	44mm FRAMED LEDGED AND BRACED DOOR SIZE 813x2032mm INCLUDING EXTERNAL WEATHER BAR
LEAF FINISH	UNDER COAT AND MINIMUM 2 COATS GLOSS ENAMEL - COLOUR TBC
LOOK	3 LEVER MORTISE LOCK SET
IRONMONGERY	100mm BRACE CABIN HOOK

CUBICLE DOOR	
FRAME TYPE	SINGLE BE474 STEEL DOOR FRAME – SIZE: 813x3mm (FRAME UNDERCUT TO 150mm)
FRAME FINISH	PRIME AND PAINT UNDERCOAT AND 2 COATS- GLOSS ENAMEL – COLOUR TBC
DOOR LEAF	14mm FRAMES LEAFS EMBRACED DOOR- SIZE: 813x2032mm (DOOR RAISE BY 150mm TO TOP OF FRAME)
LEAF FINISH	UNDER COAT AND MINIMUM 2 COATS GLOSS ENAMEL – COLOUR TBC
LOCK	WALE'S INDICATOR LOCK
IRONMONGERY	100mm CHROME PLATED "D" TYPE HANDLE B1- SOLID BRASS HINGES

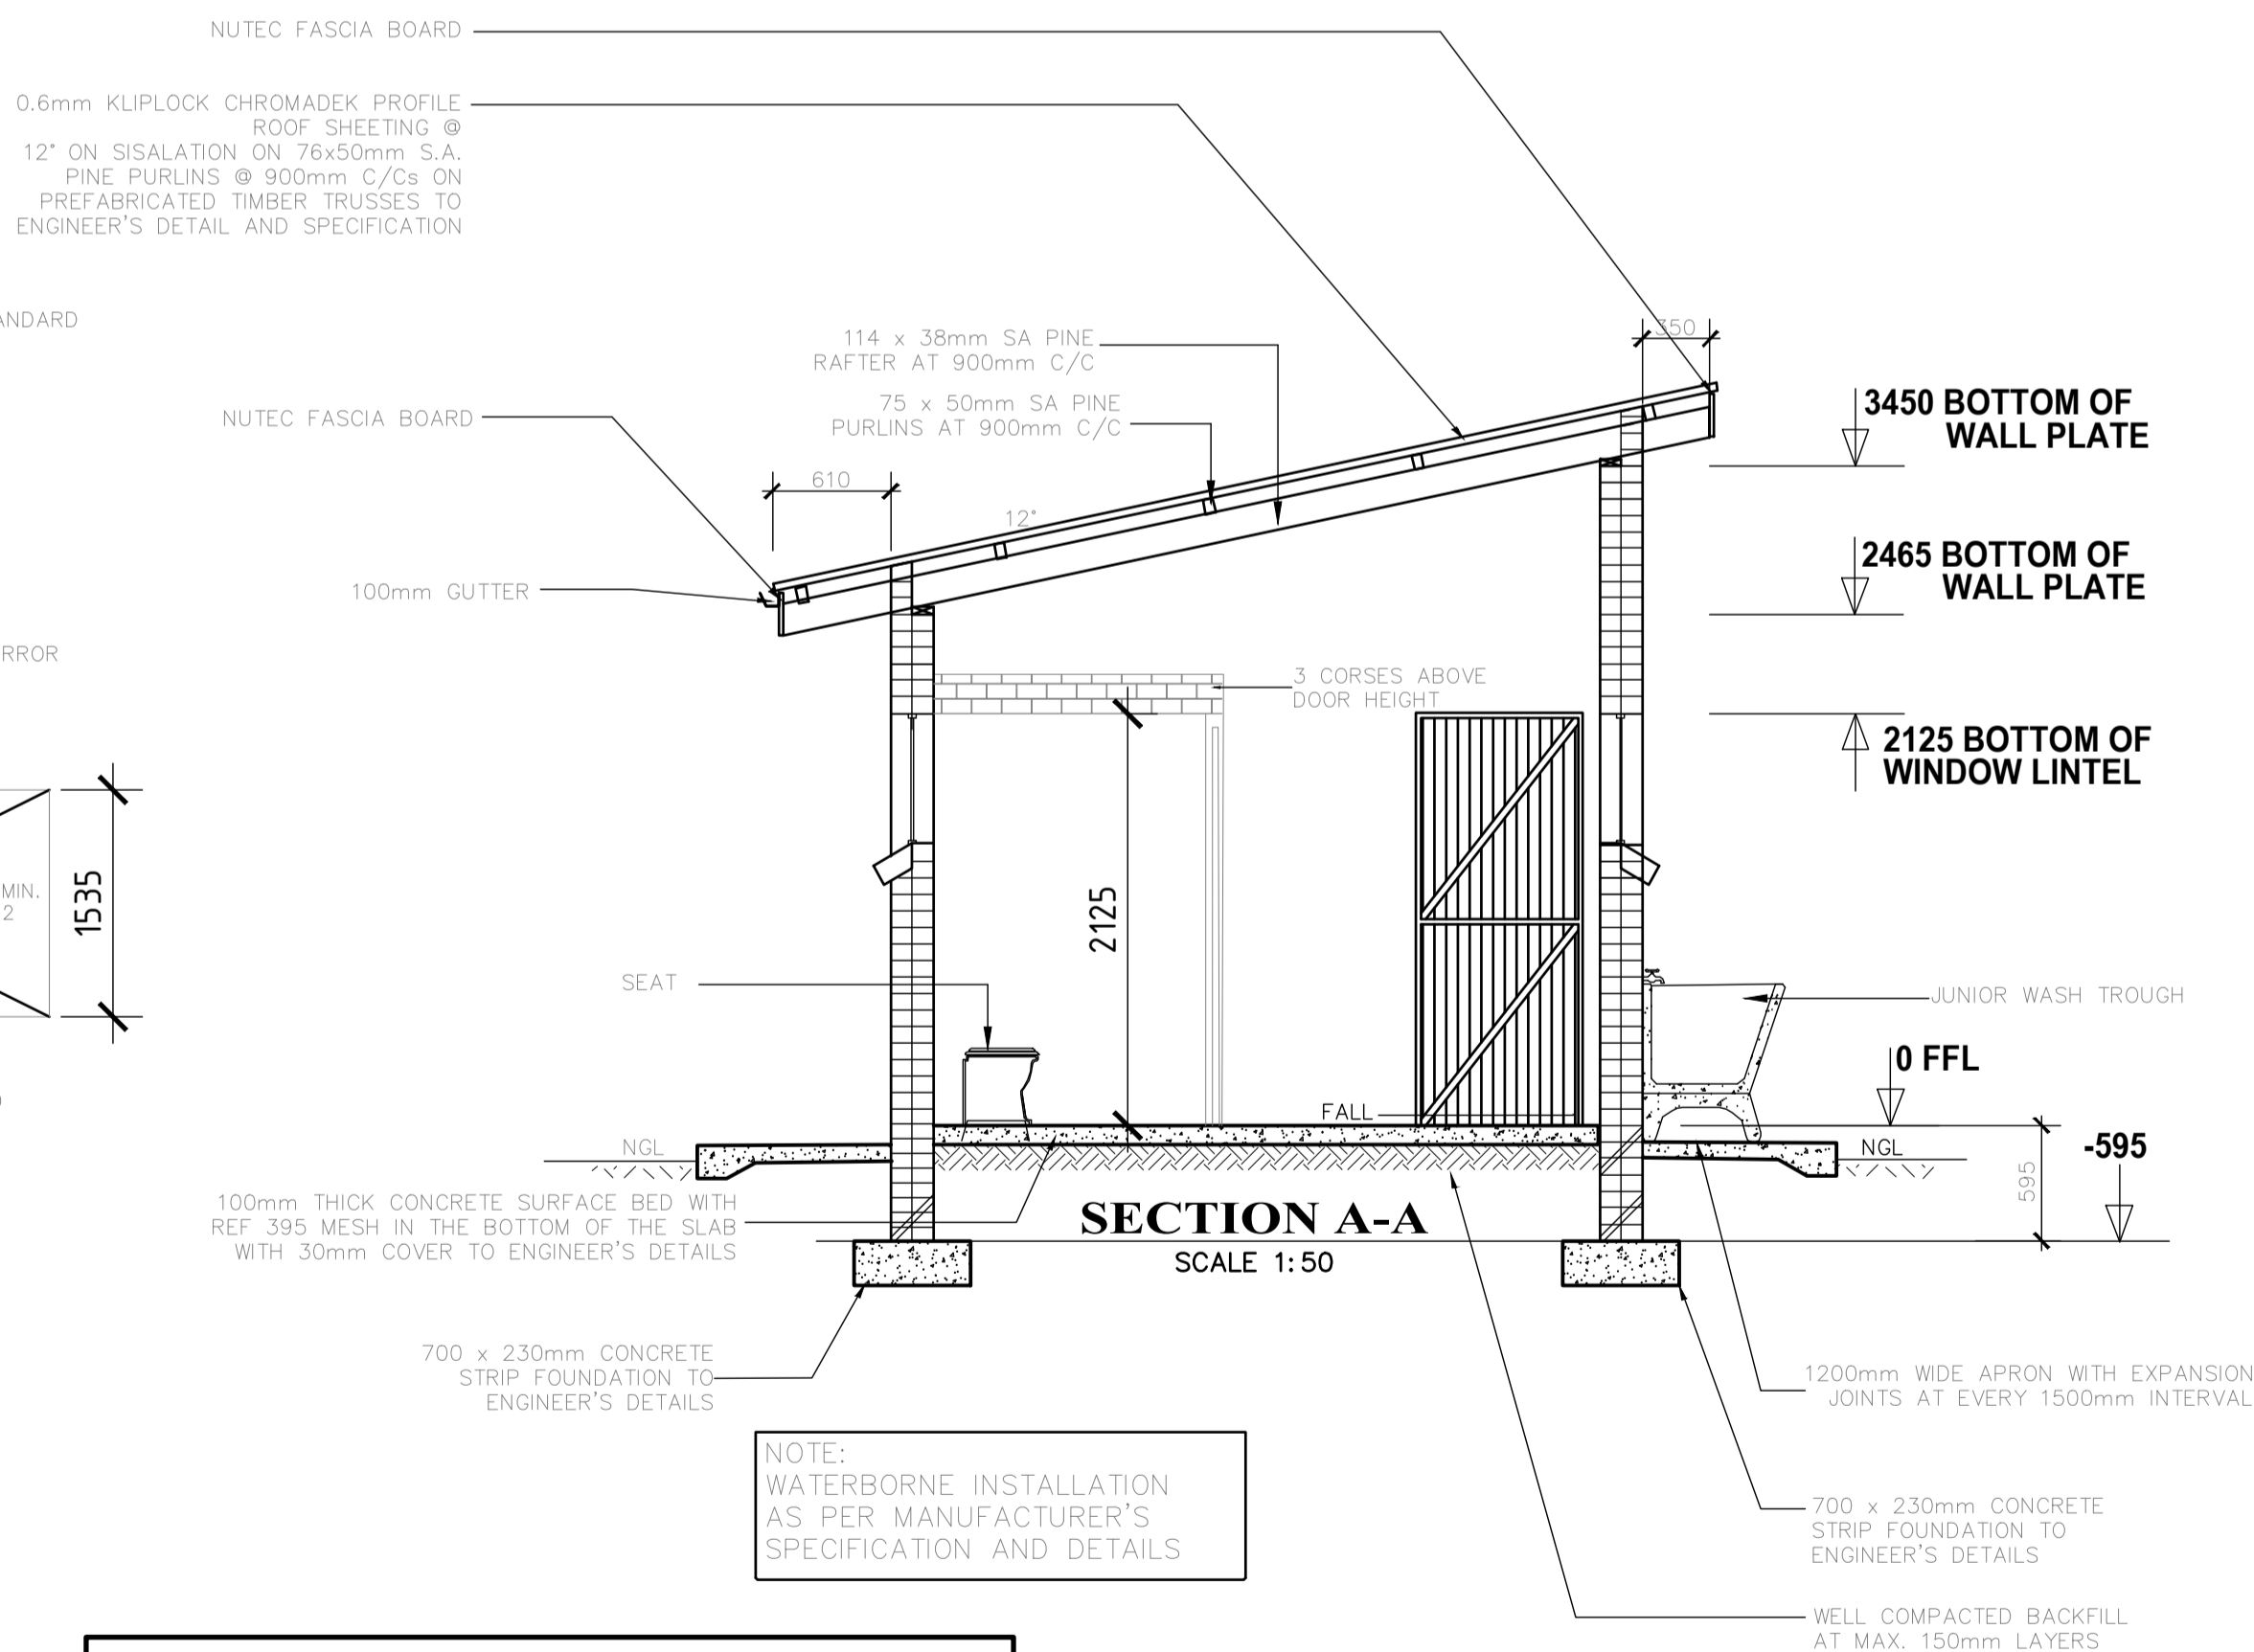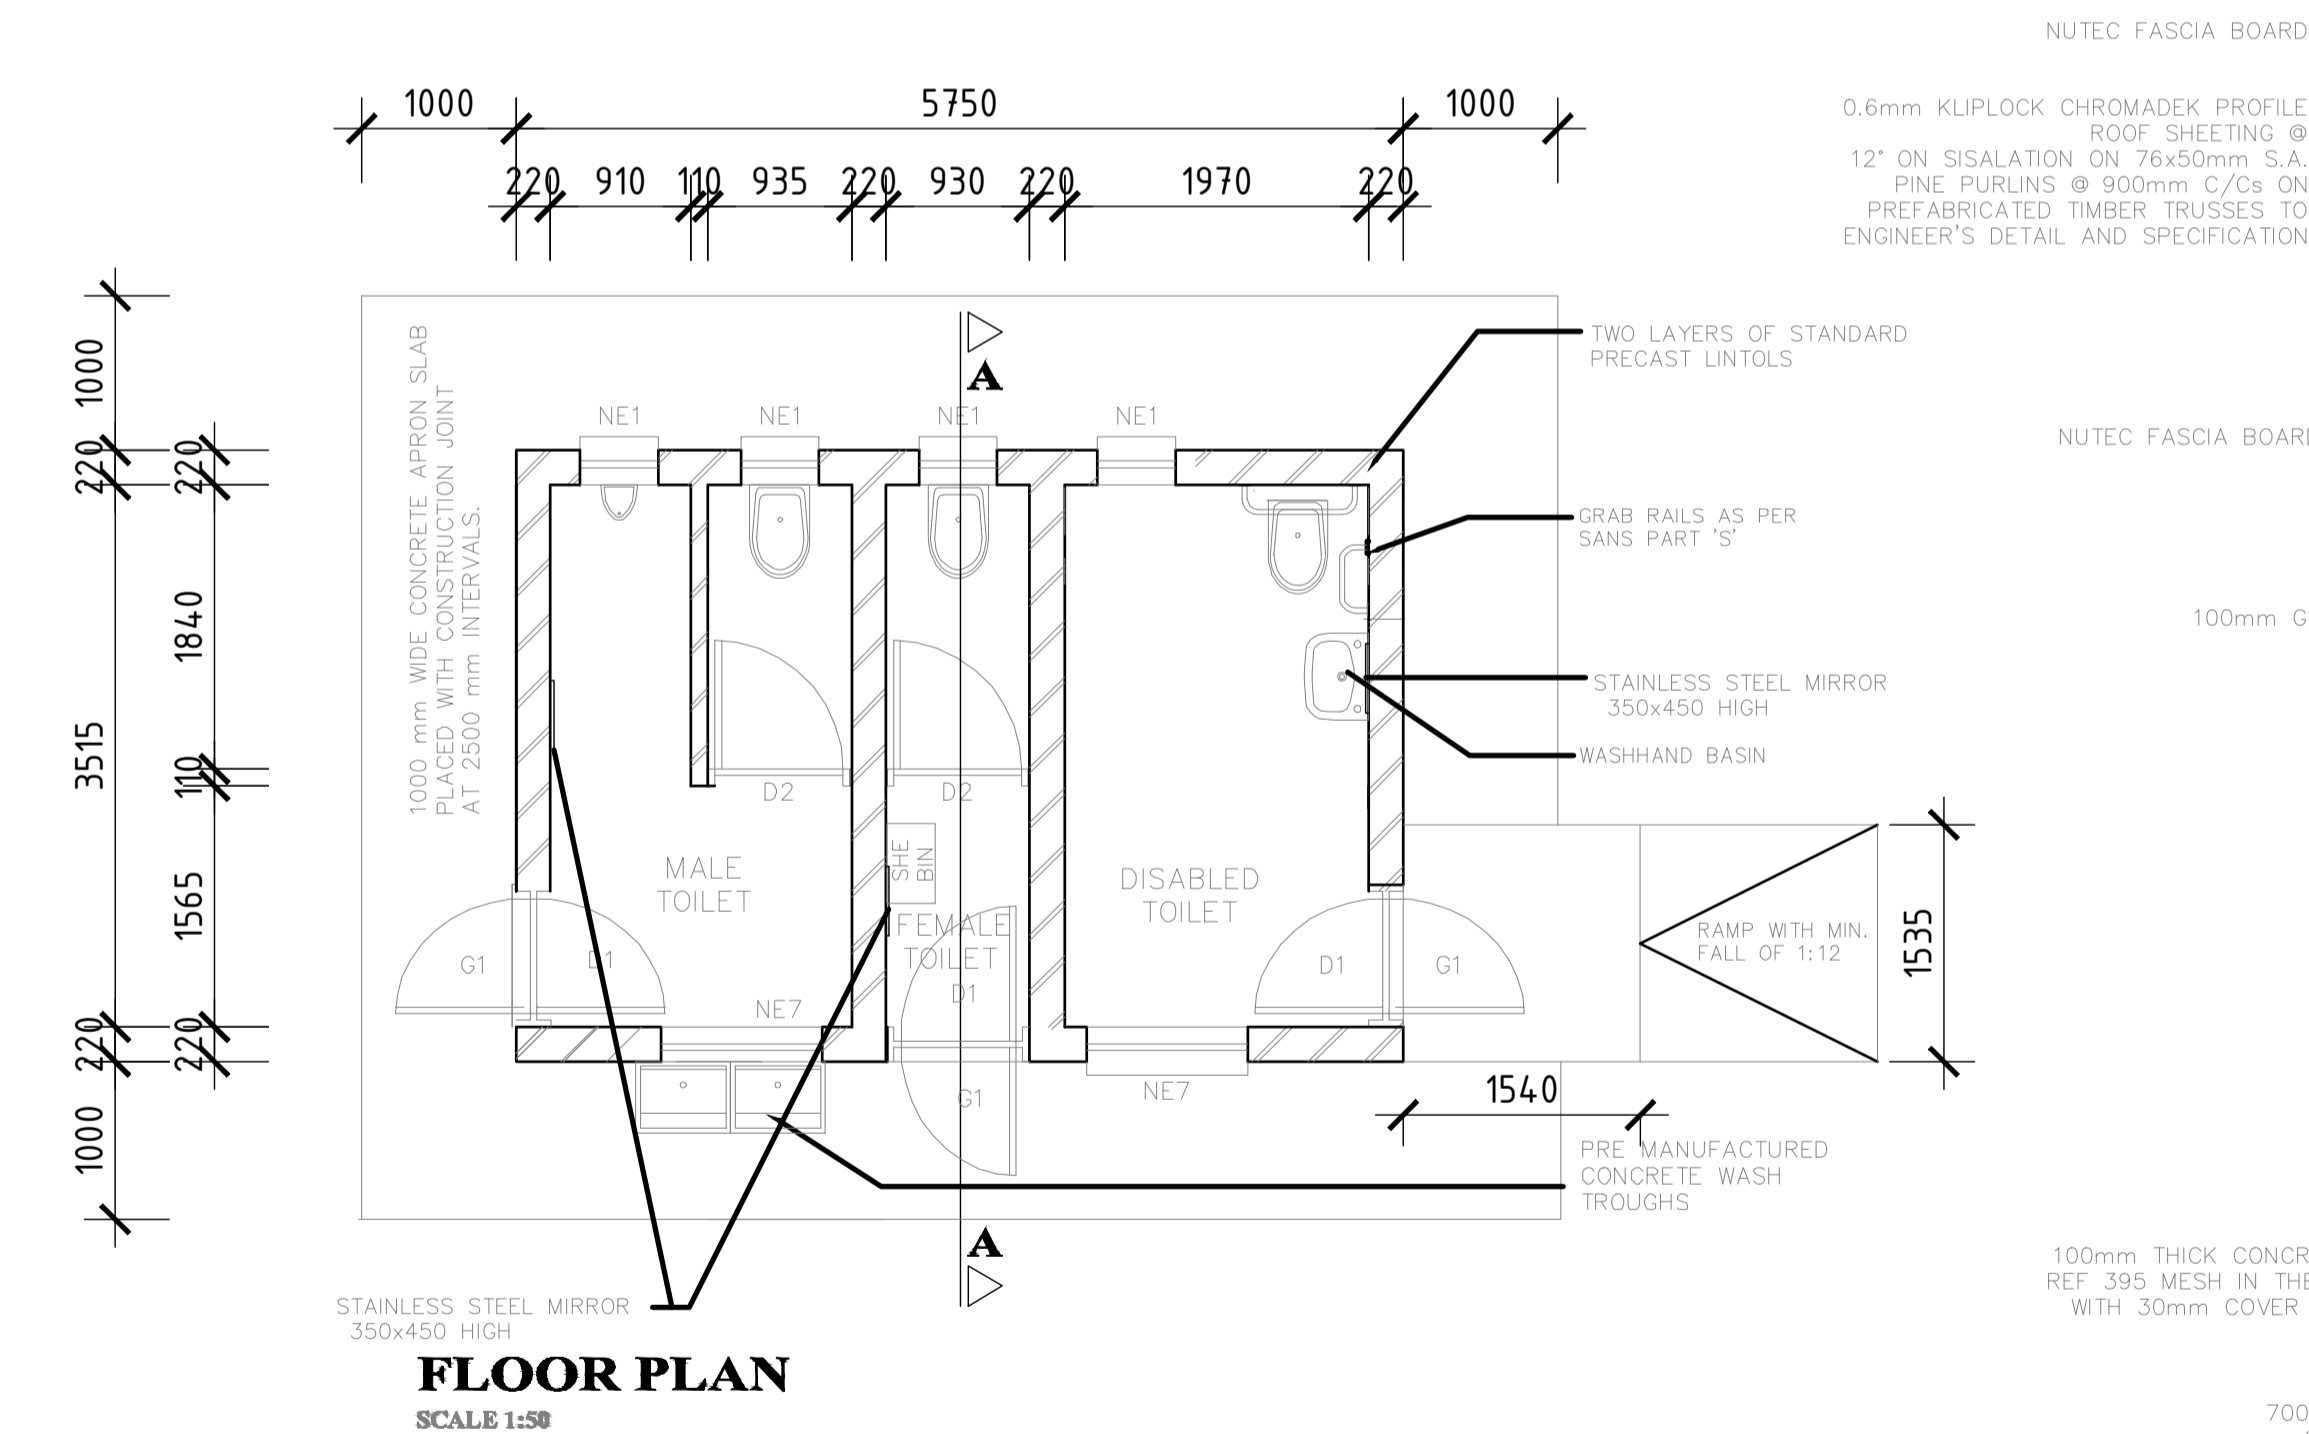

- ## GENERAL NOTES:
1. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH THE NATIONAL BUILDING REGULATION AND SABS 0400 OF 1990
 2. CONTRACTOR TO READ ONLY FIGURED DIMENSION
 3. CONTRACTOR TO VERIFY ALL DIMENSION ON SITE BEFORE COMMENCING WITH ANY WORK.

- ## NOTES AND SPECIFICATIONS:
- GENERAL
1. Use dimensions provided and do not scale drawing.
 2. All work to comply with SANS, PW371 and SABS.
 3. All dimensions, levels and positions to be verified on site prior to construction.
 4. All concrete work to be as per Engineer's details and specifications.
 5. All pits to face North.
 6. All brickwork have brickface at every 2nd course in pit lining and 3rd course in superstructure.
- ### PIT EXCAVATION
1. All stages of pit excavation to be inspected and approved by Engineer and signed off.
 2. All pit lining to be inspected by EnviroLoc Services before slab casting.
- ### COMPOSITION OF SURFACES
- All ground surfaces receiving concrete floors / slab should be compacted to 150mm layers 93% MoDAASHTO density before casting concrete.
- ### CONCRETE WORKS
1. All concrete to be as per Engineer's details and specifications.
 2. 25 MPa strength concrete to be used throughout construction.
- Trial Concrete Mixes: Proportions
- Concrete Strength at 28 Days 25Mpa:
- 1 : 2 : 2 (m³ mix proportion by volume)
- 1 bag cement : 0.08m³ Sand : 0.09m³ Stone (Volume/Bag)
- 385 kg cement : 820 kg sand : 960 kg stone (Mass/m³)
1. Pre-cast concrete lintels to be used as support under top slab of pit.
 2. All concrete aprons to be 1000mm wide.
- ### MORTAR
- Mixed proportions to be:
- 1 bag cement : 3 sand
(i.e.1 bag cement : 3 wheelbarrows (37 litres) sand)
- ### BRICKWORK
- Sub-structure
1. All pit lining / foundation brickwork to be solid NFP clay brick.
 2. All internal surface of pit lining to be painted with two coats black epoxy paint installing Enviro-Loo units.
- Super-structure
1. All external walls / partitions to be of clay face brick to SABS quality.
 2. All cubic partition walls to be 3 courses above door height.
 3. All brickwork above door openings should have brickface on every course at least 3 courses.
 4. All bricks: Standard 230X115X76mm terra-cotta vermicl proofed louvered air grating to be used above all window openings.
- ### ROOF SHEETING
1. 0.6mm kilopack chromadek roof sheeting.
- ### ROOF TIMBER / CEILING
1. All roof timbers to be machine SABS treated wood with three coats of approved wood preservative.
 2. Timber connections (Hurricane Clips) are required all interconnections between rafters and purlins.
 3. Sissolation is to be applied internal under all roof surfaces.
- ### METALWORK
1. All metalwork should be primed before installation.
 2. All steel window should have 6x20mm flat bar burglar proofing.
- ### PLUMBING
1. Double concrete wash trough to be used.
 2. All wash troughs should be connected to the school's water supply system and the waste water should be piped to a soakaway.
 3. The size of the pipe should be as per Engineer's detail and position to be determined on site.
 4. Only 20mm and galvanised pipework should be used as connection from wall to the discharge points.
- ### GLAZING
1. 6.28mm obscure safety glass
 2. Stainless steel mirrors size 350x450mm high.
- ### PAINTING
1. All paintwork to comply with SABS and PW371 specification.
 2. All steel window and door frames including doors and fascia / barge boards to be discharge points.

- | GENERAL NOTES: | |
|--|--|
| * ALL DIMENSIONS AND LEVELS ARE TO BE VERIFIED ON SITE PRIOR TO COMMENCING SETTING OUT , WORKSHOP DRAWINGS OR CONSTRUCTION . | |
| * FIGURED DIMENSIONS ONLY TO BE USED . | |
| * DISCREPANCIES , ERRORS AND OMISSIONS ARE TO BE REPORTED TO ARCHITECTS IMMEDIATELY THEY BECOME EVIDENT . | |
| * SHOP DRAWINGS TO BE SUBMITTED FOR APPROVAL PRIOR TO MANUFACTURE OR INSTALLATION . | |
| * COPYRIGHT AND RIGHT OF REPRODUCTION OF THIS DRAWINGS OR ANY PORTION THEREOF IS RESERVED MLA ARCHITECTS . | |

- | Revisions During Construction | | | |
|-------------------------------|-------------|-----------------------|--------|
| Rev. #: | Issue Date: | Revision Description: | Signed |
| | | | |

[illegible]

- | | | | |
|-------------------|--|--------------------|--|
| Issued for: | | | |
| Information | | Construction | |
| Tender - Contract | | Client Approval | |
| Measurement | | Municipal Approval | |
-
- Detail Symbols**
-
- The diagram illustrates detail symbols used in technical drawings. It features two circular symbols, B and D1, connected by leader lines to their respective annotations. Symbol B is labeled 'B' and 'Drawing location'. Symbol D1 is labeled 'D1' and '500'. A third symbol, '300', is also shown with a leader line pointing to it. The annotations include 'Section annotation', 'Leader', 'Detail/Layout annotation', 'Originating drawing', 'Drawing Name', and 'Scale'.



Client:



Client project number: CLUSTER 04

PROPOSED NEW WATER, SANITATION AND
FENCING FOR THE MVULA TRUST CM
SEHLAPELO PRIMARY SCHOOL EMIS No.:
922220125

Site information:
SESHEGO TOWNSHIP

Project Architect:

Project Architectural Technician:

DRAWING TITLE
WATERBORNE TOILET -
DISABLED 1; FEMALE,
STAFF 1; MALE STAFF 1,
URINALS 1

Project number:	Drawing number:	Project Stage:	Drawing Revision:
-	101	Constr	0

Scale:	Drawn:	Checked:
AS SHOWN	TM	BM

First issue date:	Latest issue date:
2022/06/20	2022/09/16