

CLARIFICATION QUESTION AND ANSWERS


SUPPLY, DELIVERY, INSTALLATION, TESTING AND COMMISSIONING OF AN 800KVA DIESEL BACKUP GENERATOR FOR A 6 MONTH RENTAL PERIOD.

RFQ 74516

Date: 24 August 2026

No.	Questions:	Answers:
1.	Is the Electrician and Technician required to be permanently stationed at Cape Town International Airport, or available on a call-out basis?	The Electrician and Technician will not be based on site. They will come for the installation, once that is complete, they will not be required on site.
2.	Is the generator for standby use only or continuous operation?	The generator will be for standby use only. It will only be running in an event of a power failure.
3.	If operation is anticipated, please provide	It is practically impossible to estimate the anticipated running time as this is entirely depended on Eskom power failure.
4.	Can you kindly provide the pictures of the site for an accurate pricing of installation & commissioning. The ones that were shown to us during the briefing should suffice.	

		
--	--	--

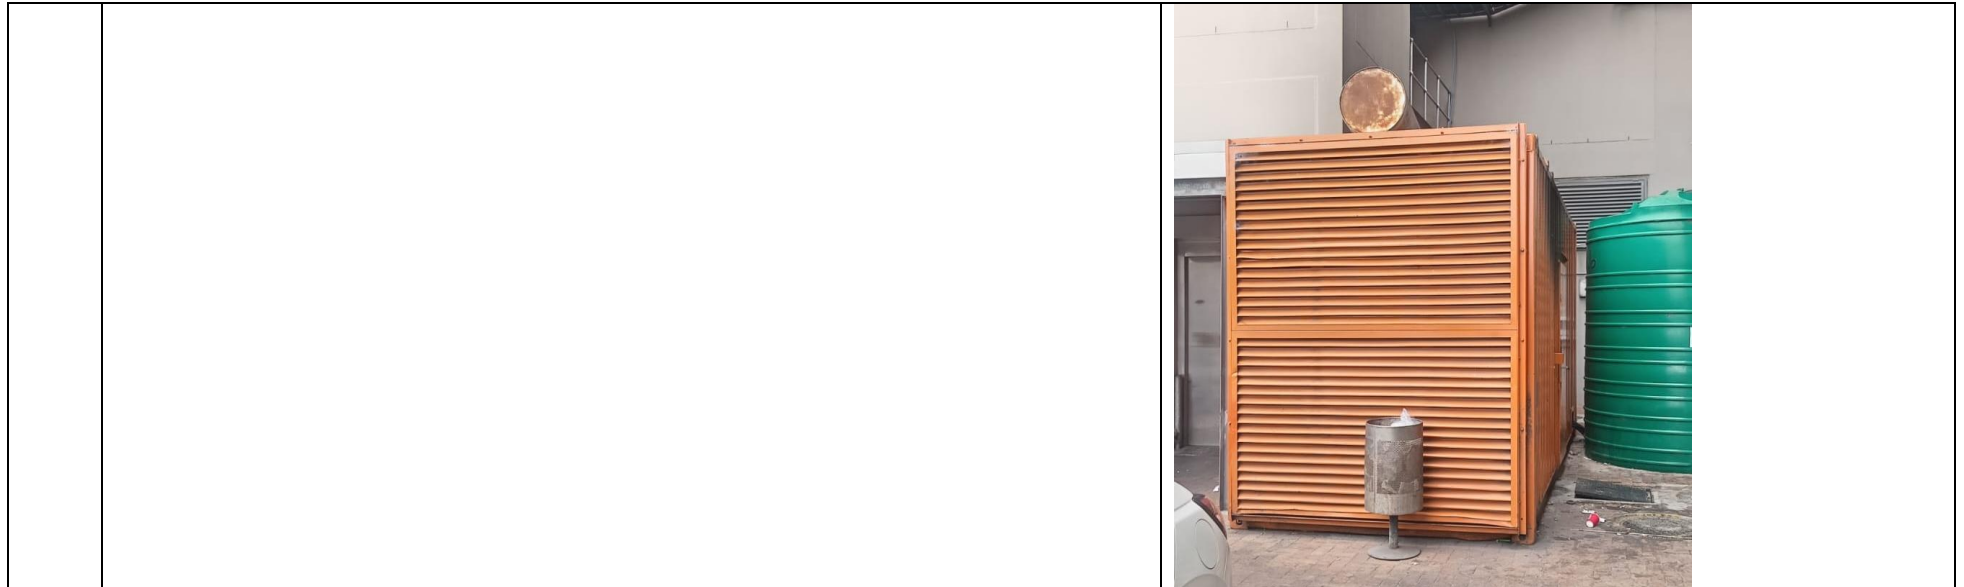

IMPORTANT: Tenderers are required to acknowledge this Q&A in their tender submission in the table for RECORD OF ADDENDA TO TENDER DOCUMENTS

BIDDER'S ACKNOWLEDGEMENT

I/We accept that Clarification Question & Answers will form part of the Tender Documents and subsequent Contract. I/We confirm that I/we

(a) have noted the contents of this Q&A.

(b) have fully considered this Q&A; and

(c) have incorporated the amendments, omissions, additions and/or amplifications contained in this Q&A in my / our submission for the Tenders relating to

Tender no:

RFQ 74516

I, the undersigned, warrant that I am duly authorised to do so on behalf of the enterprise and confirm that the contents of this schedule are, to my personal knowledge and best belief, both true and correct.

Date

Signed

.....

Name

Position

.....

Tenderer

Name &

Telephone

Number

.....