




TYPICAL HOUSE CONNECTION DETAIL
SCALE: NTS

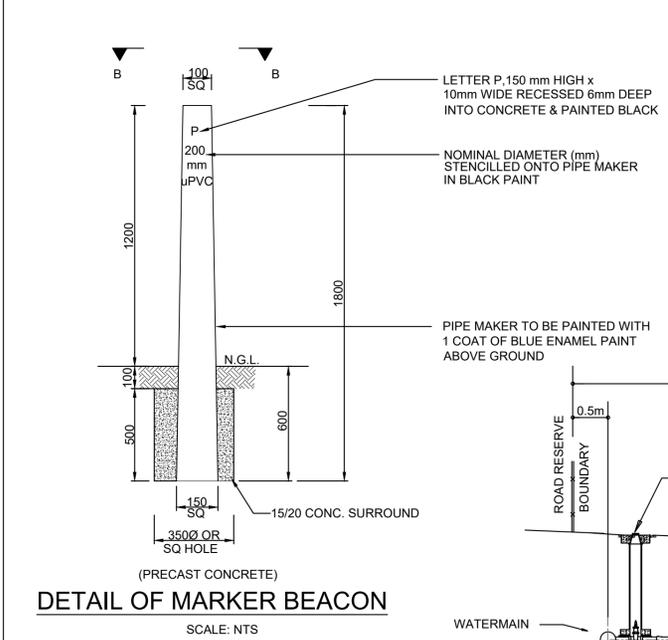


DETAIL OF MARKER BEACON
SCALE: NTS

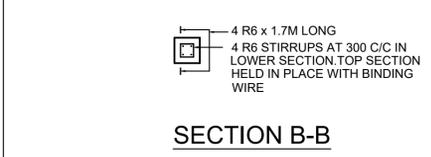


SECTION B-B

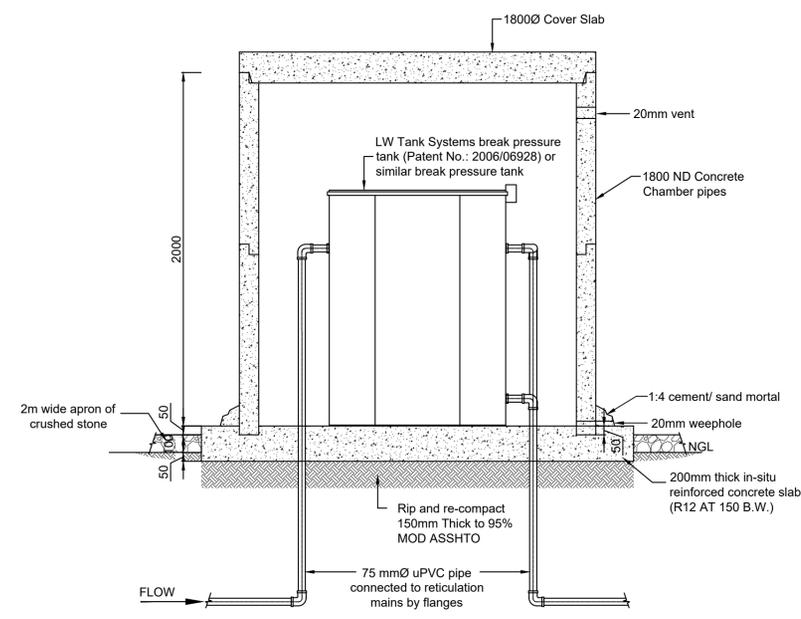


BREAK PRESSURE TANK CHAMBER DETAIL
SCALE: NTS



PLAN

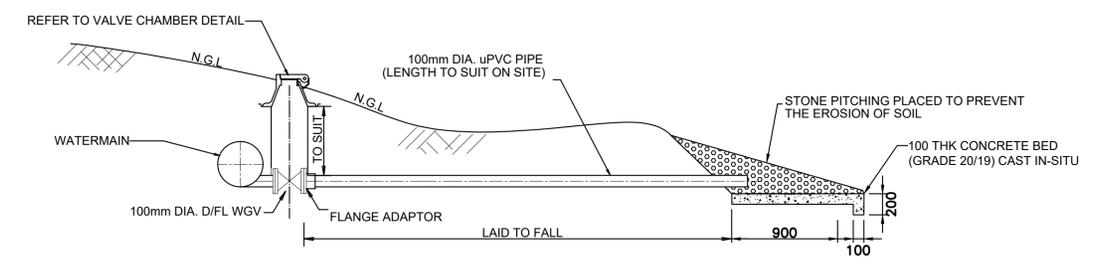


TYPICAL SCOUR VALVE ASSEMBLY
NTS

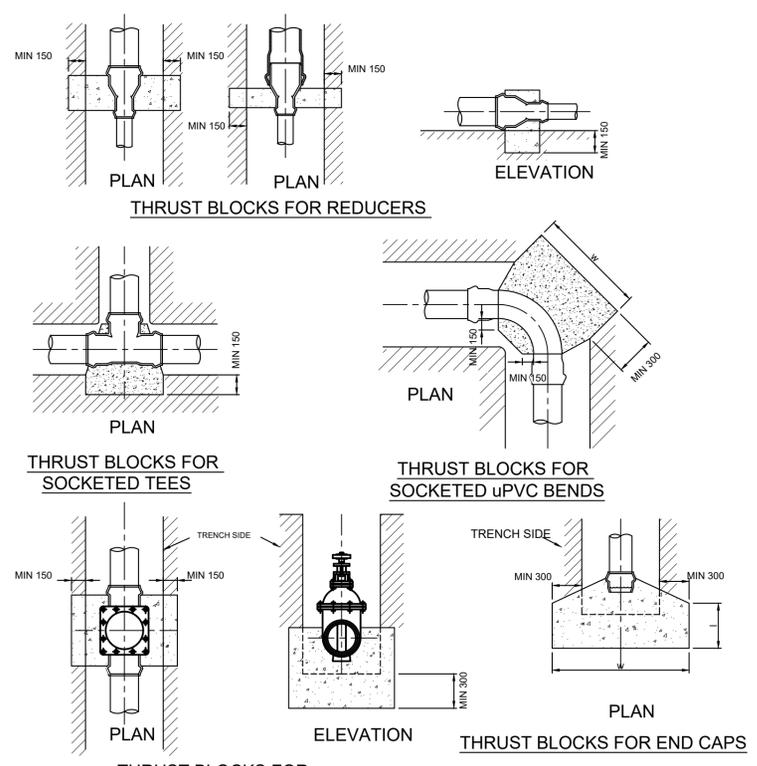

DETAILS OF ANCHOR BLOCKS
SCALE: NTS

- NOTES:**
1. ALL ANCHOR BLOCKS ARE TO BE EXTENDED ONTO THE SOCKET AREA OF THE FITTING THAT IS BEING ANCHORED AND KEYED INTO THE SIDE AND BOTTOM OF THE TRENCH.
 2. ALL CONCRETE TO BE GRADE 20/19 AND CAST AGAINST A SOLID, TRIMMED UNDISTURBED SOIL FACE.
 3. THE DIMENSIONS OF THE ANCHOR BLOCKS FOR EACH PIPE SIZE TO BE PROVIDED BY ENGINEER AT TIME OF CONSTRUCTION.

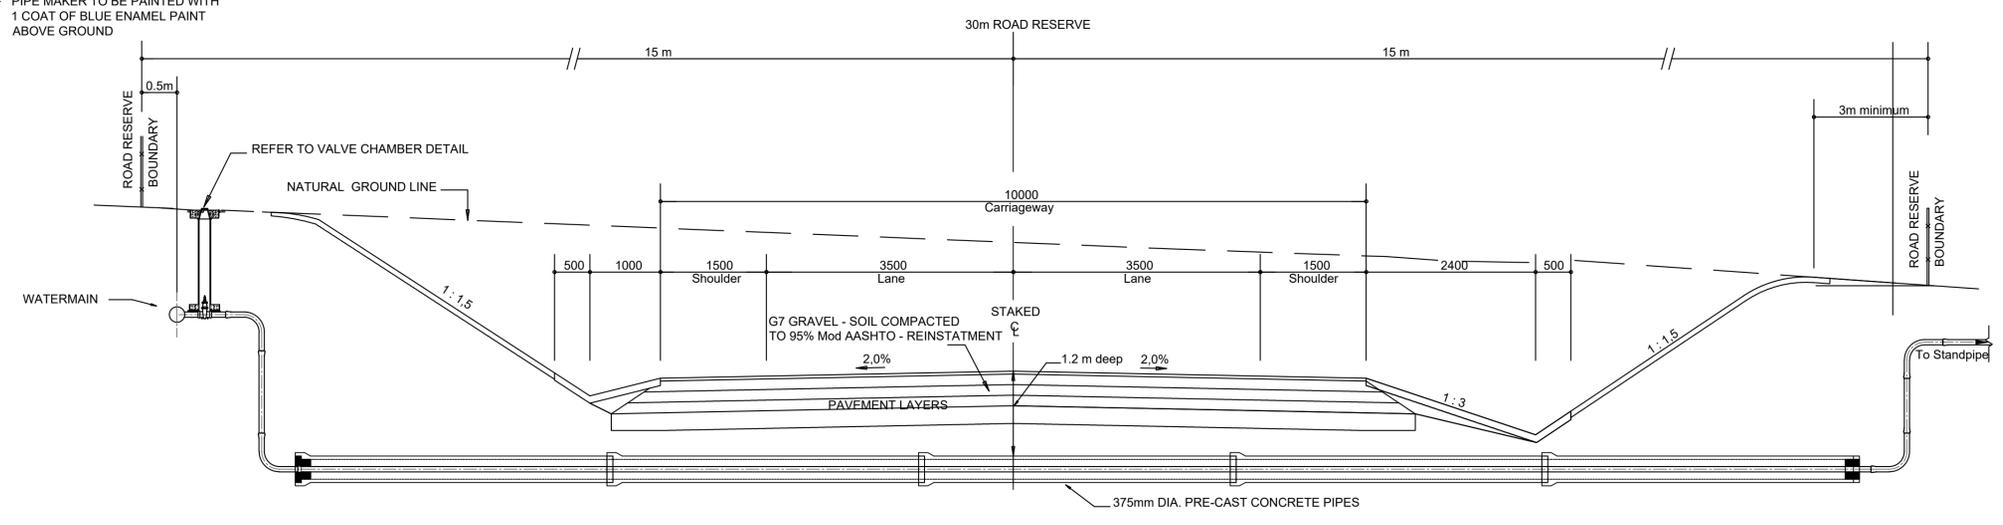

TYPICAL CROSS SECTION
SCALE: NTS

Signature by Client Department

Rev. no	Date	Description	Rev by
A	22/06/2021	REPORT	B.J

Checked by Consultant
Name: Pr. Eng. No.
Signature Date

Client:

**STAND 13,
433 KINGFISHER ROAD
MKUZE 3965**
TEL: 035 573 1536
PO BOX 449
MKUZE 3965

UMKHANYAKUDA DISTRICT MUNICIPALITY

Implementing Agent:

**SYDWALT (PTY) Ltd
2 MORRIS STREET
WOODMEAD EXT 1
2191**
TEL: 010 442 4795
info@sydwalt.co.za

Project:
WATER INTERVENTION FOR HOTSPOT AREAS IN WARD 9 AND 13 UMLABUYALINGANA LOCAL MUNICIPALITY

Drawing Description
TYPICAL DETAILS

Designed by	S.C	Date:	FEBRUARY 2023
Drawn by	B.J	Date:	FEBRUARY 2023
Checked by	D.K	Scale:	AS SHOWN
Sheet Number	R = REPORT D = DRAFT T = TENDER	P = PRELIMINARY C = CONSTRUCTION A = AS BUILT	DISCIPLINE: WATER
PROJECT	NUMBER	STATUS	REVISION
SYD23WI913	- 902 -	R	- 00