


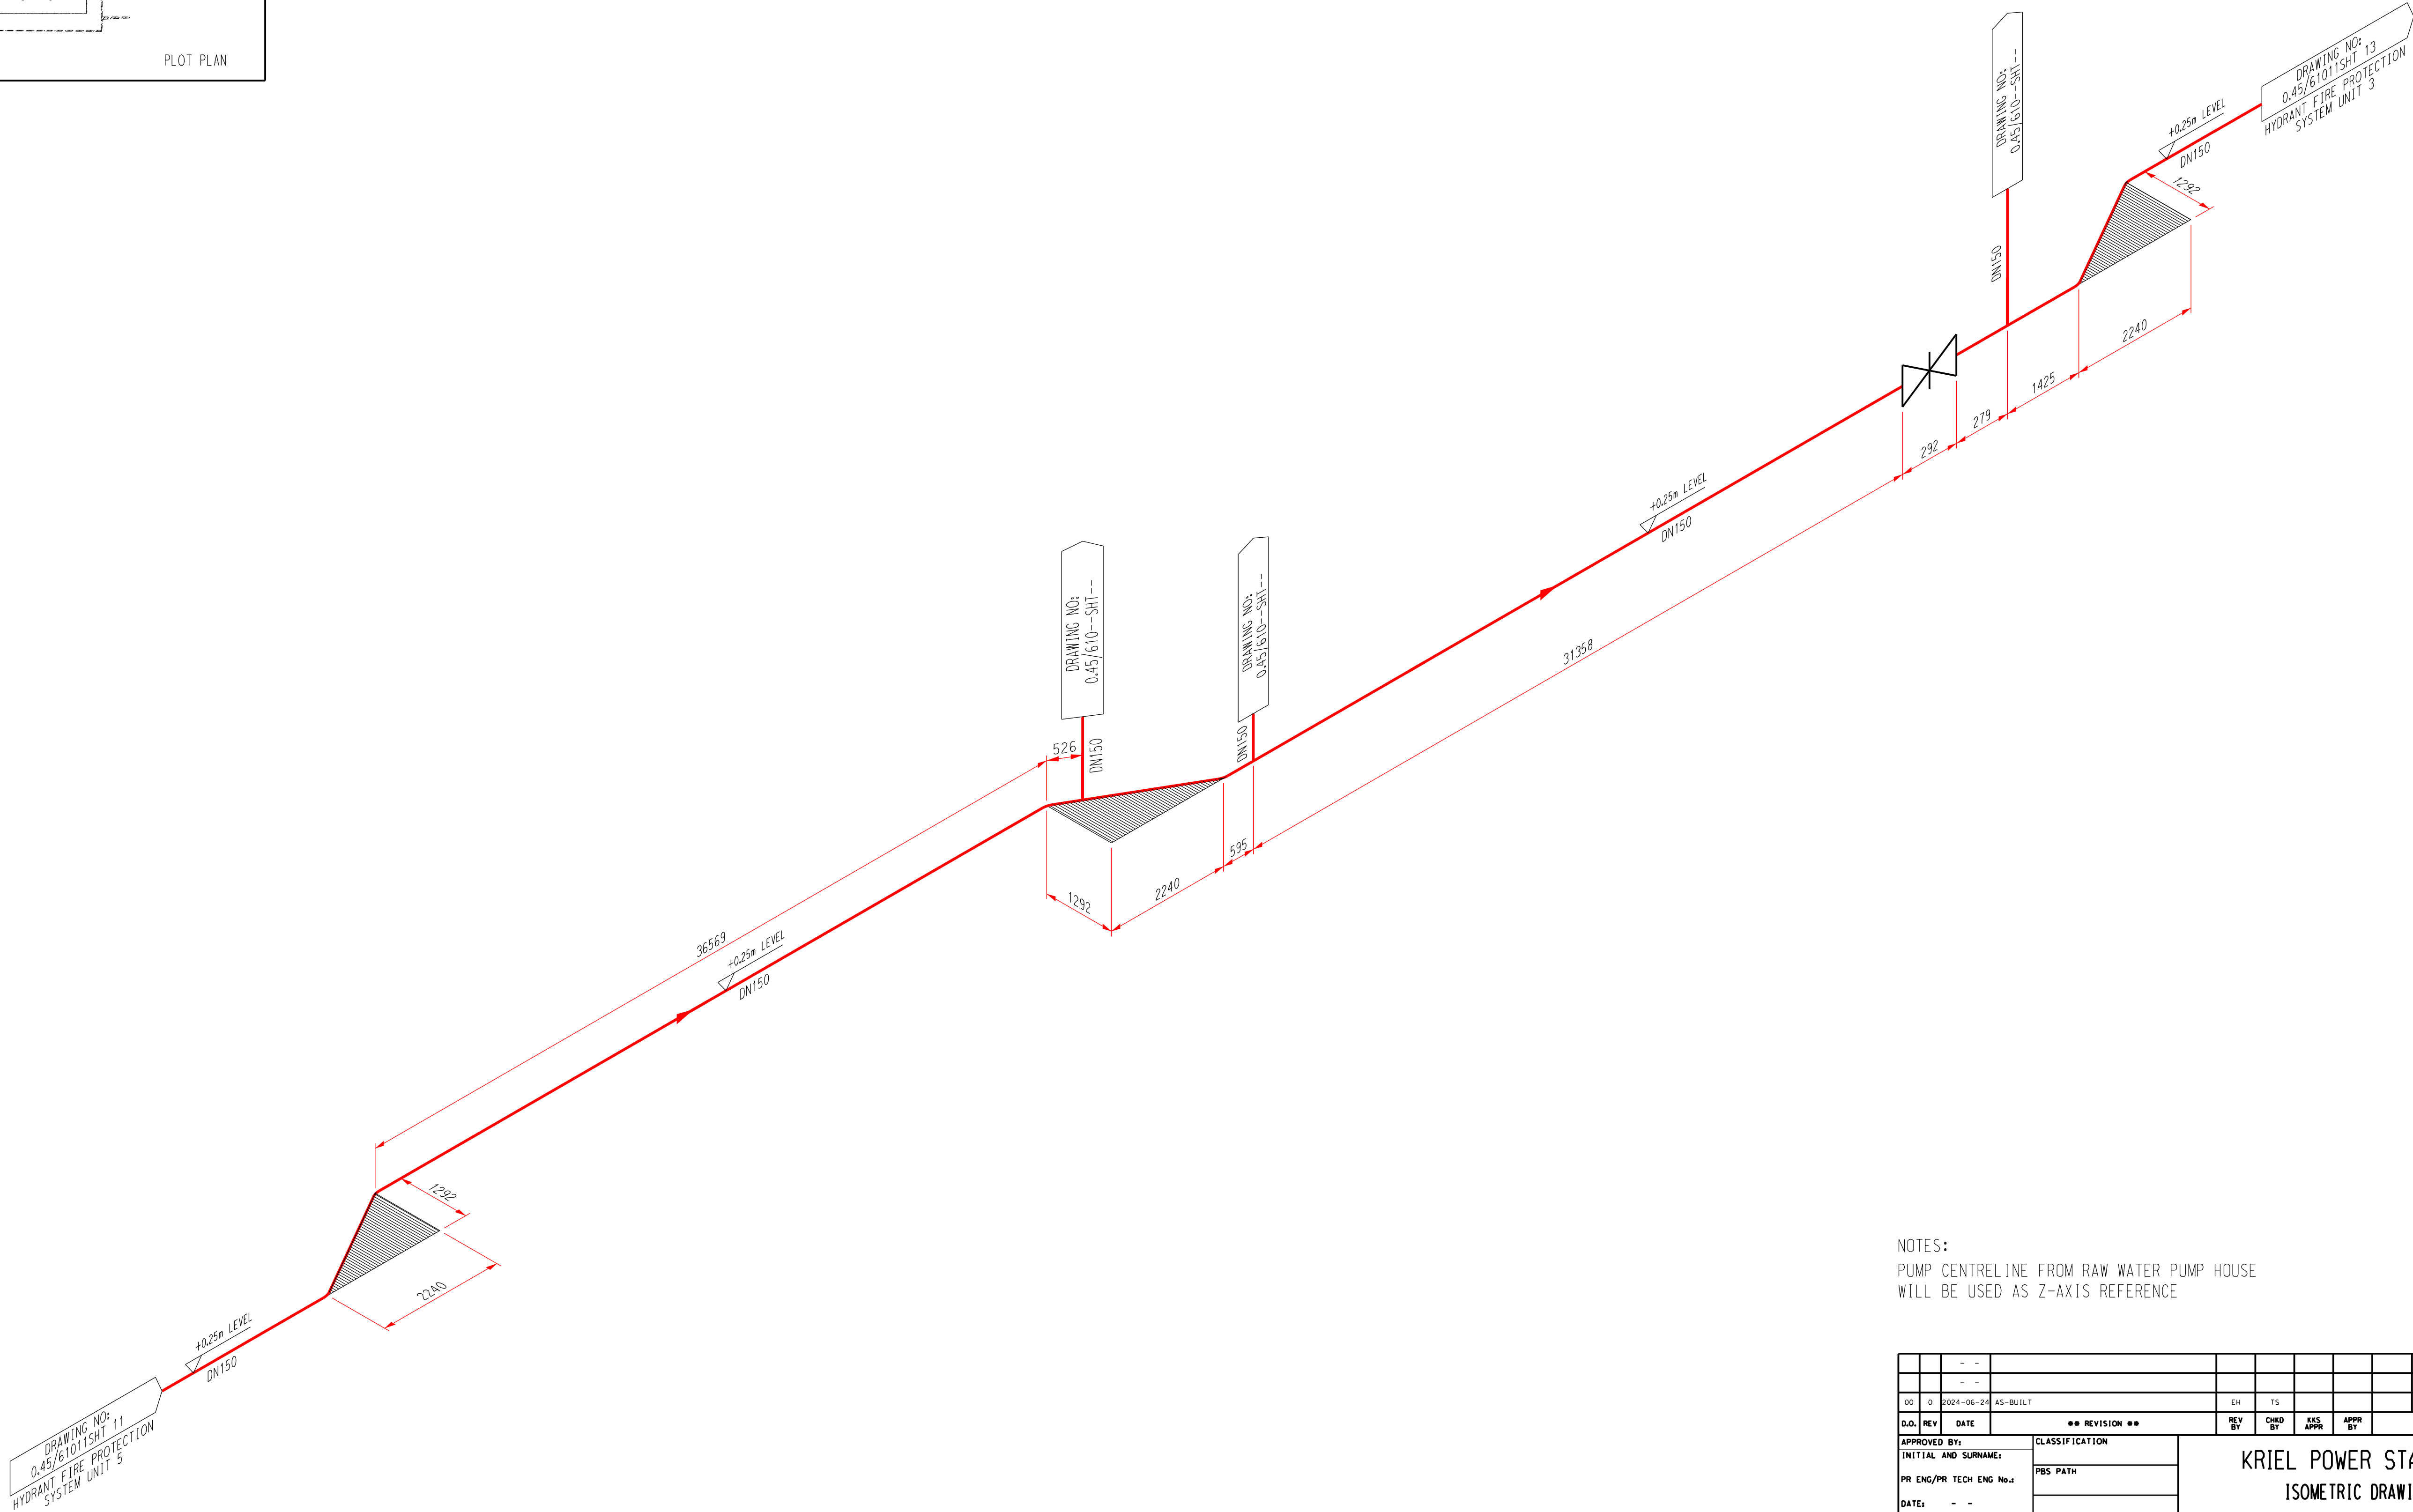

NOTES:
PUMP CENTRELINE FROM RAW WATER PUMP HOUSE
WILL BE USED AS Z-AXIS REFERENCE

[illegible]

REFERENCE DRAWINGS	
0.45/61011SHT11	HYDRANT FIRE PROTECTION SYSTEM
0.45/61011SHT13	HYDRANT FIRE PROTECTION SYSTEM