

## **Transnet Freight Rail**

an Operating Division TRANSNET SOC LTD

[Registration Number 1990/000900/30]

## **REQUEST FOR QUOTATION (RFQ) ERACMM-FDT-51150**

FOR THE SUPPLY AND INSTALL OUTDOOR EARTHING AT BROOD AND MIDPOINT 3KV DC TRACTION SUBSTATIONS UNDER THE CONTROL DEPOT ENGINEER, ERMELO

RFQ NUMBER : ERACMM-KDS-51150

ISSUE DATE : 25 APRIL 2025
COMPULSORY SITE BRIEFING DATE : 06 MAY 2025
CLOSING DATE : 13 MAY 2025
CLOSING TIME : 10h00am

TENDER VALIDITY PERIOD : 05 AUGUST 2025

## Note to the bidders:

Bidders are required to ensure that electronic bid submissions are done at least a day before the closing date to prevent issues which they may encounter due to their internet speed, bandwidth or the size of the number of uploads they are submitting. Transnet will not be held liable for any challenges experienced by bidders as a result of the technical challenges. Please do not wait for the last hour to submit. A Bidder can upload 30mb per upload and multiple uploads are permitted.

## **CONTENTS**

#### The Tender

## **Part T1: Tendering Procedures**

- Tender Notice and Invitation to Tender T1.1
- T1.2 Tender Data

#### **Part T2: Returnable Documents**

- T2.1 List of Returnable Document
- T2.2 Returnable Schedules

#### **The Contract**

## Part C1: Agreements and Contract Data

- C1.1 Form of Offer and Acceptance
- C1.2 Contract Data (Parts 1 & 2)

## Part C2: Pricing Data

- C2.1 **Pricing Instructions**
- C2.2 Price List

## Part C3: Scope of Work

C3.1 Service Information

## **Part C4: Affected Property**

C4.1 Information about the affected property at time of tender which may affect

the work in this contract.

TRANSNET

## **T1.1 TENDER NOTICE AND INVITATION TO TENDER**


## **SECTION 1: NOTICE TO TENDERERS**

## 1. INVITATION TO TENDER

Responses to this Tender [hereinafter referred to as a **Tender**] are requested from persons, companies, close corporations, or enterprises [hereinafter referred to as a Tenderer].

DESCRIPTION	For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo (service)		
TENDER DOWNLOADING	This RFQ may be downloaded directly from National Treasury's e-Tender Publication Portal at <a href="https://www.etenders.gov.za">www.etenders.gov.za</a> free of charge  To download RFQ and Annexures:  Click on "Tender Opportunities";  Select "Advertised Tenders";  In the "Department" box, select Transnet SOC Ltd.  Once the tender has been in the list, click on the 'Tender documents" tab and process to download all uploaded documents.  The RFQ may also be downloaded from the Transnet Portal at <a href="https://transnetetenders.azurewebsites.net">https://transnetetenders.azurewebsites.net</a> (please use Google Chrome to access Transnet link/site) free of charge (refer to section 2, paragraph 3 below for detailed		
COMPULSORY TENDER CLARIFICATION MEETING	A Compulsory Tender Clarification Meeting point will be at Broodsnyersplaas Mine (R35 Road) on the 06 of May 2025, at [11h00'clock] thereafter will proceed to one of the substation for physical viewing of the site.  [Tenderers to provide own transportation and accommodation].  For directions contact Nomveliswa Ndaba on 076 660 3147  For technical or commercial enquiries: Matete Kutumela by email to: matete.kutumela@transnet.net		

CPM 2020 Rev05 Page 1 of 4 Part T1: Tendering procedures T 1.1: Tender Notice and Invitation



TRANSNET

control Depot Engineer, Ermelo

	The Compulsory Tender Clarification Meeting will start punctually, and information
	will not be repeated for the benefit of Tenderers arriving late.
	A Site visit/walk will take place, tenderers are to note:
	Tenderers are required to wear safety shoes, goggles, long sleeve shirts, high
	visibility vests and hard hats.
	Tenderers without the recommended PPE will not be allowed on the site walk.
	Tenderers and their employees, visitors, clients and customers entering Transnet
	Offices, Depots, Workshops and Stores will have to undergo breathalyser testing.
	All forms of firearms are prohibited on Transnet properties and premises.
	The relevant persons attending the meeting must ensure that their identity
	documents, passports or drivers' licences are on them for inspection at the
	access control gates.
	Certificate of Attendance in the form set out in the Returnable Schedule T2.2-1
	hereto must be completed and submitted with your Tender as proof of attendance is
	required for a <b>compulsory</b> site meeting and/or tender briefing.
	Tenderers are required to bring this Returnable Schedule T2.2-1 to the
	Compulsory Tender Clarification Meeting to be signed by the Employer's
	Representative.
	Tenderers failing to attend the compulsory tender briefing will be disqualified.
	10:00am on (13 May 2025)
CLOSING DATE	Tenderers must ensure that tenders are uploaded timeously onto the system.
	If a tender is late, it will not be accepted for consideration.

#### 2. TENDER SUBMISSION

Transnet has implemented a new electronic tender submission system, the e-Tender Submission Portal, in line with the overall Transnet digitalization strategy where suppliers can view advertised tenders, register their information, log their intent to respond to bids and upload their bid proposals/responses on to the system.

a) The Transnet e-Tender Submission Portal can be accessed as follows:

Log on to the Transnet eTenders management platform website (https://transnetetenders.azurewebsites.net);

- Click on "ADVERTISED TENDERS" to view advertised tenders.
- Click on "SIGN IN/REGISTER for bidder to register their information (must fill in all mandatory information).
- Click on "SIGN IN/REGISTER" to sign in if already registered.

Part T1: Tendering procedures T 1.1: Tender Notice and Invitation

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the

control Depot Engineer, Ermelo

Toggle (click to switch) the "Log an Intent" button to submit a bid.

Submit bid documents by uploading them into the system against each tender selected.

Tenderers are required to ensure that electronic bid submissions are done at least a day before the closing date to prevent issues which they may encounter due to their internet speed, bandwidth or the size of the number of uploads they are submitting. Transnet will not be held liable for any challenges experienced by bidders as a result of the technical

TRANSNET

challenges. Please do not wait for the last hour to submit. A Tenderer can upload 30mb per

upload and multiple uploads are permitted.

b) The tender offers to this tender will be opened as soon as possible after the closing date and time.

Transnet shall not, at the opening of tenders, disclose to any other company any confidential details

pertaining to the Tender Offers / information received, i.e. pricing, delivery, etc. The names and

locations of the Tenderers will be divulged to other Tenderers upon request.

c) Submissions must not contain documents relating to any Tender other than that shown on the

submission.

3. CONFIDENTIALITY

All information related to this RFQ is to be treated with strict confidentiality. In this regard Tenderers are required to certify that they have acquainted themselves with the Non-Disclosure Agreement. All information related to a subsequent contract, both during and after completion thereof, will be treated with

strict confidence. Should the need however arise to divulge any information gleaned from provision of the

Works, which is either directly or indirectly related to Transnet's business, written approval to divulge such

information must be obtained from Transnet.

4. DISCLAIMERS

Tenderers are hereby advised that Transnet is not committed to any course of action as a result of its

issuance of this Tender and/or its receipt of a tender offer. In particular, please note that Transnet reserves

the right to:

4.1. Award the business to the highest scoring Tenderer/s unless objective criteria justify the award

to another tenderer.

4.2. Not necessarily accept the lowest priced tender or an alternative Tender.

4.3. Go to the open market if the quoted rates (for award of work) are deemed unreasonable.

4.4. Should the Tenderers be awarded business on strength of information furnished by the Tenderer,


which after conclusion of the contract is proved to have been incorrect, Transnet reserves the

right to terminate the contract.

4.5. Request audited financial statements or other documentation for the purposes of a due diligence

exercise.

Part T1: Tendering procedures T 1.1: Tender Notice and Invitation



TRANSNET

- 4.7. Verify any information supplied by a Tenderer by submitting a tender, the Tenderer/s hereby irrevocably grant the necessary consent to the Transnet to do so.
- 4.8. Conduct the evaluation process in parallel. The evaluation of Tenderers at any given stage must therefore not be interpreted to mean that Tenderers have necessarily passed any previous stage(s).
- 4.9. Unless otherwise expressly stated, each tender lodged in response to the invitation to tender shall be deemed to be an offer by the Tenderer. The Employer has the right in its sole and unfettered discretion not to accept any offer.
- 4.10. Not be held liable if tenderers do not provide the correct contact details during the clarification session and do not receive the latest information regarding this RFQ with the possible consequence of being disadvantaged or disqualified as a result thereof.
- 4.11. Transnet reserves the right to exclude any Tenderers from the tender process who has been convicted of a serious breach of law during the preceding 5 [five] years including but not limited to breaches of the Competition Act 89 of 1998, as amended. Tenderers are required to indicate in tender returnable on [T2.2.17], [Breach of Law] whether or not they have been found guilty of a serious breach of law during the past 5 [five] years.
- 4.12. Transnet reserves the right to perform a risk analysis on the preferred tenderer to ascertain if any of the following might present an unacceptable commercial risk to the employer:
  - unduly high or unduly low tendered rates or amounts in the tender offer:
  - contract data of contract provided by the tenderer; or
  - the contents of the tender returnable which are to be included in the contract.
- 5. Transnet will not reimburse any Tenderer for any preparatory costs or other work performed in connection with this Tender, whether or not the Tenderer is awarded a contract.

#### 6. NATIONAL TREASURY'S CENTRAL SUPPLIER DATABASE

Tenderer are required to self-register on National Treasury's Central Supplier Database (CSD) which has been established to centrally administer supplier information for all organs of state and facilitate the verification of certain key supplier information. The CSD can be accessed at https://secure.csd.gov.za/. Tenderer are required to provide the following to Transnet in order to enable it to verify information on the CSD:

Supplier	Number	and	Unique	registration	reference
number					

Transnet urges its clients, suppliers and the general public to report any fraud or corruption to

TIP-OFFS ANONYMOUS: 0800 003 056 OR Transnet@tip-offs.com

rage T or



The conditions of tender are the Standard Conditions of Tender as contained in Annex C of the CIDB Standard for Uniformity in Engineering and Construction Works Contracts. The Standard for Uniformity in Construction Procurement was first published in Board Notice 62 of 2004 in Government Gazette No 26427 of 9 June 2004. It was subsequently amended in Board Notice 67 of 2005 in Government Gazette No 28127 of 14 October 2005, Board Notice 93 of 2006 in Government Gazette No 29138 of 18 August 2006, Board Notice No 9 of 2008 in Government Gazette No 31823 of 30 January 2009, Board Notice 86 of 2010 in Government Gazette No 33239 of 28 May 2010, Board Notice 136 of 2015 in Government Gazette 38960 of 10 July 2015 and Board Notice 423 of 2019 in Government Gazette No 42622 of 8 August 2019.

This edition incorporates the amendments made in Board Notice 423 of 2019 in Government Gazette 42622 of 8 August 2019. (see <a href="https://www.cidb.org.za">www.cidb.org.za</a>).

The Standard Conditions of Tender make several references to Tender data for detail that apply specifically to this tender. The Tender Data shall have precedence in the interpretation of any ambiguity or inconsistency between it and the Standard Conditions of Tender.

Each item of data given below is cross-referenced in the left-hand column to the clause in the Standard Conditions of Tender to which it mainly applies.

Clause	Data		
C.1.1	The Employer is	Transnet SOC Ltd (Reg No. 1990/000900/30)	
C.1.2	The tender documents issued by the Employ	ver comprise:	
	Part T: The Tender		
	Part T1: Tendering procedures	T1.1 Tender notice and invitation to tender T1.2 Tender data	
	Part T2: Returnable documents	T2.1 List of returnable documents T2.2 Returnable schedules	
	Part C: The contract		
	Part C1: Agreements and contract data	C1.1 Form of offer and acceptance C1.2 Contract data (Part 1 & 2)	
	Part C2: Pricing data	C2.1 Pricing instructions: Options A C2.2 Price List	
	Part C3: Scope of work	C3.1 Service Information	
	Part C4: Affected Property	C4.1 Affected Property	

Part 1: Tendering Procedures T1.2: Tender Data

TRANSNET

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the

control Depot Engineer, Ermelo

C.1.4	The Employer's agent is:	Procurement Practitioner / Procurement Manager
	Name:	Matete Kutumela / Yvonne Scannell
	Address:	Transnet Freight Rail Corner of Paul Kruger and Minnaar street Pretoria 0002
	Tel No.	012 315 2268 / 315 2059
	E – mail	matete.kutumela@transnet.net yvonne.scannell@transnet.net

C.2.1 Only those tenderers who satisfy the following eligibility criteria are eligible to submit tenders:

#### 1. Stage One - Eligibility with regards to attendance at the compulsory clarification meeting:

An authorised representative of the tendering entity or a representative of a tendering entity that intends to form a Joint Venture (JV) must attend the compulsory clarification meeting in terms C2.7

#### Eligibility in terms of the Construction Industry Development Board:

- a) Only those tenderers who are registered with the CIDB or are capable of being so prior to the evaluation of submissions, in a contractor grading designation equal to or higher than a contractor grading designation determined in accordance with the sum tendered or a value determined in accordance with Regulation 25 (1B) or 25(7A) of the Construction Industry Development Regulations, designation of 2 EP or higher class of construction work, are eligible to have their tenders evaluated.
- b) Joint Venture (JV)

Joint ventures are eligible to submit tenders subject to the following:


- 1. every member of the joint venture is registered with the CIDB;
- the lead partner has a contractor grading designation of not lower than one level below the required class of construction works under consideration and possesses the required recognition status; and
- 3. the combined Contractor grading designation calculated in accordance with the Construction Industry Development Regulations is equal to or higher than a Contractor grading designation determined in accordance with the sum tendered for a 2 EP or higher class of construction work or a value determined in accordance with Regulation 25(1B) or 25(7A) of the Construction Industry Development Regulations
- 4. The tenderer shall provide a certified copy of its signed joint venture agreement.

## 2. Stage Three - Functionality:

- a) Evaluation schedule: T2.2-2 Service Plan in two weeks
- b) Evaluation schedule: T2.2-3 Availability of plant and equipment
- c) Evaluation schedule: T2.2-4 Previous Experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations

T1.2: Tender Data

TRANSNET




TRANSNET

Part 1: Tendering Procedures

T1.2: Tender Data

	Only those tenderers who obtain the minimum qualifying score for functionality will be evaluated further in terms of price and the applicable preference point system. The minimum qualifying for score for functionality is 70 points.		
	The evaluation criteria for measuring functionality and the points for each criteria and, if any, each sub-criterion is as stated in C.3.11.3 below.		
	Any tenderer that fails to meet the stipulated eligibility criteria will be regarded as an unacceptable tender.		
C.2.7	The arrangements for a compulsory clarification meeting are as stated in the Tender Notice and Invitation		
	to Tender. <b>Tenderers must complete and sign the attendance register.</b> Addenda will be issued to and		
	tenders will only be received from those tendering entities including those entities that intends forming a		
	joint venture appearing on the attendance register.		
	Tenderers are also required to bring their RFQ document to the briefing session and have their		
	returnable document T2.2-1 certificate of attendance signed off by the Employer's authorised		
	representative.		
C.2.13.3	Each tender offer shall be in the <b>English Language</b> .		
C.2.13.5 C2.15.1	The <i>Employer</i> 's details and identification details that are to be shown on each tender offer package are as follows:		
	Identification details: The tender documents must be uploaded with:		
	<ul> <li>Name of Tenderer: (insert company name)</li> <li>Contact person and details: (insert details)</li> </ul>		
	The Tender Number:		
	■ The Tender Description		
	Documents must be marked for the attention of: <i>Employer's</i> Agent: Michael Ramusandiwa		
C.2.13.9	Telephonic, telegraphic, facsimile or e-mailed tender offers will not be accepted.		
C.2.15	The closing time for submission of tender offers is:		
	Time: 10:00am on the 13 May 2025 Location: The Transnet e-Tender Submission Portal: ( <a href="https://transnetetenders.azurewebsites.net">https://transnetetenders.azurewebsites.net</a> );		
	NO LATE TENDERS WILL BE ACCEPTED		
C.2.16	The tender offer validity period is <b>12 weeks</b> after the closing date. Tenderers are to note that they may be requested to extend the validity period of their tender, on the same terms and conditions, if Transnet's internal evaluation and governance approval processes has not been finalised within the validity period.		
C.2.23	The tenderer is required to submit with his tender:  1. A valid Tax Clearance Certificate issued by the South African Revenue Services. Tenderers also to provide Transnet with a TCS PIN to verify Tenderer's compliance status.		
	2. A <b>valid B-BBEE Certificate</b> from a Verification Agency accredited by the South African Accreditation System [ <b>SANAS</b> ], or a <b>sworn affidavit</b> confirming annual turnover and level of black ownership in case		



TRANSNET

control Depot Engineer, Ermelo

of all EMEs and QSEs with 51% black ownership or more together with the tender.

- 3. A valid CIDB CRS number in the correct designated grading.
- 4. Proof of registration on the Central Supplier Database.
- 5. Letter of Good Standing with the Workmen's compensation fund by the tendering entity or separate Letters of Good Standing from all members of a newly constituted JV.

Note: Refer to Section T2.1 for List of Returnable Documents

C3.11 The minimum number of evaluation points for functionality is **70 points** 

The procedure for the evaluation of responsive tenders is Functionality, Price, and Preference:

Only those tenderers who attain the minimum number of evaluation points for Functionality will be eligible for further evaluation, failure to meet the minimum threshold will result in the tender being disqualified and removed from any further consideration.

#### **Functionality Criteria**

The functionality criteria and maximum score in respect of each of the criteria are as follows:

(Functionality criteria)	Sub- criteria	Maximum number of points
Evaluation schedule: T2.2.2 Service Plan in two weeks		30
Evaluation scheduled: T2.2.3 Availability of plant and equipment		30
Evaluation scheduled: T2.2-4 Previous Experience supply, delivery, and installation of outdoor earthing at 3kv Traction substations		40
Maximum possible score for Functionality		100

Functionality shall be scored independently by not less than 3 (three) evaluators and averaged in accordance with the following schedules:

- Evaluation schedule: T2.2-2 Service Plan in two weeks
- Evaluation schedule: T2.2.3 Availability of plant and equipment
- Evaluation schedule: T2.2.4 Previous Experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations

Each evaluation criteria will be assessed in terms of scores of 0, 40,70, 90 & 100

The scores of each of the evaluators will be averaged, weighted and then totalled to obtain the final score for functionality, unless scored collectively. (See CIDB Inform Practice Note #9).

Note: Any tender not complying with the above-mentioned requirements, will be regarded as nonresponsive and will therefore not be considered for further evaluation. This note must be read in conjunction with Clause C.2.1.

> Page 4 of 7 Part 1: Tendering Procedures T1.2: Tender Data



control Depot Engineer, Ermelo

C.3.11. Only tenders that achieve the minimum qualifying score for functionality will be evaluated in further in accordance with the 80/20 preference points systems as described in Transnet Preferential Procurement Regulations.

80 where the financial value of one or more responsive tenders received have a value equal to or below R50 million, inclusive of all applicable taxes.

TRANSNET

Thresholds	Minimum Threshold	
Functionality	70	

Evaluation Criteria	Final Weighted Scores
Price	80
Specific Goals	20
TOTAL SCORE:	100

Up to 100 minus W<sub>1</sub> tender evaluation points will be awarded to tenderers who complete the preferencing schedule and who are found to be eligible for the preference claimed.

Should the evidence require for any of the Specific Goals applicable in this tender not be provided, a tenderer will score zero preference points for that particular "Specific Goal".

In terms of Transnet Preferential Procurement Regulations (TPPR) and Procurement Manuals, the following preference points must be awarded to a bidder who provides the relevant required evidence for claiming points.

Selected Specific Goals	Number of points allocated (80/20)
B-BBEE Level of contributor (1 or 2)	10
+50% Black Youth Owned Entities	10
Non-Compliant and/or B-BBEE Level 3-8 contributors	0

The following Table represents the evidence to be submitted for claiming preference. points for applicable specific goals in a particular tender:

Specific Goals	Acceptable Evidence
B-BBEE Level 1	B-BBEE Certificate / Sworn-Affidavit B-BBEE Certificate (in case of JV, a
or 2	consolidate scorecard will be accept) as per DTIC guidelines
+50% Black	Certified copy of ID Documents of the Owners and B-BBEE Certificate / Sworn-
Youth Owned	Affidavit / B-BBEE CIPC Certificate (in case of JV, a consolidated scorecard will be
Entities	accepted) as per DTIC guideline

Page 5 of 7 Part 1: Tendering Procedures T1.2: Tender Data

The maximum points for this bid are allocated as follows:

DISCRIPTION	POINTS
PRICE	80
Specific Goals	20
Total points for Price and Specific Goals must not exceed	100

**Note:** Transnet reserves the right to carry out an independent audit of the tenderer's scorecard

components at any stage from the date of close of the tenders until completion

of the contract.at any stage from the date of close of the tenders until completion of the contract.

## C.3.13 Tender offers will only be accepted if:

- 1. The tenderer or any of its directors/shareholders is not listed on the Register of Tender Defaulters in terms of the Prevention and Combating of Corrupt Activities Act of 2004 as a person prohibited from doing business with the public sector.
- 2. the tenderer does not appear on Transnet's list for restricted tenderers and National Treasury's list of Tender Defaulters.
- 3. the tenderer has fully and properly completed the Compulsory Enterprise Questionnaire and there are no conflicts of interest which may impact on the tenderer's ability to perform the contract in the best interests of the Employer or potentially compromise the tender process and persons in the employ of the state.
- 4. Transnet reserves the right to award the tender to the tenderer who scores the highest number of points overall, unless there are objective criteria which will justify the award of the tender to another tenderer. Objective criteria include but are not limited to the outcome of a due diligence exercise to be conducted. The due diligence exercise may take the following factors into account inter alia.

the tenderer:

- a) is not under restrictions, or has principals who are under restrictions, preventing participating in the employer's procurement,
- b) is not undergoing a process of being restricted by Transnet or other state institution that Transnet may be aware of,
- c) can, as necessary and in relation to the proposed contract, demonstrate that he or she possesses the professional and technical qualifications, professional and technical competence, financial resources, equipment and other physical facilities, managerial capability, reliability, experience and reputation, expertise and the personnel, to perform the contract,
- d) has the legal capacity to enter into the contract,
- e) is not insolvent, in receivership, under Business Rescue as provided for in chapter 6 of the Companies Act, 2008, bankrupt or being wound up, has his affairs administered by a court or a judicial officer, has suspended his business activities, or is subject to legal proceedings in respect of any of the foregoing,

T1.2: Tender Data

TRANSNET

Transnet Rail Infrastructure Manager

Tender Number: ERACMM-FDT-51150
Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

	f) complies with the legal requirements, if any, stated in the tender data and
	g) is able, in the option of the employer to perform the contract free of conflicts of interest.
C.3.17	The number of paper copies of the signed contract to be provided by the Employer is 1 (one).

T1.2: Tender Data



# T2.1 List of Returnable Documents

## 2.1.1 These schedules are required for eligibility purposes:

T2.2.1 Stage One as per CIDB: Eligibility Criteria Schedule - Certificate of attendance at

Compulsory Tender Clarification Meeting and Site Meeting (fully completed and signed by Transnet official.)

NB: Any tenderer that fails to meet the above stipulated eligibility criteria will be regarded as an unacceptable tender.

## 2.1.2 These schedules will be utilised for evaluation purposes:

- Evaluation schedule: T2.2-2 Service Plan in two weeks
- Evaluation schedule: T2.2.3 Availability of plant and equipment relevant for the service
- Evaluation schedule: T2.2.4 Previous Experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations

#### T2.2 List of Returnable Schedules

#### 2.1.3 Returnable Schedules:

#### General:

- T2.2-5 Health and Safety Questionnaire
- T2.2-6 Health and Safety Cost Breakdown
- T2.2-7 Management of CV's of key personnel and qualifications
- T2.2-8 Authority to submit tender
- T2.2-9 Record of addenda to tender documents
- T2.2-10 Letter of Good Standing
- T2.2-11 Risk Elements
- T2.2-12 Schedule of proposed Subcontractors
- T2.2-13 Affected property Establishment requirements



## **Agreement and Commitment by Tenderer:**

- T2.2-14 CIDB SFU ANNEX G Compulsory Enterprise Questionnaire
  - Valid proof of Respondent's compliance to Specific Goals evidence (Preference Claim Form) requirements stipulated in SBD6.1.


T2.2-15	Non-Disclosure Agreement
T2.2-16	RFQ Declaration Form
T2.2-17	RFQ – Breach of Law
T2.2-18	Certificate of Acquaintance with Tender Document
T2.2-19	Service Provider Integrity Pact
T2.2-20	POPI Act form

#### 1.3.2 Bonds/Guarantees/Financial/Insurance:

- T2.2-21 Insurance provided by the Contractor
- T2.2-22 Three (3) years audited financial statements

## 1.3.3 Transnet Vendor Registration Form:

- T2.2-23 Transnet Vendor Registration Form
- 2.2 C1.1 Offer portion of Form of Offer & Acceptance
- 2.3 C1.2 Contract Data Part Two (Data by Contractor)
- 2.4 C2.2 Price List





Substations under the control Depot Engineer, Ermelo

SBD 6.

# T2.2-1: Eligibility Criteria Schedule:

Certificate of Attendance at Tender Clarification Meeting					
This is to certify	that				
					(Company Name)
Represented by:					(Name and Surname)
Was represente	d at the compulsory tender clarific	atio	n meeting		
Held at:					
On (date)	Starting time:				
Particulars of	person(s) attending the meeti	ng:			
Name			Signature		
Capacity					
Attendance of	the above company at the me	etir	ng was confirn	ned:	
Name			Signature		
	For and on Behalf of the Employers Agent.		Date		

Tender Number: ERACMM-KDS-51150

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo



#### T2.2-2 Evaluation schedule - Service plan

#### Note to tenderers:

#### Programme

The Tenderer details the programme for evaluation and attaches it to this schedule. In addition, the Tenderer is to provide an electronic copy of the programme in Ms Word or any other compatible software.

The tenderer shall provide the proposed programme, (showing but not limited to the following:


- Ability to execute the works in terms of the Employer's requirements and within the required timeframe indicating, in a logical sequence, the order and timing of the construction that will take place in order to Provide the Works clearly indicating the capacity & capability to achieve the dates stated in the Contract Data.
- Dates when the Contractor will need access to any part of the Site; submission & approval process & timing for Health & Safety Files, Environmental Files and Quality Files. In addition the Program must clearly demonstrate the procurement process for all long lead items if applicable.
- The Contractor indicates how he plans in achieving the following dates and clearly demonstrates them on the schedule - Start Date, Access Date, Planned Completion, Key Dates/Sectional Completion Dates & Completion Date. In addition, the Program clearly demonstrates adequate provisions for Time Risk Allowance (TRA). Time Risk Allowances are not float, are owned by the Tenderer, can be included in the activity duration and illustrated in the schedule in a code field or as an attachment.

1. Index of documentation attached to this schedule:

#### Note to tenderers:

Tenderer must provide an electronic copy of the Gantt Chart in Ms Word or any other compatible software.

The table above is for information purposes only to indicate the method of scoring that will be followed to evaluate the service plan submitted by the Tenderer



Substations under the control Depot Engineer, Ermelo



## The scoring of the Service plan for 2 weeks will be as follows:

Total Score	Evaluation Criteria – Service Plan
30 points	
	Ability to execute the works in terms of the Employer's requirements and within the required timeframe indicating, in a logical sequence, the order and timing of the construction that will take place in order to Provide the Services clearly indicating the capacity & capability to achieve the dates stated in the Contract Data.
	Dates when the Contractor will need access to site and/or persons and/or information, as well as submission approval process and timing for Health & Safety Files.
	The Program must be fully Resource Loaded, including, People, Equipment, Plant and Materials & Other Resources, but excluding Cost).
	Indication of time frame
Score 0	Did not submit any proof of service plan
Score 40	Contractor has indicated service plan of > 5 weeks
Score 70	Contractor has indicated service plan of > 4 - ≤ 5 weeks
Score 90	Contractor has indicated service plan of > 3 - ≤ 4 weeks
Score 100	Contractor has indicated service plan of ≤ 2 weeks
	NB: If the above information not provided, it will have a negative influence on your technical evaluation scoring

Signed	Date
Name	Position
Tenderer	

Tender Number: ERACMM-KDS-51150

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo




Tenderers to submit a list of all Equipment and other resources that he proposes to use to execute the work as described in the service information as well as the availability and details of ownership for each item. The following minimum list of equipment is required:

- Multi-meter test leads
- Generator
- Toolbox
- Grinder
- Drilling machine
- Crane truck with certified operator
- Stepladder
- Crimping machine (must have capacity to crimp 500mm<sup>2</sup> cable)
- Shovel
- **Picks**

Number of Equipment	List of Plant and Equipment – Description	Hourly Rate

The table below is for information purposes only to indicate the method of scoring that will be followed to evaluate the Availability of Plant & Equipment and Other Resources submitted by the Tenderer:

TRANSNET








Scoring will be as follows;

Total Score	Availability of Plant & Equipment and Other Resources		
30 Points			
Score 0	0 = No proof of plant and equipment specified		
Score 40	Contractor has listed (1 - 2) of required plant and equipment as per requirements in the RFQ		
Score 70	Contractor has listed (3 – 5) of plant and equipment is available as per requirements in the RFQ		
Score 90	Contractor has listed (6 - 8) of plant and equipment is available as per requirements in the RFQ		
Score 100	Contractor has listed (9 - 10) of plant and equipment is available as per requirements in the RFQ		

Signed	Date	
Name	Position	
Tenderer		



Substations under the control Depot Engineer, Ermelo



# T2.2-4 Evaluation Schedule- Previous experience to install outdoor earthing in 3kv Traction substations:

#### Note to tenderers:

Tenderers are required to demonstrate performance in comparable projects of similar size and nature by supplying the following:

- A list of past / current comparable projects.
- Construction of similar works as detailed in the Service Information with reference to:
  - Previous experience in installation of outdoor earthing at UMID and UBSX 3kv substation substations.
- Sufficient references to substantiate experience indicated (Client name and contact details, project description, duration and contract value)

Client	Client contact details	Project Description	Year of project completion	Contract Value	Subcontractors
NB: If the a	above information n	not provided, it will have	a negative influen	ce on your te	 chnical evaluation

The table below is for information purposes only to indicate the method of scoring that will be followed to evaluate the previous experience submitted by the Tenderer



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

<b>Previous Experienc</b>	e to install out	door earthing a	at 3kv traction s	substations = 40	points

0 = Did not submit any proof of award and Purchase order to supply, delivery, and installation of outdoor earthing at 3kv Traction substations


40 = Contractor has experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations and completed (0 -2) projects and submitted previous PO's/appointment letter and/or completion certificates

70 = Contractor has experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations and completed three (3) projects and submitted previous PO's/appointment letter and/or completion certificates

90 = Contractor has experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations and completed four (4) projects and submitted previous PO's/appointment letter and/or completion

100 = Contractor has experience to supply, delivery, and installation of outdoor earthing at 3kv Traction substations and completed five (5) projects and submitted previous PO's/appointment letter and/or completion

Signed	Date
Name	Position
Tenderer	





Substations under the control Depot Engineer, Ermelo



1.	SAFE WORK PERF	ORMANCE				
1A.	Injury Experience / H	istorical Performand	e - All	berta		
Use t	he previous three yea	rs injury and illne	ss rec	ords to complet	e the following:	
Year						
	er of medical treatmen					
Numb	er of restricted workdage	y cases				
	er of lost time injury ca	ses				
Numb	er of fatal injuries					
Total	recordable frequency	,				
Lost t	ime injury frequency					
Numb	er of worker manhours					
					•	
1 - Me	edical Treatment	Any occupational	injury	or illness requirin	g treatment provide	ed by a
	Case				e direction of a phy	
2 – R	estricted Workday			•	vents a worker from	m performing
	Case	any of his/her craf	•			
3 – Lo	ost Time injury Cases			that prevents the	worker from perfor	ming any work
		for at least one da	•			
4 – To	otal Recordable				ricted Work and Lo	
	Frequency		-		by total manhours	
5- Los	st Time Injury		ost Tir	me Injury cases m	nultiplied by 200,00	0 then divide by
4.5	Frequency	total manhours				
1B.	Workers' Compensa	tion Experience				
Use t	he previous three yea	rs injury and illne	ss rec	ords to complet	e the following (if	applicable):
	Industry Code:		Indu	stry Classification	:	
Year						
Indus	try Rate					
Contr	actor Rate					
	count or Surcharge					
•	ır Workers' Compensat	ion account in good	l	Yes		
stand		irmation)		☐ No		
(Flea	se provide letter of conf	iiiialioii)				
2.	CITATIONS					
2A.	Has your company bee	en cited, charged o	r pros	ecuted under Hea	lth. Safetv and/or	Environmental
	Legislation in the last 5	_			,	
	☐ Yes ☐ No	•				
	If yes, provide details:					
ļ						

TRANSNET





2B.		, charged	d or pro	secuted under the above Legisla	tion in anoth	ner
	Country, Region or State?					
	If yes, provide details:					
	ii yes, provide details.					
3.	CERTIFICATE OF RECOGN					
	Does your company have a Co			ognition? · No Issue D	ate	
	res no ii res, what i	S life Ce	Tillicate	100155ue D	ale	
•						
4.	SAFETY PROGRAM		1/			
	Do you have a written safety p If Yes, provide a copy for revie	-	manual	? □	Yes	☐ No
	Do you have a pocket safety b		r field d	listribution?	Yes	□No
	If Yes, provide a copy for revie		i iicia a		103	□ 140
	Does your safety program con		ollowing	g elements?		
	, , , ,	YES	No		YES	No
Cori	PORATE SAFETY POLICY			EQUIPMENT MAINTENANCE		
INCID	ENT NOTIFICATION POLICY			EMERGENCY RESPONSE		
RECO	ORDKEEPING & STATISTICS			HAZARD ASSESSMENT		
REFE	RENCE TO LEGISLATION			SAFE WORK PRACTICES		
GENE	ERAL RULES & REGULATIONS			SAFE WORK PROCEDURES		
Prod	GRESSIVE DISCIPLINE POLICY			WORKPLACE INSPECTIONS		
RESF	PONSIBILITIES			Investigation Process		
PPE	STANDARDS			TRAINING POLICY & PROGRAM		
Envi	RONMENTAL STANDARDS			COMMUNICATION PROCESSES		
Mod	FIED WORK PROGRAM					
5.	TRAINING PROGRAM					
5A.	Do you have an orientation p	rogram fo	or new l	hire employees?	☐ No	
	If Yes, include a course outlin	ne. Does	it includ	de any of the following:		
		YES	No		YES	No
GENE	ERAL RULES & REGULATIONS			CONFINED SPACE ENTRY		
Емея	RGENCY REPORTING			TRENCHING & EXCAVATION		
INJUF	RY REPORTING			SIGNS & BARRICADES		
LEGIS	SLATION			DANGEROUS HOLES & OPENINGS		
Righ	T TO REFUSE WORK			RIGGING & CRANES		
PERS	ONAL PROTECTIVE EQUIPMENT			MOBILE VEHICLES		
Емея	RGENCY PROCEDURES			PREVENTATIVE MAINTENANCE		


TRANSNET



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

PROJECT	SAFETY COMMITTEE			HAND & POWER TOOLS		
Houseke	EPING			FIRE PREVENTION & PROTECTION		
LADDERS	& SCAFFOLDS			ELECTRICAL SAFETY		
FALL ARR	EST STANDARDS			COMPRESSED GAS CYLINDERS		
AERIAL W	ORK PLATFORMS			WEATHER EXTREMES		
5B. D	Do you have a program for train	ning nev	vly hire	d or promoted supervisors?   Yes	☐ No	
(	If Yes, submit an outline for ev	/aluation	. Does	it include instruction on the following:		
		Yes	No		Yes	No
EMPLOYE	R RESPONSIBILITIES			SAFETY COMMUNICATION		
EMPLOYE	E RESPONSIBILITIES			FIRST AID/MEDICAL PROCEDURES		
DUE DILIG	GENCE			New Worker Training		
SAFETY L	EADERSHIP			ENVIRONMENTAL REQUIREMENTS		
Work Re	FUSALS			HAZARD ASSESSMENT		
INSPECTIO	ON PROCESSES			PRE-JOB SAFETY INSTRUCTION		
EMERGEN	ICY PROCEDURES			DRUG & ALCOHOL POLICY		
INCIDENT	Investigation			PROGRESSIVE DISCIPLINARY POLICY		
SAFE WO	RK PROCEDURES			SAFE WORK PRACTICES		
SAFETY M	MEETINGS			NOTIFICATION REQUIREMENTS		
6. 8	SAFETY ACTIVITIES					
	Do you conduct safety inspect	ions?		Yes No Weekly Month	nly Qua	arterly
	Describe your safety inspection	n proces	s (inclu	ide participation, documentation require	ements,	
fo	ollow-up, report distribution).					
_						
_	Who follows up on inspection	action it	ems?			
	Oo you hold site safety meetin	gs for fie	ld emp	loyees? If Yes, how often?		
				Yes No Daily Wee	kly Biw	eekly
г	Do you hold aita maatinga who	ro oofot	, io oda	dragged with management and field our	 	<u> </u>
L	Do you noid site meetings whe	re sarety	/ 15 auc	dressed with management and field sup Yes No Weekly Biwe		onthly
ls	s pre-job safety instruction pro	vided be	efore to	each new task?	] No	
	s the process documented?			☐ Yes ☐ No	_	
٧	Who leads the discussion?					
	– Do you have a hazard assessr	nent pro	cess?	☐ Yes ☐ No		
•				yes, how are hazard assessments com		
	implemented on each proj	ect? Who	o is res	ponsible for leading the hazard assess	ment pro	cess?
_						



Substations under the control Depot Engineer, Ermelo

	Does your company have policies and proceed reporting, waste disposal, and recycling as part					oill clean-up,
	reporting, waste disposal, and recycling as pair	. Or the ri		Yes No	•	
	How does your company measure its H&S suc	cess?				
	Attach separate sheet to explain					
7.	SAFETY STEWARDSHIP					
7A	Are incident reports and report summaries sent	t to the fo	llowin	g and how	often?	
		Yes	No	Monthly	Quarterly	Annually
	Project/Site Manager					
	Managing Director					
	Safety Director/Manager					
	/Chief Executive Officer					
7B	How are incident records and summaries kept?	? How oft	en are	they repor	ted internally?	
		Yes	No	Monthly	Quarterly	Annually
	Incidents totaled for the entire company					
	Incidents totaled by project					
	<ul> <li>Subtotaled by superintendent</li> </ul>					
	<ul> <li>Subtotaled by foreman</li> </ul>					
7C	How are the costs of individual incidents kept?					^ ~~···olly
	Costs totaled for the entire company	Yes	No □	Monthly	Quarterly	Annually □
	Costs totaled by project					
	<ul> <li>Subtotaled by project</li> <li>Subtotaled by superintendent</li> </ul>					
	OSubtotaled by superinterident     OSubtotaled by foreman/general foreman					
7D	Does your company track non-injury					ш
incide		.,			<b>2</b>	• "
		Yes	No	Monthly	Quarterly	Annually
	Near Miss					
	Property Damage					
	Fire					
	Security					
	Environmental					
8	PERSONNEL					
	List key health and safety officers planned for the Name	his projed Position			e. Designat	tion
	Ivanic	1 00100	1/ 1 1110		Doolgila	шоп
	Supply name, address and phone number representative. Does this individual have respo	nsibilities	s other		n, safety and e	nvironment?
	Name	Addr	ess		Telephone N	lumber
	Other responsibilities:					
9	Other responsibilities:  REFERENCES					

Phone Number

TRANSNET

Name and Company

Address

Tender Number: ERACMM-KDS-51150



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

## T2.2-6 Health and Safety Cost Breakdown

Tenderer (Company)	Responsible Person	Designation	Date
Project/Tender Title	Project/Tender No.	Project Location / Descr	iption

#	Cost element	Unit Cost (R)	# of Units	Total Cost (R)
1.	Human Resources			
2.	Systems Documentation			
3.	Meetings & Administration			
4.	H&S Training			
5.	PPE & Safety Equipment			
6.	Signage & Barricading			
7.	Workplace Facilities			
8.	Emergency & Rescue Measures			
9.	Hygiene Surveys & Monitoring			
10.	Medical Surveillance			
11.	Safe Transport of Workers			
12.	HazMat Management (e.g. asbestos /silica)			
13.	Substance Abuse Testing (3 kits @R500 pm)			
14.	H&S Reward & Recognition			

Total Health and Safety Estimate (R)	
Total Estimate Value (R)	
H&S Cost as % of Tender value	

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo



## T2.2-7 Management & CV's of Key Personnel

The tender must be able to demonstrate that the project personnel have sufficient knowledge, experience and qualifications to provide the required services and submit the following documents as a minimum with the tender:


- The qualifications of assigned key persons in relation to the scope of work will be evaluated.
   The following qualifications will be required:
- Trade Test Electrical
- ii. Proof of the above requirement must be attached to the C.V.
- 1. Comprehensive CV's should be attached to this schedule:

As a minimum each CV should address the following, but not limited to:

- i. Personal particulars
  - a. Name
  - b. Place (s) of tertiary education and dates associated therewith
  - c. Professional awards
- ii. Qualifications (degrees, diplomas, grades of membership of professional societies and professional registrations)
- iii. Name of current employer and position in enterprise
- Overview of post graduate experience (year, organization and position)
- v. Outline of recent assignments / experience that has a bearing on the Scope of Service

List of Key Persons assigned to the above disciplines

No.	Key Persons	Name and Surname	CV	attached
			(Yes/No)	
1				
2				
3				
4				
5				
6			_	







## T2.2-8: Authority to submit a Tender

Indicate the status of the tenderer by ticking the appropriate box hereunder. The tenderer must complete the certificate set out below for his category of organisation or alternatively attach a certified copy of a company / organisation document which provides the same information for the relevant category as requested here.

A - COMPANY	B - PARTNERSHIP	C - JOINT VENTURE	D - SOLE PROPRIETOR

,		chairperson	of the board of directors
		, hereby conf	firm that by resolution of the board taken
on	(date), Mr/Ms		, acting in the
capacity of		, wa	s authorised to sign all documents in
connection with th	is tender offer and any con	tract resulting fro	m it on behalf of the company.
connection with th	is tender offer and any con	tract resulting fro	m it on behalf of the company.




Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

<ul> <li>B. Certificate for Partnership</li> </ul>
--

	hereby authorise Mr/Ms		acting in the
apacity of		, to sign all documents in con	nection with the
ender offer for Co	ntract	and any contract res	sulting from it on
ur behalf.			
Name	Address	Signature	Date
Name	Address	Signature	Date
Name	Address	Signature	Date
Name	Address	Signature	Date

**NOTE**: This certificate is to be completed and signed by the full number of Partners necessary to commit the Partnership. Attach additional pages if more space is required.



Substations under the control Depot Engineer, Ermelo



## C. Certificate for Joint Venture


We, the undersigned, are submitting this tender offer in Joint Venture and hereby authorise Mr/Ms				
	, an authorised signatory of th	e company		
	, acting in the capacity of lea	d partner, to sign all documents		
in connection with the tender offer for	Contract	and		
any contract resulting from it on our b	ehalf.			
This authorisation is evidenced by signatories of all the partners to the Je Furthermore, we attach to this Sched statement that all partners are liable j lead partner is authorised to incur liable the entire execution of the contract for	oint Venture.  dule a copy of the joint venture a ointly and severally for the execupilities, receive instructions and p	agreement which incorporates a ution of the contract and that the ayments and be responsible for		
Name of firm	Address	Authorising signature, name (in caps) and capacity		



 ${\hbox{Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv\ Dc\ Traction}$ 

Substations under the control Depot Engineer, Ermelo

D. Certificate for Sole Proprietor					
,	hereby confi	rm that I an	n the sole	owner of	the
ousiness trading as					
Signed	Date				
Name	Position	Sole Proprie	etor		



Substations under the control Depot Engineer, Ermelo




## T2.2-9: Record of Addenda to Tender Documents

This schedule as submitted confirms that the following communications received from the *Employer* before the submission of this tender offer, amending the tender documents, have been taken into account in this specific tender offer:

	Date	Title or Details
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Attach additional pages if more space is required.






Attached to this schedule is the Letter/s of Good Standing.



# T2.2-10 Letter/s of Good Standing with the Workmen's Compensation Fund

-
1.
2.
3.
4.
Name of Company/Members of Joint Venture:



Substations under the control Depot Engineer, Ermelo



#### T2.2-11: Risk Elements

Tenderers to identify and evaluate the potential risk elements associated with the Works and possible mitigation thereof. The risk elements and the mitigation as identified thereof by the Tenderer are to be submitted.

If No Risks are identified "No Risks" must be stated on this schedule.

Tenderers are also to evaluate any risk/s stated by the *Employer* in Contract Data Part C1, and provide possible mitigation thereof.


Tenders to note: Notwithstanding this information, all costs related to risk elements which are at the Contractor's risk are deemed to be included in the tenderer's offered total of the Prices.

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo




## T2.2-12: Schedule of Proposed Subcontractors

Tenderer to note that if successful, any deviations from the list of proposed sub-contractors in the contract phase will be subject to acceptance by the *Service Manager* in terms of the Conditions of Contract. Please also note the applicable Z clauses in Contract Data by *Employer*.

Provide detailed information of the proposed Sub-contractors below:

	Name of proposed Sub-contractor	Proposed Sub- contractor National Treasury Central Supplier Database Registration Number Address and Region	Nature and extent of work	B-BBEEE Certificates or Sworn Affidavit attached behind this schedule? Yes/No	Percentage (%) of the sub-contracted works in terms of the tendered total of the prices.
1.					
2.					
3.					
4.					
5.					
6.					




Substations under the control Depot Engineer, Ermelo



# T2.2-13: Affected Property Establishment Requirements

Tenderers to indicate their Affected Property establishment area requirements:


Substations under the control Depot Engineer, Ermelo



T2	T2.2-14: CIDB SFU ANNEX G Compulsory Enterprise Questionnaire					
The	e following pa	rticulars hereur	der must be furnished.			
In t	he case of a	Joint Venture,	separate enterprise questionnaires in	respect of each partner/member		
mu	st be complet	ted and submitt	ed.			
1.	Section 1:	Name of ente	Name of enterprise:			
2.	Section 2:	VAT registrat	VAT registration number, if any:			
3.	Section 3:	CIDB registra	tion number, if any:			
4.	Section 4:	CSD number:	CSD number:			
5.	5. Section 5: Particulars of sole proprietors and partners in partnerships					
Name Identity number Personal income tax		Personal income tax number				
* Complete only if sole proprietor or partnership and attach separate page if more than 3 partners						
6.	Section 6:	Particulars of	companies and close corporations			
Co	Company registration number					
Clo	Close corporation number					
Tax	Tax reference number:					

Section 7: The attached SBD 6 must be completed for each tender and be attached as a tender requirement.

Section 8: The attached SBD 4 must be completed for each tender and be attached as a requirement.




Substations under the control Depot Engineer, Ermelo



The undersigned, who warrants that he / she is duly authorised to do so on behalf of the enterprise:

- i) authorizes the Employer to obtain a tax clearance certificate from the South African Revenue Services that my / our tax matters are in order;
- ii) confirms that the neither the name of the enterprise or the name of any partner, manager, director or other person, who wholly or partly exercises, or may exercise, control over the enterprise appears on the Register of Tender Defaulters established in terms of the Prevention and Combating of Corrupt Activities Act of 2004;
- iii) confirms that no partner, member, director or other person, who wholly or partly exercises, or may exercise, control over the enterprise appears, has within the last five years been convicted of fraud or corruption;
- iv) confirms that I / we are not associated, linked or involved with any other tendering entities submitting tender offers and have no other relationship with any of the tenderers or those responsible for compiling the scope of work that could cause or be interpreted as a conflict of interest; and
- v) confirms that the contents of this questionnaire are within my personal knowledge and are to the best of my belief both true and correct.

Signed	Date	
Name	Position	
Enterprise		
name		



Substations under the control Depot Engineer, Ermelo



**SBD 6.1** 

#### PREFERENCE POINTS CLAIM FORM

This preference form must form part of all bids invited. It contains general information and serves as a claim for preference points for Specific Goals contribution. Transnet will award preference points to companies who provide valid proof of evidence as per the table of evidence in paragraph 4.1 below.

#### 1. GENERAL CONDITIONS

- 1.1 The following preference point systems are applicable to all bids:
  - the 80/20 system for requirements with a Rand value of up to R50 000 000 (all applicable taxes included); and
- 1.2 The value of this bid is estimated to not exceed R50 000 000 (all applicable taxes included) and therefore the 80/20 preference point system shall be applicable. Despite the stipulated preference point system, Transnet shall use the lowest acceptable bid to determine the applicable preference point system in a situation where all received acceptable bids are received outside the stated preference point system.
- 1.3 Preference points for this bid shall be awarded for:
  - (a) Price;
  - (b) B-BBEE Status Level of Contribution; and
  - (c) Any other specific goal determined in the Transnet preferential procurement policy
- 1.4 The maximum points for this bid are allocated as follows:

	POINTS
PRICE	80
Specific Goals	20
Total points for Price and B-BBEE must not exceed	100

- 1.5 Failure on the part of a bidder to submit proof of evidence required for any of the specific goals together with the bid will be interpreted to mean that preference points for that specific goal are not claimed.
- 1.6 The purchaser reserves the right to require of a bidder, either before a bid is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the purchaser.

#### 2. **DEFINITIONS**

- (a) "all applicable taxes" includes value-added tax, pay as you earn, income tax, unemployment insurance fund contributions and skills development levies;
- (b) "B-BBEE" means broad-based black economic empowerment as defined in section 1 of the Broad-Based Black Economic Empowerment Act;



Substations under the control Depot Engineer, Ermelo



- (c) "B-BBEE status level of contributor" means the B-BBEE status received by a measured entity based on its overall performance using the relevant scorecard contained in the Codes of Good Practice on Black Economic Empowerment, issued in terms of section 9(1) of the Broad-Based Black Economic Empowerment Act;
- (d) "bid" means a written offer in a prescribed or stipulated form in response to an invitation by an organ of state for the supply/provision of services, works or goods, through price quotations, advertised competitive bidding processes or proposals;
- (e) "Broad-Based Black Economic Empowerment Act" means the Broad-Based Black Economic Empowerment Act, 2003 (Act No. 53 of 2003);
- (f) "EME" means an Exempted Micro Enterprise as defines by Codes of Good Practice under section 9 (1) of the Broad-Based Black Economic Empowerment Act, 2003 (Act No. 53 of 2003);
- (g) "functionality" means the ability of a bidder to provide goods or services in accordance with specification as set out in the bid documents
- (h) "Price" includes all applicable taxes less all unconditional discounts.
- (i) "Proof of B-BBEE Status Level of Contributor"
  - i) the B-BBBEE status level certificate issued by an authorised body or person;
  - ii) a sworn affidavit as prescribed by the B-BBEE Codes of Good Practice; or
  - iii) any other requirement prescribed in terms of the B-BBEE Act.
- (j) "QSE" means a Qualifying Small Enterprise as defines by Codes of Good Practice under section 9 (1) of the Broad-Based Black Economic Empowerment Act, 2003 (Act No. 53 of 2003);
- (k) "rand value" means the total estimated value of a contract in South African currency, calculated at the time of bid invitations, and includes all applicable taxes and excise duties.
- (I) **Specific goals**" means targeted advancement areas or categories of persons or groups either previously disadvantaged or falling within the scope of the Reconstruction and Development Programme identified by Transnet to be given preference in allocation of procurement contracts in line with section 2(1) of the PPPFA.

#### 3. POINTS AWARDED FOR PRICE

#### 3.1 THE 80/20 PREFERENCE POINT SYSTEMS

A maximum of 80 points is allocated for price on the following basis:

80/20


$$Ps = 80 \left( 1 - \frac{Pt - P\min}{P\min} \right)$$

Where

Ps = Points scored for comparative price of bid under consideration

Pt = Comparative price of bid under consideration

Pmin = Comparative price of lowest acceptable bid



Substations under the control Depot Engineer, Ermelo



## 4. EVIDENCE REQUIRED FOR CLAIMING SPECIFIC GOALS

4.1 In terms of Transnet Preferential Procurement Policy (TPPP) and Procurement Manuals, preference points must be awarded to a bidder for providing evidence in accordance with the table below:

Description	Points	
B-BBEE Level of contributor (1 or 2)	10	
+50% Black Youth Owned Entities	10	
Non-Compliant and/or B-BBEE Level 3-8 contributors	0	

Specific Goals	Acceptable Evidence
B-BBEE	B-BBEE Certificate / Sworn- Affidavit / B-BBEE CIPC Certificate (in case of JV, a consolidated scorecard will be accepted) as per DTIC guideline
+50% Black Youth Owned Entities	Certified copy of ID Documents of the Owners and B-BBEE Certificate / Sworn- Affidavit / B-BBEE CIPC Certificate (in case of JV, a consolidated scorecard will be accepted) as per DTIC guideline

4.2 The table below indicates the required proof of B-BBEE status depending on the category of enterprises:

Enterprise	B-BBEE Certificate & Sworn Affidavit
Large	Certificate issued by SANAS accredited verification agency
QSE	Certificate issued by SANAS accredited verification agency
	Sworn Affidavit signed by the authorised QSE representative and attested by a Commissioner of Oaths confirming annual turnover and black ownership (only black-owned QSEs - 51% to 100% Black owned)
	[Sworn affidavits must substantially comply with the format that can be obtained on the DTI's website at <a href="https://www.dti.gov.za/economic_empowerment/bee_codes.jsp.">www.dti.gov.za/economic_empowerment/bee_codes.jsp.</a> ]
EME	Sworn Affidavit signed by the authorised EME representative and attested by a Commissioner of Oaths confirming annual turnover and black ownership
	Certificate issued by CIPC (formerly CIPRO) confirming annual turnover and black ownership



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

Certificate issued by SANAS accredited verification agency only if the EME is
being measured on the QSE scorecard

- 4.3 A trust, consortium or joint venture (including unincorporated consortia and joint ventures) must submit a consolidated B-BBEE Status Level verification certificate for every separate bid.
- 4.4 Tertiary Institutions and Public Entities will be required to submit their B-BBEE status level certificates in terms of the specialized scorecard contained in the B-BBEE Codes of Good Practice.
- 4.5 A person will not be awarded points for B-BBEE status level if it is indicated in the bid documents that such a bidder intends sub-contracting more than 25% of the value of the contract to any other enterprise that does not qualify for at least the points that such a bidder qualifies for, unless the intended sub-contractor is an EME that has the capability and ability to execute the sub-contract.
- A person awarded a contract may not sub-contract more than 25% of the value of the contract to any other enterprise that does not have an equal or higher B-BBEE status level than the person concerned, unless the contract is sub-contracted to an EME that has the capability and ability to execute the sub-contract.
- 4.7 Bidders are to note that the rules pertaining to B-BBEE verification and other B-BBEE requirements may be changed from time to time by regulatory bodies such as National Treasury or the DTI. It is the Bidder's responsibility to ensure that his/her bid complies fully with all B-BBEE requirements at the time of the submission of the bid.

### 5. BID DECLARATION

5.1 Bidders who claim points in respect of B-BBEE Status Level of Contribution must complete the following:

# 6. B-BBEE STATUS LEVEL OF CONTRIBUTION CLAIMED IN TERMS OF PARAGRAPHS 1.4 AND 6.1

6.1 B-BBEE Status Level of Contribution: . = .......(maximum of 20 points)

(Points claimed in respect of paragraph 6.1 must be in accordance with the table reflected in paragraph 4.1 and must be substantiated by relevant proof of B-BBEE status level of contributor.

#### 7. SUB-CONTRACTING


7.1 Will any portion of the contract be sub-contracted?

(Tick applicable box)

YES	NO	

- 4 4			
7.1.1	lt \	ves. ind	IICATA.
<i>1</i>		vos. IIIo	iioaic.

- i) What percentage of the contract will be subcontracted......%
- ii) The name of the sub-contractor.....



Substations under the control Depot Engineer, Ermelo

TRANSNE	I

iii) The B-BBEE status level of the sub-contractoriv) Whether the sub-contractor is an EME or QSE.  (Tick applicable box)  YES  NO	 
DECLARATION WITH REGARD TO COMPANY/FIRM	
Name of company/firm:	 
VAT registration number:	 
Company registration number:	 
TYPE OF COMPANY/ FIRM	
□ Partnership/Joint Venture / Consortium	

8.5

8.8.18.28.38.4

One person business/sole propriety

DESCRIBE PRINCIPAL BUSINESS ACTIVITIES

Close corporation

Company

[TICK APPLICABLE BOX]

(Pty) Limited

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo




8.6	COMPANY	CLASSIFICATION
0.0		

	Manufacturer		
	Supplier		
	Professional Service provider		
	Other Service providers, e.g. transporter, etc.		
[TICH	[TICK APPLICABLE BOX]		

- 8.7 Total number of years the company/firm has been in business:.....
- 8.8 I/we, the undersigned, who is / are duly authorised to do so on behalf of the company/firm, certify that the points claimed, based on the B-BBE status level of contribution indicated in paragraphs 1.4 and 6.1 of the foregoing certificate, qualifies the company/ firm for the preference(s) shown and I / we acknowledge that:
  - The information furnished is true and correct;
  - ii) The preference points claimed are in accordance with the General Conditions as indicated in paragraph 1 of this form;
  - iii) In the event of a contract being awarded as a result of points claimed as shown in paragraph 1.4 and 6.1, the contractor may be required to furnish documentary proof to the satisfaction of the purchaser that the claims are correct;
  - iv) If a bidder submitted false information regarding its B-BBEE status level of contributor,, which will affect or has affected the evaluation of a bid, or where a bidder has failed to declare any subcontracting arrangements or any of the conditions of contract have not been fulfilled, the purchaser may, in addition to any other remedy it may have
    - (a) disqualify the person from the bidding process;
    - (b) recover costs, losses or damages it has incurred or suffered as a result of that person's conduct;
    - (c) cancel the contract and claim any damages which it has suffered as a result of having to make less favourable arrangements due to such cancellation;
    - (d) if the successful bidder subcontracted a portion of the bid to another person without disclosing it, Transnet reserves the right to penalise the bidder up to 10 percent of the value of the contract;
    - (e) recommend that the bidder or contractor, its shareholders and directors, or only the shareholders and directors who acted on a fraudulent basis, be restricted by the National Treasury from obtaining business from any organ of state for a period not exceeding 10 years, after the audi alteram partem (hear the other side) rule has been applied; and
    - (f) forward the matter for criminal prosecution.

	WITNESSES		
	1		SIGNATURE(S) OF BIDDERS(S)
CF	า	2	DATE:



Substations under the control Depot Engineer, Ermelo



#### **BIDDER'S DISCLOSURE**

#### 1. PURPOSE OF THE FORM

Any person (natural or juristic) may make an offer or offers in terms of this invitation to bid. In line with the principles of transparency, accountability, impartiality, and ethics as enshrined in the Constitution of the Republic of South Africa and further expressed in various pieces of legislation, it is required for the bidder to make this declaration in respect of the details required hereunder.

Where a person/s are listed in the Register for Tender Defaulters and / or the List of Restricted Suppliers, that person will automatically be disqualified from the bid process.

## 2. Bidder's declaration

2.1 Is the bidder, or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest1 in the enterprise,

employed by the state?

YES/NO

2.1.1 If so, furnish particulars of the names, individual identity numbers, and, if applicable, state employee numbers of sole proprietor/ directors / trustees / shareholders / members/ partners or any person having a controlling interest in the enterprise, in table below.

		Full Name	Identity Number	Name of State institution
2.2	Do			

	you, or any person connected with the bidder, have a relationship with any person who is employed by the procuring institution? <b>YES/NO</b>
2.2.1	If so, furnish particulars:
alterna	ower, by one person or a group of persons holding the majority of the equity of an enterprise, tively, the person/s having the deciding vote or power to influence or to direct the course and decisions of erprise.

Part T2: Returnable Documents T2.2: Returnable Schedules



escription of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction
ubstations under the control Depot Engineer, Ermelo

2.3 Does the bidder or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest in the enterprise have any interest in any other related enterprise whether or not they are bidding for this contract?

YES/NO

2.3.1	If so, furnish particulars:


#### 3 **DECLARATION**

I, the undersigned, (name)......in submitting the accompanying bid, do hereby make the following statements that I certify to be true and complete in every respect:

- I have read and I understand the contents of this disclosure; 3.1
- 3.2 I understand that the accompanying bid will be disqualified if this disclosure is found not to be true and complete in every respect;
- 3.3 The bidder has arrived at the accompanying bid independently from, and without consultation, communication, agreement or arrangement with any competitor. However, communication between partners in a joint venture or consortium2 will not be construed as collusive bidding.
- 3.4 In addition, there have been no consultations, communications, agreements or arrangements with any competitor regarding the quality, quantity, specifications, prices, including methods, factors or formulas used to calculate prices, market allocation, the intention or decision to submit or not to submit the bid, bidding with the intention not to win the bid and conditions or delivery particulars of the products or services to which this bid invitation relates.
- 3.4 The terms of the accompanying bid have not been, and will not be, disclosed by the bidder, directly or indirectly, to any competitor, prior to the date and time of the official bid opening or of the awarding of the contract.
- 3.5 There have been no consultations, communications, agreements or arrangements made by the bidder with any official of the procuring institution in relation to this procurement process prior to and during the bidding process except to provide clarification on the bid submitted where so required by the institution; and the bidder was not involved in the drafting of the specifications or terms of reference for this bid.
- 3.6 I am aware that, in addition and without prejudice to any other remedy provided to combat any restrictive practices related to bids and contracts, bids that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and or may be reported to the National Prosecuting Authority (NPA) for criminal investigation and or may be restricted from conducting business with the public sector for a period not exceeding ten (10) years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.

I CERTIFY THAT THE INFORMATION FURNISHED IN PARAGRAPHS 1, 2 and 3 ABOVE IS

<sup>2</sup> Joint venture or Consortium means an association of persons for the purpose of combining their expertise, property, capital, efforts, skill and knowledge in an activity for the execution of a contract.



Substations under the control Depot Engineer, Ermelo

# TRANSNET

CO	RR	EC	Τ.
			-

PARAGRAPH 6 OF PFMA SCN	MAY REJECT THE BID OR ACT AGAINST ME IN TERMS OF MINSTRUCTION 03 OF 2021/22 ON PREVENTING AND SUPPLY CHAIN MANAGEMENT SYSTEM SHOULD THIS FALSE.
Signature	Date
Position	Name of bidder

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo



#### T2.2-15 NON-DISCLOSURE AGREEMENT

Note to	tenderers:	This	Non-Disclosure	Agreement	is	to be	completed	and	signed	by	an
authoris	ed signator	y:									

THIS AGREEMENT is made effective as of day of
TRANSNET SOC LTD
(Registration No. 1990/000900/30), a company incorporated and existing under the laws of South Africa, having its principal place of business at Transnet Corporate Centre 138 Eloff Street , Braamfontein , Johannesburg 2000
and
(Registration No),a private company incorporated and existing under the
laws of South Africa having its principal place of business at

#### **WHEREAS**

Transnet and the Company wish to exchange Information [as defined below] and it is envisaged that each party may from time to time receive Information relating to the other in respect thereof. In consideration of each party making available to the other such Information, the parties jointly agree that any dealings between them shall be subject to the terms and conditions of this Agreement which themselves will be subject to the parameters of the Tender Document.

#### IT IS HEREBY AGREED

#### IT IS HEREBY AGREED

#### 1. INTERPRETATION

In this Agreement:

- 1.1 **Agents** mean directors, officers, employees, agents, professional advisers, contractors or sub-contractors, or any Group member;
- 1.2 Bid or Bid Document (hereinafter Tender) means Transnet's Request for Information [RFI]
  Request for Proposal [RFP] or Request for Quotation [RFQ], as the case may be;
- 1.3 Confidential Information means any information or other data relating to one party [the Disclosing Party] and/or the business carried on or proposed or intended to be carried on by that party and which is made available for the purposes of the Bid to the other party [the



Receiving Party] or its Agents by the Disclosing Party or its Agents or recorded in agreed minutes following oral disclosure and any other information otherwise made available by the Disclosing Party or its Agents to the Receiving Party or its Agents, whether before, on or after the date of this Agreement, and whether in writing or otherwise, including any information, analysis or specifications derived from, containing or reflecting such information but excluding information which:

- 1.3.1 is publicly available at the time of its disclosure or becomes publicly available [other than as a result of disclosure by the Receiving Party or any of its Agents contrary to the terms of this Agreement]; or
- 1.3.2 was lawfully in the possession of the Receiving Party or its Agents [as can be demonstrated by its written records or other reasonable evidence] free of any restriction as to its use or disclosure prior to its being so disclosed; or
- 1.3.3 following such disclosure, becomes available to the Receiving Party or its Agents [as can be demonstrated by its written records or other reasonable evidence] from a source other than the Disclosing Party or its Agents, which source is not bound by any duty of confidentiality owed, directly or indirectly, to the Disclosing Party in relation to such information;
- 1.4 Group means any subsidiary, any holding company and any subsidiary of any holding company of either party; and
- Information means all information in whatever form including, without limitation, any 1.5 information relating to systems, operations, plans, intentions, market opportunities, knowhow, trade secrets and business affairs whether in writing, conveyed orally or by machine-readable medium.

#### 2. **CONFIDENTIAL INFORMATION**

- 2.1 All Confidential Information given by one party to this Agreement [the **Disclosing Party**] to the other party [the Receiving Party] will be treated by the Receiving Party as secret and confidential and will not, without the Disclosing Party's written consent, directly or indirectly communicate or disclose [whether in writing or orally or in any other manner] Confidential Information to any other person other than in accordance with the terms of this Agreement.
- 2.2 The Receiving Party will only use the Confidential Information for the sole purpose of technical and commercial discussions between the parties in relation to the Tender or for the subsequent performance of any contract between the parties in relation to the Tender.
- 2.3 Notwithstanding clause above, the Receiving Party may disclose Confidential Information:
- 2.3.1 to those of its Agents who strictly need to know the Confidential Information for the sole purpose set out in clause above, provided that the Receiving Party shall ensure that



such Agents are made aware prior to the disclosure of any part of the Confidential Information that the same is confidential and that they owe a duty of confidence to the Disclosing Party. The Receiving Party shall at all times remain liable for any actions of such Agents that would constitute a breach of this Agreement; or

- 2.3.2 to the extent required by law or the rules of any applicable regulatory authority, subject to clause, below.
- 2.4 In the event that the Receiving Party is required to disclose any Confidential Information in accordance with clause, above, it shall promptly notify the Disclosing Party and cooperate with the Disclosing Party regarding the form, nature, content and purpose of such disclosure or any action which the Disclosing Party may reasonably take to challenge the validity of such requirement.
- 2.5 In the event that any Confidential Information shall be copied, disclosed or used otherwise than as permitted under this Agreement then, upon becoming aware of the same, without prejudice to any rights or remedies of the Disclosing Party, the Receiving Party shall as soon as practicable notify the Disclosing Party of such event and if requested take such steps [including the institution of legal proceedings] as shall be necessary to remedy [if capable of remedy] the default and/or to prevent further unauthorised copying, disclosure or use.
- 2.6 All Confidential Information shall remain the property of the Disclosing Party and its disclosure shall not confer on the Receiving Party any rights, including intellectual property rights over the Confidential Information whatsoever, beyond those contained in this Agreement.

#### 3. RECORDS AND RETURN OF INFORMATION

- 3.1 The Receiving Party agrees to ensure proper and secure storage of all Information and any copies thereof.
- 3.2 The Receiving Party shall keep a written record, to be supplied to the Disclosing Party upon request, of the Confidential Information provided and any copies made thereof and, so far as is reasonably practicable, of the location of such Confidential Information and any copies thereof.
- 3.3 The Company shall, within 7 [seven] days of receipt of a written demand from Transnet:
- 3.3.1 return all written Confidential Information [including all copies]; and
- 3.3.2 expunge or destroy any Confidential Information from any computer, word processor or other device whatsoever into which it was copied, read or programmed by the Company or on its behalf.
- 3.4 The Company shall on request supply a certificate signed by a director as to its full compliance with the requirements of clause 3.3.2 above.

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

#### 4. ANNOUNCEMENTS

4.1 Neither party will make or permit to be made any announcement or disclosure of its prospective interest in the Tender without the prior written consent of the other party.

4.2 Neither party shall make use of the other party's name or any information acquired through its dealings with the other party for publicity or marketing purposes without the prior written consent of the other party.

#### 5. DURATION

The obligations of each party and its Agents under this Agreement shall survive the termination of any discussions or negotiations between the parties regarding the Tender and continue thereafter for a period of 5 [five] years.

#### 6. PRINCIPAL

Each party confirms that it is acting as principal and not as nominee, agent or broker for any other person and that it will be responsible for any costs incurred by it or its advisers in considering or pursuing the Tender and in complying with the terms of this Agreement.

#### 7. ADEQUACY OF DAMAGES

Nothing contained in this Agreement shall be construed as prohibiting the Disclosing Party from pursuing any other remedies available to it, either at law or in equity, for any such threatened or actual breach of this Agreement, including specific performance, recovery of damages or otherwise.

#### 8. PRIVACY AND DATA PROTECTION


8.1 The Receiving Party undertakes to comply with South Africa's general privacy protection in terms Section 14 of the Bill of Rights in connection with this Tender and shall procure that its personnel shall observe the provisions of such Act [as applicable] or any amendments and re-enactments thereof and any regulations made pursuant thereto.

8.2 The Receiving Party warrants that it and its Agents have the appropriate technical and organisational measures in place against unauthorised or unlawful processing of data relating to the Tender and against accidental loss or destruction of, or damage to such data held or processed by them.

#### 9. GENERAL

9.1 Neither party may assign the benefit of this Agreement, or any interest hereunder, except with the prior written consent of the other, save that Transnet may assign this Agreement at any time to any member of the Transnet Group.

TRANSNET




Substations under the control Depot Engineer, Ermelo



- 9.2 No failure or delay in exercising any right, power or privilege under this Agreement will operate as a waiver of it, nor will any single or partial exercise of it preclude any further exercise or the exercise of any right, power or privilege under this Agreement or otherwise.
- 9.3 The provisions of this Agreement shall be severable in the event that any of its provisions are held by a court of competent jurisdiction or other applicable authority to be invalid, void or otherwise unenforceable, and the remaining provisions shall remain enforceable to the fullest extent permitted by law.
- 9.4 This Agreement may only be modified by a written agreement duly signed by persons authorised on behalf of each party.
- 9.5 Nothing in this Agreement shall constitute the creation of a partnership, joint venture or agency between the parties.
- 9.6 This Agreement will be governed by and construed in accordance with South African law and the parties irrevocably submit to the exclusive jurisdiction of the South African courts.

Signed	Date	
Name	Position	
Tenderer		



Substations under the control Depot Engineer, Ermelo

# TRANSNET

#### T2.2-16: RFQ DECLARATION FORM


NAME OF COMPANY: _	
We	do hereby certify that:

- 1. Transnet has supplied and we have received appropriate tender offers to any/all questions (as applicable) which were submitted by ourselves for tender clarification purposes;
- 2. we have received all information we deemed necessary for the completion of this Tender;
- at no stage have we received additional information relating to the subject matter of this tender from Transnet sources, other than information formally received from the designated Transnet contact(s) as nominated in the tender documents;
- 4. we are satisfied, insofar as our company is concerned, that the processes and procedures adopted by Transnet in issuing this tender and the requirements requested from tenderers in responding to this tender have been conducted in a fair and transparent manner; and
- 5. furthermore, we acknowledge that a direct relationship exists between a family member and/or an owner / member / director / partner / shareholder (unlisted companies) of our company and an employee or board member of the Transnet Group as indicated below: [Respondent to indicate if this section is not applicable]

ADDRESS:

[Failure to furnish complete and accurate information in this regard may lead to the disqualification of your response and may preclude a Respondent from doing future business with Transnet]

We declare, to the extent that we are aware or become aware of any relationship between ourselves and Transnet (other than any existing and appropriate business relationship with Transnet) which could unfairly advantage our company in the forthcoming adjudication process, we shall notify Transnet immediately in writing of such circumstances.



Substations under the control Depot Engineer, Ermelo



- 6. We accept that any dispute pertaining to this tender will be resolved through the Ombudsman process and will be subject to the Terms of Reference of the Ombudsman. The Ombudsman process must first be exhausted before judicial review of a decision is sought. (Refer "Important Notice to respondents" below).
- 7. We further accept that Transnet reserves the right to reverse a tender award or decision based on the recommendations of the Ombudsman without having to follow a formal court process to have such award or decision set aside.
- 8. We have acquainted ourselves and agree with the content of T2.2-20 "Service Provider Integrity Pact".

For and on behalf of
duly authorised thereto
Name:
Signature:
Date:

#### IMPORTANT NOTICE TO TENDERERS

- Transnet has appointed a Procurement Ombudsman to investigate any <u>material complaint</u> in respect of tenders exceeding R5,000,000.00 (five million S.A. Rand) in value. Should a Tenderer have any material concern regarding an tender process which meets this value threshold, a complaint may be lodged with Transnet's Procurement Ombudsman for further investigation.
- It is incumbent on the Tenderer to familiarise himself/herself with the Terms of Reference for the Transnet Procurement Ombudsman, details of which are available for review at Transnet's website www.transnet.net.
- An official complaint form may be downloaded from this website and submitted, together with any supporting documentation, within the prescribed period, to <a href="mailto:procurement.ombud@transnet.net">procurement.ombud@transnet.net</a>
- For transactions below the R5,000,000.00 (five million S.A. Rand) threshold, a complaint may be lodged with the Chief Procurement Officer of the relevant Transnet Operating Division.

All Tenderers should note that a complaint must be made in good faith. If a complaint is made in bad faith, Transnet reserves the right to place such a tenderer on its List of Excluded Bidder

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

## T2.2-17: REQUEST FOR QUOTATION - BREACH OF LAW


NAME OF COMPANY: \_\_\_\_\_

We _	do hereby certify that:
1.	Transnet has supplied and we have received appropriate tender offers to any/all questions (as applicable) which were submitted by ourselves for tender clarification purposes;
2.	we have received all information we deemed necessary for the completion of this Tender;
3.	at no stage have we received additional information relating to the subject matter of this tender from Transnet sources, other than information formally received from the designated Transnet contact(s) as nominated in the tender documents;
4.	we are satisfied, insofar as our company is concerned, that the processes and procedures adopted by Transnet in issuing this tender and the requirements requested from tenderers in responding to this tender have been conducted in a fair and transparent manner; and
5.	furthermore, we acknowledge that a direct relationship exists between a family member and/or an owner / member / director / partner / shareholder (unlisted companies) of our company and an employee or board member of the Transnet Group as indicated below: [Respondent to indicate if this section is not applicable]  FULL NAME OF OWNER/MEMBER/DIRECTOR/  PARTNER/SHAREHOLDER:  ADDRESS:
	Indicate nature of relationship with Transnet:
	[Failure to furnish complete and accurate information in this regard may lead to the disqualification of your response and may preclude a Respondent from doing future business with Transnet]

Part T2: Returnable Documents T2.2: Returnable Schedules TRANSNET

CPM 2020 - Rev 05

We declare, to the extent that we are aware or become aware of any relationship between ourselves and Transnet (other than any existing and appropriate business relationship with



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

Transnet) which could unfairly advantage our company in the forthcoming adjudication process, we shall notify Transnet immediately in writing of such circumstances.

- ii. We accept that any dispute pertaining to this tender will be resolved through the Ombudsman process and will be subject to the Terms of Reference of the Ombudsman. The Ombudsman process must first be exhausted before judicial review of a decision is sought. (Refer "Important Notice to respondents" below).
- iii. We further accept that Transnet reserves the right to reverse a tender award or decision based on the recommendations of the Ombudsman without having to follow a formal court process to have such award or decision set aside.
- We have acquainted ourselves and agree with the content of T2.2-20 "Service iv. Provider Integrity Pact".

For and on behalf of
duly authorised thereto
Name:
Signature:
Date:

### IMPORTANT NOTICE TO TENDERERS

- Transnet has appointed a Procurement Ombudsman to investigate any material complaint in respect of tenders exceeding R5,000,000.00 (five million S.A. Rand) in value. Should a Tenderer have any material concern regarding an tender process which meets this value threshold, a complaint may be lodged with Transnet's Procurement Ombudsman for further investigation.
- It is incumbent on the Tenderer to familiarise himself/herself with the Terms of Reference for the Transnet Procurement Ombudsman, details of which are available for review at Transnet's website www.transnet.net.
- An official complaint form may be downloaded from this website and submitted, together with any supporting documentation, within the prescribed period, to procurement.ombud@transnet.net
- For transactions below the R5,000,000.00 (five million S.A. Rand) threshold, a complaint may be lodged with the Chief Procurement Officer of the relevant Transnet Operating Division.

All Tenderers should note that a complaint must be made in good faith. If a complaint is made in bad faith, Transnet reserves the right to place such a tenderer on its List of Excluded Bidder

TRANSNET


Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo



## T2.2-18 Certificate of Acquaintance with Tender Documents

- 1. By signing this certificate I/we acknowledge that I/we have made myself/ourselves thoroughly familiar with, and agree with all the conditions governing this RFP. This includes those terms and conditions of the Contract, the Supplier Integrity Pact, Non-Disclosure Agreement etc. contained in any printed form stated to form part of the documents thereof, but not limited to those listed in this clause.
- 2. I/we furthermore agree that Transnet SOC Ltd shall recognise no claim from me/us for relief based on an allegation that I/we overlooked any tender/contract condition or failed to take it into account for the purpose of calculating my/our offered prices or otherwise.
- 3. I/we understand that the accompanying Tender will be disqualified if this Certificate is found not to be true and complete in every respect.
- 4. For the purposes of this Certificate and the accompanying Tender, I/we understand that the word "competitor" shall include any individual or organisation, other than the Tenderer, whether or not affiliated with the Tenderer, who:
  - a) has been requested to submit a Tender in response to this Tender invitation;
  - b) could potentially submit a Tender in response to this Tender invitation, based on their qualifications, abilities or experience; and
  - c) provides the same Services as the Tenderer and/or is in the same line of business as the Tenderer
- 5. The Tenderer has arrived at the accompanying Tender independently from, and without consultation, communication, agreement or arrangement with any competitor. However communication between partners in a joint venture or consortium will not be construed as collusive Tendering.
- 6. In particular, without limiting the generality of paragraph 5 above, there has been no consultation, communication, agreement or arrangement with any competitor regarding:
  - a) prices;
  - b) geographical area where Services will be rendered [market allocation]
  - c) methods, factors or formulas used to calculate prices;



Substations under the control Depot Engineer, Ermelo



- d) the intention or decision to submit or not to submit, a Tender;
- e) the submission of a tender which does not meet the specifications and conditions of the tender; or
- f) Tendering with the intention not winning the tender.
- 7. In addition, there have been no consultations, communications, agreements or arrangements with any competitor regarding the quality, quantity, specifications and conditions or delivery particulars of the Services to which this tender relates.
- 8. The terms of the accompanying tender have not been, and will not be, disclosed by the Tenderer, directly or indirectly, to any competitor, prior to the date and time of the official tender opening or of the awarding of the contract.
- 9. I/We am/are aware that, in addition and without prejudice to any other remedy provided to combat any restrictive practices related to tenders and contracts, tenders that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and/or may be reported to the National Prosecuting Authority [NPA] for criminal investigation. In addition, Tenderers that submit suspicious tenders may be restricted from conducting business with the public sector for a period not exceeding 10 [ten] years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.

20

Signed on this	uay oi	20
	•	
SIGNATURE OF TEND	ERER .	

dov. of

Cianad on this

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

# T2.2-19 Service Provider Integrity Pact

Important Note: All potential tenderers must read this document and certify in the RFP Declaration Form that that have acquainted themselves with and agree with the content.

The contract with the successful tenderer will automatically incorporate this Integrity Pact and shall be deemed as part of the final concluded contract.

#### **INTEGRITY PACT**

Between

#### TRANSNET SOC LTD

Registration Number: 1990/000900/30

("Transnet")

and

The Contractor (hereinafter referred to as the "Tenderer/Service Providers/Contractor")

#### **PREAMBLE**

Transnet values full compliance with all relevant laws and regulations, ethical standards and the principles of economical use of resources, fairness and transparency in its relations with its Tenderers / Service Providers/Contractors.

In order to achieve these goals, Transnet and the Tenderer / Service Provider hereby enter into this agreement hereinafter referred to as the "Integrity Pact" which will form part of the Tenderer's / Service Provider's / Contractor's application for registration with Transnet as a vendor.

The general purpose of this Integrity Pact is to agree on avoiding all forms of dishonesty, fraud and corruption by following a system that is fair, transparent and free from any undue influence prior to, during and subsequent to the currency of any procurement and / or reverse logistics event and any further contract to be entered into between the Parties, relating to such event.

All Tenderers / Service Providers / Contractor's will be required to sign and comply with undertakings contained in this Integrity Pact, should they want to be registered as a Transnet vendor.

#### 1 OBJECTIVES

1.1 Transnet and the Tenderer / Service Provider / Contractor agree to enter into this Integrity Pact, to avoid all forms of dishonesty, fraud and corruption including practices that are anticompetitive in nature, negotiations made in bad faith and under-pricing by following a system that is fair, transparent and free from any influence / unprejudiced dealings prior to, during and subsequent to the currency of the contract to be entered into with a view to:

TRANSNET



- a) Enable Transnet to obtain the desired contract at a reasonable and competitive price in conformity to the defined specifications of the works, goods and services; and
- b) Enable Tenderers / Service Providers / Contractors to abstain from bribing or participating in any corrupt practice in order to secure the contract.


#### 2 COMMITMENTS OF TRANSNET

Transnet commits to take all measures necessary to prevent dishonesty, fraud and corruption and to observe the following principles:

- 2.1 Transnet hereby undertakes that no employee of Transnet connected directly or indirectly with the sourcing event and ensuing contract, will demand, take a promise for or accept directly or through intermediaries any bribe, consideration, gift, reward, favour or any material or immaterial benefit or any other advantage from the Tenderer, either for themselves or for any person, organisation or third party related to the contract in exchange for an advantage in the tendering process, Tender evaluation, contracting or implementation process related to any contract.
- 2.2 Transnet will, during the registration and tendering process treat all Tenderers / Service Providers with equity, transparency and fairness. Transnet will in particular, before and during the registration process, provide to all Tenderers / Service Providers the same information and will not provide to any Tenderers / Service Providers / Contractors confidential / additional information through which the Tenderers / Service Providers / Contractors could obtain an advantage in relation to any tendering process.
- 2.3 Transnet further confirms that its employees will not favour any prospective Tenderer in any form that could afford an undue advantage to a particular Tenderer during the tendering stage, and will further treat all Tenderers / Service Providers / Contractors participating in the tendering process.
- 2.4 Transnet will exclude from the tender process such employees who have any personal interest in the Tenderers / Service Providers / Contractors participating in the tendering process.

#### 3 OBLIGATIONS OF THE TENDERER / SERVICE PROVIDER

- 3.1 Transnet has a 'Zero Gifts' Policy. No employee is allowed to accept gifts, favours or benefits.
  - a) Transnet officials and employees **shall not** solicit, give or accept, or from agreeing to solicit, give, accept or receive directly or indirectly, any gift, gratuity, favour,



Substations under the control Depot Engineer, Ermelo



entertainment, loan, or anything of monetary value, from any person or juridical entities in the course of official duties or in connection with any operation being managed by, or any transaction which may be affected by the functions of their office.

- b) Transnet officials and employees **shall not** solicit or accept gifts of any kind, from vendors, suppliers, customers, potential employees, potential vendors, and suppliers, or any other individual or organisation irrespective of the value.
- c) Under **no circumstances** should gifts, business courtesies or hospitality packages be accepted from or given to prospective suppliers participating in a tender process at the respective employee's Operating Division, regardless of retail value.
- d) Gratuities, bribes or kickbacks of any kind must never be solicited, accepted or offered, either directly or indirectly. This includes money, loans, equity, special privileges, personal favours, benefit or services. Such favours will be considered to constitute corruption.
- 3.2 The Tenderer / Service Provider / Contractor commits itself to take all measures necessary to prevent corrupt practices, unfair means and illegal activities during any stage of its Tender or during any ensuing contract stage in order to secure the contract or in furtherance to secure it and in particular the Tenderer / Service Provider / Contractor commits to the following:
  - a) The Tenderer / Service Provider / Contractor will not, directly or through any other person or firm, offer, promise or give to Transnet or to any of Transnet's employees involved in the tendering process or to any third person any material or other benefit or payment, in order to obtain in exchange an advantage during the tendering process; and
  - b) The Tenderer / Service Provider / Contractor will not offer, directly or through intermediaries, any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any employee of Transnet, connected directly or indirectly with the tendering process, or to any person, organisation or third party related to the contract in exchange for any advantage in the tendering, evaluation, contracting and implementation of the contract.



- The Tenderer/Service Provider/Contractor will not collude with other parties interested in 3.3 the contract to preclude a competitive Tender price, impair the transparency, fairness and progress of the tendering process, Tender evaluation, contracting and implementation of the contract. The Tenderer / Service Provider further commits itself to delivering against all agreed upon conditions as stipulated within the contract.
- 3.4 The Tenderer/Service Provider/Contractor will not enter into any illegal or dishonest agreement or understanding, whether formal or informal with other Tenderers/Service Providers/Contractors. This applies in particular to certifications, submissions or nonsubmission of documents or actions that are restrictive or to introduce cartels into the tendering process.
- 3.5 The Tenderer/Service Provider/Contractor will not commit any criminal offence under the relevant anti-corruption laws of South Africa or any other country. Furthermore, the Tenderer/Service Provider/Contractor will not use for illegitimate purposes or for restrictive purposes or personal gain, or pass on to others, any information provided by Transnet as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.
  - 3.6 A Tenderer/Service Provider/Contractor of foreign origin shall disclose the name and address of its agents or representatives in South Africa, if any, involved directly or indirectly in the registration or tendering process. Similarly, the Tenderer / Service Provider / Contractor of South African nationality shall furnish the name and address of the foreign principals, if any, involved directly or indirectly in the registration or tendering process.
  - The Tenderer/Service Provider/Contractor will not misrepresent facts or furnish false or forged documents or information in order to influence the tendering process to the advantage of the Tenderer/Service Provider/Contractor or detriment of Transnet or other competitors.
  - 3.8 Transnet may require the Tenderer/Service Provider/Contractor to furnish Transnet with a copy of its code of conduct. Such code of conduct must address the compliance programme for the implementation of the code of conduct and reject the use of bribes and other dishonest and unethical conduct.
  - 3.9 The Tenderer/Service Provider/Contractor will not instigate third persons to commit offences outlined above or be an accessory to such offences.
  - 3.10 The Tenderer/Service Provider/Contractor confirms that they will uphold the ten principles of the United Nations Global Compact (UNGC) in the fields of Human Rights, Labour,




Anti-Corruption and the Environment when undertaking business with Transnet as follows:

- a) Human Rights
- Principle 1: Businesses should support and respect the protection of internationally proclaimed human rights; and
- Principle 2: make sure that they are not complicit in human rights abuses.
- b) Labour
- Principle 3: Businesses should uphold the freedom of association and the effective recognition of the right to collective bargaining;
- Principle 4: the elimination of all forms of forced and compulsory labour;
- Principle 5: the effective abolition of child labour; and
- Principle 6: the elimination of discrimination in respect of employment and occupation.
- c) Environment
- Principle 7: Businesses should support a precautionary approach to environmental challenges;
- Principle 8: undertake initiatives to promote greater environmental responsibility; and
  - Principle 9: encourage the development and diffusion of environmentally friendly technologies.
  - d) Anti-Corruption
  - Principle 10: Businesses should work against corruption in all its forms, including extortion and bribery.

#### 4 INDEPENDENT TENDERING

- 4.1 For the purposes of that Certificate in relation to any submitted Tender, the Tenderer declares to fully understand that the word "competitor" shall include any individual or organisation, other than the Tenderer, whether or not affiliated with the Tenderer, who:
  - a) has been requested to submit a Tender in response to this Tender invitation;
  - b) could potentially submit a Tender in response to this Tender invitation, based on their qualifications, abilities or experience; and
  - c) provides the same Goods and Services as the Tenderer and/or is in the same line of business as the Tenderer.
- 4.2 The Tenderer has arrived at his submitted Tender independently from, and without consultation, communication, agreement or arrangement with any competitor. However communication between partners in a joint venture or consortium will not be construed as collusive tendering.



Substations under the control Depot Engineer, Ermelo




- 4.3 In particular, without limiting the generality of paragraph 5 above, there has been no consultation, communication, agreement or arrangement with any competitor regarding:
  - a) prices;
  - b) geographical area where Goods or Services will be rendered [market allocation];
  - c) methods, factors or formulas used to calculate prices;
  - d) the intention or decision to submit or not to submit, a Tender;
  - e) the submission of a Tender which does not meet the specifications and conditions of the RFP; or
  - f) tendering with the intention of not winning the Tender.
- 4.4 In addition, there have been no consultations, communications, agreements or arrangements with any competitor regarding the quality, quantity, specifications and conditions or delivery particulars of the Goods or Services to which his/her tender relates.
- 4.5 The terms of the Tender as submitted have not been, and will not be, disclosed by the Tenderer, directly or indirectly, to any competitor, prior to the date and time of the official Tender opening or of the awarding of the contract.
- 4.6 Tenderers are aware that, in addition and without prejudice to any other remedy provided to combat any restrictive practices related to Tenders and contracts, Tenders that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and/or may be reported to the National Prosecuting Authority [NPA] for criminal investigation and/or may be restricted from conducting business with the public sector for a period not exceeding 10 [ten] years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.
- 4.7 Should the Tenderer find any terms or conditions stipulated in any of the relevant documents quoted in the Tender unacceptable, it should indicate which conditions are unacceptable and offer alternatives by written submission on its company letterhead, attached to its submitted Tender. Any such submission shall be subject to review by Transnet's Legal Counsel who shall determine whether the proposed alternative(s) are acceptable or otherwise, as the case may be.

#### 5 DISQUALIFICATIONS FROM TENDERING PROCESS

- 5.1 If the Tenderer / Service Provider / Contractor has committed a transgression through a violation of section 3 of this Integrity Pact or in any other form such as to put its reliability or credibility as a Tenderer / Service Provider into question, Transnet may reject the Tenderer's / Service Provider's / Contractor's application from the registration or tendering process and remove the Tenderer / Service Provider from its database, if already registered.
- 5.2 If the Tenderer / Service Provider / Contractor has committed a transgression through a violation of section 3, or any material violation, such as to put its reliability or credibility into question. Transnet may after following due procedures and at its own discretion also exclude the Tenderer / Service Provider / Contractor from future tendering processes. The

# Transnet Rail Infrastructure Manager





Substations under the control Depot Engineer, Ermelo



imposition and duration of the exclusion will be determined by the severity of the transgression. The severity will be determined by the circumstances of the case, which will include amongst others the number of transgressions, the position of the transgressors within the company hierarchy of the Tenderer / Service Provider /Contractor and the amount of the damage. The exclusion will be imposed for up to a maximum of 10 (ten) years. However, Transnet reserves the right to impose a longer period of exclusion, depending on the gravity of the misconduct.

5.3 If the Tenderer / Service Provider / Contractor can prove that it has restored the damage caused by it and has installed a suitable corruption prevention system, or taken other remedial measures as the circumstances of the case may require, Transnet may at its own discretion revoke the exclusion or suspend the imposed penalty.

#### 6 TRANSNET'S LIST OF EXCLUDED TENDERERS (BLACKLIST)

- 6.1 The process of restriction is used to exclude a company/person from conducting future business with Transnet and other organs of state for a specified period. No Tender shall be awarded to a Tenderer whose name (or any of its members, directors, partners or trustees) appear on the Register of Tender Defaulters kept by National Treasury, or who have been placed on National Treasury's List of Restricted Suppliers. Transnet reserves the right to withdraw an award, or cancel a contract concluded with a Tenderer should it be established, at any time, that a tenderer has been restricted with National Treasury by another government institution.
- All the stipulations around Transnet's blacklisting process as laid down in Transnet's 6.2 Supply Chain Policy and Procurement Procedures Manual (CPM included) are included herein by way of reference. Below follows a condensed summary of this blacklisting procedure.
- On completion of the restriction procedure, Transnet will submit the restricted entity's 6.3 details (including the identity number of the individuals and registration number of the entity) to National Treasury for placement on National Treasury's Database of Restricted Suppliers for the specified period of exclusion. National Treasury will make the final decision on whether to restrict an entity from doing business with any organ of state for a period not exceeding 10 years and place the entity concerned on the Database of Restricted Suppliers published on its official website.
- 6.4 The decision to restrict is based on one of the grounds for restriction. The standard of proof to commence the restriction process is whether a "prima facie" (i.e. on the face of it) case has been established.
- 6.5 Depending on the seriousness of the misconduct and the strategic importance of the Goods/Services, in addition to restricting a company/person from future business, Transnet may decide to terminate some or all existing contracts with the company/person as well.
  - 6.6 A Service Provider or Contractor to Transnet may not subcontract any portion of the contract to a blacklisted company.



- 6.7 Grounds for blacklisting include: If any person/Enterprise which has submitted a Tender, concluded a contract, or, in the capacity of agent or subcontractor, has been associated with such Tender or contract:
  - a) Has, in bad faith, withdrawn such Tender after the advertised closing date and time for the receipt of Tenders;
  - b) has, after being notified of the acceptance of his Tender, failed or refused to sign a contract when called upon to do so in terms of any condition forming part of the Tender documents;
  - c) has carried out any contract resulting from such Tender in an unsatisfactory manner or has breached any condition of the contract;
  - d) has offered, promised or given a bribe in relation to the obtaining or execution of the contract:
  - e) has acted in a fraudulent or improper manner or in bad faith towards Transnet or any Government Department or towards any public body, Enterprise or person;
  - f) has made any incorrect statement in a certificate or other communication with regard to the Local Content of his Goods or his B-BBEE status and is unable to prove to the satisfaction of Transnet that:
    - (i) he made the statement in good faith honestly believing it to be correct; and
    - (ii) before making such statement he took all reasonable steps to satisfy himself of its correctness;
  - g) caused Transnet damage, or to incur costs in order to meet the contractor's requirements and which could not be recovered from the contractor;
  - h) has litigated against Transnet in bad faith.
- 6.8 Grounds for blacklisting include a company/person recorded as being a company or person prohibited from doing business with the public sector on National Treasury's database of Restricted Service Providers or Register of Tender Defaulters.
- 6.9 Companies associated with the person/s guilty of misconduct (i.e. entities owned, controlled or managed by such persons), any companies subsequently formed by the person(s) guilty of the misconduct and/or an existing company where such person(s) acquires a controlling stake may be considered for blacklisting. The decision to extend the blacklist to associated companies will be at the sole discretion of Transnet.

#### 7 PREVIOUS TRANSGRESSIONS

7.1 The Tenderer / Service Provider /Contractor hereby declares that no previous transgressions resulting in a serious breach of any law, including but not limited to, corruption, fraud, theft, extortion and contraventions of the Competition Act 89 of 1998,



which occurred in the last 5 (five) years with any other public sector undertaking, government department or private sector company that could justify its exclusion from its registration on the Tenderer's / Service Provider's / Contractor's database or any tendering process.


If it is found to be that the Tenderer / Service Provider /Contractor made an incorrect 7.2 statement on this subject, the Tenderer / Service Provider / Contractor can be rejected from the registration process or removed from the Tenderer / Service Provider / Contractor database, if already registered, for such reason (refer to the Breach of Law Form contained in the applicable RFX document.)

#### 8 SANCTIONS FOR VIOLATIONS

- 8.1 Transnet shall also take all or any one of the following actions, wherever required to:
  - a) Immediately exclude the Tenderer / Service Provider / Contractor from the tendering process or call off the pre-contract negotiations without giving any compensation the Tenderer / Service Provider / Contractor. However, the proceedings with the other Tenderer / Service Provider / Contractor may continue;
  - Immediately cancel the contract, if already awarded or signed, without giving any compensation to the Tenderer / Service Provider / Contractor;
  - Recover all sums already paid by Transnet; c)
  - Encash the advance bank guarantee and performance bond or warranty bond, if furnished d) by the Tenderer / Service Provider / Contractor, in order to recover the payments, already made by Transnet, along with interest;
  - Cancel all or any other contracts with the Tenderer / Service Provider; and
- Exclude the Tenderer / Service Provider / Contractor from entering into any Tender with Transnet in future.

#### **CONFLICTS OF INTEREST** 9

- 9.1 A conflict of interest includes, inter alia, a situation in which:
  - A Transnet employee has a personal financial interest in a tendering / supplying entity; and
  - A Transnet employee has private interests or personal considerations or has an affiliation or a relationship which affects, or may affect, or may be perceived to affect his / her judgment in action in the best interest of Transnet, or could affect the employee's motivations for acting in a particular manner, or which could result in, or be perceived as favouritism or nepotism.
- 9.2 A Transnet employee uses his / her position, or privileges or information obtained while acting in the capacity as an employee for:



Substations under the control Depot Engineer, Ermelo

- a) Private gain or advancement; or
- b) The expectation of private gain, or advancement, or any other advantage accruing to the employee must be declared in a prescribed form.


Thus, conflicts of interest of any Tender committee member or any person involved in the sourcing process must be declared in a prescribed form.

- 9.3 If a Tenderer / Service Provider / Contractor has or becomes aware of a conflict of interest i.e. a family, business and / or social relationship between its owner(s) / member(s) / director(s) / partner(s) / shareholder(s) and a Transnet employee / member of Transnet's Board of Directors in respect of a Tender which will be considered for the Tender process, the Tenderer / Service Provider / Contractor:
  - a) must disclose the interest and its general nature, in the Request for Proposal ("RFX") declaration form; or
  - b) must notify Transnet immediately in writing once the circumstances has arisen.
- 9.4 The Tenderer / Service Provider / Contractor shall not lend to or borrow any money from or enter into any monetary dealings or transactions, directly or indirectly, with any committee member or any person involved in the sourcing process, where this is done, Transnet shall be entitled forthwith to rescind the contract and all other contracts with the Tenderer / Service Provider / Contractor.

#### 10 DISPUTE RESOLUTION

- 10.1 Transnet recognises that trust and good faith are pivotal to its relationship with its Tenderer / Service Provider / Contractor. When a dispute arises between Transnet and its Tenderer / Service Provider / Contractor, the parties should use their best endeavours to resolve the dispute in an amicable manner, whenever possible. Litigation in bad faith negates the principles of trust and good faith on which commercial relationships are based. Accordingly, following a blacklisting process as mentioned in paragraph 0 above, Transnet will not do business with a company that litigates against it in bad faith or is involved in any action that reflects bad faith on its part. Litigation in bad faith includes, but is not limited to the following instances:
  - a) Vexatious proceedings: these are frivolous proceedings which have been instituted without proper grounds;
  - b) **Perjury:** where a Tenderer / Service Provider / Contractor make a false statement either in giving evidence or on an affidavit;

TRANSNET



Substations under the control Depot Engineer, Ermelo



- c) Scurrilous allegations: where a Tenderer / Service Provider / Contractor makes allegations regarding a senior Transnet employee which are without proper foundation, scandalous, abusive or defamatory; and
- d) **Abuse of court process:** when a Tenderer / Service Provider / Contractor abuses the court process in order to gain a competitive advantage during a Tender process.

#### 11 GENERAL

- 11.1 This Integrity Pact is governed by and interpreted in accordance with the laws of the Republic of South Africa.
- 11.2 The actions stipulated in this Integrity Pact are without prejudice to any other legal action that may follow in accordance with the provisions of the law relating to any civil or criminal proceedings.
- 11.3 The validity of this Integrity Pact shall cover all the tendering processes and will be valid for an indefinite period unless cancelled by either Party.
- 11.4 Should one or several provisions of this Integrity Pact turn out to be invalid the remainder of this Integrity Pact remains valid.
- 11.5 Should a Tenderer / Service Provider / Contractor be confronted with dishonest, fraudulent or corruptive behaviour of one or more Transnet employees, Transnet expects its Tenderer / Service Provider / Contractor to report this behaviour directly to a senior Transnet official / employee or alternatively by using Transnet's "Tip-Off Anonymous" hotline number 0800 003 056, whereby your confidentiality is guaranteed.

The Parties hereby declare that	each of them has read and understood the clauses of this Integrity
Pact and shall a Tenderer by it.	To the best of the Parties' knowledge and belief, the information
provided in this Integrity Pact is	true and correct.
1	duly authorised by the tendering entity, hereby certify that
the tendering entity are fully ac	cquainted with the contents of the Integrity Pact and further agree
to abide by it in full.	
Signature	
Date	


Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo



# T2.2.20 PROTECTION OF PERSONAL INFORMATION (For normal contract)

- 1. The following terms shall bear the same meaning as contemplated in Section 1 of the Protection of Person information act, No.4 of 2013. ("POPIA"):
  - consent; data subject; electronic communication; information officer; operator; person; personal information; processing; record; Regulator; responsible party; special information; as well as any terms derived from these terms.
- 2. Transnet will process all information by the Respondent in terms of the requirements contemplated in Section 4(1) of the POPIA:
  - Accountability; Processing limitation; Purpose specification; Further processing limitation; Information quality; Openness; Security safeguards and Data subject participation.
- 3. The Parties acknowledge and agree that, in relation to personal information that will be processed pursuant to this RFQ, the Responsible party is "Transnet" and the Data subject is the "Respondent". Transnet will process personal information only with the knowledge and authorisation of the Respondent and will treat personal information which comes to its knowledge as confidential and will not disclose it, unless so required by law or subject to the exceptions contained in the POPIA.
- 4. Transnet reserves all the rights afforded to it by the POPIA in the processing of any of its information as contained in this RFQ and the Respondent is required to comply with all prescripts as detailed in the POPIA relating to all information concerning Transnet.
- 5. In responding to this bid, Transnet acknowledges that it will obtain and have access to personal information of the Respondent. Transnet agrees that it shall only process the information disclosed by Respondent in their response to this bid for the purpose of evaluating and subsequent award of business and in accordance with any applicable law.
- 6. Transnet further agrees that in submitting any information or documentation requested in this RFQ, the Respondent is consenting to the further processing of their personal information for the purpose of, but not limited to, risk assessment, assurances, contract award, contract management, auditing, legal opinions/litigations, investigations (if applicable), document storage for the legislatively required period, destruction, de-identification and publishing of personal information by Transnet and/or its authorised appointed third parties.
- 7. Furthermore, Transnet will not otherwise modify, amend or alter any personal data submitted by the Respondent or disclose or permit the disclosure of any personal data to any third party without the prior written consent from the Respondent. Similarly, Transnet requires the Respondent to process any personal information disclosed by Transnet in the bidding process in the same manner.
- 8. Transnet shall, at all times, ensure compliance with any applicable laws put in place and maintain sufficient measures, policies and systems to manage and secure against all forms of risks to any



Substations under the control Depot Engineer, Ermelo



information that may be shared or accessed pursuant to this RFQ (physically, through a computer or any other form of electronic communication).

- 9. Transnet shall notify the Respondent in writing of any unauthorised access to information, cybercrimes or suspected cybercrimes, in its knowledge and report such crimes or suspected crimes to the relevant authorities in accordance with applicable laws, after becoming aware of such crimes or suspected crime. The Respondent must take all necessary remedial steps to mitigate the extent of the loss or compromise of personal information and to restore the integrity of the affected personal information as quickly as is possible.
- 10. The Respondent may, in writing, request Transnet to confirm and/or make available any personal information in its possession in relation to the Respondent and if such personal information has been accessed by third parties and the identity thereof in terms of the POPIA. The Respondent may further request that Transnet correct (excluding critical/mandatory or evaluation information), delete, destroy, withdraw consent or object to the processing of any personal information relating to the Respondent in Transnet's possession in terms of the provision of the POPIA and utilizing Form 2 of the POPIA Regulations.
- 11. In submitting any information or documentation requested in this RFQ, the Respondent is hereby consenting to the processing of their personal information for the purpose of this RFQ and further confirming that they are aware of their rights in terms of Section 5 of POPIA.

#### Respondents are required to provide consent below:

YES

Further,	the Respondent	declares t	that they	have	obtained	all	consents	pertaining	to	other	data
subject's	s personal informa	ation includ	led in its s	submis	ssion and	the	reby inden	nnifying Tra	ansı	net ag	ainst

any civil or criminal action, administrative fines or other penalty or loss that may arise as a result of

NO


the processing of any personal information that the Respondent submitted.

13. The Respondent declares that the personal information submitted for the purpose of this RFQ is complete, accurate, not misleading, is up to date and may be updated where applicable.

Signature of Peer	ondent's authorise	d representative:	
Sidilatule of Mesh	JUHUEHILS AULHUHSE	iu representative.	

Should a Respondent have any complaints or objections to processing of its personal information, by Transnet, the Respondent can submit a complaint to the Information Regulator on <a href="https://www.justice.gov.za/inforeg/">https://www.justice.gov.za/inforeg/</a>, click on contact us, click on complaints.IR@justice.gov.za

12.



Substations under the control Depot Engineer, Ermelo





#### T2.2-21: Insurance provided by the Contractor

Clause 83.1 in NEC3 Term Service Contract (June 2005) (amended June 2006 and April 2013) requires that the *Contractor* provides the insurance stated in the insurance table except any insurance which the *Employer* is to provide as stated in the Contract Data.

Please provide the following details for insurance which the *Contractor* is still to provide. Notwithstanding this information all costs related to insurance are deemed included in the tenderer's rates and prices.

Insurance against (See clause 83.1 of the TSC)	Name of Insurance Company	Cover	Premium
Liability for death of or bodily injury to employees of the <i>Contractor</i> arising out of and in the course of their employment in connection with this contract			
Motor Vehicle Liability Insurance comprising (as a minimum) "Balance of Third Party" Risks including Passenger and Unauthorised Passenger Liability indemnity with a minimum indemnity limit of R5 000 000			
Insurance in respect of loss of or damage to own property and equipment.			







## T2.2-22: Three (3) years audited financial statements

Attached to this schedule is the last three (3) years audited financial statements of the single tenderer/members of the Joint Venture.

NAME OF COMPANY/IES and INDEX OF ATTACHN	

Substations under the control Depot Engineer, Ermelo



# T2.2-23 TRANSNET VENDOR REGISTRATION SUPPLIER DECLARATION FORM

Transnet Vendor Management has received a request to load / update your company details on to the Transnet vendor database. Please return the completed Supplier Declaration Form (SDF) together with the required supporting documents as per Appendix V to the Transnet Official who is intending to procure your company's services / products, to enable us to process this request. Please only submit the documentation relevant to your request.

- 1. Complete the "Supplier Declaration Form" (SDF) on page 2 of this letter
- 2. Original cancelled cheque OR letter from the bank verifying banking details (with bank stamp)
- 3. **Certified** copy of Identity document of Shareholders/Directors/Members (where applicable)
- 4. **Certified** copy of certificate of incorporation, CM29 / CM9 (name change)
- 5. **Certified** copy of share Certificates of Shareholders, CK1 / CK2 (if CC)
- 6. A letter with the company's letterhead confirming physical and postal addresses
- 7. Original or certified copy of SARS Tax Clearance certificate and Vat registration certificate
- 8. A signed letter from the Auditor / Accountant confirming most recent annual turnover and percentage black ownership in the company **AND/OR** BBBEE certificate and detailed scorecard from an accredited rating agency (SANAS member).

**NB:** Effective 1 April 2016 all organisations, institutions and individuals who wish to provide goods and/or services to Organs of the State must be registered on the National Treasury Central Supplier Database (CSD). This needs to be done via their portal at <a href="https://secure.csd.gov.za/">https://secure.csd.gov.za/</a> before applying to Transnet.

#### **General Terms and Conditions:**

Failure to submit the relevant documentation will delay the vendor creation / change process.

Where applicable, the respective Transnet Operating Division processing your application may request further information from you.

The Service Provider warrants that the details of its bank account ("the nominated account") provided herein, are correct and acknowledges that payments due to the Supplier will be made into the nominated account. If details of the nominated account should change, the Service Provider must notify Transnet in writing of such change, failing which any payments made by Transnet into the nominated account will constitute a full discharge of the indebtedness of Transnet to the Supplier in respect of the payment so made. Transnet will incur no liability for any payments made to the incorrect account or any costs associated therewith. In such event, the Service Provider indemnifies and holds Transnet harmless in respect of any payments made to an incorrect bank account and will, on demand, pay Transnet any costs associated herewith.

Transnet expects its suppliers to timeously renew their Tax Clearance and B-BBEE certificates (where applicable, as EMEs and QSEs are only expected to supply an affidavit as per Appendix III and IV), as well as all affidavits, annually. Failure to do so may result in the supplier's account being temporarily suspended.



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction

Substations under the control Depot Engineer, Ermelo

## **Supplier Declaration Form**

NB: Effective 1 April 2016 all organisations, institutions and individuals who wish to provide goods and/or services to										
Organs of the State must be registered on the National Treasury Central Supplier Database (CSD). This needs to be done										
via their portal at htt							` '			
CSD Number (MAA	Δ ×××××××).									
COD Number (MAA	A ******/.									
Company Trading N	lame									
Company Registere	ed Name									
Company Registrati Sole Proprietor	ion No Or ID No	If a								
Company Income T	ax Number									
	CC	,	Trust	Pty Ltd	Limited	I	Partners	hip	Sole Pro	prietor
Form of Entity	Non-profit		ersonal bility Co	State Owned Co	National Govt	Provincial Govt		Local Govt		
	Educational Institution	Specialised Profession		Financial Institution	Foreign International	Foreign Branch Office				
Did your company p	Did your company previously operate under another name?  Yes  No									
If YES state the pre-	vious details bel	low:								
Trading Name										
Registered Name										
Company Registration No Or ID No If a Sole Proprietor										
	CC		Trust	Pty Ltd	Limited	I	Partners	hip	Sole Pro	prietor
Form of Entity	Non-profit	Lia	ersonal bility Co	State Owned Co	National Govt		ovincial		Local	Govt
	Educational Institution	-	ecialised ofession	Financial Institution	Foreign International	Fo	oreign Bra Office			
Your Current Comp	any's VAT Regis	stratio	n Status							



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo


VAT Registration Number						
If Exempted from VAT registration, state reason and submit proof from SARS in confirming the exemption status						
If your business entity is not VAT Register Your Non VAT Registration must be conf		rent original swo	orn affidavit (s	ee exampl	e in Appendix	( I).
Company Banking Details		Bank Nam	e			
Universal Branch Code		Bank Acco	unt Number			
				•		
Company Physical Address						
			С	ode		
Company Postal Address			·	·		
Company Coda Madicos			С	ode		
Company Telephone number						
Company Fax Number						
Company E-Mail Address						
Company Website Address						
	L					
Company Contact Person Name						
Designation						
Telephone						
Email						
Is your company a Labour Broker?			Yes		No	
Main Product / Service Supplied e.g. Sta	tionery / Consulting /					
Labour etc.						
How many personnel does the business	employ?	Full Time		Part Time	)	
Please Note: Should your business employ more than 2 full time employees who are not connected persons as defined in the Income Tax Act, please submit a sworn affidavit, as per Appendix II.						



Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction


Substations under the control Depot Engineer, Ermelo

Most recent Financial Year's	<r10million< th=""><th></th><th>&gt;R10Million <r50million< th=""><th></th><th>&gt;R50Million</th><th></th></r50million<></th></r10million<>		>R10Million <r50million< th=""><th></th><th>&gt;R50Million</th><th></th></r50million<>		>R50Million		
Does your company have a v	Does your company have a valid BBBEE certificate?  Yes No						
What is your broad based BE	E status (Level 1 to	9)					
Majority Race of Ownership							
% Black Ownership	% Black Wor ownership		, , ,	ack Disabled (s) ownership		% Black Youth ownership	
Please Note: Please provide affidavit following the exampl ownership, then provide a <b>ce</b>	es provided in Appe	endix III and IV re	espective	ly. If you have inc	licated Bla	ack Disabled pers	son(s)
	By signing below, I hereby verify that I am duly authorised to sign for and on behalf of firm / organisation and that all information contained herein and attached herewith are true and correct						
Name			Des	ignation			
Signature			Date	9			
Stema And Simpton Of Co		م داد م		·			
Stamp And Signature Of Commissioner Of Oaths							
Name			Date	9			
Signature			Tele	phone No			





APPENDIX	В
Affidavit or Solemn Declaration as to VAT registration status	
Affidavit or Solemn Declaration	
I,solemnly	
swear/declare that is	
not a registered VAT vendor and is not required to register as a VAT vendor because the combine	∍d
value of taxable supplies made by the provider in any 12 month period has not exceeded or is r	ot
expected to exceed R1million threshold, as required in terms of the Value Added Tax Act.	
Signature:	
Designation:	
Date:	
Commissioner of Oaths	
Thus signed and sworn to before me at on this thed	ay
of,	
the Deponent having knowledge that he/she knows and understands the contents of this Affidavit, a that he/she has no objection to taking the prescribed oath, which he/she regards binding on his/h conscience and that the allegations herein contained are all true and correct.	
Commissioner of Oaths	



Substations under the control Depot Engineer, Ermelo



#### **APPENDIX C**

#### SWORN AFFIDAVIT - B-BBEE QUALIFYING SMALL ENTERPRISE - GENERAL

I, the undersigned,

Full name & Surname	
Identity number	

Hereby declare under oath as follows:

- 1. The contents of this statement are to the best of my knowledge a true reflection of the facts.
- 2. I am a Member / Director / Owner of the following enterprise and am duly authorised to act on its behalf:

Enterprise Name:	
Trading Name (If Applicable):	
Registration Number:	
Enterprise Physical Address:	
Type of Entity (CC, (Pty) Ltd, Sole Prop etc.):	
Nature of Business:	
Definition of "Black People"	As per the Broad-Based Black Economic Empowerment Act 53 of 2003 as Amended by Act No 46 of 2013 "Black People" is a generic term which means Africans,  Coloureds and Indians —  (a) who are citizens of the Republic of South Africa by birth or descent;  or  (b) who became citizens of the Republic of South Africa by naturalisation—  i. before 27 April 1994; or  ii. on or after 27 April 1994 and who would have been entitled to acquire citizenship by naturalization prior to that date;"
Definition of "Black Designated Groups"	Black Designated Groups means:  (a) unemployed black people not attending and not required by law to attend an educational institution and not awaiting admission to an educational institution;  (b) Black people who are youth as defined in the National Youth Commission Act of 1996;



 ${\hbox{Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv\ Dc\ Traction}$ 

Substations under the control Depot Engineer, Ermelo

(c)	Black people who are persons with disabilities as defined in the Code of Good
	Practice on employment of people with disabilities issued under the
	Employment Equity Act;

- (d) Black people living in rural and underdeveloped areas;
- (e) Black military veterans who qualifies to be called a military veteran in terms of the Military Veterans Act 18 of 2011;"

3. I her	eby declare under Oath that:
•	The Enterprise is% Black Owned as per Amended Code Series 100 of the
	Amended Codes of Good Practice issued under section 9 (1) of B-BBEE Act No 53 of 2003 as
	Amended by Act No 46 of 2013,
•	The Enterprise is% Black Female Owned as per Amended Code Series
	100
	of the Amended Codes of Good Practice issued under section 9 (1) of B-BBEE Act No 53 of
	2003 as Amended by Act No 46 of 2013,
•	The Enterprise is% Black Designated Group Owned as per Amended Code
	Series 100 of the Amended Codes of Good Practice issued under section 9 (1) of B-BBEE Act
	No 53 of 2003 as Black Designated Group Owned % Breakdown as per the definition stated
above:	
•	Black Youth % =%
•	Black Disabled % =%
•	Black Unemployed % =%
•	Black People living in Rural areas % =%
•	Black Military Veterans % =%
•	Based on the Financial Statements/Management Accounts and other information available on
	the latest financial year-end of, the annual Total Revenue was between
	R10,000,000.00 (Ten Million Rands) and R50,000,000.00 (Fifty Million Rands),
•	Please confirm on the table below the B-BBEE level contributor, by ticking the applicable

box.




Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

100% Black Owned	Level One (135% B-BBEE procurement recognition level)	
At Least 51% black owned	Level Two (125% B-BBEE procurement recognition level)	

4. I know and understand the contents of this affidavit and I have no objection to take the prescribed oath and consider the oath binding on my conscience and on the owners of the enterprise which I represent in this matter.						
5. The sworn affidavit will be valid for	a period of 12 months from the date signed by commissioner.					
Deponent Signature						
Date						
Commissioner of Oaths						
Thus signed and sworn to before me	at on this theday					
of	20					
that he/she has no objection to taking	he/she knows and understands the contents of this Affidavit, and ng the prescribed oath, which he/she regards binding on his/her therein contained are all true and correct.					
Commissioner of Oaths						
Stamp and date						

Part T2: Returnable Documents T2.2: Returnable Schedules Tender Number: ERACMM-KDS-51150



Substations under the control Depot Engineer, Ermelo



#### **APPENDIX D** SWORN AFFIDAVIT - B-BBEE EXEMPTED MICRO ENTERPRISE - GENERAL

I, the undersigned,

Full name & Surname	
Identity number	

Hereby declare under oath as follows:

- 1. The contents of this statement are to the best of my knowledge a true reflection of the facts.
- 2. I am a Member / Director / Owner of the following enterprise and am duly authorised to act on its behalf:

Enterprise Name:	
Trading Name (If	
Applicable):	
Registration	
Number:	
Enterprise	
Physical Address:	
Type of Entity	
(CC, (Pty) Ltd,	
Sole Prop etc.):	
Nature of	
Business:	
Definition of	As per the Broad-Based Black Economic Empowerment Act 53 of 2003 as
"Black	Amended by Act No 46 of 2013 "Black People" is a generic term which
People"	means Africans, Coloureds and Indians –
	(a) who are citizens of the Republic of South Africa by birth or descent;
	or
	(b) who became citizens of the Republic of South Africa by naturalisationi-
	i. before 27 April 1994; or
	25.2.0




Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

	ii. on or after 27 April 1994 and who would have been entitled to	
	acquire citizenship by naturalization prior to that date;"	
Definition of	"Black Designated Groups means:	
"Black	(a) unemployed black people not attending and not required by law to	
Designated	attend an educational institution and not awaiting admission to an	
Groups"	educational institution;	
	(b) Black people who are youth as defined in the National Youth	
	Commission Act of 1996;	
	(c) Black people who are persons with disabilities as defined in the Code of	
	Good Practice on employment of people with disabilities issued under	
	the Employment Equity Act;	
	(d) Black people living in rural and under developed areas;	
	(e) Black military veterans who qualifies to be called a military veteran in	
	terms of the Military Veterans Act 18 of 2011;"	

3.	ı	hereby	/ declare	under	Oath	that:

•	The Enterprise is	_% Black Owned as per Amended Code Series 100 of the
	Amended Codes of Good Practice	sissued under section 9 (1) of B-BBEE Act No 53 of 2003
	as Amended by Act No 46 of 2013	3,
•	The Enterprise is	_% Black Female Owned as per Amended Code Series
	100 of the Amended Codes of Go	od Practice issued under section 9 (1) of B-BBEE Act No 53
	of 2003 as Amended by Act No 46	of 2013,
•	The Enterprise is	_% Black Designated Group Owned as per Amended Code
	Series 100 of the Amended Codes	s of Good Practice issued under section 9 (1) of B-BBEE Act
	No 53 of 2003 as Amended by Ac	t No 46 of 2013,
	ŕ	
•	Black Designated Group Owned %	6 Breakdown as per the definition stated above:
•	Black Youth % =	_%
•	Black Disabled % =	%
•	Black Unemployed % =	%
•	Black People living in Rural areas	% =%
•	Black Military Veterans % =	%
•	Based on the Financial Statement	s/Management Accounts and other information available on
	the latest financial year-end of	, the annual Total Revenue was
	R10,000,000.00 (Ten Million Rand	



Substations under the control Depot Engineer, Ermelo

 Please Confirm on the below table the B-BBEE Level Contributor, by ticking the applicable box.

100% Black Owned	Level One (135% B-BBEE procurement recognition	
At least 51% Black Owned	Level Two (125% B-BBEE procurement recognition level)	
Less than 51% Black Owned	Level Four (100% B-BBEE procurement recognition level)	

4. I know and understand the contents of this affice oath and consider the oath binding on my con represent in this matter.	•	
5. The sworn affidavit will be valid for a period of	12 months from the date signed by commis	ssioner.
Deponent Signature		
Date		
Commissioner of Oaths		
Thus signed and sworn to before me at	on this the	day
of20	,	
the Deponent having knowledge that he/she know that he/she has no objection to taking the preso conscience and that the allegations herein contain	cribed oath, which he/she regards binding	
Commissioner of Oaths		

Part T2: Returnable Documents T2.2: Returnable Schedules TRANSNET

CPM 2020 - Rev 05

Signature & stamp





Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

# C1.1 Form of Offer & Acceptance

#### Offer

The Employer, identified in the Acceptance signature block, has solicited offers to enter into a contract for the procurement of:

For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

The tenderer, identified in the Offer signature block, has

either	examined the documents listed in the Tender Data and addenda thereto as listed in the Returnable Schedules, and by submitting this Offer has accepted the Conditions of Tender.
or	examined the draft contract as listed in the Acceptance section and agreed to provide this Offer.

By the representative of the tenderer, deemed to be duly authorised, signing this part of this Form of Offer and Acceptance the tenderer offers to perform all of the obligations and liabilities of the *Contractor* under the contract including compliance with all its terms and conditions according to their true intent and meaning for an amount to be determined in accordance with the *conditions of contract* identified in the Contract Data.

The offered total of the Prices exclusive of VAT is	
Value Added Tax @ 15% is	
The offered total of the Prices inclusive of VAT is	
(in words)	

This Offer may be accepted by the Employer by signing the Acceptance part of this Form of Offer and Acceptance and returning one copy of this document including the Schedule of Deviations (if any) to the tenderer before the end of the period of validity stated in the Tender Data, or other period as agreed, whereupon the tenderer becomes the party named as the *Contractor* in the *conditions of contract* identified in the Contract Data.

Signature(s)			
Name(s)			
Capacity			
For the tenderer:			
	(Insert name and address of organisation)		
Name & signature of witness		Date	
Tenderer's CII	DB registration number:		



Transnet Rail Infrastructure Manager Contract Number: ERACMM-FDT-51150

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the

control Depot Engineer, Ermelo

#### Acceptance

By signing this part of this Form of Offer and Acceptance, the Employer identified below accepts the tenderer's Offer. In consideration thereof, the Employer shall pay the Contractor the amount due in accordance with the *conditions of contract* identified in the Contract Data. Acceptance of the tenderer's Offer shall form an agreement between the Employer and the tenderer upon the terms and conditions contained in this agreement and in the contract that is the subject of this agreement.

The terms of the contract, are contained in:

Part C1 Agreements and Contract Data, (which includes this Form of Offer and Acceptance)

Part C2 Pricing Data

Part C3 Scope of Work: Service Information

and drawings and documents (or parts thereof), which may be incorporated by reference into the above listed Parts.

Deviations from and amendments to the documents listed in the Tender Data and any addenda thereto listed in the Returnable Schedules as well as any changes to the terms of the Offer agreed by the tenderer and the Employer during this process of offer and acceptance, are contained in the Schedule of Deviations attached to and forming part of this Form of Offer and Acceptance. No amendments to or deviations from said documents are valid unless contained in this Schedule.

The tenderer shall within two weeks of receiving a completed copy of this agreement, including the Schedule of Deviations (if any), contact the Employer's agent (whose details are given in the Contract Data) to arrange the delivery of any securities, bonds, guarantees, proof of insurance and any other documentation to be provided in terms of the *conditions of contract* identified in the Contract Data at, or just after, the date this agreement comes into effect. Failure to fulfil any of these obligations in accordance with those terms shall constitute a repudiation of this agreement.

Notwithstanding anything contained herein, this agreement comes into effect on the date of award.

Unless the tenderer (now *Contractor*) within five working days of the date of such receipt notifies the Employer in writing of any reason why he cannot accept the contents of this agreement, this agreement shall constitute a binding contract between the Parties.

Signature(s)		
Name(s)		
Capacity		
for the Employer		
	(Insert name and address of organisation)	
Name & signature of witness		Date

CPM 2020 Rev 01 PAGE 2 Part C1



Transnet Rail Infrastructure Manager Contract Number: ERACMM-FDT-51150

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

#### Schedule of Deviations

Note:


- To be completed by the Employer prior to award of contract. This part of the Offer & Acceptance would not be required if the contract has been developed by negotiation between the Parties and is not the result of a process of competitive tendering.
- The extent of deviations from the tender documents issued by the Employer prior to the tender closing date is limited to those permitted in terms of the Conditions of Tender.
- A tenderer's covering letter must not be included in the final contract document. Should any matter in such letter, which constitutes a deviation as aforesaid be the subject of agreement reached during the process of Offer and Acceptance, the outcome of such agreement shall be recorded here and the final draft of the contract documents shall be revised to incorporate the effect of it.

No.	Subject	Details
1		
2		
3		
4		
5		
6		
7		

By the duly authorised representatives signing this Schedule of Deviations below, the Employer and the tenderer agree to and accept this Schedule of Deviations as the only deviations from and amendments to the documents listed in the Tender Data and any addenda thereto listed in the Tender Schedules, as well as any confirmation, clarification or changes to the terms of the Offer agreed by the tenderer and the Employer during this process of Offer and Acceptance.

It is expressly agreed that no other matter whether in writing, oral communication or implied during the period between the issue of the tender documents and the receipt by the tenderer of a completed signed copy of this Form shall have any meaning or effect in the contract between the parties arising from this Agreement.

	For the tenderer:	For the Employer
Signature		
Name		
Capacity		
On behalf of	(Insert name and address of organisation)	(Insert name and address of organisation)
Name & signature of witness		
Date		



# C1.2 Contract Data

# Part one - Data provided by the Employer


Clause	Statement	Data			
1	General				
	The <i>conditions of contract</i> are the core clauses and the clauses for main Option:				
		A:	Priced contract with price list		
	dispute resolution Option	W1:	Dispute resolution procedure		
	and secondary Options	X2:	Changes in the law		
		X18:	Limitation of liability		
		Z:	Additional conditions of contract		
	of the NEC3 Term Service Contract (June 2005) (and amended June 2006 and April 2013)				
10.1	The <i>Employer</i> is:	Transnet SOC Ltd			
	Address	Transnet Corporate Centre 138 Eloff Street Braamfontein Johannesburg 2000			
	Having elected its Contractual Address for the purposes of this contract as:	Transnet Freight Rail Supply Chain Services- Pretoria Nzasm Building Corner Minaar and Paul Kruger Street Pretoria 0001			
	Tel No.	012 3	15 2059 / 012 315 2125		
10.1	The Service Manager is (name):	Mpho	Machethe		
	Address	22 In Ermel 2351	dustria Avenue o		
	Tel	083 9	80 0954		



6	Compensation events	No additional data is required for this section of the <i>conditions of contract</i> .
51.4	The <i>interest rate</i> is	The prime lending rate of the Standard Bank South Africa.
51.2	The period within which payments are made is	Payment will be effected on or before the last day of the month following the month during which a valid Tax Invoice and Statement were received.
51.1	The <i>currency of this contract</i> is the	South African Rand.
50.1	The assessment interval is	After completion of the service.
5	Payment	
4	Testing and defects	No additional data is required for this section of the <i>conditions of contract</i> .
30.1	The <i>service period</i> is	30 days
30.1	The starting date is.	02 June 2025
3	Time	
21.1	The <i>Contractor</i> submits a first plan for acceptance within	2 weeks of the <i>Contract</i> Date
2	The <i>Contractor'</i> s main responsibilities	No additional data is required for this section of the <i>conditions of contract</i> .
13.3	The <i>period for reply</i> is	2 weeks
13.1	The <i>language of this contract</i> is	English
12.2	The law of the contract is the law of	the Republic of South Africa subject to the jurisdiction of the Courts of South Africa.
11.2(15)	The Service Information is in	The Scope of Services
11.2(14)	The following matters will be included in the Risk Register	<ol> <li>Continuous theft by the public passing by and residents of the nearby informal settlement.</li> <li>Working at heights</li> <li>Oil spillages from the transformer</li> <li>Employees working on-site safety</li> <li>Bees and snakes</li> </ol>
11.2(13)	The <i>service</i> is	For the supply and installation of outdoor earthing
11.2(2)	The Affected Property is	Brood and Midpoint 3kv Dc Traction Substations
	e-mail	Mpho.Machethe@transnet.net




7	Use of Equipment Plant and Materials	No additional data is required for this section of the <i>conditions of contract</i> .
8	Risks and insurance	
80.1	These are additional <i>Employers</i> risks	None
83.1	•	Whatever <i>Contractor</i> deems necessary as the <i>Employer</i> is not carrying this indemnity.
83.1	insurance in respect of death of or bodily injury to employees of the <i>Contractor</i>	As prescribed by the Compensation for Occupational Injuries and Diseases Act No. 130 of 1993 and the <i>Contractor's</i> common law liability for people falling outside the scope of the Act.
83.1	Motor Vehicle Liability Insurance comprising (as a minimum) "Balance of Third Party" Risks including Passenger and Unauthorised Passenger Liability indemnity with a minimum indemnity limit of R 5 000 000	
83.1	The <i>Contractor</i> liability to the <i>Employer</i> for indirect or consequential loss including loss of profit, revenue and goodwill, is limited to:	The Total of the Prices.
83.1	For any one event, the <i>Contractor</i> liability to the <i>Employer</i> for loss of or damage to the <i>Employers</i> property is limited to:	The Total of the Prices.
83.1	The <i>Contractor</i> total liability to the <i>Employer</i> for all matters arising under or in connection with this contract, other than the excluded matters, is limited to:	The Total of the Prices.
9	Termination	There is no <i>Contract</i> Data required for this section of the <i>conditions of contract</i> .
10	Data for main Option clause	
A	Priced contract with price list	
20.5	The <i>Contractor</i> prepares forecasts of the final total of the Prices for the whole of the <i>service</i> at intervals no longer than	4 weeks.
11	Data for Option W1	





W1.1	The <i>Adjudicator</i> is (Name)	Both parties will agree as and when a dispute arises. If the parties cannot reach an agreement on the <i>Adjudicator</i> , the chairman of the Association of Arbitrators will appoint an <i>Adjudicator</i> .
W1.2(3)	The Adjudicator nominating body is:	
	If no <i>Adjudicator nominating body</i> is entered, it is	The Association of Arbitrators (Southern Africa)
W1.4(2)	The <i>tribunal</i> is:	Arbitration
W1.4(5)	The arbitration procedure is	The Rules for the Conduct of Arbitrations of the Association of Arbitrators (Southern Africa)
	The place where arbitration is to be held is	Pretoria; South Africa
	The person or organisation who will choose an arbitrator - if the Parties cannot agree a choice or - if the arbitration procedure does not state who selects an arbitrator, is	The Chairman of the Association of Arbitrators (Southern Africa)
12	Data for secondary Option clauses	
X2	Changes in the law	No additional data is required for this Option
X18	Limitation of liability	
X18.1	The <i>Contractor's</i> liability to the <i>Employer</i> for indirect or consequential loss is limited to	Nil.
X18.2	For any one event, the <i>Contractor's</i> liability to the <i>Employer</i> for loss of or damage to the <i>Employer's</i> property is limited to	The deductible of the relevant insurance policy
X18.3	The <i>Contractor's</i> liability for Defects due to his design of an item of Equipment is limited to	The cost of correcting the defect.
X18.4	The <i>Contractor's</i> total liability to the <i>Employer</i> , for all matters arising under or in connection with this contract, other than the excluded matters, is limited to	Total of the Prices.
X18.5	The end of liability date is	1 year after the end of the service period.

PAGE 4



<b>Z1</b>	Obligations in respect of Termination	
Z1.1		The following will be included under core clause 91.1:
		In the second main bullet, after the word 'partnership' add 'joint venture whether incorporated or otherwise (including any constituent of the joint venture)'; and
		Under the second main bullet, insert the following additional bullets after the last sub-bullet:  • commenced business rescue proceedings (R22)  • repudiated this Contract (R23)
Z1.2	Termination Table	The following will be included under core clause 90.2 Termination Table as follows:
		Amend "A reason other than R1 – R21" to "A reason other than R1 – R23" $$
Z1.3		Amend "R1 – R15 or R18" to "R1 – R15, R18, R22 or R23."
<b>Z2</b>	Right Reserved by Transnet to Conduct Vetting through SSA	
Z2.1		Transnet reserves the right to conduct vetting through State Security Agency (SSA) for security clearances of any Contractor who has access to National Key Points for the following without limitations:
		<ol> <li>Confidential – this clearance is based on any information which may be used by malicious, opposing or hostile elements to harm the objectives and functions of an organ of state.</li> </ol>
		<ol> <li>Secret – clearance is based on any information which may be used by malicious, opposing or hostile elements to disrupt the objectives and functions of an organ of state.</li> </ol>
		3. Top Secret – this clearance is based on information which may be used by malicious, opposing or hostile elements to


Additional clause relating to Collusion in

the Construction Industry


**Z3** 


neutralise the objectives and functions of

an organ of state.



the con	trol Depot Engineer, Ermelo			
Z3.1		The contract award is made without prejudice to any rights Transnet may have to take appropriate action later with regard to any declared bid rigging including blacklisting.		
<b>Z4</b>	<b>Protection of Personal Information Act</b>			
Z4.1		The <i>Employer</i> and the <i>Contractor</i> are required to process information obtained for the duration of the Agreement in a manner that is aligned to the Protection of Personal Information Act		







# C1.2 Contract Data

## Part two - Data provided by the Contractor


The tendering *Contractor* is advised to read both the NEC3 Term Service Contract (June 2005) and the relevant parts of its Guidance Notes (TSC3-GN) in order to understand the implications of this Data which the tenderer is required to complete.

Completion of the data in full, according to Options chosen, is essential to create a complete contract.

Clause	Statement	Data
10.1	The <i>Contractor</i> is (Name):	
	Address	
	Tel No.	
	Fax No.	
11.2(8)	The <i>direct fee percentage</i> is	%
	The subcontracted fee percentage is	%
11.2(14)	The following matters will be included in the Risk Register	
11.2(15)	The Service Information for the <i>Contractor's</i> plan is in:	
21.1	The plan identified in the <i>Contract</i> Data is	
	contained in:	
24.1	The key persons are:	
	1 Name:	
	Job:	
	Responsibilities:	
	Qualifications:	
	Experience:	
	2 Name:	
	Job	
	Responsibilities:	
	Qualifications:	
	Experience:	
		CV's (and further key person's data including CVs) are in




Transnet Freight Rail






A Priced contract with price list			
11.2(12)	The <i>price list</i> is in		
11.2(19)	The tendered total of the Prices is	R	



Substations under the control Depot Engineer, Ermelo

# **PART C2: PRICING DATA**

Document reference	Title	No of pages
C2.1	Pricing instructions: Option A	1
C2.2	Price List	3



Substations under the control Depot Engineer, Ermelo

### **C2.1 Pricing instructions: Option A**

#### 1.1 The conditions of contract

#### 1.2 How the contract prices work and assesses it for progress payments

Clause 11 in NEC3 Term Services Contract (TSC), June 2005 (with amendments June 2006 and April 2013) Option A states:

Identified 11 and defined terms 11.2

(17) The Price for Services Provided to Date is the total of

- the Price for each lump sum item in the Price List which the Contractor has completed and
- where a quantity is stated for an item in the Price List, an amount calculated by multiplying the quantity which the *Contractor* has completed by the rate.

(19) The Prices are the amounts stated in the Price column of the Price List, where a quantity is stated for an item in the Price List, the Price is calculated by multiplying the quantity by the rate.

#### 1.3 Measurement and Payment

- 1.3.1 The Price List provides the basis of all valuations of the Price for Services Provided to Date, payments in multiple currencies and general progress monitoring.
- 1.3.2 The amount due at each assessment date is based on activities and/or milestones completed as indicated on the Price List.
- 1.3.3 The Price List work breakdown structure provided by the Contractor is based on the activity/milestone provided by the Employer. The activities listed by the Employer are the minimum activities acceptable and identify the specific activities which are required to achieve Completion. The Price List work breakdown structure is compiled to the satisfaction of the Employer with any additions and/or amendments deemed necessary.
- 1.3.4 The *Contractor's* detailed Price List summates back to the activity/milestone provided by the *Employer* and is sufficient detail to monitor completion of activities related to the operations on the Accepted Plan in order that payment of completed activities may be assessed.
- 1.3.5 The Prices are obtained from the Price List. The Prices includes for all direct and indirect costs, overheads, profits, risks, liabilities, obligations, etc. relative to the contract.


1.3.6



Substations under the control Depot Engineer, Ermelo

# **C2.2 Price List**


Item	Description of Goods /Services	Quantity	Unit of	Unit Price	Total Price
No			Measure		
PART A	OUTDOOR EARTHING at BROOD.  Supply and Install:				
1.	AC earth leakage.	1	Each		
2.	95mm2 bare copper conductor	80	Metres		
3.	95mm2 PVC insulated copper cable	150	Metres		
4.	95mm2 Lugs	75	Each		
5.	Spark gap	1	Each		
6.	Gate switch	1	Each		
7.	Earth spike	8	Each		
8.	Test And Commissioning	1	Each		
9.	P's and G's  (Please prepare cost breakdown for this item on separate sheet)	1	sum		
	Sub Total excluding VAT FOR PART A				



Item	Description of Goods /Services	Quantity	Unit of	Unit Price	Total Price
No			Measure		
	OUTDOOR EARTHING at MIDPOINT				
PART B	UNIT A & B				
	Supply and Install:				
10.	AC earth leakage.	2	Each		
11.	95mm2 bare copper conductor	160	Metres		
12.	95mm2 PVC insulated copper cable	300	Metres		
13.	95mm2 X 14 Lugs	150	Each		
14.	Spark gap	2	Each		
15.	Gate switch	2	Each		
16	Earth spike	16	Each		
17.	Test And Commissioning	1	Each		
18.	P's and G's	1	01100		
10.	(Please prepare cost breakdown for this item)	'	sum		
	Sub Total excluding VAT FOR PART B				1

#### **SUMMARY OF TOTALS**

Sub Total excluding VAT	
Sub Total excluding VAT	
Sub Total excluding VAT for Part A & Part B	
Vat @ 15%	
Grand total including VAT	



nent Clause:	
Specified by TFR):	
cepted (by Contractor)	
Sign:	Date:
s not accepted, complete and sign the cl	ause below:
, Representative of _	confirm
, Representative of cannot be able to deliver these se	
	vices within the expected delivery
cannot be able to deliver these ser	vices within the expected delivery
	Specified by TFR):  septed (by Contractor)  Sign:

Substations under the control Depot Engineer, Ermelo

# 3: Service Information



#### 1. Description of the service

The Contractor shall perform the following:

#### 1.1. Outdoor Earthing

- 1.1.1 Ensure outdoor earthing in accordance with TFR specification BBB 3059, installation specification BBB 5452 clause 30.0 and refer to drawing No. BBB 3620. Eskom and TFR earthing systems shall be connected (coupled) together to ensure that the systems are always at the same potential.
- 1.1.2 Supply and install an enclosed-type AC earth leakage current transformer, and the *Contractor* shall provide a polycarbonate box sized to house the current transformer and connections/terminals.
- 1.1.3 The CT and GCB steelwork shall be insulated from the foundations and associated hold down bolts.
- 1.1.4 The *Contractor* shall test and ensure that the earth resistance between outdoor yard steelwork and earth mat, with the steelwork connected in parallel and disconnected from the AC earth system, is not less than 10 ohms.

#### 1.2. Testing and Commissioning

- 1.2.1 All outdoor tests shall be done in accordance with TFR specification BBB 5452 clause 49.0.
- 1.2.2 The Contractor shall supply all test equipment and instruments required to perform these tests.
- 1.2.3 Type test certificates for all equipment offered shall be submitted with the tenders while routine test certificates are submitted with equipment.
- 1.2.4 The Contractor shall be responsible for commissioning all equipment installed.

#### 1.3 Quality and Inspection

- 1.3.1 The Contractor shall apply 14 days in advance for the date of energizing.
- 1.3.2 The *Contractor* shall be responsible to issue a compliance certificate in terms of SANS 0142 for each site before energizing of the equipment shall take place.

#### 1.4 Minimum equipment relevant for Service

Multi-meter test leads

Generator

**Toolbox** 

Grinder

Drilling machine

Crane truck with certified operator

Stepladder

Crimping machine (must have capacity to crimp 500mm<sup>2</sup> cable)

Shovel and picks

Substations under the control Depot Engineer, Ermelo



#### 2. Drawings

Drawing number	Revision	Title
Earthing arrangement for traction substations	CEE-TBD-0007	

3. Trans	net Freight Rail:	Original revision	Revised
BBB3620	3kV DC Earthing arrangement system for high voltage outdoor yards		Ver 7
BBB3059	3kV DC traction substation earthing system for high voltage outdoor yards		Ver 2
BBB5452	3Kv DC requirements for the installation of Electrical Equipment.		Ver 6

#### 4. Constraints on how the Contractor Provides the Service

- 4.1. The *Contractor* shall not make use of any *Sub-Contractor* to perform the service or parts thereof without prior permission from the *Service Manager*.
- 4.2. The Contractor shall ensure that a safety representative is always at site. All safety measures prescribed by Transnet Freight Rail Electrical Safety Instructions and the "Occupational Health and Safety Act 1993 (Act 85 of 1993)" associated with working on a Service of this nature shall be adhered to.
- 4.3 The *Contracto*r shall supply a **site diary** (with triplicate pages). This book shall be used to record any unusual events during the period of the work. Any delays to the work shall also be recorded such as delays caused by poor weather conditions, delays caused by permits being cancelled etc. The appointed *Service Manager* must countersign such delays. Other delays such as non-availability of equipment from 3<sup>rd</sup> party suppliers must be communicated to the *Service Manager* in writing.
- 4.4 The Contractor shall supply a site instruction book (with triplicate pages). This book shall be used to record any instructions to the Contractor regarding problems encountered on site for example the quality of work or the placement of equipment. This book shall be filled in by the Service Manager and must be countersigned by the Contractor.
- 4.5 Both books mentioned in 1.3 and 1.4 shall be the property of Transnet Freight Rail and shall be handed over to the *Service Manager* on the day of energising or handing over.
- 4.6 The successful *Contractor* shall provide a Gantt or a similar chart showing when the service will be done and energised. A final chart should be submitted to the *Service Manager* within 14 days after the award has been made to the successful *Contractor*.

Substations under the control Depot Engineer, Ermelo



- 4.7 All processes or the manufacture and assembly of the product components must be subjected to a quality assurance system.
- 4.8 The *Contractor* will assume full responsibility for assuring that the products purchased meet the requirements of Transnet Freight Rail for function, performance, and reliability, including purchased products from 3<sup>rd</sup> part suppliers.
- 4.9 The onus is on the manufacturer to prove the effectiveness of their system to Transnet Freight Rail during the production of the prototype.
- 4.10 ISO.9000 to 9004 inclusive (SABS 0157 parts 1 to 4) must be regarded as a guideline, where applicable.
- 4.11 The *Contractor* will remain liable for contractual delivery dates irrespective of deficiencies discovered during service hop inspections.

#### 5. Requirements for the programme

5.1 Programme of work : To be submitted by successful *Contractor* 

5.2 Format : Bar chart

5.3 CIDB rating : 2 EP or higher

5.4 Information : How work is going to be executed and commissioned

5.5 Site diary : Successful *Contractor* to supply in triplicates carbon copies

5.6. Personnel Qualification : Trade Test Electrical

#### 6 Services and other things provided by the *Employer*

- 6.1 Transnet Freight Rail shall inspect all equipment before dispatching the equipment to site.
- 6.2 Transnet Freight Rail shall have an electrician available for isolation and the erection of barriers to live electrical equipment and issuing of work permits.
- 6.2.1 The *Contractor* shall make necessary arrangements for sanitation, water, and electricity at these relevant sites during the installation of the equipment.
- 6.2.2 Transnet Freight Rail will arrange for the reconnecting of telecontrol equipment in the substation and no final energising shall take place without this.

Substations under the control Depot Engineer, Ermelo



#### 7 The Contractor's Invoices

- 7.1 When the *Service Manager* certifies payment following an assessment date the *Contractor* complies with the *Employer*'s procedure for invoice submission.
- 7.2 The invoice must correspond to the *Service Manager's* assessment of the amount due to the *Contractor* as stated in the payment certificate.
- 7.3 The invoice states the following:
  - Invoice addressed to Transnet Limited:
  - Transnet Limited's VAT No: 4720103177;
  - Invoice number;
  - The Contractor's VAT Number; and
  - The Contract number
- 7.4 The invoice contains the supporting detail
- 7.5 The invoice is presented either by post or by hand delivery.
- 7.6 Invoices submitted by post are addressed to:

For the attention of:

Service Manager: Mpho Machete

22 Industria Avenue

Infra Building

Ermelo

2350

7.7 Invoices submitted by hand are presented to:

22 Industria Avenue

Infra Building

Ermelo

2350

7.8 The invoice is presented as an original.



TRANSNET

Description of the Service: For the supply and install outdoor earthing at Brood and Midpoint 3kv Dc Traction Substations under the control Depot Engineer, Ermelo

## **PART 4: AFFECTED PROPERTY**

Core clause 11.2(2) states

"Affected Property is property which

- Is affected by the work of the Contractor or used by the Contractor in Providing the Service
- is in the documents which the Contract Data states it is in."

In Contract Data, reference has been made to this Part 4 of the contract for the location of the Affected Property.

Outdoor Earthing at Midpoint and Brood Substations.

Addresses:

Brood: -26.079117, 29.461720 Midpoint: -26.305917, 29.578750

- 1. Description of the Affected Property and its surroundings
- 1.1. General description

N/A

1.2. Existing buildings, structures, and plant & machinery on the Affected Property

N/A

1.3. Subsoil information

N/A

1.4 Hidden services

N/A

1.5 Other reports and publicly available information



A Division of Transnet Limited

## TECHNOLOGY MANAGEMENT

# **SPECIFICATION**

# 3 KV DC TRACTION SUBSTATION EARTHING SYSYTEM FOR HIGH VOLTAGE OUTDOOR YARDS

Author:

Chief Engineering Technician

**Technology Management** 

Approved:

Senior Engineer

**Technology Management** 

Authorised:

Principal Engineer

**Technology Management** 

B.L. Ngobeni

L.O. Borchard

W.A. Coetzee

Date:

27 August 2010

Circulation Restricted To:

Transnet Freight Rail

Transnet and Relevant Third Parties

© This document as a whole is protected by copyright. The information herein is the sole property of Transnet Ltd. It may not be used, disclosed or reproduced in part or in whole in any manner whatsoever, except with the written permission of and in a manner permitted by the proprietors.

# INDEX

1.0	SCOPE	3
2.0	STANDARDS AND PUBLICATIONS	3
3.0	METHOD OF TENDERING	3
4.0	DEFINITIONS	3
5.0	EARTHING SYSTEMS OF TRACTION SUBSTATIONS	4
6.0	SERVICE CONDITIONS	4
7.0	TECHNICAL REQUIREMENTS	5
3.0	EARTHING LAYOUT	5
9.0	MATERIALS TO BE USED.	6
10.0	INSTALLATION OF EARTHING SYSTEM.	6
11.0	SPECIAL TOOLS (OPTIONAL)	8
120	TESTS AND ACCEPTANCE	Q

#### 1.0 SCOPE

- 1.1 This specification specifies Transnet freight rail's requirements for the design, supply, installation and testing of the earthing systems for new and existing 3kV DC traction substations.
- 1.2 This specification must be read in conjunction with Transnet freight rail's drawings BBB 3620 and CEE-TBD-7.

#### 2.0 STANDARDS AND PUBLICATIONS

- 2.1 Unless otherwise specified all materials and equipment supplied shall comply with the applicable and latest editions of SANS and Transnet Freight Rail's publications.
- 2.2 The following publications (latest editions) are referred to in this specification:

#### 2.2.1 SOUTH AFRICAN NATIONAL STANDARDS

SANS 1063 Earth rods, couplers and connections.

SANS 1507 -1-3 Electric cables with extruded solid dielectric insulation for fixed

installations. (300/500V to 1900/3300V).

SANS 2063 Thermal spraying - Metallic and other inorganic coatings - Zinc,

aluminium and their alloys.

SANS 10199 The design and installation of earth electrodes.

#### 2.2.2 TRANSNET FREIGHT RAIL

CEE.0177 Code of Practice:

Earth systems for electric light and power and traction installations.

# TRANSNET FREIGHT RAIL'S DRAWINGS.

BBB 3620 3kV DC earthing arrangement system for high voltage outdoor

yards.

CEE-TBD-7 3kV DC earthing arrangement system of traction substation.

#### 3.0 METHOD OF TENDERING

- 3.1 Tenderers shall indicate clause by clause compliance with the specification. This shall take the form of a separate document listing all the specification's clause numbers indicating the individual statement of compliance or non-compliance.
- 3.2 A statement of non-compliance shall be motivated by the tenderer.
- 3.3 Tenderers shall submit descriptive literature consisting of detailed technical specifications, general constructional details and principal dimensions, together with clear illustrations of the equipment offered.
- 3.4 Failure to comply with clauses 3.1, 3.2, 3.3 could preclude a tender from consideration.

#### 4.0 DEFINITIONS

Definitions are in accordance with SANS 10199.

#### 4.1 EARTH ELECTRODE

One or more conductive parts embedded in the earth for the purpose of making effective electrical contact with the general mass of the earth, and to act as a path for the discharge of either lightning currents or fault currents.

#### 4.2 EARTHED

So connected to the general mass of earth as to ensure at all times an immediate discharge of electrical energy without danger.

#### 4.3 EARTHING SYSTEM

A system intended to provide at all times, by means of one or more earth electrodes, a low impedance path for the immediate discharge of electrical energy without danger into the general mass of earth.

#### 5.0 EARTHING SYSTEMS OF TRACTION SUBSTATIONS

The earth leakage protection consists of an AC earth leakage and a DC earth leakage system as described below:

#### 5.1 AC EARTH LEAKAGE SYSTEM

The AC earth leakage system is used to detect flashovers on high voltage HV outdoor yard equipment. The equipment in the outdoor yard is insulated from the substation earth mat and connected in parallel through a current transformer to earth mat. (Minimum resistance to earth mat is 10 Ohms). The output of the current transformer feeds to an earth leakage relay, which will trip and lock out the primary circuit breaker when operated.

#### 5.2 DC EARTH LEAKAGE SYSTEM

The DC earth leakage system is used to detect 3kV DC and 380V AC insulation failures. The steelwork and panels inside the traction substation are bonded to a DC earth leakage busbar, which is insulated from earth mat. (Minimum resistance to earth mat is 25 Ohms). The DC earth leakage busbar is connected to the substation negative busbar through a DC earth leakage relay.

Operation of this relay will isolate the complete substation from all sources of supply and lock out the primary circuit breaker and all the 3kV DC high speed circuit breakers.

#### 6.0 SERVICE CONDITIONS

#### 6.1 ATMOSPHERIC CONDITIONS:

Altitude : 0 to 1800m above sea level.

Ambient temperature : -10% to +50 °C.

Relative humidity : 10% to 90% percent

Lightning Conditions : 12 ground flashes per square kilometre

per annum.

Pollution : Heavily salt laden or polluted with smoke

from industrial sources.

#### 6.2 SOIL CONDITION:

The soil resistivity can vary from 10 Ohmmeter to more than 5,000 Ohmmeter. Earth value enhancement methods will have to be used, where necessary to obtain the desired value of 5 Ohms or less.

#### 6.3 CORROSION:

Buried conductors will be exposed to both severe galvanic and chemical corrosion. There is a high level of stray current in the vicinity of 3kV DC traction substations which will reduce the life of the earthing system.

#### 7.0 TECHNICAL REQUIREMENTS

- 7.1 The design and installation of Transnet Freight Rail's earthing system for outdoor yards shall be in accordance with Transnet Freight Rail's drawings BBB 3620 and CEE-TBD-7.
- A 5-second fault current duration shall be used for the rating of the earthing system. The earth down conductors and earth tails shall be able to withstand 6,2 kA for 5 seconds when exothermically welded. The rated AC fault level for 3kV DC traction substations shall be taken to be 16kA.
- 7.3 Deviation of the design shall be submitted to the project manager for approval.

#### 8.0 EARTHING LAYOUT

- 8.1 The following electrical equipment in the outdoor yard shall be bonded directly to earth mat.
  - The support steel structures for the surge arresters at the Eskom supply side.
  - All high voltage surge arresters.
  - The high voltage AC disconnects.
  - Voltage transformer steel structures where applicable.
  - Main Current transformers on Eskom side of primary circuit breaker in high voltage (HV) yard.
  - The perimeter fence posts and gates.
  - Substation metal roof.
- The following electrical equipment forms part of the AC earth leakage system and shall be connected via a current transformer to earth.
  - Main traction transformer.
  - Primary circuit breaker.
  - Main current transformers between primary circuit breaker and main traction transformer.
  - The Auxiliary transformer's barrier screen.
- 8.3 The following electrical equipment is connected directly to the substation negative busbar.
  - The auxiliary transformer tank.
  - All spark gaps.
- The following outdoor electrical equipment is connected directly to the DC earth leakage relay busbar.
  - The Anode wall plate (Wall Bushings).
  - The auxiliary transformer neutral point.
  - AC / DC motorised link framework and structure where fitted.
  - The auxiliary transformer short circuiting switch fitted on substation wall in the outdoor yard.

#### 9.0 MATERIALS TO BE USED.

#### **EARTHING**

9.1 Only copper rods of at least 70 mm<sup>2</sup> shall be used for earth electrodes in accordance to SANS 1063

The length of the rods will be dependant on the application:

- Earth electrodes (earth spikes). Minimum length of 1.5 meters shall be used.
- Down conductors, earth tails and interconnecting conductors. Rods of varying lengths may be used.
- 9.2 The minimum size of cable/conductor used for the earthing system shall be 95 mm<sup>2</sup> copper.
- 9.3 For the installation or replacement of the main earth mat/earth electrode, Copper conductor of at least 16mm diameter shall be used and shall be buried at least 1,5 meters below the ground. The earth mat shall cover an area of at least 1,5 square metre.
- 9.4 The earth mat shall be provided with a test point connection for test purposes. This test point shall protrude a minimum of 100mm above ground level and shall be protected by means of a metal pipe or metal housing.
- 9.5 The location of the earth mat/earth spike shall be as close as possible to the main surge arresters support structures.

#### **AC EARTH LEAKAGE SYSTEM**

- 9.6 PVC insulated 95 mm<sup>2</sup> copper cable shall be used where insulated earthing conductors are required for the interconnecting of the high voltage equipment on the AC earth leakage system.
- 9.7 The resistance between the outdoor yard steelwork connected to AC earth leakage system and main earth electrode shall be a minimum of 10 Ohms.

#### 10.0 INSTALLATION OF EARTHING SYSTEM.

#### 10.1 EARTHING SURVEY

- 10.1.1 For new installations the contractor shall carry out an earthing survey in accordance with the method as described in specification CEE.0177 or SANS 10199 to determine the type of earthing system required. The contractor shall be required to submit a separate quotation for the survey.
- 10.1.2 For existing substations the contractor shall carry out earth resistance tests to establish the condition of the existing earth mat/earth spike and shall replace such earth mat/earth spike where required.

#### 10.2 TRENCHING

- 10.2.1 Before any trenching commences the contractor shall consult with Transnet Freight Rail staff for approval with regard to the routing of the trenches in the outdoor yard.
- 10.2.2 Trenching shall include all trenches required for the installation of the earthing system.
- The perimeter fence trenching shall be as close as possible to the perimeter fence on the inside of the HV yard.

- The depth of trenches shall be at least 700 millimetres. Care must be taken not to damage existing cables in the high voltage outdoor yard during trenching operations.
- 10.2.5 Before the trenches are closed a representative from Transnet Freight Rail shall inspect the earthing system for correct installation procedure.

#### 10.3 INSTALLATION PROCEDURES

- 10.3.1 Earth electrodes shall be driven into the ground in the perimeter fence trench at the corners of the outdoor yard and in between the corners.
- In the case of double unit substations the number of earth electrodes between the corner electrodes shall be determined in consultation with Transnet Freight Rail.
- The depth of the earth electrodes driven into the ground shall be such that the top of the earth electrode shall be a minimum of 700 mm below the surface of the ground.
- The earthing of the support steel structures for the surge arresters, AC disconnects, voltage transformers (where installed) and current transformers shall be in accordance with Transnet Freight Rail's drawing BBB 3620.
- 10.3.5 The surge arresters base shall be connected directly to earth mat/spike.
- 10.3.6 Where surge arresters are fitted on the main transformer provision shall be made to install an earth electrode in close proximity to the transformer. The earth electrode shall be connected directly to the earth system as shown in drawing BBB3620.
- All underground connections which include connections to the earth electrodes, the joints in the copper plated steel rods, connections to the perimeter fence posts, support steel structures and the connection to the new or existing earth mat shall be exothermic welded or crimped by means of tinned lugs or by means of brass clamping system.
- 10.3.8 Where exothermic welding cannot be carried out, galvanised or stainless steel grade S304 studs, nuts, tinned cable lugs and any other approved means may be used for the termination of the earthing conductors to the fence posts, surge arresters down leads, metal structure and other electrical equipment.
- 10.3.9 Exothermic welded joints and steel components exposed to corrosion shall be sealed with a durable waterproofing compound i.e. Bitumen, Denso tape or Noxide.
- 10.3.10 All crimped connections that are above ground level must be filled with an anti corrosive compound.
- 10.3.11 Where the exothermic welding is carried out on galvanised surfaces of the support steel structures, the galvanising must be removed and the surface cleaned. After completion of the exothermic weld, the surface area on the support steel structure where the galvanising was removed shall be treated in accordance with the requirements of SANS 2063.
- 10.3.12 Exothermic joints shall be hammer tested on recommendation of the manufacturer to ensure that the mechanical strength of the joints are adequate. The exothermic weld is tapped by a hammer and by sound it is determined whether the joints are solid or that there are voids in the joint.
- 10.3.13 Where two earthing conductors run parallel to each other, exothermic parallel joints shall be installed every 1,5 metres on all straight sections between these conductors.

#### 10.4 CERTIFICATION OF CONTRACTORS (EXOTHERMIC WELDING)

10.4.1 Only Contractors who are certified and accredited by the exothermic welding industry shall be used for the installation.

#### 10.5 CRUSHER STONE

#### **NEW SUBSTATIONS**

- 10.5.1 After completion of construction, installation of equipment, the laying of all cables and earthing conductors, a suitable weed killer approved by Transnet Freight Rail's Project Manager shall be applied in the outdoor yard unless otherwise specified.
- 10.5.2 The successful tenderer shall exercise the greatest care to avoid contaminating private property.
- 10.5.3 After treatment with the weed killer, a 100mm layer of 25mm to 37mm crusher stone shall be laid over the whole area of the Transnet Freight Rail high voltage outdoor yard (within the apron).

#### **EXISTING SUBSTATIONS**

- 10.5.4 The contractor shall remove the necessary crusher stone before any excavation commences.
- 10.5.5 The contractor shall restore the crusher stone to its original condition once the installation work has been completed.
- 10.5.6 The contractor shall supply any additional crusher stone required to restore the trenched areas to original condition.


# 11.0 SPECIAL TOOLS (OPTIONAL)

- Tenderers shall furnish quotations for the special bending equipment, crimping tools and exothermic welding moulds required for the installation of the earthing system.
- 11.2 The price shall form a separate part of the quotation.

#### 12.0 TESTS AND ACCEPTANCE

- 12.1 The contractor shall perform resistance measurement tests, which shall be witnessed by a representative of Transnet Freight Rail. The resistance measurements shall be entered into the substation station log book.
- 12.2 In the event of any dispute, Transnet Freight Rail reserves the right to make the final decision on the acceptance of the earthing system.


**END** 

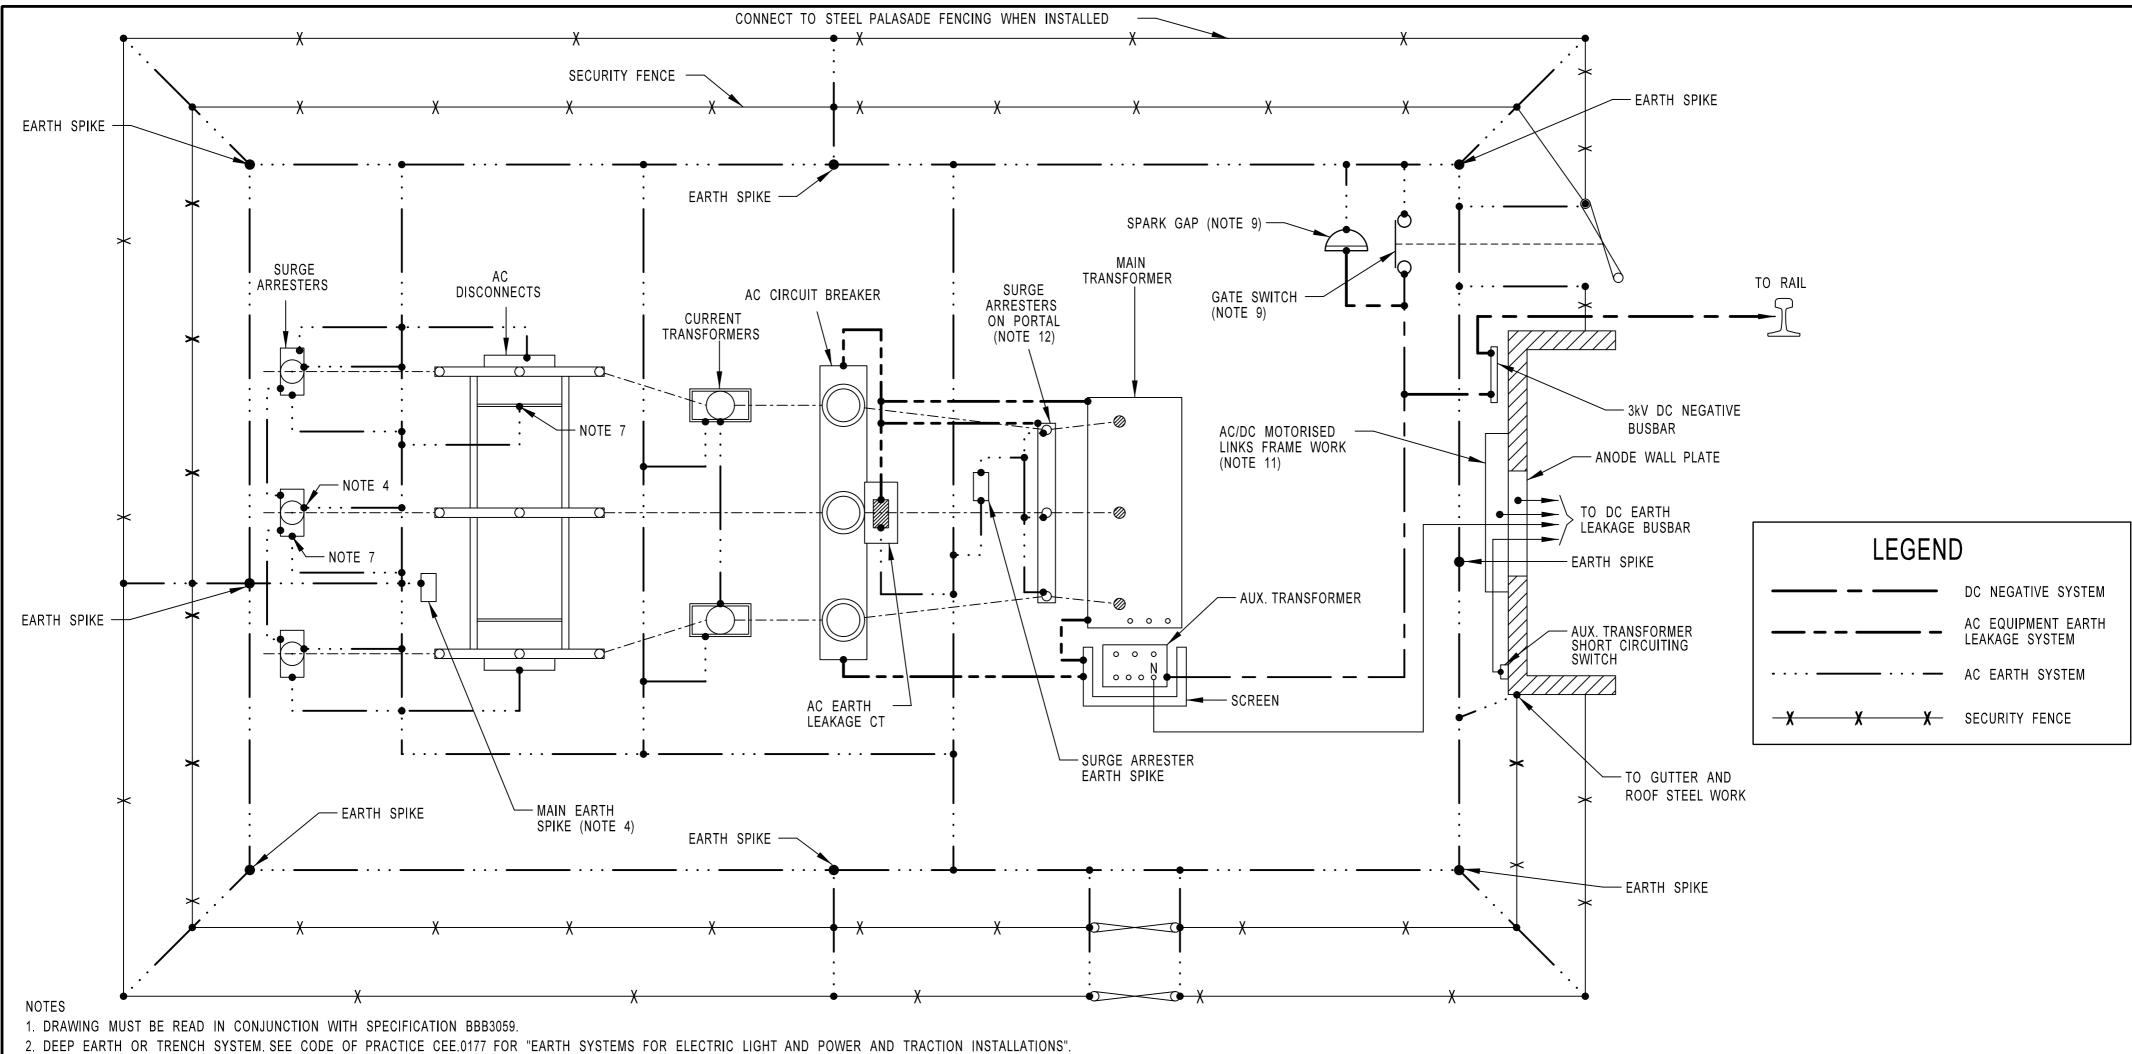

- 3. THE OVERALL RESISTANCE OF THE AC EARTH SYSTEM MUST NOT EXCEED 5 OHMS.
- 4. UNNECESSARY BENDS IN THE DOWN LEADS FROM THE SURGE ARRESTERS TO THE AC EARTH SYSTEM SHALL BE AVOIDED.
- 5. THE INSTALLATION OF THE MAIN EARTH AND TEST SPIKE SHALL BE LOCATED AS CLOSE AS POSSIBLE TO THE INCOMING SUPPLY AC SURGE ARRESTERS.
- 6. ALL BURIED CONNECTIONS, CONNECTIONS TO THE SUPPORT STEEL STRUCTURES AND CONNECTIONS TO THE CORNER, INTERMEDIATE AND GATE POSTS OF THE SECURITY FENCES SHALL BE EXOTHERMIC WELDED.
- 7. THE EARTHING TAILS FROM THE SUPPORT STEEL STRUCTURES OF THE AC DISCONNECTS AND SURGE ARRESTERS TO THE AC EARTH SYSTEM SHALL BE LOOPED.
- 8. THE MINIMUM SIZE OF CABLE / CONDUCTOR USED FOR EARTHING SHALL BE 95mm2 COPPER CONDUCTOR.
- 9. THE GATE SWITCH ATTACHED TO THE SUBSTATION OUTDOOR YARD GATE, THE 3kV DC O/H FEEDER SECURITY AREA GATE AND THE REGEN RESISTANCE ENCLOSURE ARE TO BE SO MOUNTED THAT THE GATE SWITCH IS OPEN WHEN THE GATE IS CLOSED AND CLOSED WHEN THE GATE IS OPEN.

THE SPARK GAP USED WITH THE GATE SWITCH ASSEMBLY SHALL COMPLY WITH SPECIFICATION BBB1616 AND DRG BBB0906.

- 10. SUPPORT STEEL STRUCTURES OF CURRENT TRANSFORMERS INSTALLED BETWEEN PRIMARY CIRCUIT BREAKER AND MAIN TRANSFORMER SHALL BE CONNECTED TO THE AC EARTH LEAKAGE SYSTEM.
- 11. AC/DC MOTORISED LINKS FRAME WORK SHALL BE CONNECTED TO THE DC EARTH LEAKAGE BUSBAR.
- 12. FOR CONNECTION OF HIGH VOLTAGE SURGE ARRESTER INSTALLED ON CROSS ARM SEE DRG. NO. BBB0938.
- © COPYRIGHT PROTECTED. PREPARED BY CENTRAL DRAWING OFFICE

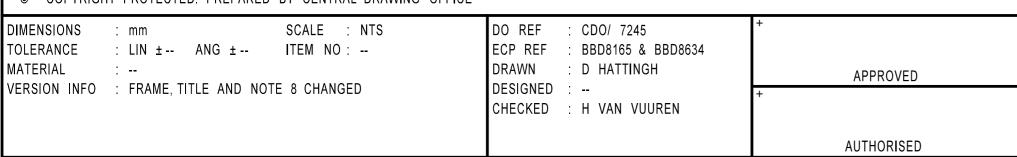

3kV DC EARTHING ARRANGEMENT SYSTEM FOR HIGH VOLTAGE OUTDOOR YARDS



BBB3620 VERSION 5



# **TECHNOLOGY MANAGEMENT.**

# SPECIFICATION.

# TRANSNET FREIGHT RAIL'S REQUIREMENTS FOR THE INSTALLATION OF ELECTRICAL EQUIPMENT FOR 3kV DC TRACTION SUBSTATIONS

Author

Chief Engineering Technician

B.L. Ngobeni

Technology Management

Senior Engineer

L.O. Borchard

Authorised:

Approved:

Principal Engineer

W. A. Coetzee

Technology Management

Technology Management

Date:

06<sup>th</sup> October 2011

Circulation Restricted To:

Transnet Freight Rail – Chief Engineer Infrastructure - Technology Management

© This document as a whole is protected by copyright. The information herein is the sole property of Transnet Ltd. It may not be used, disclosed or reproduced in part or in whole in any manner whatsoever, except with the written permission of and in a manner permitted by the proprietors.

# INDEX

SECTION	CONTENTS	PAGE
	SECTION 1: SUBSTATION DESIGN INFORMATION	
1.0	SCOPE	4
2.0	STANDARDS, PUBLICATIONS AND DRAWINGS	4
3.0	TENDERING PROCEDURE	5
4.0	SERVICE CONDITIONS	5
5.0	ELECTRICAL SERVICE CONDITIONS	5
6.0	GENERAL REQUIREMENTS	6
7.0	GENERAL DESIGN OF EQUIPMENT	6
8.0	INSULATION AND CLEARANCE	6
9.0	OUTDOOR CLEARANCES AND INSULATION LEVELS	7
	SECTION 2: TRACTION SUBSTATION EQUIPMENT	
	OUTDOOR EQUIPMENT	
10.0	METAL OXIDE SURGE ARRESTERS	8
11.0	HIGH VOLTAGE AC DISCONNECTOR	9
12.0	HIGH VOLTAGE PRIMARY CIRCUIT BREAKERS	9
13.0	MAIN CURRENT TRANSFORMERS	9
14.0	MAIN TRACTION TRANSFORMER	9
15.0	AUXILIARY TRANSFORMER	9
16.0	AUXILIARY TRANSFORMER PROTECTION	10
17.0	AC EARTH LEAKAGE CURRENT TRANSFORMER	10
	INDOOR EQUIPMENT	
18.0	3kV RECTIFIER EQUIPMENT	10
19.0	3kV DC REACTOR	11
20.0	WAVE FILTER EQUIPMENT	11
21.0	POSITIVE ISOLATOR	12
22.0	CONTROL PANELS	12
23.0	BATTERY	12
24.0	BATTERY CHARGER	12
25.0	TRACK FEEDER HIGH SPEED CIRCUIT BREAKERS	12
26.0	MODULAR TYPE, STEEL HOUSED HIGH SPEED CIRCUIT BREAKERS	13
27.0	REGENERATIVE HIGH SPEED CIRCUIT BREAKER	13
28.0	3kV DC UNDERVOLTAGE RELAY	13
	SECTION 3: INSTALLATION	
	SUBSTATION EARTHING	14
29.0	INDOOR EARTHING	14
30.0	OUTDOOR EARTHING	14
31.0	INTERLOCKING	15
32.0	ISOLATING PROCEDURE	15
33.0	INDOOR CABLING, BUSBARS AND ASSOCIATED EQUIPMENT	16

34.0	CABLES, BUSBARS AND CONNECTIONS (OUTDOOR)	17
35.0	LABELS AND TERMINALS	18
36.0	SUBSTATION NEGATIVE RETURN	19
37.0	3kV DC POSITIVE FEEDER CABLES	20
38.0	TRENCHING FOR OUTDOOR YARD EARTHING CONDUCTORS AND CONTROL CABLES	20
39.0	FOUNDATIONS	21
40.0	SUPPORT STRUCTURES	21
41.0	FENCING	22
42.0	GATES	22
43.0	CRUSHER STONE AND WEED KILLER	23
44.0	PAINTING	23
45.0	DISTRIBUTION AND LIGHTING OF SUBSTATION BUILDING	23
46.0	COOLING AND VENTILATION	24
47.0	BATTERY ROOM	24
48.0	CLEARING OF SITE	24
	SECTION 4: SITE TESTS AND COMMISSIONING	
49.0	SITE TEST AND COMMISSIONING	24
	SECTION 5: GENERAL	
50.0	QUALITY ASSURANCE	26
51.0	GUARANTEE AND DEFECTS	26
52.0	DRAWINGS, INSTRUCTION MANUALS AND SPARES LISTS	26
53.0	SPECIAL TOOLS AND SERVICING AIDS	26
54.0	TRAINING	26
55.0	PACKAGING AND TRANSPORT	26
	APPENDIX 1: LIST OF RELEVANT DRAWINGS	27

#### **SECTION 1: SUBSTATION DESIGN INFORMATION**

#### 1.0 SCOPE

- 1.1 This specification covers Transnet Freight Rail's requirements for the installation of electrical equipment in 3kV DC traction substations.
- 1.2 This specification should be read with the Scope of Work specification for each site/project and the applicable equipment specifications.
- 1.3 This specification also covers the requirements for the supply of security fencing, preparation of the High Voltage (HV) outdoor yard and the erection of all structural steelwork.

#### 2.0 STANDARDS, PUBLICATIONS AND DRAWINGS

Unless otherwise specified this specification must be read in conjunction with the current edition of the relevant SANS, BS and Transnet Freight Rail's specifications.

#### 2.1 SOUTH AFRICAN NATIONAL STANDARDS (SANS)

SANS 121: Hot dip galvanized coatings for fabricated iron or steel

articles. Specifications and test methods.

SANS 156: Moulded-case Circuit Breakers.

SANS 780: Distribution Transformers.

SANS 1019: Standard voltages, currents and insulation levels for electricity

supply.

SANS 1091: National Colour Standard.

SANS 1222: Enclosures for Electrical Equipment.

SANS 1339: Cross-Linked Polyethylene (XLPE) - Insulated Electric cables

for rated voltages (3,8/6,6kV to 19/33kV)

SANS 1431: Weldable structural steels.

SANS 1507: Electric cables with extruded solid dielectric insulation for

fixed installations. (300/500V to 1900/3,300V) Part 1

SANS 10142-1: The wiring of premises. Part 1

SANS 60044-1: Instrument Transformers Part 1. Current Transformers.

#### 2.2 TRANSNET FREIGHT RAIL SPECIFICATIONS/ ENGINEERING INSTRUCTIONS

CEE.0023: Laying of cables.

CEE.0045: Painting of steel components of electrical equipment.

CEE.0099: Specification for 3kV DC high speed circuit breakers for

traction substations.

CEE.0224: Drawings, catalogues, instruction manuals and spares lists for

electrical equipment supplied under contract.

CEE.0227: The manufacture of 3kV DC breaker cells and trucks.

BBB 0496: 3kV rectifier for traction substations.

BBB 0845: Requirements for metal oxide surge arresters in accordance

with SANS 60099-4.

BBB 1267: Specification for Outdoor High Voltage Alternating Current

Circuit Breaker in Accordance with SANS 62271-100.

BBB 1616: 450 Volt gas arrester spark gap for traction power supplies.

	DDD0 102 Version 0
BBB 2502:	Requirements for battery charger for 3kV DC traction substations.
BBB 2721:	AC primary circuit breaker control panel and AC/DC distribution panel for 3kV traction substation.
BBB 3005:	3kV DC under voltage relay manufacturing specification.
BBB 3139:	Wave filter capacitors for 3kV DC traction substations.
BBB 3162:	Wave filter inductors for 3 kV DC traction substations.
BBB 3890:	Requirements for 1.8 milli Henry DC reactor for 3kV DC traction substations.
BBB 5019:	Requirements for traction transformers for 3kV DC traction substations in accordance with BS 171 and IEC 60076-1.
BBB 7842	Outdoor, High Voltage, Alternating Current Disconnectors combined with earthing switch.
BBC 0198:	Requirements for the supply of cables.
BBC 0330:	Isolation transformer.

#### 2.3 STATUTORY REQUIREMENTS

Occupational Health and Safety Act and Regulations, Act 85,1993

#### 3.0 TENDERING PROCEDURE

- 3.1 Tenderers shall indicate clause-by-clause compliance with the specification as well as the relevant equipment specifications. This shall take the form of a separate document listing all the specifications clause numbers indicating the individual statement of compliance or non-compliance.
- 3.2 The tenderer shall motivate a statement of non-compliance.
- 3.3 Tenderers shall submit descriptive literature consisting of detailed technical specifications, general constructional details and principal dimensions, together with clear illustrations of the equipment offered.
- 3.4 Failure to comply with clauses 3.1, 3.2, and 3.3 could preclude a tender from consideration.

#### 4.0 SERVICE CONDITIONS

The equipment shall be designed and rated for installation and continuous operation under the following conditions:

Altitude: 0 to 1800m above sea level.

Ambient temperature: -5°C to +45 °C.
Relative humidity: 10% to 90%

Lightning Conditions: 12 ground flashes per square kilometre per annum.

Pollution: Heavily salt laden or polluted with smoke from industrial

sources.

#### 5.0 ELECTRICAL SERVICE CONDITIONS

- 5.1 The incoming AC voltage can vary  $\pm 5\%$  of the nominal system r.m.s voltage. Under crippled conditions the supply voltage can drop to as low as minus 15% of the nominal r.m.s voltage.
- 5.2 Frequency of the supply voltage is  $50 \pm 2.5$  Hz.
- 5.3 The AC high voltage system shall be treated as effectively earthed unless otherwise specified.
- 5.4 The traction DC supply voltage is 3,15 kV DC nominal but can vary between 2,4kV and 3,9kV for sustained periods.
- 5.5 The 3kV DC equipment may be subjected to fault currents up to 30kA for 200 milli seconds.

#### 6. 0 GENERAL REQUIREMENTS

- 6.1 Equipment/Installations supplied shall be in terms of this specification. Deviations from the specification will not be allowed without the written consent of the Project Manager/Engineer.
- 6.2 Transnet Freight Rail reserves the right to subject material and equipment offered to test or inspection to verify compliance with the clauses of this specification, prior to adjudication or at any stage during manufacture.
- The tenderer shall submit the layout drawings of equipment, electrical wiring schematics, and constructional designs to Transnet Freight Rail for design review.
- The successful tenderer will be responsible for all costs caused by modifying or replacing equipment accepted by Transnet Freight Rail on the grounds of his statement of compliance and found by Transnet Freight Rail not to comply.
- 6.5 All equipment shall be adequately earthed, insulated, enclosed and interlocked to ensure the safety of staff as well as equipment.
- 6.6 The general design and layout of all equipment shall provide for easy access to all parts.
- The equipment shall be installed in such a manner so as to limit fire damage, which may be caused by equipment failure, overheating or flashovers.
- The substation control and protection circuits shall be designed and wired according to the fail-safe principle. Control equipment, contactors and relays shall de-energise under fault, power failure or alarm (flag) conditions.
- 6.9 No high voltage cables shall be laid in the same trench or duct as low voltage cables.

#### 7.0 GENERAL DESIGN OF EQUIPMENT

- 7.1 This section covers substation equipment with electrical capacities between 3,0 MW and 6,0 MW.
- 7.2 The overload ratings of the rectifier units shall be:
  - 2 times full load for thirty minutes.
  - 3 times full load for one minute.
  - 3 ½ times full load for ten seconds.
- 7.3 The substation can either be a single unit or double unit substation. Each unit comprises of one set of high voltage AC switchgear, one rectifier transformer, and one rectifier assembly, connected for 6 or 12 pulse operation and protected by a AC primary circuit breaker.
- 7.4 For a double unit substation each unit shall have the overload rating as specified in clause 7.2.
- 7.5 Each substation unit shall be capable of operating independently to allow for maintenance, fault finding and servicing of the equipment.

#### 8.0 INSULATION AND CLEARANCES FOR 3kV DC EQUIPMENT

- 8.1 All indoor equipment, which may be energised at a potential of more than 1,0kV shall be protected by, metal barriers, mesh type screens or panels.
- The minimum clearance in air between the rectifier unit and any metal barriers, mesh type screens or panels shall not be less than 450mm.
- All exposed electrical equipment and busbars connected between the rectifier transformer secondary and the rectifier cubicle(s), or between the rectifier cubicle(s), positive isolators, DC smoothing equipment or track breakers, which is at a potential above 1,0kV, shall be arranged so that there is a minimum clearance of 2,7 m from the lowest "live" high voltage connections and ground or the floor of the access way, unless suitably screened, or otherwise protected.
- 8.4 All nominal 1,5kV and 3kV insulation to earth shall be designed such that the complete rectifier assembly, when installed on site ready for commissioning, will successfully withstand a test voltage of 10,5kV, 50 Hz AC for one minute.

- Where the equipment or subassemblies of the rectifier assembly is enclosed and insulated from the outer framework, the insulation between the equipment and outer framework shall withstand the test voltage of 10,5kV 50 Hz for one minute.
- The clearance between the reactor and any metal frame shall not be less 100mm. The reactor must successfully withstand a test voltage of 10,5kV AC 50 Hz for one minute
- 8.7 The successful tenderer shall advise what precautions must be taken before undertaking the withstand insulation level voltage tests to avoid damage to the equipment.
- 8.8 Creepage distance of insulation and the required air clearances shall be as large as possible. The latter shall not be less than:
  - Outdoors: 150mm between the transformer secondary busbars and any steelwork such as wall plates, screening etc.
  - Indoors: 100mm between the equipment at nominal 1,5kV or 3kV DC and negative busbars and panel steelwork, between the high voltage AC supply to the rectifier cubicles and panel steelwork, the equipment at nominal 3kV DC and negative busbars.

#### 9.0 OUTDOOR CLEARANCES AND INSULATION LEVELS

9.1 The minimum safety outdoor earth clearances which shall be maintained between any live conductor or metal and earthed metal and the minimum clearances of power lines above ground are in accordance with the statutory requirements of clause 15.1 of the "Electrical Machinery Regulations" of the "Occupational Health and Safety Act and Regulations, Act 85,1993", and are tabled below: -

TABLE 1:

Highest phase-to- phase r.m.s voltage for equipment. (U <sub>m</sub> )	24kV	36kV	48kV	72kV	100kV	145kV
Nominal system r.m.s. voltage. (U <sub>n</sub> )	22kV	33kV	44kV	66kV	88kV	132kV
Minimum safety outdoor clearance	320mm	430mm	540mm	770mm	1000mm	1450mm
Minimum clearance of power lines above ground						
Outside security fence but within Transnet Freight Rail's reserve	5200mm	5300mm	5400mm	5700mm	5900mm	6300mm
Outside Transnet Freight Rail's reserve	5500mm	5500mm	5500mm	5700mm	5900mm	6300mm

9.2 In terms of Transnet Freight Rail's Electrical Safety Instructions the clearances between the nearest exposed electrical equipment and a restricted access way are tabled below: -

TABLE 2:

Highest phase-to- phase r.m.s voltage for equipment. (U <sub>m</sub> )	24kV	36kV	48kV	72.5kV	100kV	145kV
Nominal system r.m.s. voltage. (Un)	22kV	33kV	44kV	66kV	88kV	132kV
Restricted access way (Vertical height) *	2820mm	2930mm	3040mm	3270mm	3500mm	3950mm

\*See clause 903.1.3 of "Transnet Freight Rail's Electrical Safety Instructions" (The vertical heights in restricted access ways for the various system voltages are calculated by adding 2,5metres to the normal outdoor earth clearance for the different system voltages. Refer to Annexure 9.4 of Transnet Freight Rail's Electrical safety Instructions).

#### **INSULATION LEVELS**

9.2 For the medium and high voltage nominal r.m.s voltage systems on Transnet Freight Rail the recommended Insulation levels in accordance with SANS 1019 is tabled in table 3.

**TABLE 3** 

Highest phase-to- phase r.m.s voltage for equipment. (Um)	Nominal system r.m.s. voltage. ( <sub>Un</sub> )	Rated lightning impulse withstand voltage peak.	Rated short duration power- frequency withstand r.m.s voltage.	
7,2 kV	6,6 kV	75 kV	22 kV	
12 kV 11 kV		95 kV	28 kV	
24 kV	22 kV	150kV	50 kV	
36 kV 33 kV		200 kV	70 kV	
52 kV	44 kV	250 kV	95 kV	
72,5 kV	66 kV	350 kV	140 kV	
100 kV	88kV	380 kV 450 kV	150 kV 185 kV	
145 kV	132 kV	550 kV 650 kV	230 kV 275 kV	
245 kV	220 kV	850 kV 950 kV	360 kV 395 kV	

Insulation levels for highest voltage for equipment  $U_m < 100 \text{ kV}$  are based on an earth fault factor equal to  $\sqrt{3}$  and for  $U_m > 100 \text{ kV}$  an earth fault factor equal to  $0.8\sqrt{3}$ . Where more than one insulation level is given per voltage system, the higher level is appropriate for equipment where the earth fault factor is greater than 1,4.

TABLE 3: Standard Voltages and insulation levels in accordance with SANS 1019:2008 [1]

# **SECTION 2: TRACTION SUBSTATION EQUIPMENT**

#### **OUTDOOR YARD EQUIPMENT**

#### 10.0 METAL OXIDE SURGE ARRESTERS

- The contractor shall supply and install metal oxide gapless surge arresters in accordance with Transnet Freight Rail's specification BBB 0845.
- The surge arresters shall be connected between each phase of the high voltage supply and substation main earth electrode/earth mat
- The maximum protected distance from the main transformer bushing terminal to the surge arrester terminal shall be as indicated in table 4.

#### TABLE 4:

NOMINAL SYSTEM R.M.S VOLTAGE (kV)	MAXIMUM DISTANCE (Metres)
44kV	5
66kV	6
88kV	6
132kV	7

- The neutrals of high voltage supplies are to be treated as effectively earthed unless otherwise specified.
- For the installation of high voltage surge arresters on the main transformer, refer to Transnet Freight Rail's drawing BBB 0938

#### 11.0 HIGH VOLTAGE AC DISCONNECTOR

The contractor shall supply and install the high voltage AC disconnecting switch in accordance with Transnet Freight Rail's specification BBB 7842.

#### 12.0 HIGH VOLTAGE PRIMARY CIRCUIT BREAKER

The contractor shall supply and install the high voltage AC primary circuit breaker in accordance with Transnet Freight Rail's specification BBB 1267.

#### 13.0 MAIN CURRENT TRANSFORMERS

- The main current transformers shall comply with the requirements of Transnet Freight Rail specification BBB 0937.
- The main current transformers shall either be fitted in the high voltage bushings of the main traction transformer or shall be the freestanding post type current transformers install on the line side of the main traction transformer.
- In the event of Eskom or Local Utility requiring three current transformers for metering purposes the successful contractor shall supply and install the additional current transformer.
- The ratios, accuracy and burdens of the current transformers shall be in accordance with Transnet Freight Rail's Specification BBB 0937.as specified:

#### 14.0 MAIN TRACTION TRANSFORMER

14.1 The contractor shall be responsible for the delivery, assembling, filling of transformer oil and installation on site of the main traction transformer in accordance with Transnet Freight Rail's Specification BBB 5019.

#### 15.0 AUXILIARY TRANSFORMER

- The contractor shall make provision for the supply of an auxiliary transformer which shall comply with the requirements of SANS.780
- 15.1.1 The auxiliary transformer shall be three phase with a minimum rating of 50kVA or higher depending on the substation requirements.
- 15.1.2 The 3 phase auxiliary transformer shall be supplied from the tertiary winding of the main traction transformer
- 15.1.3 The auxiliary transformer shall be the sealed unit type suitable for outdoor installation. Full details of the transformer shall be submitted.

- In the case of a double unit substation one auxiliary transformer may be provided unless otherwise specified.
- 15.3 The secondary winding of the auxiliary transformer shall be star-connected.
- The auxiliary transformer shall supply the required kVA rating without exceeding the permissible temperature rise laid down in SANS 780.
- 15.5 The nominal no-load secondary voltage of the auxiliary transformer shall be 400V three phase.
- Off-load, externally operated tap changing gear shall be provided on the transformer, with tappings to compensate for any change in the main transformer tapping.
- All primary and secondary terminals, including the secondary neutral, shall be brought out through the transformer tank by means of bushing type terminals and shall be arranged for busbar/cable connections.

#### 16.0 AUXILIARY TRANSFORMER PROTECTION

#### **PRIMARY WINDING**

- 16.1 The contractor shall make provision for overload protection of the primary winding. Refer to clause 8.8 of specification No BBB 2721.
- The protection system shall consist of an approved type of overload relay with its associated current transformers.

#### 16.3 SECONDARY WINDING

- The contractor shall supply and install a three phase isolating and earthing switch for the secondary supply of the auxiliary transformer to the substation.
- The isolating and earthing switch shall be fitted with mechanical interlocking of the key exchange type, which shall form part of the interlocking procedure for the substation. Refer to clauses 31.0 and 32.0 of this specification.

#### 17.0 AC EARTH LEAKAGE CURRENT TRANSFORMER.

- 17.1 The contractor shall supply and install a bar primary current transformer for the AC earth leakage protection. The current transformer shall be installed on the support steel structure of the primary circuit breaker.
- One terminal of the primary winding shall be connected to the primary circuit breaker frame and the other terminal shall be connected to the substation main earth electrode/mat. (Refer to drawing CEE-TBD-7 and BBB 3620).
- 17.3 The current transformer shall be class 10P10, ratio 50/5 or 100/5.
- 17.4 The current transformer shall be designed to withstand a test voltage of 2kV for 1 minute.

#### INDOOR EQUIPMENT

# 18.0 3kV DC RECTIFIER

- The contractor shall supply and install 3kV DC rectifiers in accordance with Transnet Freight Rail's Specification BBB 0496.
- 18.2 Each rectifier unit and its associated control equipment shall be designed to form an independent unit.
- 18.3 The rectifier equipment shall be installed in screened bays fitted with gates.
- The gates shall be fitted with mechanical interlocks of the key exchange type in accordance with clauses 31 and 32 of the specification.
- The bay screens shall be constructed of approximately 25mm woven wire mesh or expanded metal fixed to tubular or angle iron frames complete with doors, pillars, gates etc.

- The height of the screens and gates shall be similar to the height of the control panels but shall be not be less than 1,8 m.
- 18.7 In a double unit substation the rectifier units are referred to as the "A" and "B" units and shall be labelled as such.
- 18.8 It is required that each rectifier unit in a double unit substation can be isolated independently and earthed without shutting down the whole substation.
- 18.9 Individual rectifier units shall be screened from each other and from any other live common equipment. A mechanical key exchange interlocking system type in accordance with clauses 31 and 32 shall be fitted to ensure the safety of personnel working on the isolated rectifier equipment.
- 18.10 The rectifier units and bay screens shall be insulated from the floor.

#### 19.0 3kV DC REACTOR

- 19.1 The contractor shall supply and install a 1.8 milli Henry 3kV DC air core reactor for each rectifier unit. The installation shall include the supply of all the required insulators, foundation bolts and fasteners.
- 19.2 The 3kV DC reactor shall be in accordance with Transnet Freight Rail's Specification BBB 3890.
- 19.3 The reactor shall be insulated from the substation floor by means of insulators.
- 19.4 Sufficient space shall be allowed for access to the reactor for maintenance and inspection purposes.

### 20.0 WAVE FILTER

- The contractor shall supply and install the wave filter equipment in accordance with Transnet Freight Rail's specification BBB 3139 for wave filter capacitors and BBB 3162 for inductor coils.
- A wave filter is connected in parallel with the rectifier output. The filter unit is a capacitive inductive circuit, which is tuned to resonate at specific harmonic frequencies.
- The filter equipment shall be so designed that no individual harmonic voltage is greater than 2% of the output voltage.
- The inductor coils shall have sufficient adjustment to compensate for change in the capacitance values due to ageing. Refer to Transnet Freight Rail's drawing BBB 3483 for assembly.
- 20.5 A 100 Ampere High Rupturing Capacity (H.R.C) fuse shall be fitted to protect the wave filter equipment.
- 20.6 The fuse holder shall be mounted on insulators.
- The insulators shall be so designed that the flashover path is not less than 100mm and shall support the fuse at a distance of not less than 100mm from the bolts securing the base plate. The insulators shall have a minimum dry flashover value of 20kV.
- Access to the wave filter equipment shall only be possible once the wave filter capacitors have been connected to rail, discharged and the primary circuit breaker tripped.

  A 75 kilo Ohm resistor consisting of two 150 Kilo Ohm, 150 watt vitreous enamel resistors connected in parallel shall be provided for the discharging of the wave filter capacitors when the equipment is isolated and earthed.
- The discharge resistors shall be mounted on a suitable insulation panel or bar, which shall be insulated for 3kV DC. A minimum clearance of 75mm must be provided between the terminals, and 100mm between any 3kV live portion of the equipment and earth.
- 20.10 The wave filter capacitors shall be earthed with 95mm² PVC insulated copper cables to the DC earth leakage system.
- 20.11 The wave filter equipment shall be housed in a separate explosion proof room or cubicle.

#### 21.0 3kV DC POSITIVE ISOLATOR

- The contractor shall supply and install the 3kV DC positive isolator in accordance with Transnet Freight Rail's specification BBB 4724.
- 21.2 The DC positive isolator metal cubicle/housing shall be insulated from the substation floor.

#### 22.0 CONTROL PANELS

- The contractor shall supply and install the AC primary circuit breaker control panel and the AC/DC distribution panel in accordance with Transnet Freight Rail's specification BBB 2721.
- 22.2 The control panels shall be insulated from the substation floor.

#### **ELECTRONIC EQUIPMENT**

- The tenderer must be aware that high voltage surges and transient voltages can be induced in low voltage and control wiring due to switching and lightning. Special care shall be taken in the design and layout of the equipment to limit these voltages.
- 22.4 Electronic equipment shall suitably be protected against over voltages, surges and transients. Dehn type surge protection units or equivalent shall be used. Liberal use of metal oxide varistors is also encouraged.

#### 23.0 BATTERIES

- The contractor shall supply, install and commission a 53 cell 110 Volt Planté lead acid battery bank. The capacity of the battery can either be 100 Ampere hour rating, 200 Ampere hour rating or capacity dependant on the substation requirements.
  - The standard for the batteries shall be the 10-hour rate at 20°C. The battery shall be capable of delivering a minimum of 10 Amperes for 10 hours.
- Batteries are installed in traction substations for control and protection purposes. The battery is used for the following functions:
  - Tripping and closing of primary circuit breakers.
  - Supply to protection relays.
  - · Closing and holding coil supply to DC high speed circuit breakers.
  - 110 Volt supply to control panel.

#### 24.0 BATTERY CHARGER.

- 24.1 The contractor shall supply and install the battery charger in accordance with Transnet Freight Rail's specification BBB 2502.
- 24.2 The battery charger shall be insulated from the substation floor by means of "Marley" or "Lino" floor covering not less than 2mm thickness.

#### 25.0 TRACK FEEDER HIGH SPEED CIRCUIT BREAKERS

- 25.1 The successful tenderer shall supply and install the required 3kV DC high speed circuit breakers in accordance with Transnet Freight Rail's specification CEE.0099 as well as with the following additional requirements:
- The high-speed circuit breakers shall be of the conventional truck mounted type as commonly used by Transnet Freight Rail in the 3kV DC traction substations.
- High-speed circuit breakers shall be fitted with an automatic reclosing feature, which provides for 1 (one) reclosure at 20 to 35 seconds interval. Refer to drawings CEE-TBP-35. "Connection diagram for the high speed circuit breaker and electronic control relay".

  CEE-TBP-39."Circuit diagram for auto reclosure for the high speed circuit breaker.
- 25.4 Transnet Freight Rail shall provide the auto reclosure relays. The relays shall be wired by the contractor in accordance with the requirements of clause 25.3.

- The high speed circuit breakers shall be complete in all respects. This shall include housings, rack out trucks, base rails, main and auxiliary contacts and flapper gear and any other fittings or equipment required for the correct operation of the high-speed circuit breakers.
- The high-speed circuit breakers shall be racked into breaker cells, each having two fixed contacts mounted at the rear of the breaker cell. One contact is connected to the substation positive busbar and the other to a wall bushing mounted in the building outer wall.
- All other items of material such as cell slabs, main busbars, earthing connections, wall bushing plates or blanking-off plates, control cables etc, shall be included in the tenderer's offer.
- Transnet Freight Rail shall provide details of the wall plate frame and standard cell slabs where applicable.
- Where access is possible to the rear of the high-speed circuit breakers (busbar chamber) access barriers shall be installed.
- The barriers shall be fixed to angle iron frames with fasteners which only be removed with tools. Warning signs shall be fitted to the barriers.

#### 26.0 MODULAR TYPE STEEL HOUSED HIGH SPEED CIRCUIT BREAKERS

- Where tenderers offer modular type high-speed circuit breakers they shall submit full information, construction and dimensional drawings with their offer.
- 26.2 Transnet Freight Rail specification CEE.0227 shall be used as a guideline.
- The tenderers must be fully aware that the requirements of Transnet Freight Rail's specification CEE.0099 are relevant.
- Transnet Freight Rail reserves the right to accept or reject offers for equipment after consultation with tenderers. Transnet Freight Rail's Senior Engineer, Technology Management, shall approve all designs.
- 26.5 The modular type steel housings shall be insulated from the substation floor.

#### 27.0 REGENERATIVE HIGH SPEED CIRCUIT BREAKER

At certain substations Transnet Freight Rail will require 3kV DC regenerative braking energy absorption equipment. If required the successful contractor shall supply the high speed circuit breaker for the protection of the regenerative breaking equipment in accordance with Transnet Freight Rail's specification CEE.0099.

#### 28.0 3kV DC UNDERVOLTAGE RELAY

- 28.1 The contractor shall supply and install a 3kV DC undervoltage relay with a high voltage potential divider in accordance with Transnet Freight Rail Specification BBB 3005 and shall provide the following:
- Fibre optic technology must be used to provide galvanic isolation between the potential divider and the undervoltage relay.
- 28.3 The potential divider shall be mounted in the 3kV busbar chamber or in the high voltage compartment of the positive isolator cubicle in accordance with Transnet Freight Rail's Specification BBB 4724.
- The potential divider shall be protected by an H.R.C fuse connected between the positive side of the 3kV DC supply and the input of the potential divider.
- 28.5 Insulation clearance shall be not less than 100mm. All normally live equipment on the potential divider shall withstand a test voltage of 10,5kV AC RMS 50 Hz for one minute to earth without breakdown.

28.6 If the undervoltage relay is wall mounted, an engraved warning label shall be fixed to the front of the undervoltage relay panel with the following warning:

#### WARNING

THE POSITIVE BUSBAR MUST BE ISOLATED AND EARTHED BEFORE WORK IS UNDERTAKEN ON THE UNDERVOLTAGE RELAY

- 28.7 The following connections shall consist of 95mm² cross-sectional area copper or copper equivalent conductors.
  - Potential divider to negative busbar.
  - · Resistor base plate to DC earth leakage busbar.
  - Relay metal case to DC earth leakage busbar.

#### **SECTION 3: INSTALLATION**

#### SUBSTATION EARTHING

#### 29.0 INDOOR EARTHING (REFER TO DRAWING CEE-TBD-0007)

The successful contractor shall supply, install and comply with the following:

- 29.1. The supply and installation in the substation building of all earthing conductors for the earthing of all metal work which includes supporting frames, control panels, battery charger, positive isolator panel, track breaker cells, rectifier bay screens, chequer plates and metal bases of insulators mounted directly on the walls or floor etc.
- 29.2. The frames and bases of all items associated with the 3kV DC including the track feeder wall plates, shall be connected through the DC earth leakage relay to the negative busbar in accordance with Transnet Freight Rail's drawing CEE-TBD-0007.
- 29.3. The DC earth leakage relay and the installation thereof shall comply with the requirements specified in clause 8.6 of Transnet Freight Rail's specification BBB2721.
- 29.4. Earthing conductors which could be subjected to 3 kV DC faults caused by insulation breakdown, etc., shall be not less than 70mm² copper strap cross-sectional area or 95mm cross-sectional area PVC insulated stranded copper cable. Other earth conductors must have a minimum of 16mm² copper cross-sectional area.
- 29.5. The earthing system for the 3kV DC positive busbar chamber shall be supplied by the successful tenderer. The design of the system shall be in conjunction with Transnet Freight Rail staff.
- 29.6. The successful tenderer shall supply the portable earthing device and cables according to Transnet Freight Rail's requirements.
- 29.7. All connections to the DC earth leakage relay shall form part of a ring circuit for safety when part of the circuit is disconnected. Refer to drawing CEE-TBD-0007.
- 29.8. The earth conductors shall not be installed in such a manner as to bridge out the earth leakage relay.
- 29.9. The resistance between the DC earth leakage busbar and the substation main earth electrode/mat shall be not less than 25 ohms.
- 29.10. Holding-down bolts grouted in the floor shall not be in direct contact with reinforcing or in with the earth under the concrete floor in the substation.
- 29.11. Where mounting bolts are used for securing electrical equipment to the floor, these bolts must be insulated to prevent electrical contact with any reinforcing or floor.
- 29.11.1 The indoor substation equipment shall be earthed in groups as shown in Transnet Freight Rail's drawing CEE-TBD-0007.

# 30.0 OUTDOOR EARTHING (DRAWING NO CEE-TBD-7 AND BBB 3620)

The successful tenderer shall supply, install and comply with the following:

- Outdoor yard earthing which includes earth spikes, trench earths, earth connections to the support steel structures and fence posts. The material used shall comply with Transnet Freight Rail's specification BBB 3059 and drawing BBB3620.
- A rail-earth switch mounted on the gate that provides access to the outdoor yard and where applicable to the 3kV DC overhead feeder security area and provide all connections thereto.
- In Transnet Freight Rail switchyards where the supply from the Electrical Utility is terminated on portal structures or where a flying busbar is provided the contractor shall earth these structures.
- Install two 50mm² galvanised steel earth conductors, one each between the outside portal structure or flying busbar support and the gable of the substation building.
- The earth conductor shall be suitably terminated and connected to the portal or flying busbar structures. A suitable bracket shall be supplied and mounted on the gable of the substation building. The earth conductors shall directly be terminated on the bracket and connected to the main earth electrode/mat.

#### Insulating of structures and electrical equipment.

- 30.3.3 The tenderer shall make provision for the insulating of the support steel structures for i.e. the primary circuit breaker, main current transformers and any other structure that is connected to the AC earth leakage system from the concrete foundation.
- 30.3.3.1 The insulating material shall be either the same material used for the insulating of the mast bases for the overhead track equipment or other insulating material that has been approved by Technology Management.
- The tenderer shall make provision for the insulating of the base of the main traction transformer from the concrete plinth. Malthoid or any other approved insulation shall be used.

# 31.0 INTERLOCKING (mechanical)

#### **GENERAL**

- The equipment for each substation shall include a mechanical interlocking system; preferably the "Castell" or other approved key type. Full details of the type offered instead of the "Castell type shall be submitted with the tender.
- The mechanical interlocking system must be designed to prevent access to the high voltage equipment whilst "live" and ensure that switching and isolating operations are carried out in the correct sequence.
- 31.3 All equipment shall be delivered with the necessary interlocks fitted.
- It shall not be possible to operate the locks and release the keys in any but the correct sequence or in any position of the switches or gates, other than the fully "closed" or fully "open" position, as the case may be.
- When a unit is switched to local condition and isolated, no remote switching from the control office shall be possible. Tenderers shall furnish full explanatory details of the arrangement whereby the foregoing provisions are met.
- 31.6 The track feeder breakers shall remain closed throughout the isolation procedure.

#### 32.0 ISOLATING PROCEDURE

Sequence to isolate a single unit substation rectifier unit.

- 32.1 Trip high voltage AC circuit breaker.
- 32.2 Open high voltage AC disconnecting switch-key "1" released.
- 32.3 Remove key "1"- AC disconnecting switch locked in open and earthed position.

32.4 Use key "1" to operate auxiliary supply's three phase isolating and earthing switch - key "1" trapped key "2" released. 32.5 Use key "2" to unlock DC positive isolating and earthing switch. Open DC positive isolating and earthing - key "2" trapped - key "3" released. Remove key "3". DC 32.6 positive isolating and earthing switch locked in open position. 32.7 Use key "3" to open rectifier unit bay gate (and DC smoothing reactor screen if required). If a number of keys are required to open the rectifier cubicles, a key exchange system may be used. 32.8 32.9 Procedure is reversed to switch the rectifier unit back on load. The number indicated for the keys are for single unit substations only. Where there are two units in 32.10 one substation the numbers of keys for the two units shall be A1 and B1, A2, and B2, etc. It shall not be possible to exchange keys between any equipment on different units. 32.11 The foregoing sequence is given as a guide and may be altered to suit tenderer's equipment. The design shall be approved by Transnet Freight Rail. 32.12 Where the wave filter equipment is not located in the rectifier bay, the access to the equipment shall be mechanically interlocked and form part of the interlocking procedure. Access to the wave filter shall only be possible once the positive isolator is earthed and the primary 32.13 circuit breaker is tripped. Refer to clause 20.8 Any deviation from the above guideline must be approved by Transnet Freight Rail. 32.14 33.0 INDOOR CABLING, BUSBARS AND ASSOCIATED EQUIPMENT The contractor shall supply and install the following: 33.1 All low voltage PVC insulated supply and control cables. 33.2 3kV DC copper cables and copper busbars from the Anode wall plate to the rectifier and from the rectifier equipment to the DC positive isolating switches, DC smoothing reactors, and main DC negative busbar. In the event of aluminium (grade 6063) being used the minimum size shall by 50mm X 25mm busbar. 33.3 Where required, the supply and fitting of hot dip galvanised anode wall plates in the wall of the substation building, at the rectifier bays. The wall plate galvanising shall comply with SANS 121. 33.3.1 Wall plates shall be fitted with wall bushings, one for each phase and the neutral. Designs and drawings of the wall plate arrangement must be submitted for approval after 33.3.2 adjudication of the tender. The interconnecting busbars from the anode wall plate to the rectifier. 33.4 The main 3kV DC positive and negative copper busbars. Minimum dimension of busbars shall be 33.5 100mm X 10mm copper or 127mm X 12,5mm aluminium (grade 6063) busbar. 33.6 The 3kV DC output positive busbar system, which includes high-speed circuit breaker busbars, and where required the outgoing feeder cables between the high speed circuit breaker busbars and wall bushings. 33.7 Barriers in accordance with clause 8.0 where exposed busbars exist between the positive isolator and the DC track breaker positive, busbar. Cables from the DC smoothing reactor or main positive busbar to the wave-filter equipment. 33.8 Control cables from the rectifier cubicles to their respective control panels. 33.9 33.10 Cables from the auxiliary equipment to the substation control panels. 33.11 Connections and cabling between control panels.

BBB5452 Version 6 33.12 Cables between the 110V substation battery and the auxiliary DC panel (2 core, minimum 16mm²). 33.13 Cables (95mm<sup>2</sup> stranded copper) to the wave-filter room(s) for rail (negative) and DC earth leakage connections to wave-filter equipment. Earthing cables (95mm² stranded copper) between the DC earth leakage busbar and substation 33.14 negative busbar. 33.15 Two core 16mm² and multicore 2,5mm² cables between panel and high-speed 3kV DC circuit breakers. Two core 6mm² cables between the 25A circuit breakers on the DC panel and the Electrical Supply 33.16 Utility meter room. Make-off and connect at the DC panel only. 33.17 All other busbars and cables required for the interconnection of the substation indoor equipment. 33.18 Cable glands for the termination of the cables at the control panels and other equipment. Neoprene shrouds shall be fitted over the cable glands. 33.19 The maximum current density per square mm for open conductors shall not exceed 1.55 Ampere for copper and 1.0 Ampere for aluminium. 33.20 Low voltage cables for indoor use may be unarmoured. All high voltage cables shall be armoured XLPE insulated and shall comply with SANS 1339 and 33.21 Transnet Freight Rail specification BBC 0198. All wiring used on the 3kV DC equipment shall have nominal 3kV insulation unless the clearances comply with those laid down in clause 8.9. All negative connections and terminals associated with high voltage circuits and which are 33.22 accessible without first having to isolate and earth such high voltage circuits e.g. the main negative busbar, DC earth leakage relay, etc., shall be of 95mm<sup>2</sup>, copper or copper equivalent cross-section. The terminals shall be painted red. 33.23 Not withstanding the above clauses the contractor shall supply and install any other cables, conductors or busbars required for the successful operation of the substation. 33.24.0 **BLOCK JOINTS** 33.24.1 The contractor shall make block joints in the armouring of all the low voltage supply and control cables, which are connected between the indoor control equipment and the outdoor yard equipment. 33.24.2 The block joints shall be clearly visible and shall be not less than 200mm from the cable glands terminating at the outdoor equipment. 33.24.3 The block joints shall be sealed with a heat shrink covering to prevent the ingress of moisture. 33.25.0 **CHEQUER PLATES** 33.25.1 The contractor shall be responsible for the supply of all metal chequer plates required for covering of cable trenches inside the substation. 33.25.2 Earthing studs suitable for the fitting of 95mm<sup>2</sup> copper cable shall be welded to each chequer plate.

# 34.0 CABLES, BUSBARS AND CONNECTIONS. (OUTDOOR)

The Contractor shall supply and install the following:

- 34.1 The Inter-connections cables or conductors in the High Voltage yard.
- The high voltage AC connections which shall be solderless, concentric grip, or other approved solderless type. The connections must have adequate cross-sectional area to suit both electrical and mechanical requirements.
- 34.3 Copper busbars between separately mounted outdoor equipment. The busbars shall incorporate a degree of flexibility to avoid any overstressing of connections due to foundation movement and expansion or contraction.

- All negative connections and terminals associated with high voltage circuits and which are accessible without first having to isolate and earth such high voltage circuits e.g. the main negative busbar shall be of 95mm², copper or copper equivalent cross-section. The terminals shall be painted red.
- 34.5 Copper busbars with removable flexible connections or "all aluminium" stranded conductor may be used interconnection conductors between the main traction transformer secondary bushings and the anode wall bushings which are fixed to the anode wall plate of the substation building.
- 34.5.1 Where "all aluminium conductors are to be installed the following sizes and number of conductors shall be installed:
  - 2 X 800 mm<sup>2</sup> "all aluminium" stranded conductor per each phase for 4,5 MW substations, or 50mm X 25mm aluminium (grade 6063) busbar in accordance to Transnet freight rail drawing BBF1615
  - 2 X 500 mm<sup>2</sup> "all aluminium" stranded conductor per each phase for 3 MW substations, or 50mm X 25mm aluminium (grade 6063) busbar in accordance to Transnet freight rail drawing BBF1615.
- Where two different conductor material joints are used, the Bi-Metallic plates shall be applied.
- 34.6 Conductors from the high voltage AC line aerial conductors and between the surge arresters, AC disconnecting switch, high voltage AC circuit breaker, current transformers, rectifier transformer and rectifier.
- 34.7 Cables or busbars from the rectifier transformer to the auxiliary transformer.
- 34.7.1 The auxiliary transformer shall be connected directly to the tertiary winding of the traction transformer for new installations or existing installations where tertiary windings are employed on the main traction transformer.
- 34.8 Cable from the auxiliary transformer secondary to the short-circuiting switch.
- 34.9 Control cables from the high voltage AC disconnector, AC circuit breaker and main and auxiliary transformers to the substation control panels.
- A multi-core 4mm² cable between the current transformers and the Electrical Supply Utility meter room. Make-off and connect at the current transformer only.
- In the case of the Electrical Supply Utility Tee-supplies a multi-core 4mm² cable between the voltage transformers and the Electrical Supply Utility. The Electrical Supply Utility will do the cable connection.
- In the case of the Electrical Supply Utility Duplicate Supplies one multi-core 4mm² cable between Transnet Freight Rail's high voltage AC circuit breaker and the Electrical Supply Utility meter room. (For interlocking Electrical Supply Utility M.O.D's). The cable shall have 10% spare cores.
- 34.13 A multi-core 2,5mm² cable between the tele-control remote terminals on the control panel and the electrical supply utility meter room. (For tele-control of the Electrical Supply Utility equipment). The cable shall have 10% spare cores.
- 34.14 All other cables as specified. e.g. security lighting and alarms.
- 34.15 All control cables, security and alarm cables shall be armoured cables.
- Not withstanding the clauses above the contractor shall be responsible for all cables, busbars and connections required for the successful operation of the 3kV DC traction substation.

#### 35.0 LABELS AND TERMINALS

- All labels shall be in English. All lettering shall be white on a black background. Lettering shall be a minimum of 6mm in height.
- 35.2 All labels shall be neatly secured by rivets or screws.
- 35.3 All conductors and cables shall be provided with identification tags at terminals.

All terminals and equipment such as switches and relays shall be suitably numbered according to the substation schematic and wiring diagrams. All terminal blocks and groups of terminal blocks shall be suitably numbered.

#### 36.0 SUBSTATION NEGATIVE RETURN

The substation negative return system which can be in the form of the following:

- Buried XLPE insulated copper cable.
- · Rail on sleepers.
- · Aerial conductors.

#### 36.1 BURIED XLPE INSULATED COPPER CABLE

- The contractor shall install 2 x 500mm² single core XLPE copper cables from the substation negative busbar to the negative manhole situated near the railway line.
- 36.1.2 Transnet Freight Rail's staff will undertake the provision of the bare conductors from the negative manhole to track, as well as the rail connections.
- 36.1.3 The negative manhole to drawing CEE-TU-41 is to be supplied and installed by the contractor.
- The negative return cables shall be laid, in 150mm of soft soil in a trench, at a depth of not less than 1000mm below ground level and spaced not less than 300mm between centres.
- Where cables are likely to be damaged they shall be protected by concrete slabs. Refer to Transnet Freight Rail specification CEE.0023.
- 36.1.6 The cable route shall be provided with cable warning tape. Refer to Transnet Freight Rail specification CEE.0023.
- 36.1.7 The cable runs shall be marked by cable markers painted signal red. (Stores Item No 9/1503)

#### 36.2 RAIL NEGATIVE RETURN.

- Where rail is used for the negative return system Transnet Freight Rail shall supply and install the rail from the inside of the substation building to the railway track.
- The rail shall be insulated from ground by means of concrete sleepers supplied by Transnet Freight Rail.
- Where the rail enters the substation building it must be insulated from all concrete and brickwork to prevent stray current damage to building reinforcing or other metal. After installation the hole in the wall shall be sealed and made good by Transnet Freight Rail.
- The rail shall be connected to negative output of the rectifier by means of a suitably rated busbar/cable supplied by the contractor. Transnet Freight Rail will make provision for terminations on the rail.
- Transnet Freight Rail shall connect the negative return rail to the track by means of PVC insulated steel conductors.

#### 36.3 NEGATIVE FEEDER MONITORING SYSTEM.

- The contractor shall design supply and install a negative feeder monitoring system in accordance with Transnet Freight Rail specification BBB1843.
- The negative feeder monitoring system shall be designed to trip the 3 kV DC track breakers in the event of the traction substation negative return circuit becoming open circuited due to cable theft of the negative return cables or other cause of failure of the negative return circuit.

#### 36.4 AERIAL CONDUCTORS

Where aerial conductors are used for the negative return, the contractor shall provide the wall plates and wall bushings where required.

In the case of aerial conductors used for the negative return, Transnet Freight Rail shall provide the conductors and the installation.

#### 37.0 3kV DC POSITIVE FEEDER CABLES

The positive feeder cables shall be either:

- Buried armoured medium voltage XLPE insulated cable.
- · Aerial aluminium conductor

#### 37.1 BURIED XLPE INSULATED CABLE

- 37.1.1 The contractor shall install two single core 6,6kV, 500mm² armoured medium voltage XLPE insulated cables with stranded copper conductors. The cables shall be manufactured with copper tape screen, armour and sheath in accordance with SANS 1339 and Transnet Freight Rail specification BBC 0198. The cables shall run from the high-speed circuit breaker busbar chamber to the associated track switch structure.
- 37.1.2 Tenderers are to allow for making off the cables with suitable terminations. Sufficient length of cable must be left buried at the base of the track switch structure for erection and connection to the track switch. Transnet Freight Rail will do connection to the track switch.
- The medium voltage cables shall be laid in 150mm of soft soil, in a trench at a depth of not less than 1000mm below ground level and spaced not less than 300mm between centres.
- Where cables are likely to be damaged they shall be protected by concrete slabs. Refer to Transnet Freight Rail specification CEE.0023.
- 37.1.5 The cable route shall be provided with cable warning tape. Refer to Transnet Freight Rail specification CEE.0023.
- 37.1.6 The cable runs shall be marked by cable markers painted white (Stores Item No 9/1539).
- 37.1.7 Should it be necessary for the cables to pass under the tracks suitable pipes will be installed by Transnet Freight Rail.
- 37.1.8 Where required, the contractor shall supply the necessary wall bushings for positive feeder cables.

#### 37.2 AERIAL CONDUCTOR

- 37.2.1 In the case of aerial conductors used for the positive feeders, Transnet Freight Rail shall make provision for conductors and installation.
- Where aerial conductors are used for the 3kV DC positive, the contractor shall provide the wall plates and wall bushings.

# 38.0 TRENCHING FOR OUTDOOR YARD EARTHING CONDUCTORS AND CONTROL CABLES.

- Before any trenching commences the contractor shall consult with Transnet Freight Rail staff for approval of the routing of the trenches in the outdoor yard.
- In existing substation outdoor yards the contractor shall remove the necessary crusher stone in the outdoor yard before any excavation commences. The contractor shall restore the crusher stone after the completion of the work.
- 38.3 Trenching includes all trenches required for the installation of the earthing system and control cables.
- The depth of trenches shall not be less than 700 millimetres.
- With the installation of new earthing conductors and control cables at existing substations, care must be taken not to damage existing cables in the high voltage outdoor yard during trenching operations.
- 38.6 The Contractor and Transnet Freight Rail staff shall inspect the trenches before and during the installation of the earthing system and control cables.

Before the trenches are closed a representative from Transnet Freight Rail shall inspect the earthing system and other cabling for damage.

#### 39.0 FOUNDATIONS.

- The successful tenderer shall be responsible for the design and casting of foundations for the portal and support structures in the traction substation high voltage outdoor yard.
- Notwithstanding the supply arrangements (single or double) at any particular substation, tenderers shall clearly understand that all foundations and steelwork to accommodate the supply and to cater for the traction yard are to be provided and erected by the successful tenderer.
- Wherever there is a combined traction and 11kV/6,6kV distribution yard, a flying busbar is to be provided in Transnet Freight Rail's yard. All foundations and steelworks required to suit this arrangement, including the erection and earthing thereof shall be included in tenderer's offers.
- The foundations in the high voltage outdoor yard shall include the following:
  - Voltage Transformers if applicable.
  - Surge arresters.
  - AC disconnectors.
  - Current transformers. (If applicable)
  - · Primary circuit breakers.
  - Main traction transformer.
  - Auxiliary transformers.
  - · Portal lattice structures as required.
  - Any other foundations as specified.
- The successful tenderer shall carry out his own survey in regard to soil types and their load bearing capabilities.
- Equipment support foundations shall be finished off 200mm above the finished earth level of the yard. The design must be such as to prevent standing water.
- 39.7 All foundation edges shall be bevelled, and the surfaces must be float finished.
- 39.8 All support foundations shall be at the same level.
- The design of the concrete plinth for the main traction transformer shall include a concrete gutter around the perimeter of the plinth to contain any spillage of transformer oil.
- 39.10 Provision shall be made on the plinth for skid rails. The spacing of the rails between centres shall be a minimum of 1meter. Details of the design and load bearing parameters of the skid rail system, plinth and rail shall be submitted to Transnet Freight Rail for approval.
- The auxiliary transformer if separate shall be provided with its own concrete plinth with a concrete gutter, or may be installed on the same plinth as the main traction transformer.
- The 28-day strength of all concrete used shall be a minimum of 20Mpa.
- 39.13 Hand mixed concrete is not acceptable, it must be mechanically mixed.

#### 40.0 SUPPORT STRUCTURES

- The design, supply and installation of all steel structures for the support of equipment and tensioning of conductors shall be the responsibility of the successful tenderer.
- 40.2 Special attention shall be taken for the prevention of corrosion of all metallic parts.

- The bases of insulators, studs, bolts, support structures and other parts made of ferrous material associated with the electrical connections outdoors, shall be hot-dip galvanised, in accordance with SANS 121.
- 40.4 Steelwork for outdoor installation in coastal areas, i.e., within 50km of the coast, shall first be hot-dip galvanised in accordance with SANS 121, followed immediately at the galvanising plant by the application of the Sterling paint system in accordance with specification CEE.0045.
- Steelwork for outdoor installation in inland areas, i.e., at a distance greater than 50km from the coast, shall be hot-dip galvanised to SANS 121.
- 40.6 All high voltage equipment shall be provided with hot-dipped galvanised support structures or pedestals to provide a minimum clearance of 3,6 m (up to 88kV) or 4,1 m (above 88kV) from the lowest "live" high voltage connection to finished ground level.
- 40.7 Structural steel shall comply with SANS 1431.
- 40.8 All welded joints shall be seal welded with no gaps or blowholes.
- 40.9 All fasteners, nuts and bolts used for the installation of substation steelwork and equipment shall be hot dipped galvanized to prevent corrosion.

#### 41.0 FENCING

- 41.1 The successful tenderer shall supply and install new perimeter fencing as specified.
- 41.2 The successful tenderer shall make provision for the levelling of outdoor yard if required.
- 41.3 The fencing shall be either of the following:
  - Concrete palisade fencing in accordance to drawing CEE-TDF- 0016.
  - Hot dipped galvanised steel palisade fencing with the minimum requirements of: Height 2,4 metres
    - Size and thickness of pales 40mm x 40mm x 3mm thick.
    - Corner and intermediate posts 100mm x100mm x 3mm.
    - Horizontal cross bars 40mmx5mm.
- 41.3.1 The successful tenderer shall make provision for the installation of safety barriers in the high voltage yard in accordance with Transnet Freight Rail's requirements. (Refer to Transnet Freight Rail's Engineering instruction S.016)
- The successful tenderer shall make provision for a metal barrier screen of 25mm-wire mesh or expanded metal to be constructed around the auxiliary transformer to prevent accidental contact.
- 41.3.3 The successful tenderer shall cast a concrete apron of 150mm wide x 300mm under the perimeter fences of the substation. The top of the apron shall be a minimum of 100 mm above the ground level.

#### **42.0 GATES**

- The contractor shall supply and install two 4.6 metre wide X 2,4 metres minimum height lockable gates in the perimeter fence to allow for:
  - Entrance to substation building and yard.
  - Entrance to the high voltage outdoor yard adjacent to the main transformer (s).
- Where access to the HV outdoor yard is gained between the substation building and perimeter fence, a fence the same height as the perimeter fence shall be installed. A 1000mm wide lockable gate shall form part of the fence.
- 42.3 Provision must be made for the fitting of a spark gaps and rail earth switch on the HV yard small gate. Refer to drawings CEE-TBD-7 and BBB3620. The spark gaps shall be provided by Transnet Freight Rail on request.

- Where steel palisade fencing is used the gates shall be connected to the fence support post by means of a flexible connection to prevent electrolytic corrosion of gate hinges.
- Warning notices and danger signs in accordance with Transnet Freight Rail's Electrical Safety Instructions shall be fitted to the perimeter fencing and gates. This shall be provided by Transnet Freight Rail.

#### 43.0 CRUSHER STONE AND WEED KILLER

- 43.1 After completion of construction, installation of equipment, the laying of all cables and earthing conductors, a suitable weed killer approved by the Technical Officer shall be applied in HV outdoor vard.
- 43.2 Great care shall be exercised to avoid contaminating private property and water supplies.
- 43.3 After treatment with the weed killer, a 100mm layer of 25mm crusher stone shall be laid over the whole area of the Transnet Freight Rail high voltage outdoor yard (within the apron).

#### 44.0 PAINTING

- 44.1 All indoor and outdoor steelwork, metal screens and barriers shall be painted in accordance with Transnet Freight Rail's Specification CEE.0045.
- 44.2 The finishing coats for indoor equipment shall be in accordance with SANS 1091.

Metal Bay Screens - Eau-de-Nil (H43). Support frameworks (indoor) - Eau-de-Nil (H43).

# 45.0 DISTRIBUTION, LIGHTING OF SUBSTATION BUILDING AND STANDBY 400V AUXILIARY SUPPLIES

- The successful tenderer shall supply and install all light fittings, plugs, conduits, distribution boards, switches, cables and other material in accordance with SANS 10142-1. Galvanised, alternatively PVC conduit and galvanised fittings shall be provided at all substations within 50km of the coast.
- The contractor shall furnish a certificate of compliance for the 400V/220V AC distribution and lighting of the traction substation signed by the accredited person in terms of SANS 10142-1 and who is registered with "Electrical Contracting Board".
- 45.3 Complete Layout drawing showing the position/type of light fittings, position of plugs, distribution board and switches to be submitted to Transnet Freight Rail for approval.
- 45.4 220V AC fluorescent light fittings shall provided. The minimum lighting requirement shall be 100 lux in terms of the "Occupational Health and Safety Act".

#### 11KV/6.6KV TO 400V AUXILIARY SUPPLY AND CHANGE OVER SYSTEM.

- Where specified a 11kV/6,6kV to 400V distribution transformer will be installed to supply the traction substation in the event of substation failure or when the substation is taken off load.
- The 3 phase 400V supply from the above transformer shall be connected to the control circuitry via a automatic change over switching system.
- 45.5.2 The change over switching system shall be mechanically and electrically interlocked.
- 45.5.3 Transnet Freight Rail shall supply and install a suitably rated 4core armoured cable from the 11kV/6,6kV to 400V distribution transformer to the change over switching unit.
- 45.5.4 A 1:1 ratio isolation transformer shall be installed between the 11kV/6.6kV to 400V distribution transformer and change over switching system.
- 45.5.5 The isolation transformer shall comply with specification BBC 0330.
- 45.5.6 The successful tenderer shall supply the isolation transformer unless otherwise specified.

#### **EMERGENCY LIGHTING.**

45.6 Fluorescent light fittings with its own battery back up supply shall be supplied for emergency lighting.

- 45.6.1 A minimum of three fittings shall be installed in a single unit substation and four in a double unit substation.
- 45.6.2 The light fittings shall be installed at the following locations:
  - In single unit substations two in the main walkway between the control panels and rectifier unit.
     One flameproof fitting in the battery room
  - In a double unit substation three in the main walkway and one flameproof fitting in the battery room.
  - In additional locations where requested by the Project Manager/Engineer.
- 45.6.3 The light switch shall be clearly labelled " EMERGENCY LIGHTNING".

#### **MOULDED CASE CIRCUIT BREAKERS**

45.7 All low voltage circuits and equipment shall be protected by moulded case circuit breakers, which comply with specification SANS 156.

#### **SECURITY LIGHTS**

Where outdoor security lights are specified 400W high-pressure sodium fittings shall be installed at locations specified by the "Scope of Work".

#### 46.0 COOLING AND VENTILATION

- Where specified, 3 phase cooling fans shall be supplied and installed in the substation building.
- The required filters, louvres and guards shall be provided and installed.

#### 47.0 BATTERY ROOM

- 47.1 A three/single phase non-sparking extraction fan shall be installed for the battery room.
- 47.2 Only Ex non-sparking light fittings shall be installed in the battery room.
- 47.3 Light switches and plug sockets shall not be installed in the battery room.
- 47.4 No-smoking, naked flames and hand protection warning signs shall be fitted to the battery room doors.
- 47.5 A wooden stand treated with acid proof paint shall be provided for the batteries.
- 47.6 A hydrometer and logbook shall be supplied by the contractor for each installation.
- 47.7 The floor of the battery room shall be painted with acid proof paint.

#### 48.0 CLEARING OF SITE

All rubble which is left over as a direct result of work performed by the Contractor shall be removed from the substation building and yard and disposed of by the Contractor. The substation floors and walls shall be left in a clean condition. All cable, wire and conductor cut-offs and surplus material shall be removed from site.

#### **SECTION 4: SITE TESTING AND COMMISSIONING**

#### 49.0 SITE TESTS AND COMMISSIONING

The successful tenderer shall be responsible for carrying out on-site tests and commissioning of all equipment supplied and installed in terms of this specification and the contractual agreement.

#### 49.1 ON-SITE TESTS

49.1.1 Functional on-site tests shall be conducted on all items of equipment, circuitry and interlocking to prove the proper functioning and installation thereof.

- The successful tenderer shall submit a detailed list of on-site tests for the approval of the Project Manager/Engineer at least six weeks before tests are due to commence at the first substation.
- 49.1.3 The successful tenderer shall arrange for the Project Manager/Engineer or his representative to be present to witness the on-site tests at each substation.
- 49.1.4 On-site tests and subsequent commissioning shall not commence until all construction work has been completed. Construction staff, material and equipment shall be removed from site prior to the commencement of testing. Testing and commissioning of the substation equipment will not be allowed to take place in a construction site environment.
- 49.1.5 On-site tests shall include the following;
  - · Polarity tests on all CT's.
  - · Ratio tests on all CT's.
  - · Magnetising current of all CT's.
  - Secondary injection of all relays.
  - Trip testing, all relays must be checked for correct operation.
  - The functionality of all electrical circuitry must be tested.
  - The operation of both mechanical and electrical interlocking.
  - Tests on primary circuit breakers and other primary equipment in accordance with manufacturer's instructions.
- 49.1.6 At the completion of the on-site tests the Project Manager/Engineer or his representative, shall either sign the test sheets (supplied by the successful tenderer) as having witnessed the satisfactory completion thereof, or hand to the successful tenderer a list of defects requiring rectification.
- 49.1.7 Upon rectification of defects the successful tenderer shall arrange for the Project manager/Engineer or his representative to certify satisfactory completion of on-site tests for that particular substation.
- 49.1.8 Acceptance by the Project Manager/Engineer of satisfactory completion of on-site tests in no way relieves the contractor of his obligation to rectify defects which may have been overlooked or become evident at a later stage.

#### 49.2 COMMISSIONING OF EQUIPMENT

- 49.2.1 Commissioning will include the energising of equipment from the AC disconnects to the OHTE track feeder switches. The successful tenderer must prove the satisfactory operation of all equipment under live conditions.
- 49.2.2 On completion of commissioning the successful tenderer will hand the substation over to the Project Manager/Engineer in terms of the relevant instructions.
- 49.2.3 Tenderers shall allow a period of at least three days per substation between satisfactory completion of on-site tests and commissioning of equipment.
- 49.2.4 During this period the Transnet Freight Rail's Test staff will test the operation of all protective relays and circuits and set the protection relays at each substation.
- 49.2.5 The contractor shall rectify any faults found during the testing and setting of the protection relays.
- 49.2.6 The final testing of the substation must commence at least three days ahead of the contract completion date.
- 49.2.7 The commissioning of the protection equipment by Transnet Freight Rail will in no way absolve the successful tenderer from any of his responsibilities during the guarantee period. It is the successful tenderers responsibility to satisfy himself that the commissioning of the protection equipment has been carried out in a satisfactory manner and in no way compromises the proper operation of the equipment supplied in terms of the contract.

The commissioning dates for the substations will be dependent on the availability of power supplies from the supply utility as well as Transnet Freight Rail's electrification program and will be defined by the Project Manager/Engineer.

#### **SECTION 5: GENERAL**

#### 50.0 QUALITY ASSURANCE

- Transnet Freight Rail reserves the right to carry out inspection and tests on the equipment at the works of the supplier/manufacturer.
- Arrangements must be made timeously for such inspections and type/routine tests in accordance with the equipment specifications are carried out before delivery of the equipment to the site.
- 50.3 Type/routine test sheets of the equipment shall be forwarded to the Project Manager.

#### 51.0 GUARANTEE AND DEFECTS

- 51.1 The contractor shall guarantee the satisfactory operation of the complete electrical installation supplied and installed by him and accept liability for maker's defects, which may appear in design, materials and workmanship.
- 51.2 The guarantee period shall commence from the date of successful commissioning of the substation.
- 51.3 The guarantee period for all substations shall expire after a period of 12 months commencing from the date of successful completion of the contract or the date the equipment is handed over to Transnet Freight Rail whichever is the later.
- If urgent repairs have to be carried out by Transnet Freight Rail staff to maintain supply during the guarantee period the contractor shall inspect such repairs to ensure that the guarantee period is not affected and should they be covered by the guarantee, reimburse Transnet Freight Rail the cost of material and labour.
- 51.5 The cost of training shall be included in the tenderers quotation.

#### 52.0 DRAWINGS, INSTRUCTION MANUALS AND SPARES LISTS

- Drawings, instruction manuals and catalogues shall be supplied in accordance with Transnet Freight Rail specification CEE.0224.
- 52.2 The tenderer shall supply three copies of an instruction/maintenance manuals, schematic and wiring diagrams.
- 52.3 The contractor shall submit details of spares required in accordance with Transnet Freight Rail's specification no. CEE.0224.
- 52.4 All spares recommended for normal maintenance purposes that are not available locally (requires importation) must be highlighted.

#### 53.0 SPECIAL TOOLS AND/OR SERVICING AIDS

Special tools or servicing aids necessary for the efficient maintenance, repair or calibration of the equipment shall be quoted for separately.

#### 54.0 TRAINING

The contractor shall submit details with the tender of the training courses which will be conducted by the contractor for the training of Transnet Freight Rail maintenance staff in the operation and maintenance of the equipment supplied. The courses shall include theoretical as well as practical tuition. The date and venue of this training course shall be arranged with the Maintenance manager.

#### 55.0 PACKAGING AND TRANSPORT.

- 55.1 The contractor shall ensure that the equipment be packed in such a manner that it will be protected during handling and transport.
- 55.2 The contractor shall provide transport for the delivery of the equipment to the site where required.

#### 56.0 BIBLIOGRAPHY

[1] SANS 1019: 2008 Edition 2.5 Standard voltages, currents and insulation levels for electricity supply

# **APPENDIX 1**

# DRAWINGS ISSUED WITH THIS SPECIFICATION

DRAWING NUMBER	AMENDMENT	DESCRIPTION.
CEE-TDF-0016		Concrete fencing
CEE-TBD-7		Earthing Arrangements Traction Substations.
CEE-TU-41		Negative Return Cable Terminating Box.
CEE-TCK-1		Reactor 1,84mH, 1 500 A. (For reference purposes only)
CEE-TBP-1		Wiring diagram for auto reclosure for HSCB.
CEE-TBP-39		Circuit diagram for auto reclosure for HSCB
CEE-TBP-35		Connection diagram for HSCB and electronic control relay
CEE-TBP-38		Schematic Diagram of 3kV HV Protection.
CEE-TCL-63		3kV Busbar Chamber Arrangement: Cable Feeders.
CEE-TCQ-208		DC High Speed Circuit Breaker Cell Panel (Cell slabs) (sheets 1 to 10)
CEE-TBP-33		DC Track Breaker and Truck Wiring Diagram.
BBB 0938		Surge arresters mounted on traction transformer.
BBB 3620		3kV Earthing arrangement for traction substation
BBF 1615		Busbar connection assembly