


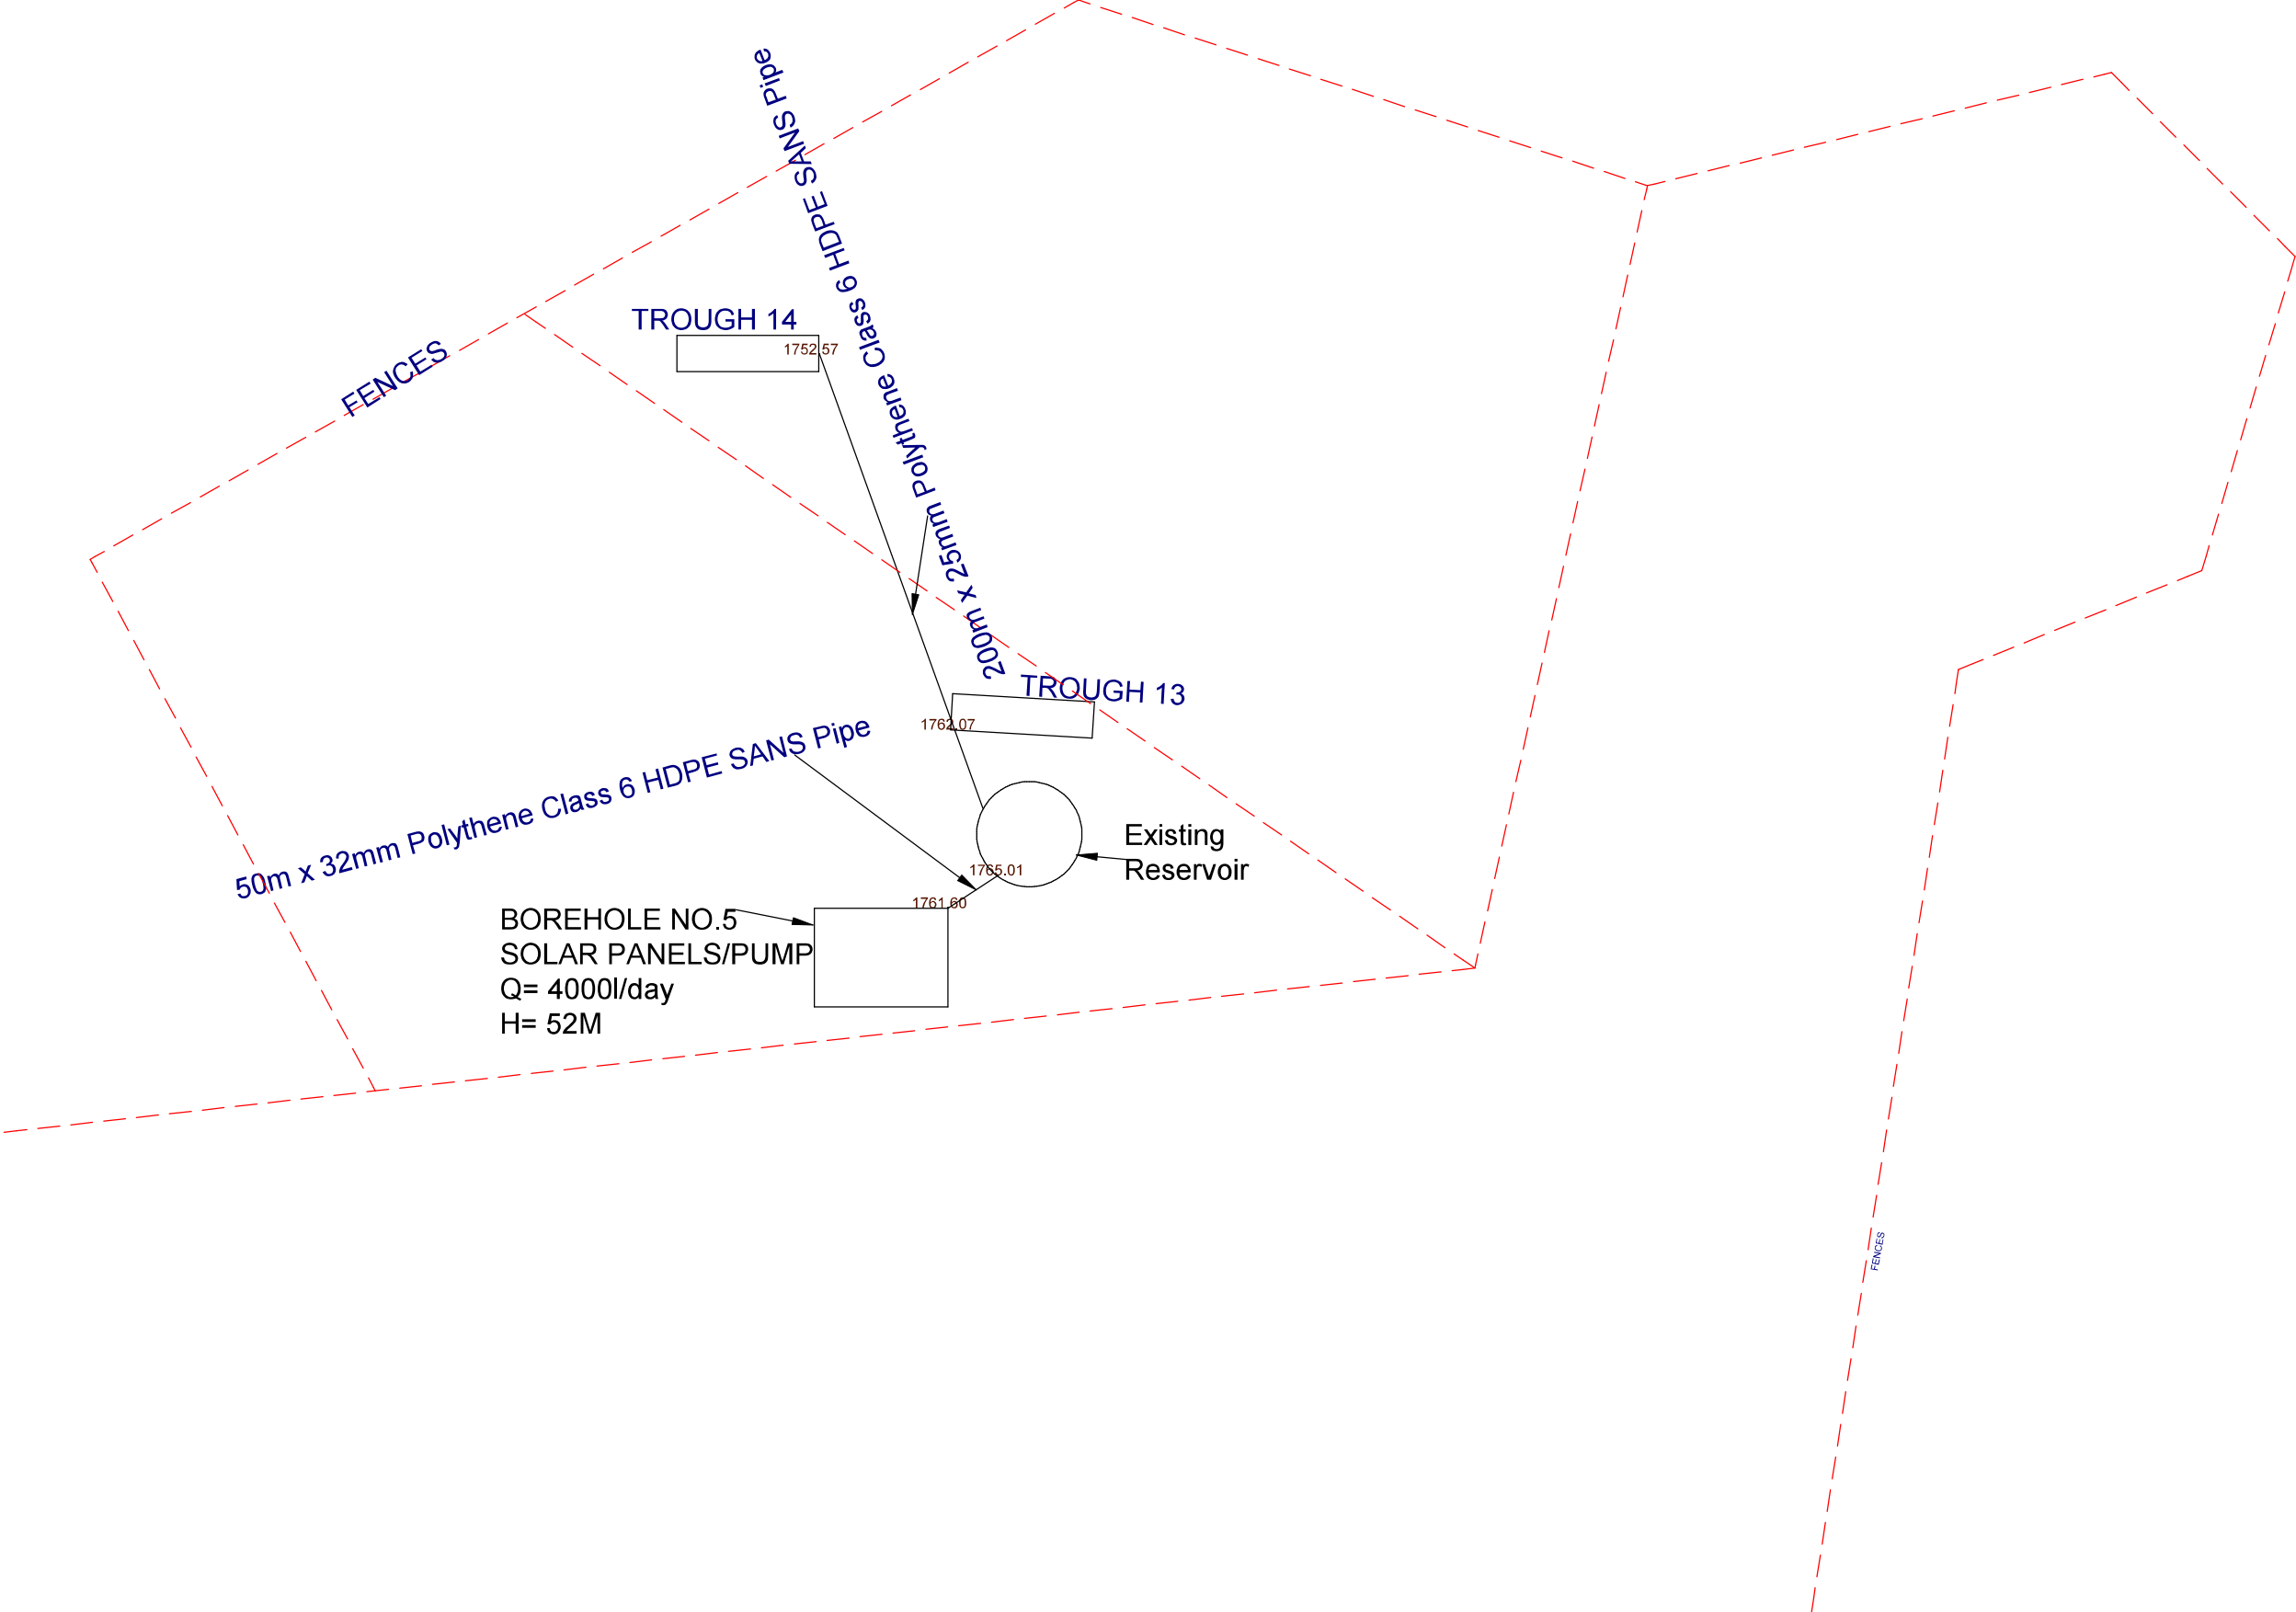

SPECIAL NOTES:
-All pipesabove ground to be galvanized steel.
-HDPE Pipes to carry an SABS Mark
-Pipes to be buried 300mm below gound
-Concrete for trough slab to be of 20 Mpa
-Trough to be fabricated poly plastics

JUNE 2023

ENGINEERING SERVICES
Private Bag X1006
ALI WAL NORTH
9750

**RURAL DEVELOPMENT AND AGRARIAN
REFORM
PROVINCE OF THE EASTERN CAPE**

STOCK WATER SYSTEMS

PELGRIMSRUS SITE LAYOUT

SCALE 1 : 6000

A3 ORIGINAL

DRAWING 2 OF 2