


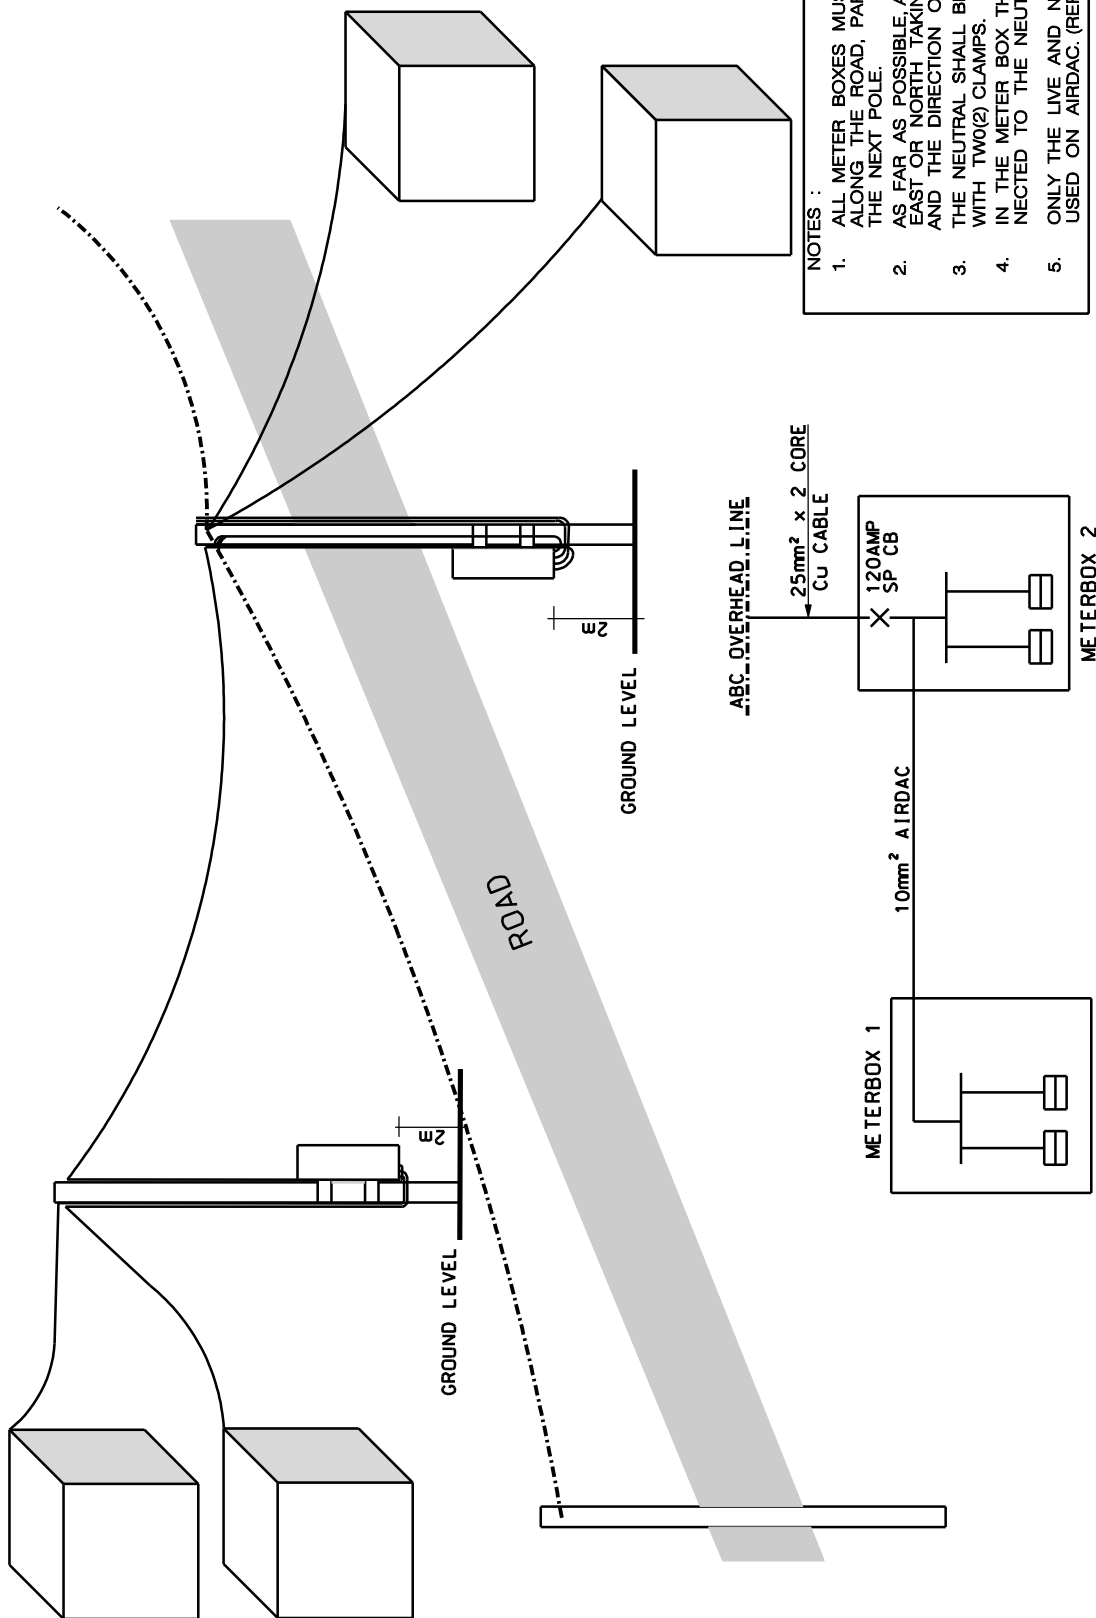

- NOTES :
1. ALL METER BOXES MUST FACE THE SAME DIRECTION ALONG THE ROAD, PARALLEL WITH THE ROAD FACING THE NEXT POLE.
 2. AS FAR AS POSSIBLE, ALL METER BOXES MUST FACE EAST OR NORTH TAKING INTO CONSIDERATION NOTE 1 AND THE DIRECTION OF THE ROAD
 3. THE NEUTRAL SHALL BE CONNECTED TO ABC NEUTRAL WITH TWO(2) CLAMPS.
 4. IN THE METER BOX THE EARTH STUD SHALL BE CONNECTED TO THE NEUTRAL WITH 10mm CU CONDUCTOR.
 5. ONLY THE LIVE AND NEUTRAL CONDUCTORS MUST BE USED ON AIRDAC. (REFER 4).

REVISION DATE 21-6-2004

CENTLEC (Pty) Ltd Reg No 2003/068270		DESIGNED T. KRUGER	DATE 15 DECEMBER 2003	FIRST DRG. MAN A. C. DE WET	EERSTE TEKENAAR NAGESIEN	CHECKED DESIGN & DEVELOPMENT AMGOQI	UTILIZATION CUSTOMER SERVICES K. V/D BERG	BENUTTING DIENSTE K. V/D BERG	REGIONAL SERVICES X. FAKU	STREEKS- TITEL DIENSTE K. V/D BERG	OVERHEAD CONNECTIONS FROM POLE MOUNTED METER BOXES(ELECTRIFICATION)	
PRIVATE BAG. X14, BRANDHOFF 9824 Tel: 051 - 402238		DRAWN F.B. FOURIE	GETEKENSKALE N.T.S.	SKAAL CHECKED	NAGESIEN	DEVELOPMENT AMGOQI	UTILIZATION CUSTOMER SERVICES K. V/D BERG	BENUTTING DIENSTE K. V/D BERG	REGIONAL SERVICES X. FAKU	STREEKS- TITEL DIENSTE K. V/D BERG	DRAWING N°. TS - 5 - 51	
											TEKENING N°. REV. VERWYS.	