



Terms of Reference:

Supply and installation of a 6KVA True Online UPS for ARC-Natural Resource and Engineering (NRE) network room at Glen

The ARC requests service providers to provide a quotation for the supply and installation of a 6KVA True Online UPS for the ARC-Natural Resource and Engineering (NRE) network room at Glen

Location:

ARC-Natural Resource and Engineering (NRE): Glen
Glen Agricultural College
Verbeeck Building
Gielie Joubert Street
Glen
9360

Specifications:

Technology:	True Online Double Conversion UPS
Size:	6 KVA
Standby time required:	4 hours calculated at full load
Input/output Voltage:	230V/230V


Design:

Tower


Equipment that will be connected to the system:

Network connection:

Extreme Networks 48-port switch

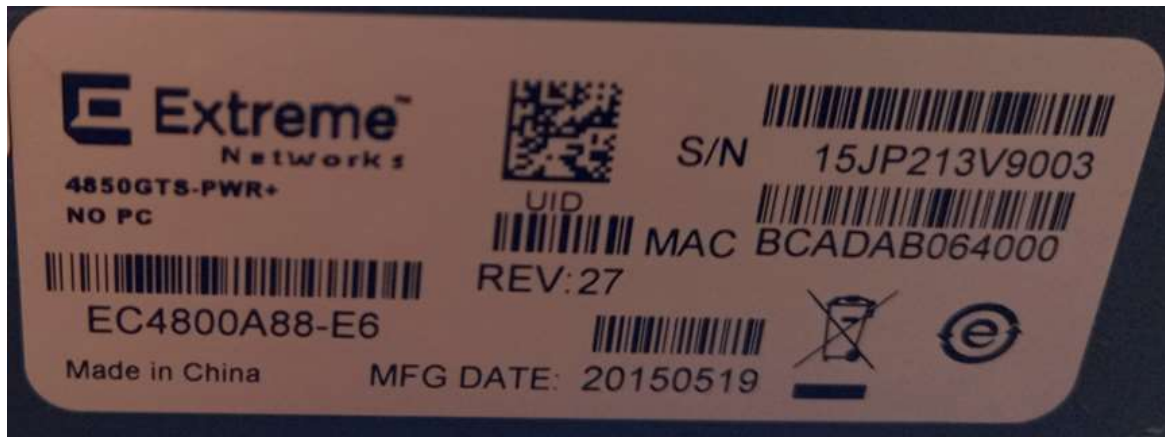

Router for Internet connection:

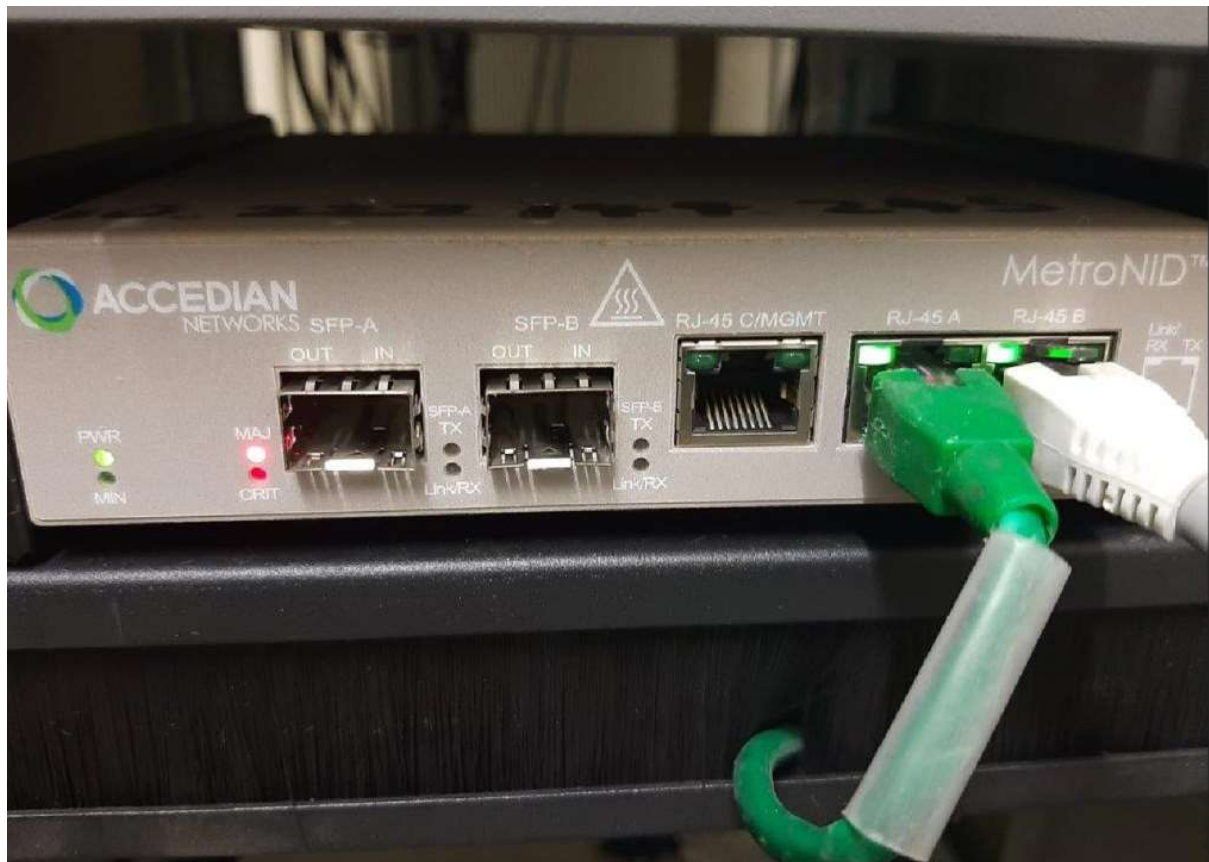

Please note:

The quotation must include and clearly show (itemized) delivery and installation costs. If not included, the quotation will not be considered.