


We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly prohibited.

Inspection engineering review

Design engineering review

Production engineering review

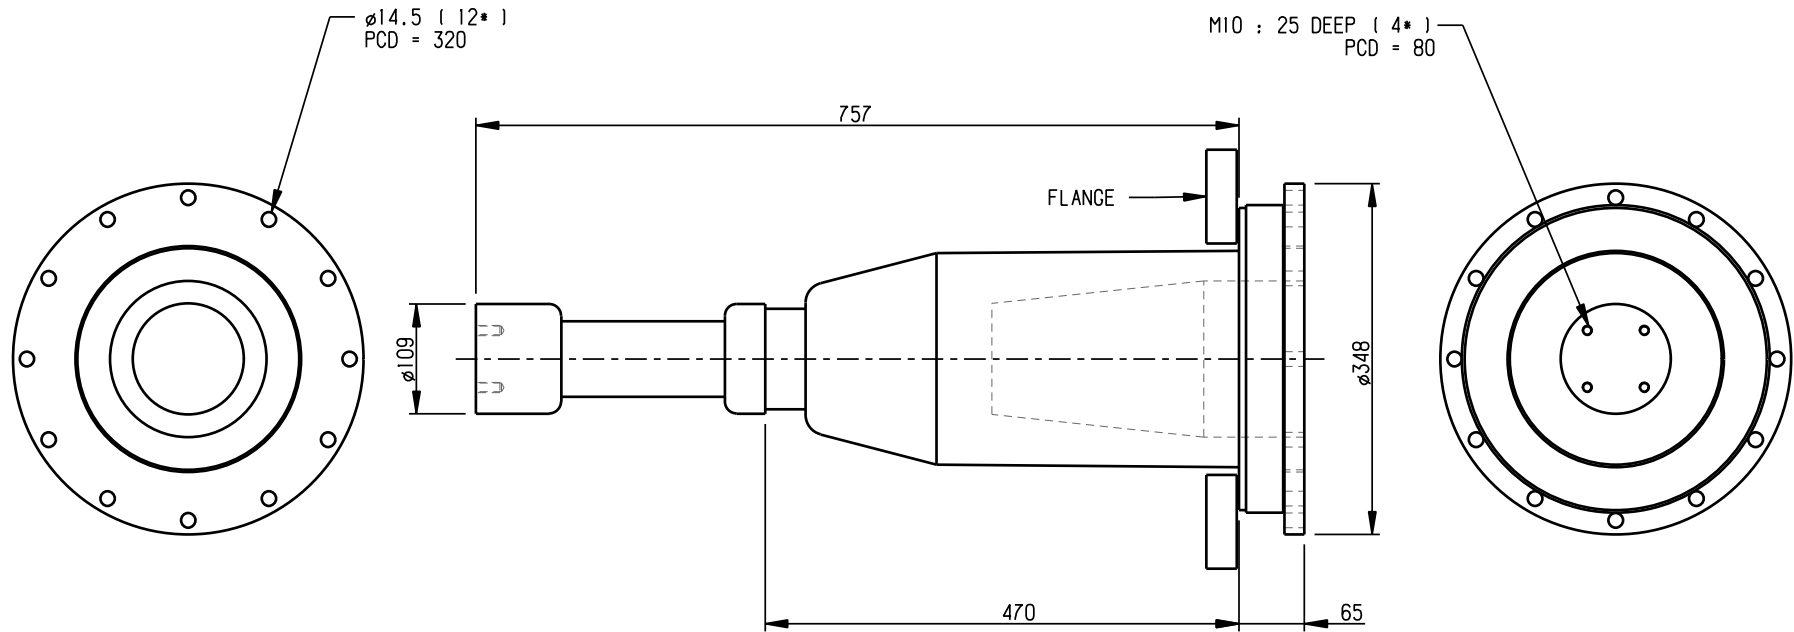

NB: MAXIMUM TORQUE 40Nm

CONNEX BUSHING SIZE 5S 145kV

| | | | |
|---------|--------------------------------------|------|---------|
| 2 | Note added (Required Torque) | MMM | 2016-08 |
| 1 | DWG. UPDATED ACC. TO SUPPLIER'S DWG. | RUDI | 2014-28 |
| Rev Ind | Revision | Appd | Date |

| | | | |
|------------------------|---|--|------------|
| Based on | Reg. No. | Title | Scale |
| Prepared RUDI | Responsible department MECH.DESIGN 2008-23 | FEMALE CONNECTION 145 kV WET TYPE FOR XLPE CABLE | 0.200 |
| Approved RUDI | Take over department | | Language |
| Revision 1 | Mass 34.3 kg | Order PURCHASE DRAWING | Page 1 |
| Powertech Transformers | | Document No. 1ZZA276004-B | Total 1 |