



# REINFORCEMENT :

ALL WALLS & FLOORS MESH REINF.  
TO METRIC FABRIC NO.245.  
WALLS 150 mm THICK  
FLOOR 100 mm THICK.

DETAIL 34A

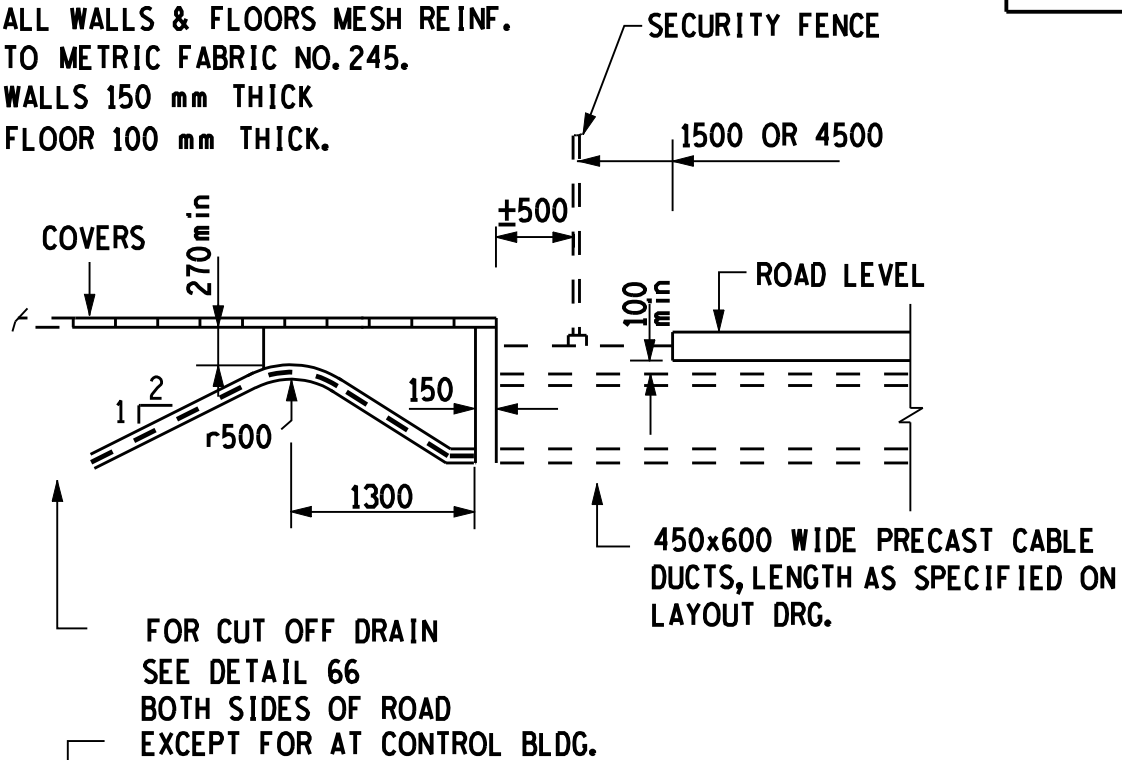

## SECTION 'X'- 'X'

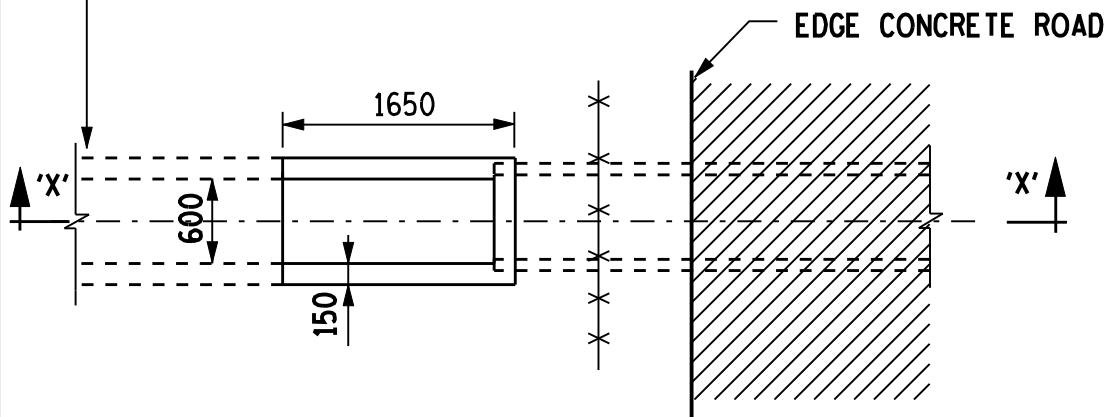

## SECTIONAL PLAN

N.T.S.

## CABLE TRENCH

SINGLE CABLE TRENCH CROSSING ROAD

THE C.A.D. REFERENCE NUMBER IS :  
MUTS0.54/00390K33.R05

TRANSMISSION  
SUBSTATION  
TECHNOLOGY  
DEPARTMENT



ESKOM

DRAWN  
GETEKEN

Z.K.F.

23/4/80

CHKD  
NAGES

R.J.C.

AUTH  
MAS

REV

DATE  
DATUM

H V YARD CIVIL WORK  
STANDARD DETAILS

0.54/390

SHEET 34A

DRG.TEK  
REGISTR

A4L