



PLAN

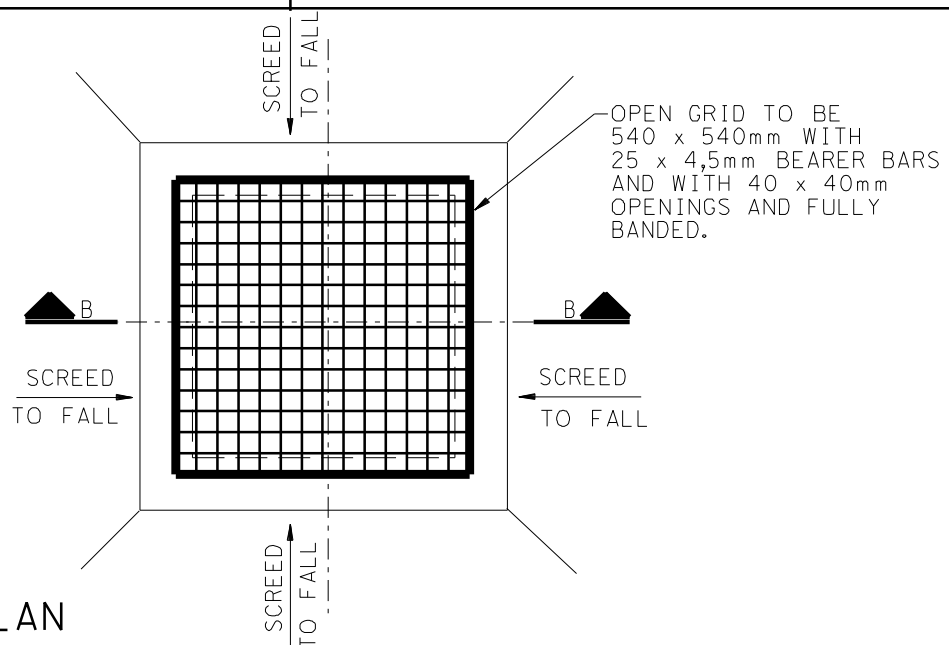

SECTION B-B

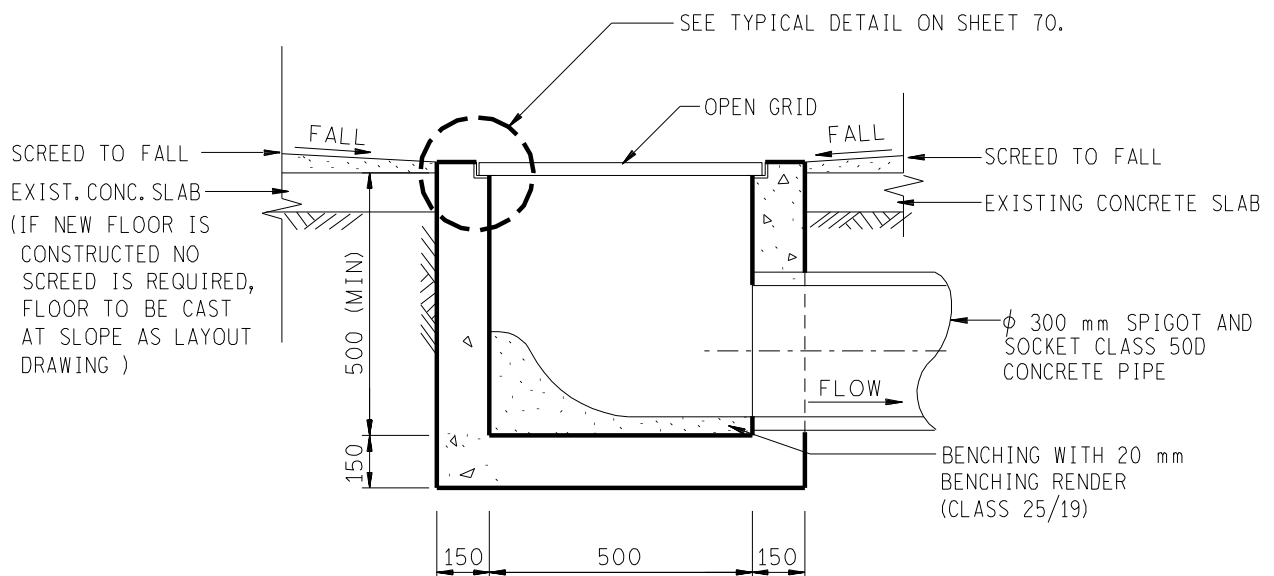

NOTES:

1. CONCRETE GRADE TO BE 25/19  
ALL CONCRETE FINISH TO BE WOOD FLOAT.
2. ALL GRIDS AND ANGLES TO BE HOT DIP GALVANIZED  
MIN 50  $\mu$ m THICK TO SABS 763.
3. SCREED TO BE 25 mm MIN THICKNESS.

SUMP DETAIL

(FOR USE INSIDE AUX. TRFR., COOLER BANK & OIL RESERVOIR BUND AREAS.)

PLOT SCALE : 141.4

DRAWING NAME : 390K69.DGN

CAD REFERENCE No.: MUTS0.54 390L069R00

TRANSMISSION  
SUBSTATION  
TECHNOLOGY  
DEPARTMENT



ESKOM

DRAWN  
GETEKEN

VC

01/94

CHKD  
NAGES

AUTH  
MAS

DJC.S

01/94

REV

0

DATE  
DATUM

H.V.YARD CIVIL WORKS  
STANDARD DETAILS

0.54/390

SHEET 69