


# DETAIL 6

FRAME TO BE 50x50x5mm ANGLE  
CAST IN AND GALVANISED

25x5mm FLATx100 LONG FISHTAIL  
LUGS WELDED TO ANGLE  
(5mm FILLET) AT 500mmc/c

M S GRATING TO BE GALVANISED,  
500mm WIDE WITH 50x4,5 BEARER  
BARS (TYPE B-RS40 25 BEARERS/m)  
FULLY BANDED (STANDERS 0,5 or 1,0m)

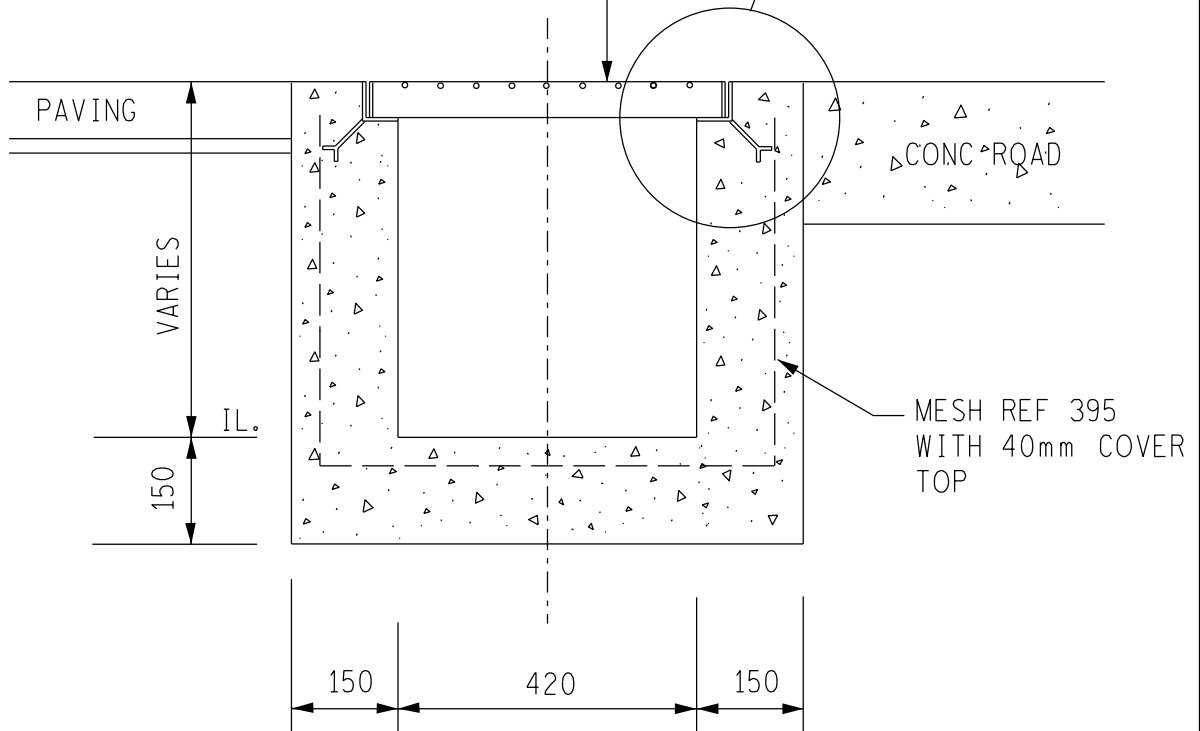

NOTE:  
FOR INVERT LEVEL SEE YARD DRAINAGE DRAWING  
EXPANSION JOINTS 20m CRS. AS PER DETAIL "X"  
ON DRG. 0.54/390 SHT. 40

## GUTTER WITH GRATING COVER

C.A.D. DRG. NAME: 390K06.DGN  
C.A.D. REFERENCE No. MUTS

TRANSMISSION  
SUBSTATION  
TECHNOLOGY  
DEPARTMENT



DRAWN GETEKEN	DJCS	10.93	CHKD NAGES		AUTH MAS	DJCS	20/04 2014	REV	4	DATE DATUM	20/04 2014
H. V. YARD CIVIL WORK STANDARD DETAILS								0.54/390			
								SHEET 6			
DRG. TEK REGISTR								A4L			