
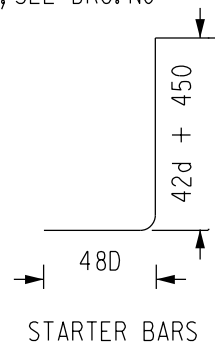


NOTES

RETAINING WALLS TO BE CONSTRUCTED IN PANELS NOT EXCEEDING 6m. EVERY THIRD PANEL TO HAVE AN EXPANSION JOINT BOTH HORIZONTALLY AND VERTICALLY. REINFORCEMENT AT CONSTRUCTION JOINTS TO BE CONTINUOUS. REINFORCEMENT TO TERMINATE EITHER SIDE OF EXPANSION JOINTS.

FOR DETAIL OF CONSTRUCTION, CONTRACTION AND LONGITUDINAL JOINTS, SEE DRG. No 0.54/390 sht 38a1.

CONCRETE GRADE 25/19.

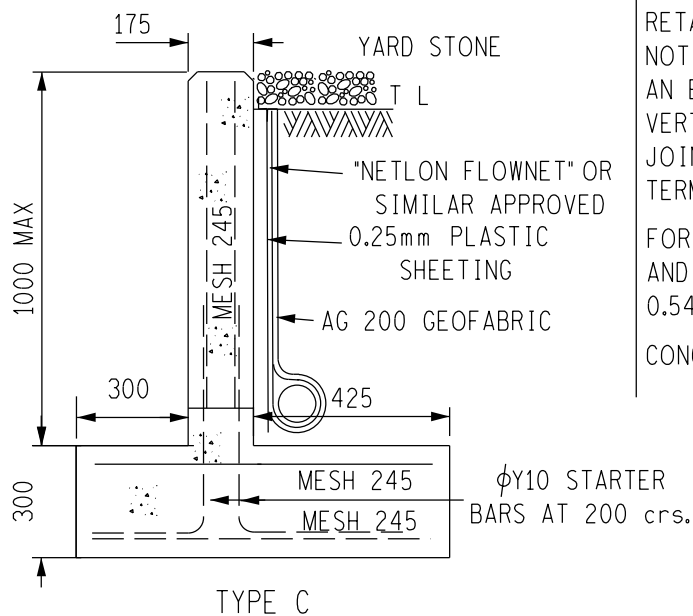

CONCRETE RETAINING WALLS

REV. 4 RE-DESIGNED AND RE-DRAWN

TRANSMISSION
SUBSTATION
TECHNOLOGY
DEPARTMENT



ESKOM

DRAWN
GETEKEN

P G

JUL. 03

CHKD
NAGES

P G

JUL. 03

AUTH
MAS

P V G

JUL. 03

REV

4

DATE
DATUM

7/03

H. V. YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 55

DRG. TEK
REGISTR

A4L