


NOTES:


- 1 - CONCRETE GRADE 20/19
- 2 - CONCRETE COVER = 40mm

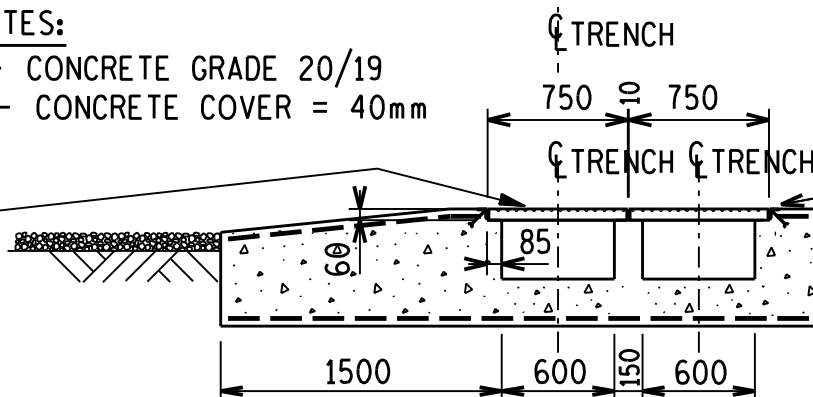


SECTION - DOUBLE TRENCH
(TYPICAL FOR TRIPLE & QUAD.)

M S GRATING WITH 60x5,5 BEARER BARS
(TYPE B RS40 25 BEARERS/m) FULLY BANDED
AND GALVANISED IN 1,0m SECTIONS - A NON SLIP
NOSING PLATE (OPEN TYPE) TO BE WELDED TO UNDERSIDE
OF GRATING

STRAPS 3x50-150 LG.
WELDED TO 50x50x6 L
AT 300 CRS.

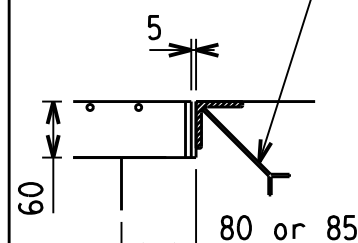

**DETAIL OF GALVANISED
ANGLE KERBING**

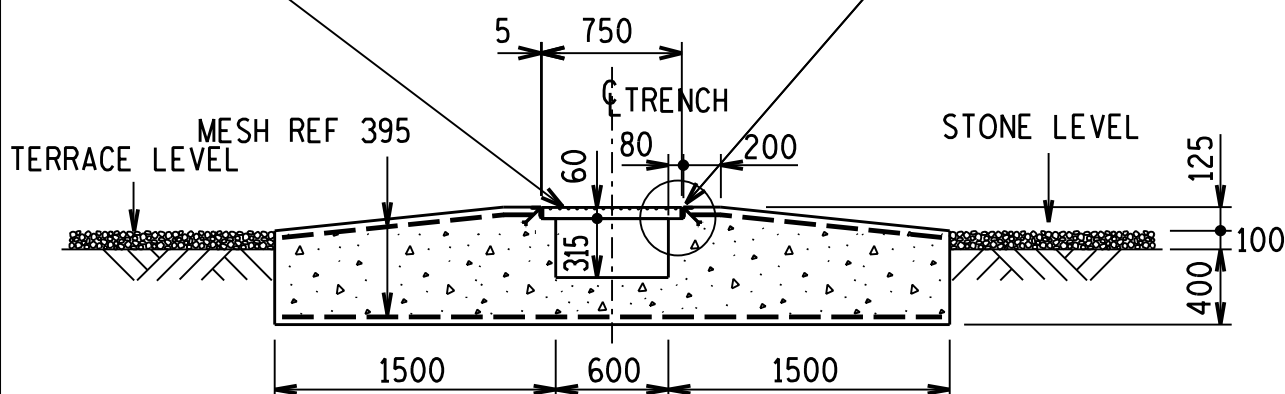

SECTION - SINGLE TRENCH
CABLE TRENCH RAMP DETAILS

**TRANSMISSION
SUBSTATION
TECHNOLOGY**



ESKOM

DRAWN
GETEKEN

DIEZ

23.4.
1980

CHKD
NAGES

PHD

AUTH
MAS

A.C.B.

D.J.C.S

REV

6

DATE
DATUM

13.06.
2014

**H.V. YARD CIVIL WORK
STANDARD DETAILS**

0.54/390

SHEET 37

DRG.TEK
REGISTR

A4L