




FOR TRENCH SECTIONS SEE DETAIL 15
FOR STEEL SUPPORTS SEE DETAIL 18.
FOR TRENCH COVERS SEE DETAIL 17A.

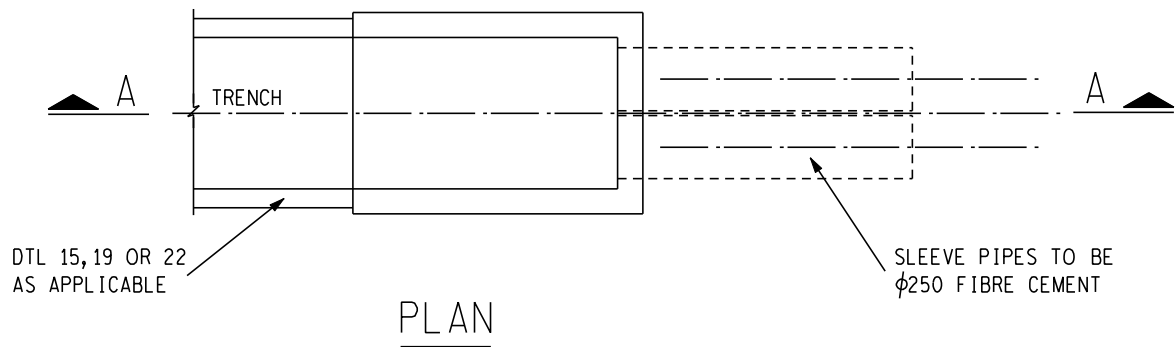

NOTE:
MESH REF 245 IN WALLS AND FLOOR
WALLS 100mm THICK
FLOOR 100mm THICK

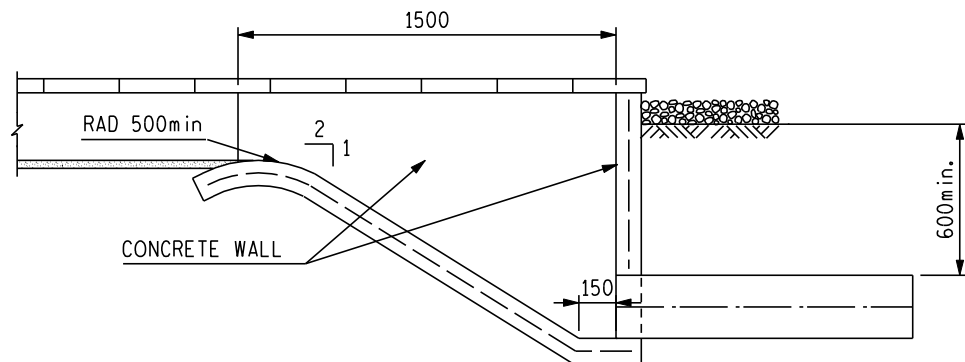

CABLE TRENCH
CROSSING DETAIL WITH SLEEVES

TRANSMISSION SUBSTATION TECHNOLOGY DEPARTMENT  ESKOM	DRAWN GETEKEN	C.F	18/06 2012	CHKD NAGES		AUTH MAS	DJC.S	18/06 2012	REV	0	DATE DATUM	
	H V YARD CIVIL WORK STANDARD DETAILS								0.54/390			
									SHEET 29d			
	DRG.TEK REGISTR								A4L			