


DETAIL 43a

TERRACE LEVEL

YARDSTONE

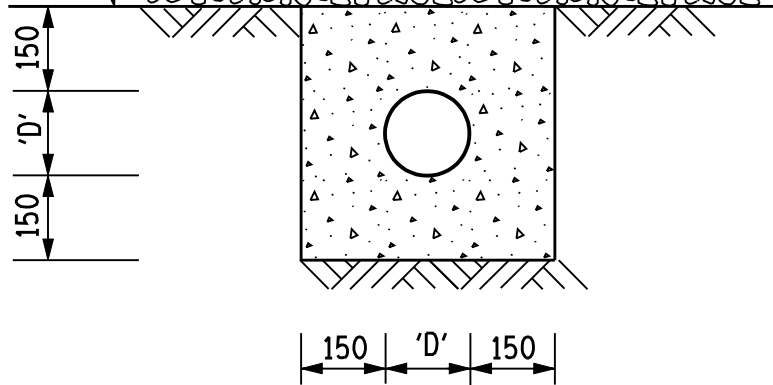


SINGLE SLEEVE PIPE

'D' - SLEEVE PIPES TO BE $\phi 160\text{mm}$ HDPE (KABELFLEX)

YARDSTONE

TERRACE LEVEL

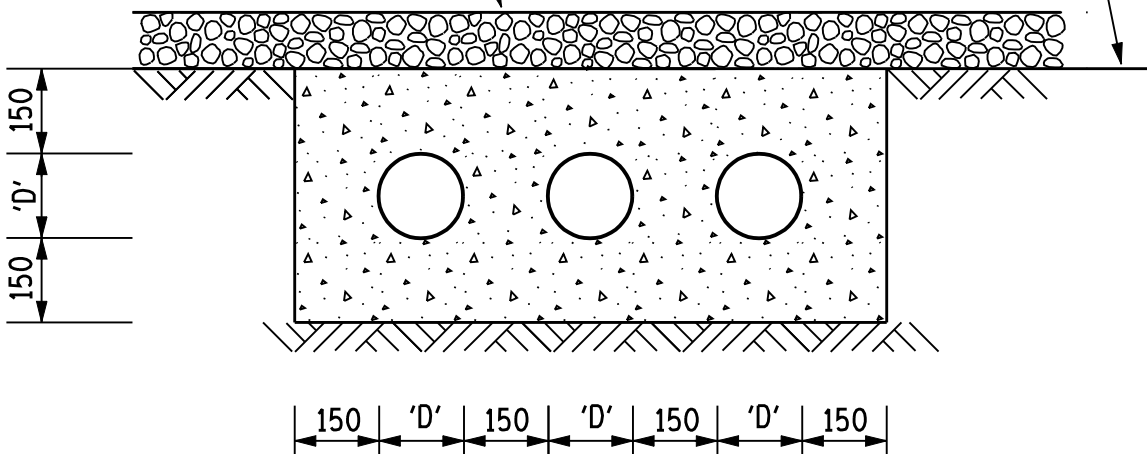

MULTI SLEEVE PIPES

SLEEVE PIPES ON TERRACE

 Eskom
Transmission

DRAWN
GETEKEN

DJC.S.

19/
01/04

CHKD
NAGES

DB.N.

19/
01/04

AUTH
MAS

REV

0

DATE
DATUM

19/
01/04

H V YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 43a

DRG.TEK
REGISTR

A4L