

FOR CONCRETE GUTTER DETAIL
SEE DRG 0.54/390 SHEET 5

20mm WIDE SLOTS
AT 1,0m C/C


PLAN

FRAME TO BE 30x30x5mm ANGLE
CAST IN AND GALVANISED

M S GRATING TO BE GALVANISED,
1000mm SQ WITH 25x4,5 BEARER
BARS (40x40mm OPENINGS)
FULLY BANDED

25x5mm FLAT x 100mm LONG
FISHTAIL LUGS WELDED TO ANGLE
(5mm FILLET) AT 500mm c/c

DETAIL A

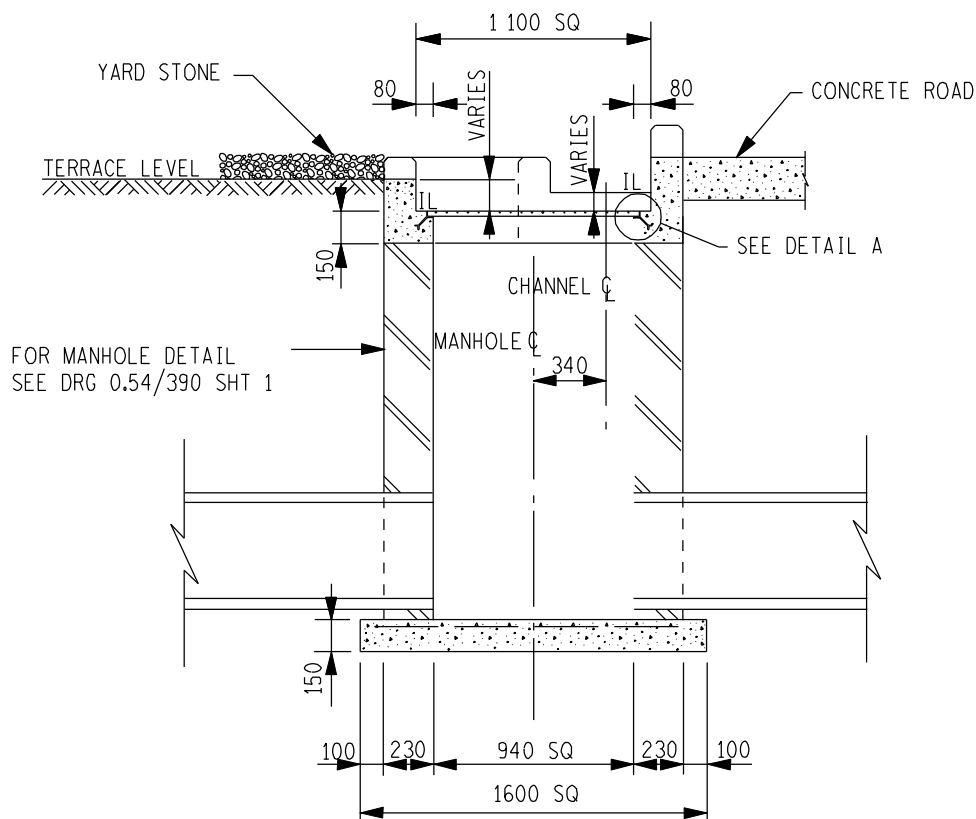

SECTION A-A

CONCRETE GUTTER GRID INLET

TRANSMISSION
SUBSTATION
TECHNOLOGY
DEPARTMENT



ESKOM

DRAWN
GETEKEN

DJC.S

01/94

CHKD
NAGES

AUTH
MAS

REV

0

DATE
DATUM

H. V. YARD CIVIL WORK

STANDARD DETAILS

0.54/390

SHEET 73