


4500 LITRE BARREL
TYPE A.C. OR PVC WATER TANK

HANDRAILS SEE
DRG 0.54/5578


SECURE WITH 40 x 3 COPPER
STRAP OR AS DETERMINED
ON SITE

Ø40 PIPE
CONNECTION


CAT LADDER & BASKET GUARD
SEE DRG 0.54/5578 (WITH CLEATS
MODIFIED AS SHOWN & BOLTED
SOLIDLY TROUGH BOTH CLEATS
& PILAR - SEE SECTION 'A - A')

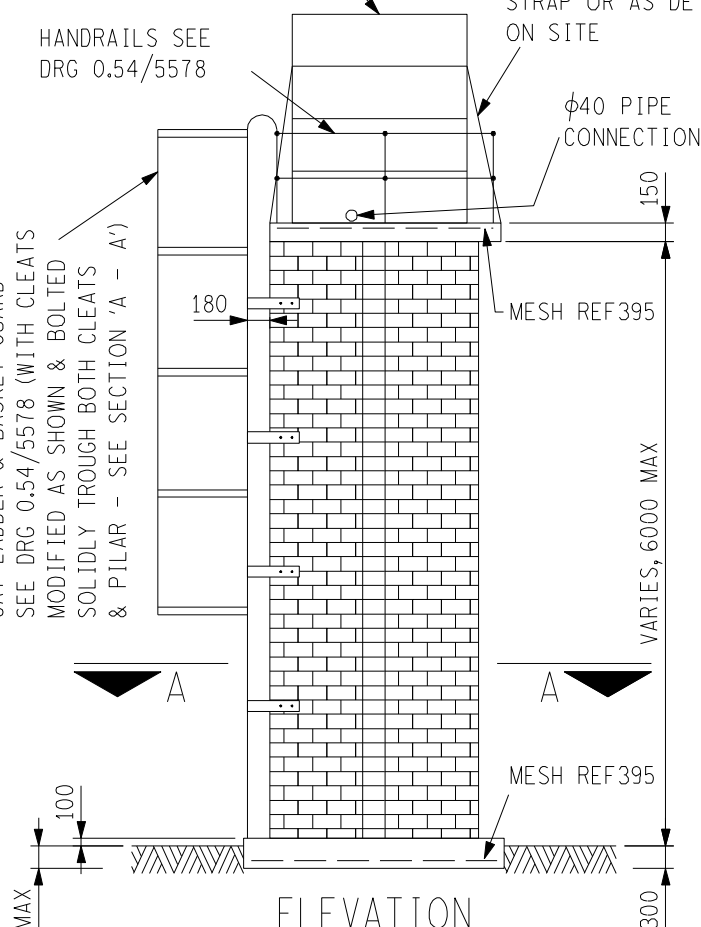


ELEVATION

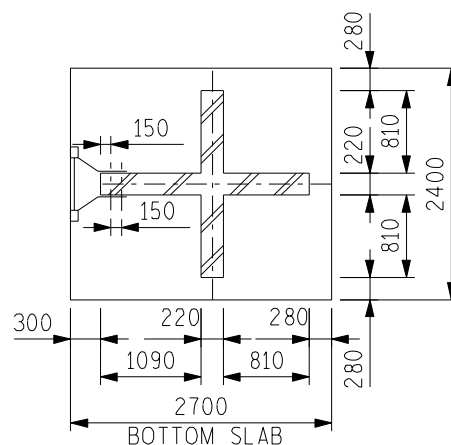

SECTION 'A - A'

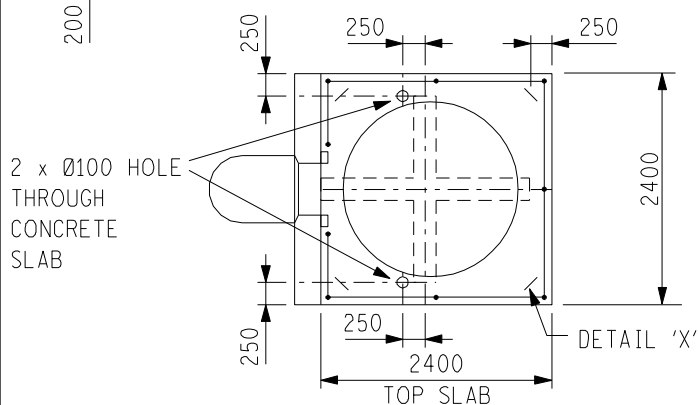

PLAN

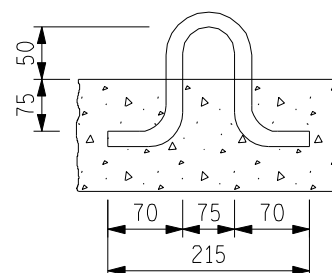

DETAIL 'X'

WATER STORAGE TANK AND STAND

THE C.A.D. REFERENCE NUMBER IS:
[100,164100390E051,R0]

TRANSMISSION
SUBSTATION
TECHNOLOGY
DEPARTMENT



ESKOM

DRAWN
GETEKEN

Z.K.F.

23/4/
1980

CHKD
NAGES

R.J.C.

23/4/
1980

AUTH
MAS

DJC.S.

19/1/
1999

REV

3

DATE
DATUM

19/1/
1999

H.V. YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 51