


* FOR NON-STANDARDS SEE NOTE 5

PLAN

MESH REF 635 (50x50x5)
SEE NOTE 5

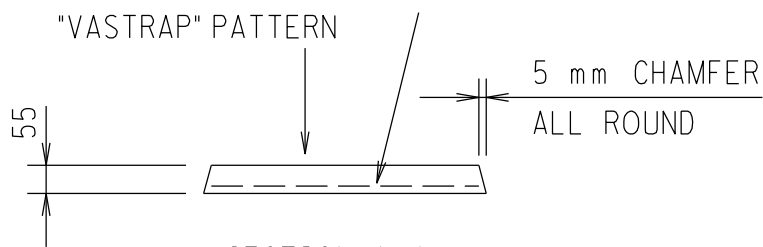

SECTION A-A

QUANTITIES:

MASS - 30kg

CONCRETE - 12,3l

MESH REF. 635 - 0,185m²

NOTES:

- 1 - CONCRETE GRADE 35/13
- 2 - CONCRETE COVER = 20mm
- 3 - REINFORCEMENT TO BE PLACED WITH MAIN STRANDS RUNNING IN LONGEST DIRECTION, SPACERS TO BE USED. (SIMILAR TO JOLUKA SIDE SPACER WITH WIRE - 011 314 0795.)
- 4 - SLABS TO BE CAST IN STEEL MOULDS WITH SIDES CHAMFERED 5mm. TOP OF SLAB TO HAVE "VASTRAP" PATTERN
- 5 - FOR NON-STANDARD PANELS FROM 750 TO 1000 USE MESH REF 635 x 1 BOTTOM, 1000 TO 1500 USE MESH REF 635 x 2 BOTTOM.



PRE-CAST SLAB TRENCH COVER

THE C.A.D. REFERENCE NUMBER IS:
MUTSO.54 00390K17A.R02

**TRANSMISSION
SUBSTATION
TECHNOLOGY**



ESKOM

DRAWN
GETEKEN

C.F

01.10.
2013

CHKD
NAGES

DB.N

01.10.
2013

AUTH
MAS

DJC.S

24.11
2014

REV

7

DATE
DATUM

24.11
2014

H.V. YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 17A

DRG. TEK
REGISTR

390K17A.DGN A4L