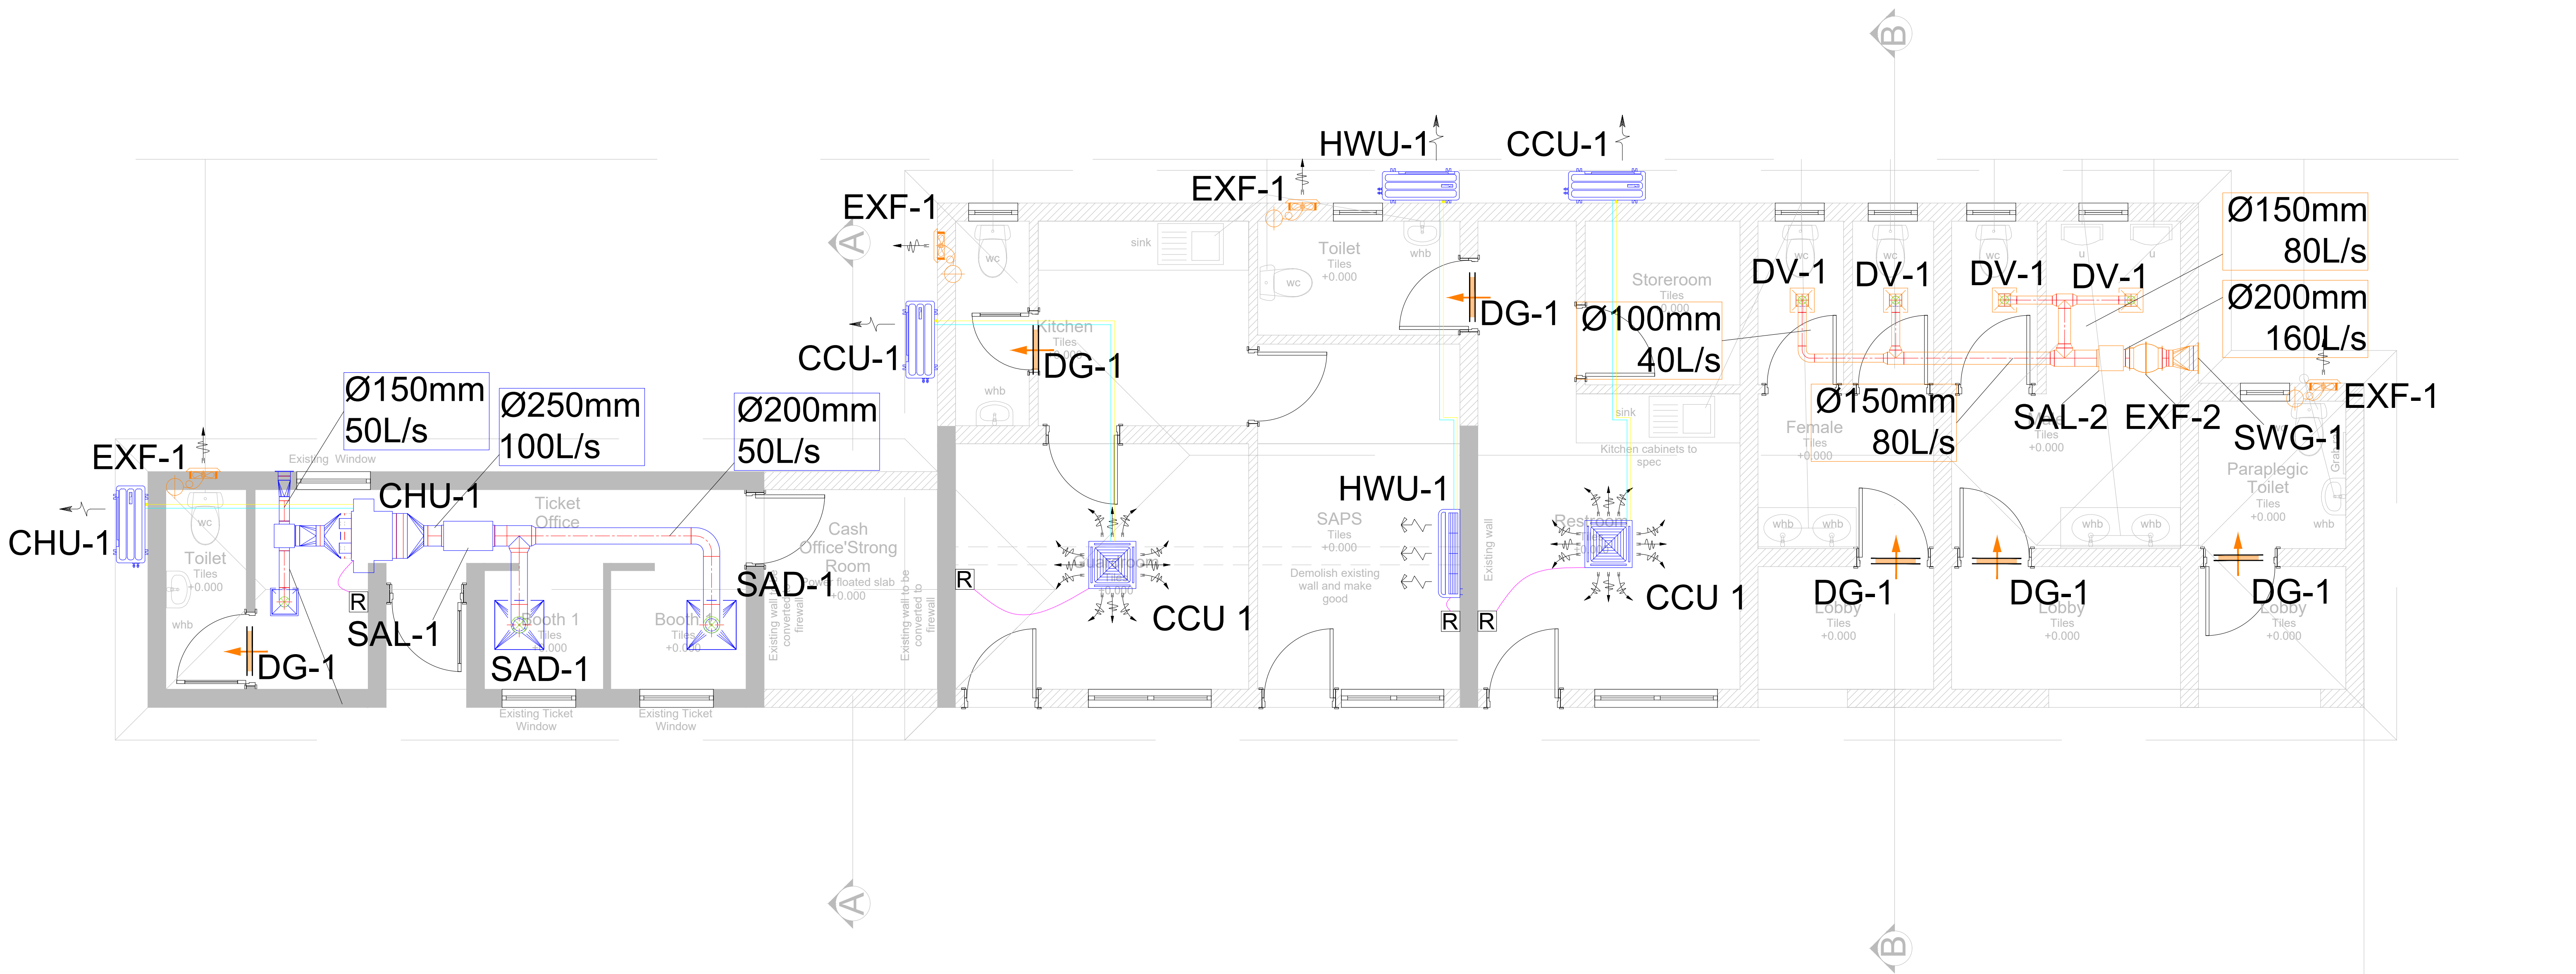





LEGEND							
Reference	Description	Caacity	Air Flow	Equipment	Quantity	Power Supply	
						kW	Ph / V / Hz
Rest Room	CCU-1	Cooling Capacity: 3.5kW Heating Capacity: 4.0kW	-	Outdoor and Indoor Unit Fixed Remote	1	1.80	1,2,220-240,50
Guard Room	CCU-1	Cooling Capacity: 3.5kW Heating Capacity: 4.0kW	-	Outdoor and Indoor Unit Fixed Remote	1	1.80	1,2,220-240,51
SAPS Room	HWU-1	Cooling Capacity: 3.5kW Heating Capacity: 4.0kW	-	Outdoor and Indoor Unit Fixed Remote	1	1.80	1,2,220-240,51
Ticket Office	CHU-1	Cooling Capacity: 5.0kW Heating Capacity: 6.0kW	100 L/s	Outdoor and Indoor Unit Fixed Remote	1	2.70	1,2,220-240,51
Ablutions	EXF-1	25L/s @ 100Pa	25 L/s	Inline Extraction Fan	4	0.25	1,2,220-240,50
Ablutions	EXF-2	160L/s @ 200Pa	160 L/s	Inline Extraction Fan	1	0.55	1,2,220-240,50

REV	DRAWINGS TITLE	CHK	APP	REV	DESCRIPTION	DATE	CHK	APP
	REFERENCE DRAWINGS				REVISIONS			

PROFESSIONAL SERVICE PROVIDER


AES
consulting

30 Long Reach Street
Dorchester Heights
East London
60541
Tel: 074 661 0248
Fax: 086 218 8523
email: admin@aesconsulting.co.za

	NAME	PR. NUMBER	SIGNATURE	DATE
DESIGNED	T. C. MANGO	201501281		17-03-2023
DRAWN	T. C. MANGO	201501281		17-03-2023
CHECKED	C. BHEBE			20-03-2023
PROJ. ENGINEER				
PROJ. MANAGER				
APPROVED				

CLIENT APPROVAL			
TITLE	INITIAL	SIGNATURE	DATE
GENERAL MANAGER			
PROJECT MANAGER			
PROJECT ENGINEER			

CLIENT

prasa
PASSENGER RAIL AGENCY
OF SOUTH AFRICA

8 Station St
East London CBD
East London
5200
Tel: 079 343 0765
Fax:
email: lwando.kran@prasa.com

PROJECT / DRAWING TITLE	
STATION DEVELOPMENT FOR PERSEVERANCE, PORT ELIZABETH	
HEATING, VENTILATION AND AIR-CONDITIONING	

SCALE: NTS	SHT. No. 1 of 1
CONTRACT No. -	PROJECT No. -
DRAWING No. AES-PRASA-ME01-PRE-001	