

A

B

C

D

E

F

A



B

C

D

E

F

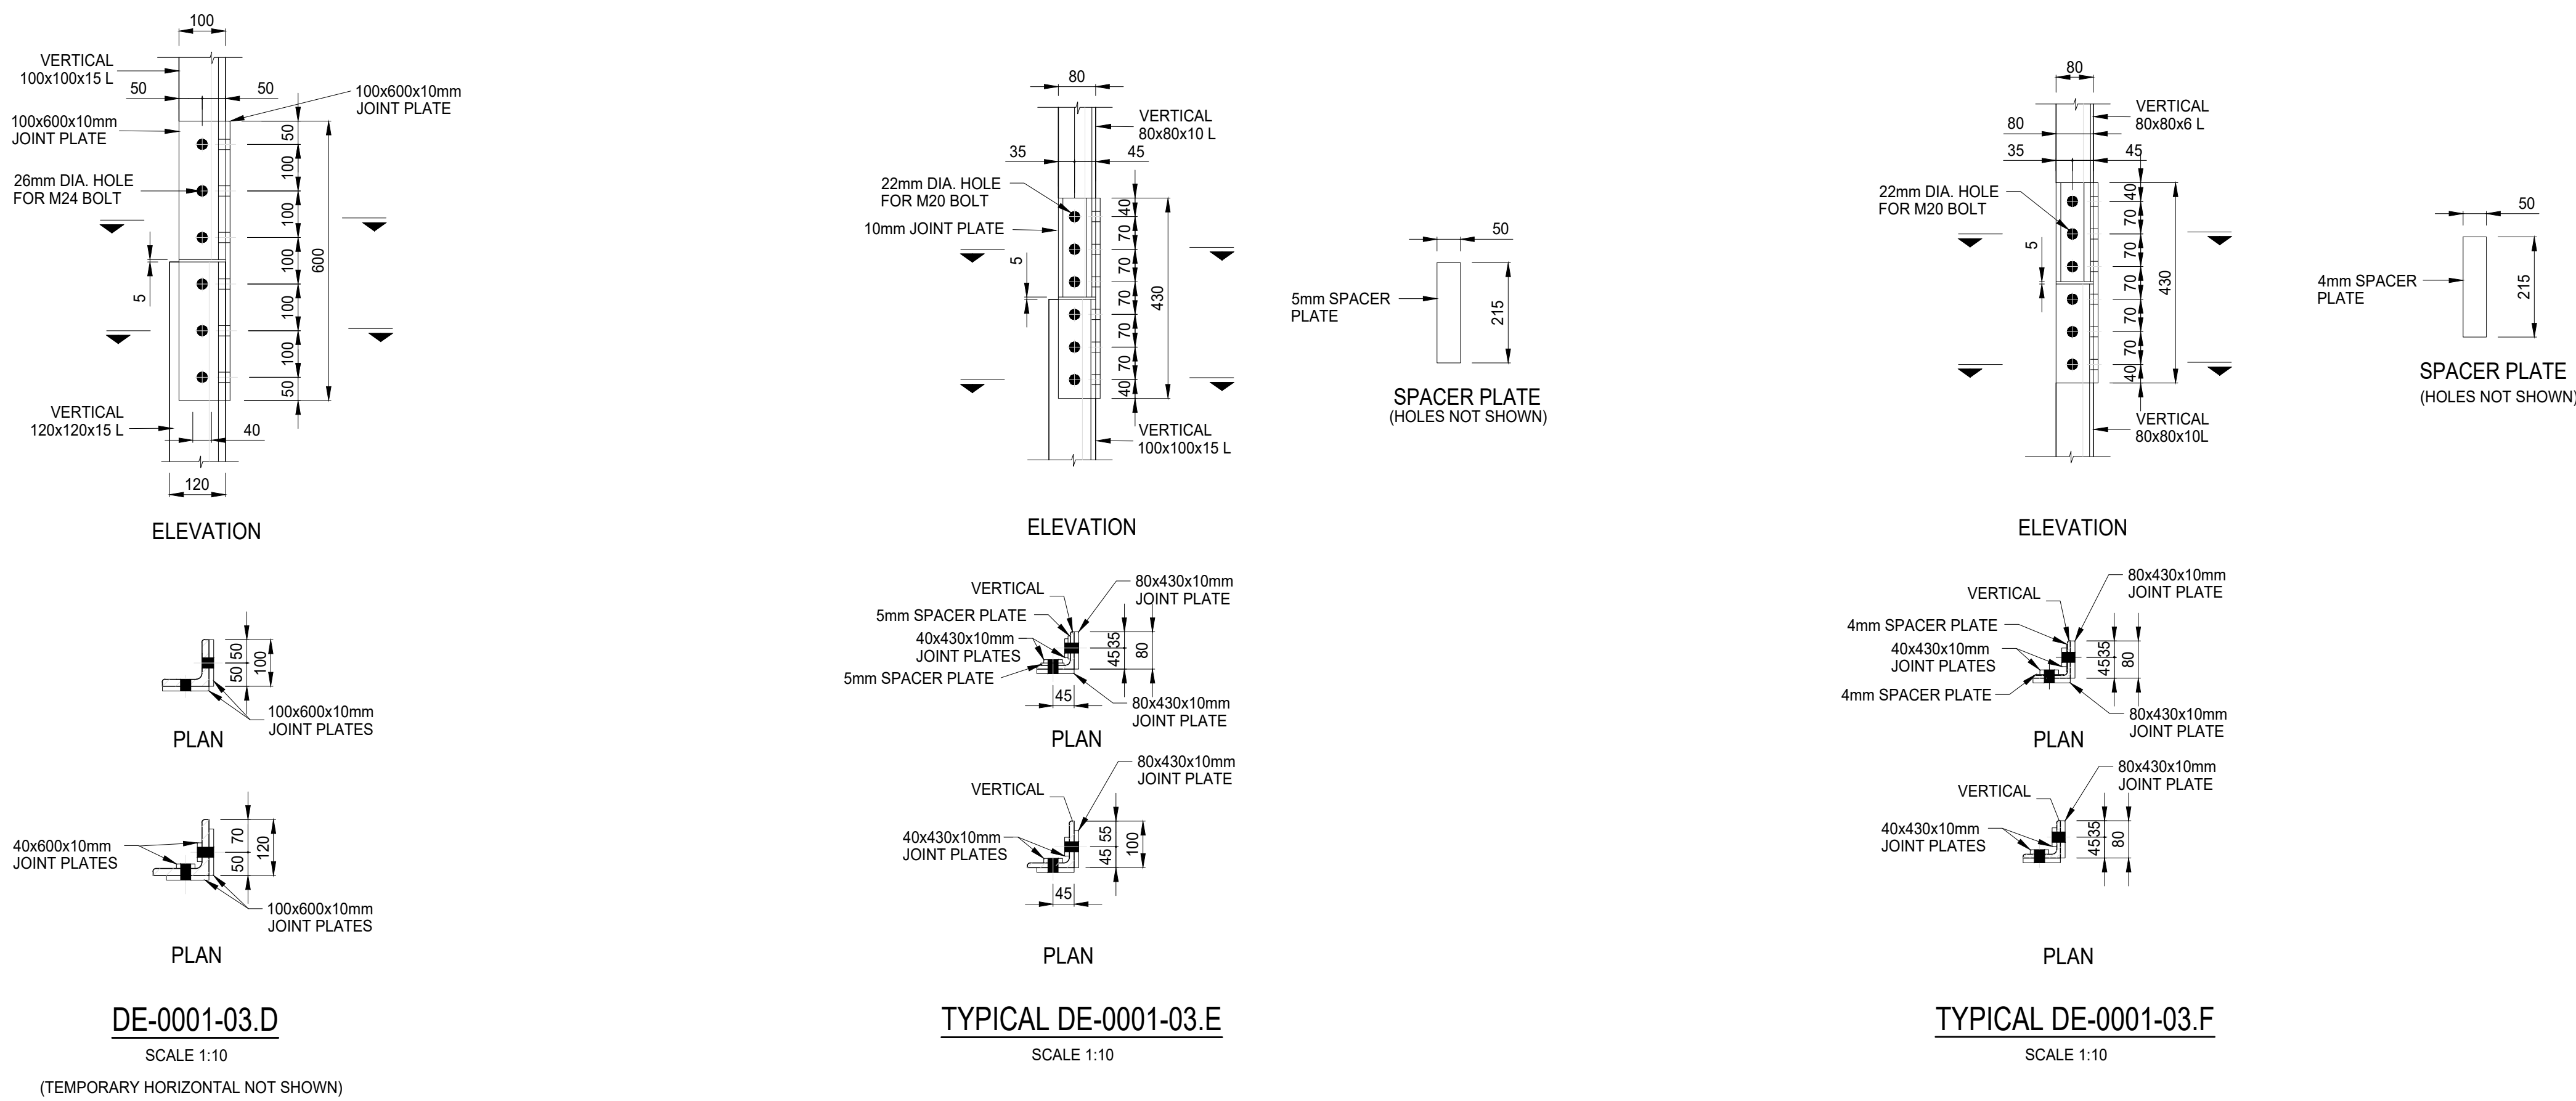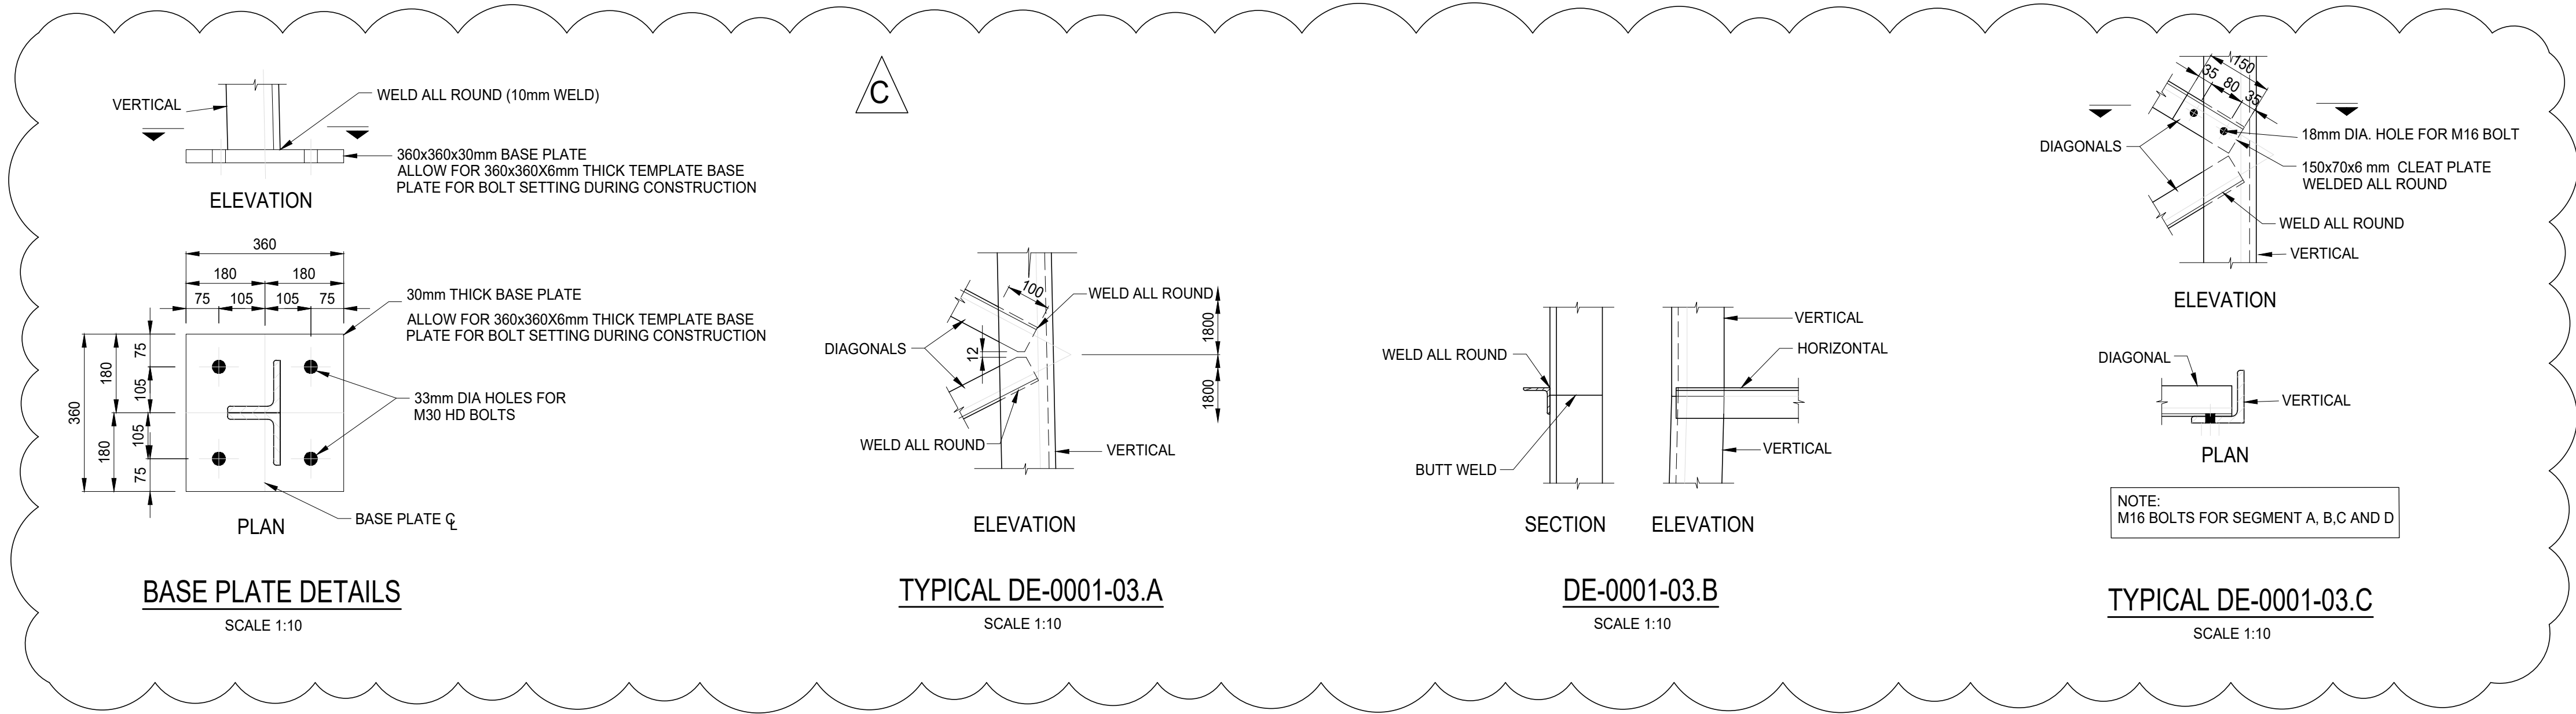

NOTES

- DO NOT SCALE DRAWING - ONLY DIMENSIONS SHOWN TO BE USED.
- THE CONTRACTOR SHALL VERIFY ALL CONDITIONS, DIMENSIONS AND LEVELS ON THE SITE AND NOTIFY THE NEC SUPERVISOR OF ANY VARIATIONS BEFORE CONSTRUCTION.
- CONCRETE CUBE STRENGTH: 30MPa
- FOR GENERAL NOTES REFER TO DRAWING V.R2A1AA-4-112-T-GA-0001-01.
- REINFORCEMENT SHALL COMPLY WITH SABS S20 AND BE BENT TO SABS 282 SYMBOLS - R = MILD STEEL BARS WITH CHARACTERISTIC STRENGTH OF 250 MPa. Y = HOT ROLLED OR COLD WORKED HIGH YIELD STEEL BARS WITH CHARACTERISTIC STRENGTH OF 450 MPa.
- T = TOP  
B = BOTTOM  
(ONLY REINFORCEMENT FABRICATED UNDER THE SABS MARK SCHEME SHALL BE DEEMED TO COMPLY WITH SABS REQUIREMENTS)