
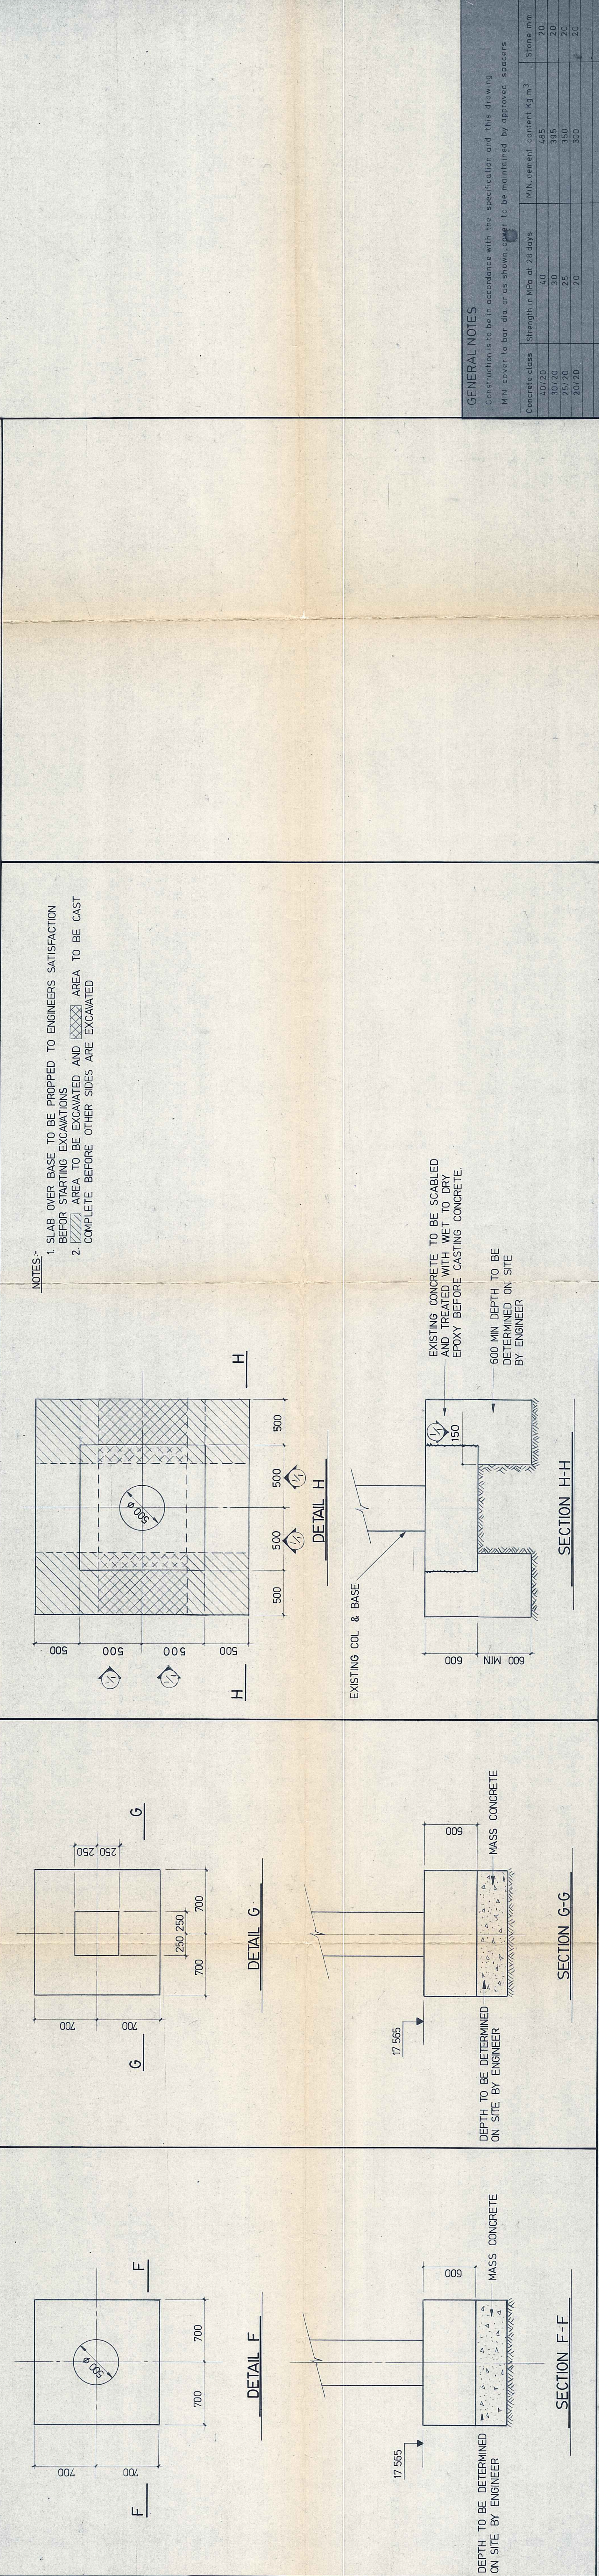


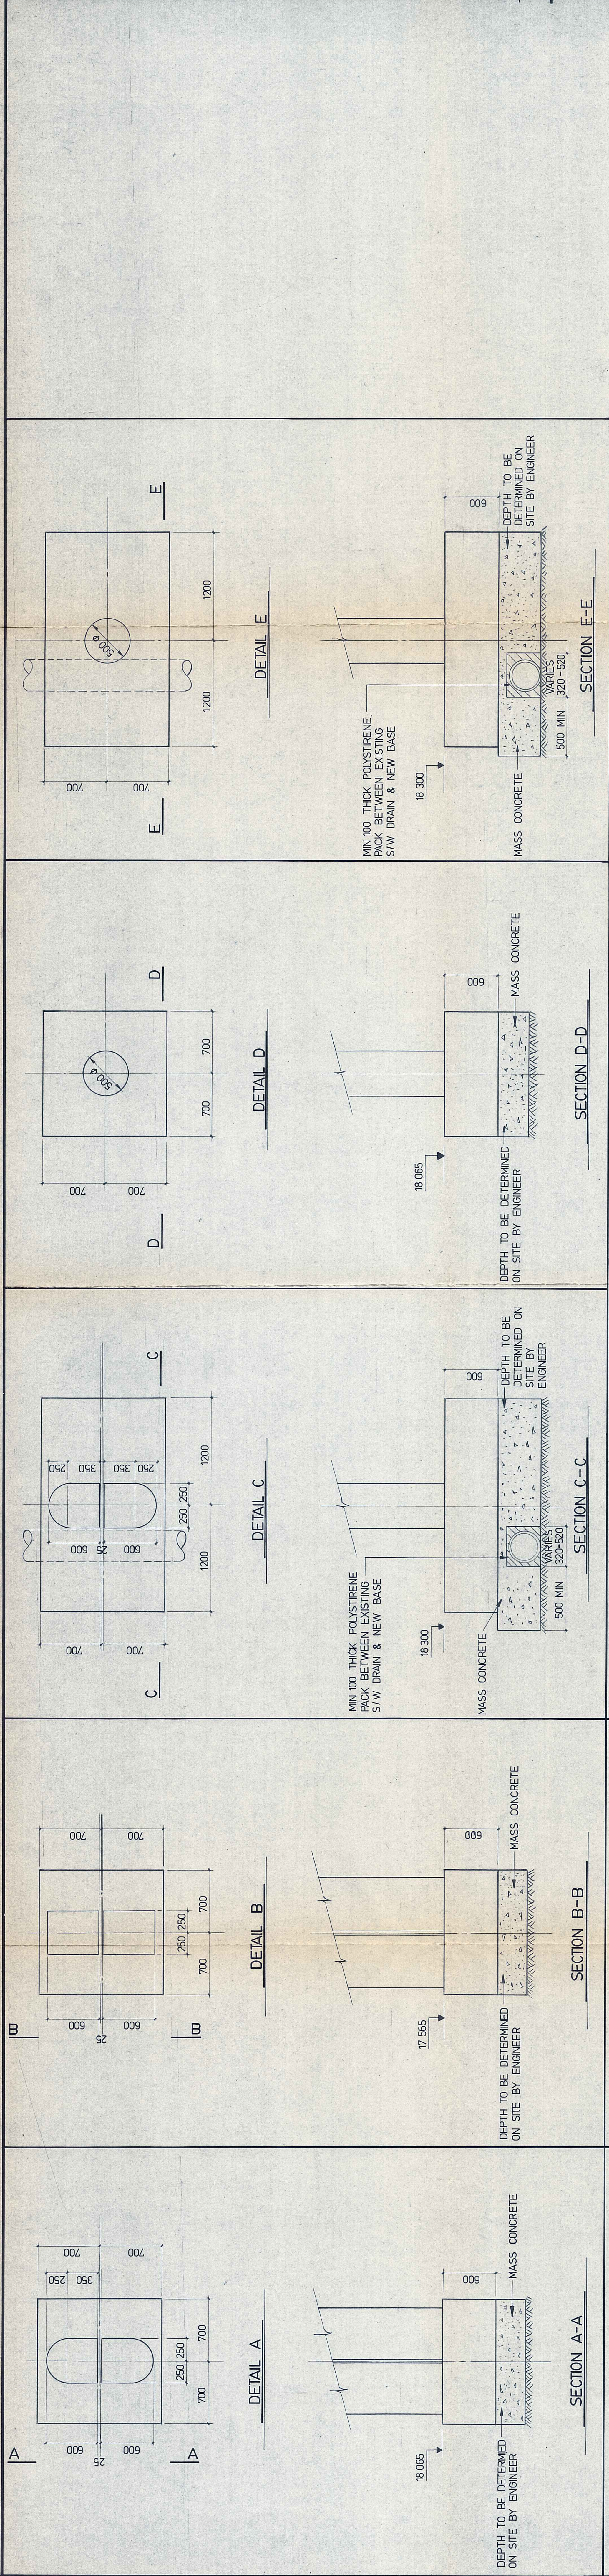

GENERAL NOTES

Construction is to be in accordance with the specification and this drawing.

MIN cover to bar, dia or as shown, cover to be maintained by approved spacers.

Concrete class	Strength in MPa at 28 days	MIN cement content Kg m ⁻³	Stone mm
20/20	20	20	20
25/20	25	25	25
30/20	30	30	30
35/20	35	35	35
40/20	40	40	40

Member	Concrete class	Internal mm cover (MIN)	Exposed mm cover (MIN)
Foundations	20/20	75	75
Columns	25/20	40	40
Beams	25/20	40	40
Walls	25/20	40	40

REVISION

1 763-82 DIMENSIONS W/REVISION

ISSUED BY

REVISIONS

10-50/12030

ARCHITECTS

NEILL POWELL NEILL INC.

PAULUS WISSER & DE VILLIERS

CONSULTING CIVIL AND STRUCTURAL ENGINEERS

FOUNDATION - SECTIONS

MECHANICAL AND ELECTRICAL ENGINEERS

G.H. MARAIS & PARTNERS

DATE 25-11-81

SCALE 1:25

NO 3030

1

EW 8 774

21-04-1987

21-04-1987