

A

B

C

D

E

F

132kV	SHEET	DESCRIPTION
	5A	ISOLATOR CAP OES LAYOUT (3000mm PHASE SPACING)
	5B	ISOLATOR CAP 2ES LAYOUT (3000mm PHASE SPACING)
	5C	ISOLATOR CAP LHES LAYOUT (3000mm PHASE SPACING)
	5D	ISOLATOR CAP RHES LAYOUT (3000mm PHASE SPACING)
	5E	INLINE ISOLATOR CAP LAYOUT (3600mm PHASE SPACING)
	5F	EARTH SWITCH CAP LAYOUT (3000mm PHASE SPACING)
	5G	CIRCUIT BREAKER LAYOUT

220kV	SHEET	DESCRIPTION
	6A	ISOLATOR LAYOUT (4300mm PHASE SPACING)
	6B	EARTH SWITCH LAYOUT (4300mm PHASE SPACING)

275kV	SHEET	DESCRIPTION
	7A	ISOLATOR LAYOUT (4300mm PHASE SPACING)
	7B	ISOLATOR LAYOUT (6700mm PHASE SPACING)
	7C	EARTH SWITCH LAYOUT (4300mm PHASE SPACING)
	7D	EARTH SWITCH LAYOUT (6700mm PHASE SPACING)
	7E	CIRCUIT BREAKER LAYOUT (4300mm & 6700mm PHASE SPACING)

400kV	SHEET	DESCRIPTION
	8A	ISOLATOR LAYOUT (5500mm PHASE SPACING)
	8B	ISOLATOR LAYOUT (6500mm PHASE SPACING)
	8C	ISOLATOR LAYOUT (7010mm PHASE SPACING)
	8D	EARTH SWITCH LAYOUT (5500mm PHASE SPACING)
	8E	EARTH SWITCH LAYOUT (6500mm PHASE SPACING)
	8F	EARTH SWITCH LAYOUT (7010mm PHASE SPACING)
	8G	CIRCUIT BREAKER LAYOUT (5500mm,6500mm & 7010mm PHASE SPACING)

33kV	SHEET	DESCRIPTION
	3A	CIRCUIT BREAKER LAYOUT

A


B


C

D


E

F


REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY					Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 19 - 11 - 21							
CHECKED BY		APPLICATION GUIDE CONTENTS SHEET					
DATE 19/11/2021							
DRAWN BY A.TIFLOEN							
DATE 31/03/2021		0.54/8829				SHEET NUMBER	REVISION
SCALE NTS						1	0

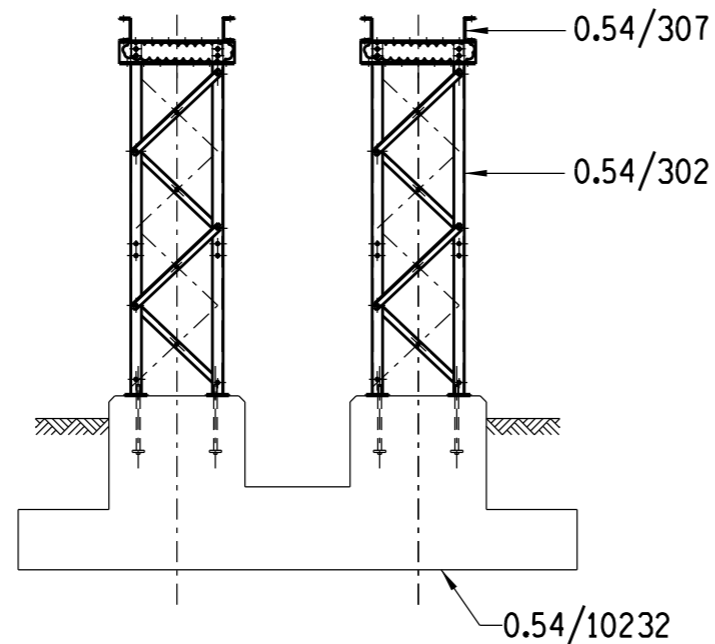

ELEVATION
NTS

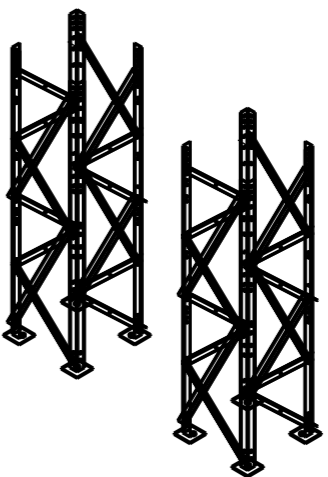

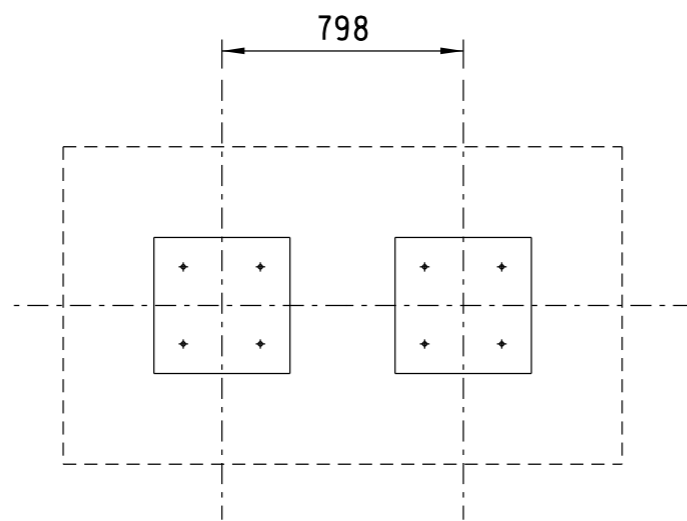


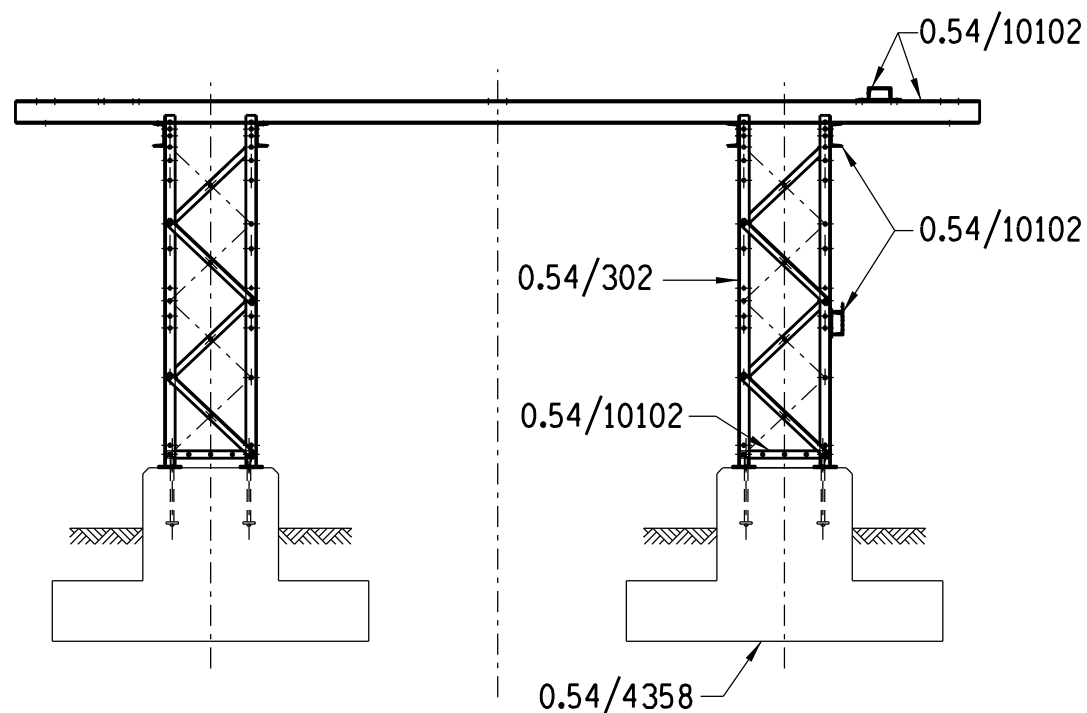
ISOMETRIC VIEW
NTS




FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/307	ADJUSTABLE TOP CAP	2
0.54/10232	33kV CIRCUIT BREAKER FOUNDATION	1


REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS
APPROVED BY 			 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30	
DATE13 - 10 - 2021							
CHECKED BY 			33kV CIRCUIT BREAKER LAYOUT				
DATE 12/10/2021							
DRAWN BY A.TIFLOEN							
DATE 29/07/2021							
SCALE NTS			0.54/8829			SHEET NUMBER	REVISION
						3A	0



ELEVATION
NTS

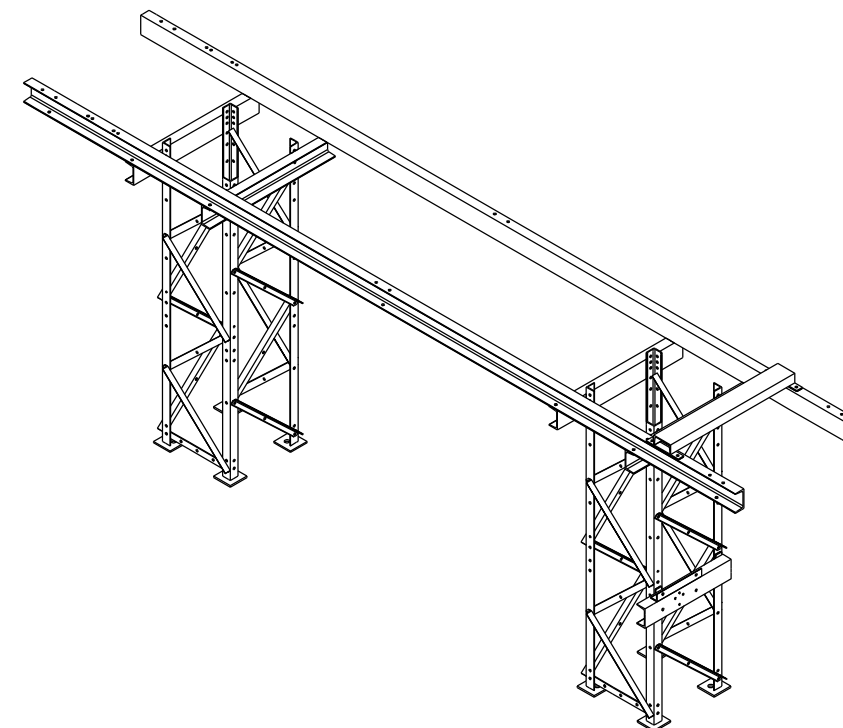

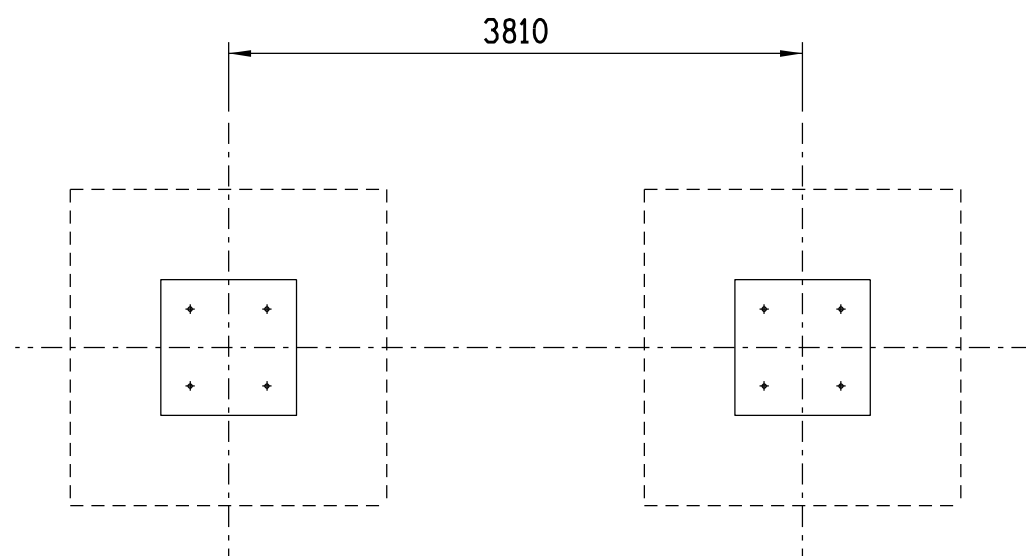


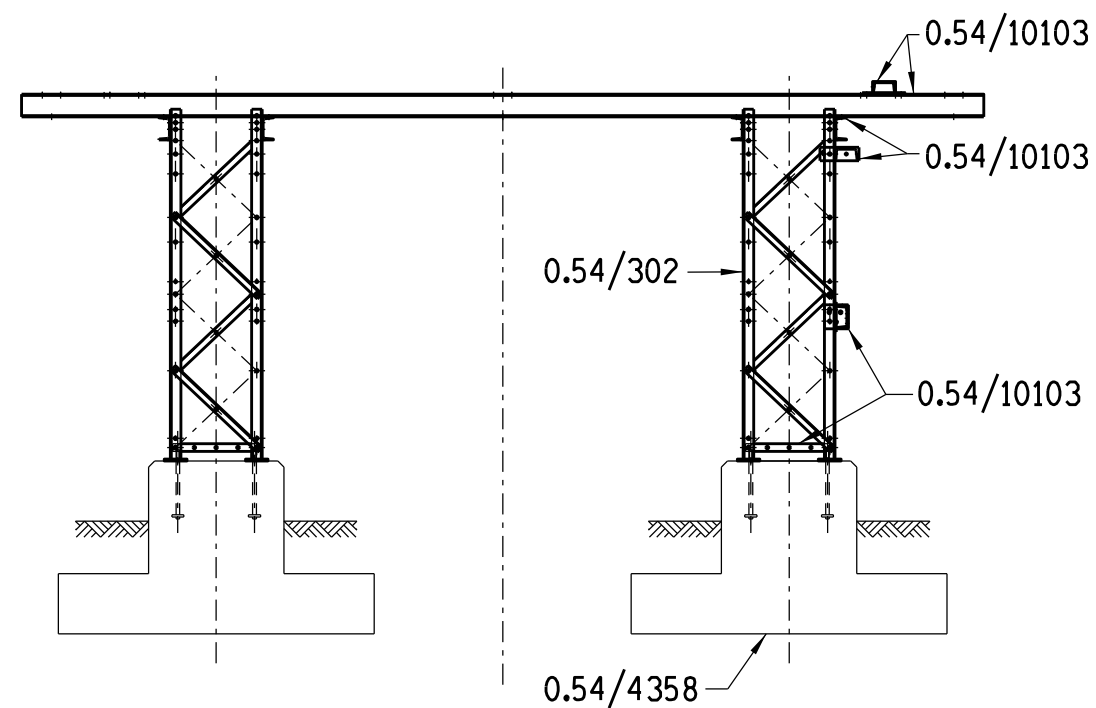
ISOMETRIC VIEW
NTS




FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/10102	132kV ISOLATOR CAP OES	1
0.54/4358	MED. EQP. SUPP. FND.	2


REV	REVISION DESCRIPTION			DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY		<div> Eskom</div>				Eskom Holdings SOC Ltd Reg No 2002/015527/30			
									
DATE 25 - 03 - 2021		<div>132kV ISOLATOR CAP OES LAYOUT</div> <div>3m PHASE SPACING MANUAL AND MOTORIZED</div>							
CHECKED BY									
									
DATE 25/03/2021									
DRAWN BY									
A.TIFLOEN		©							
DATE 8/03/2021									
SCALE NTS		0.54/8829				SHEET NUMBER		REVISION	
						5A		0	



ELEVATION
NTS

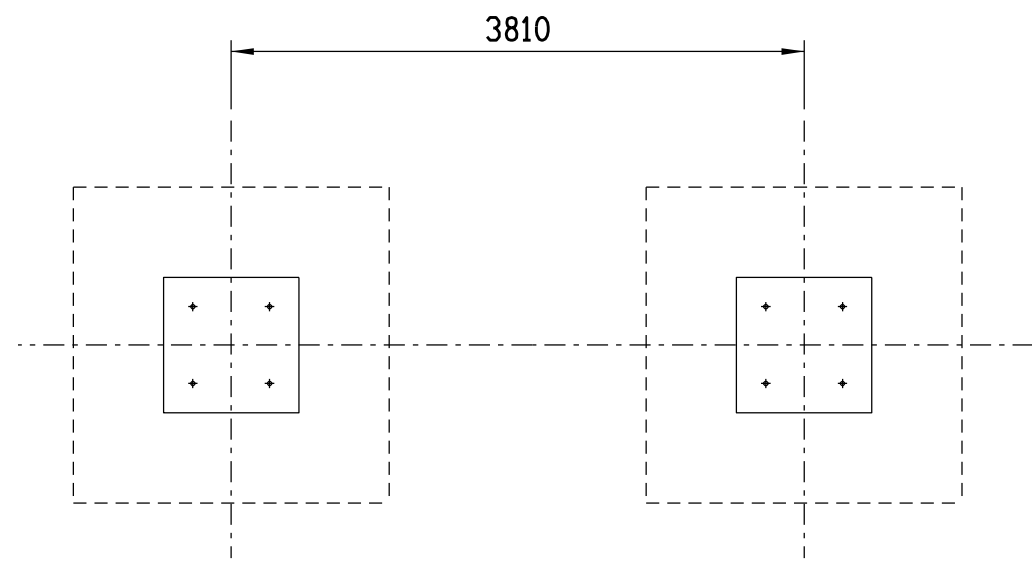

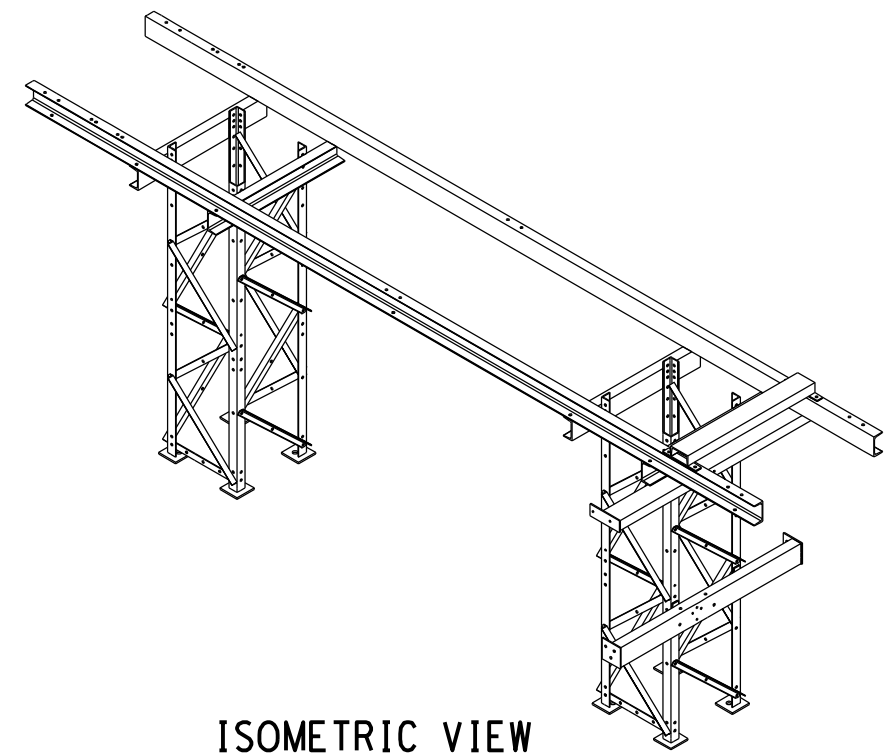


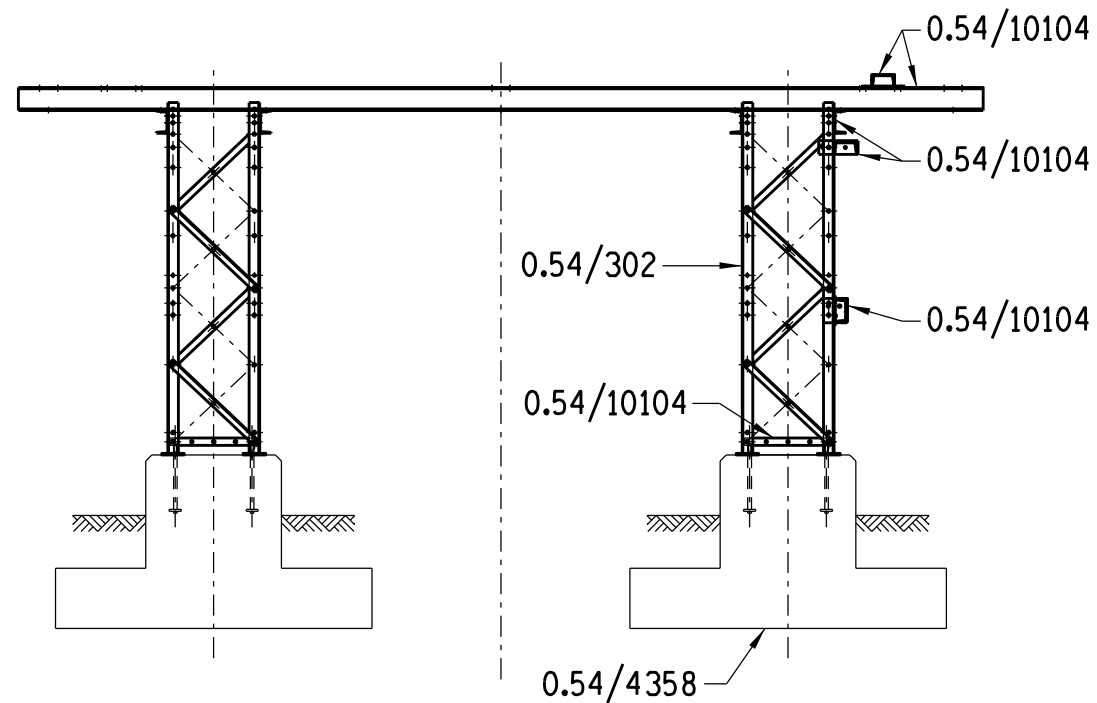
FOUNDATION PLAN VIEW
NTS




ISOMETRIC VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/10103	132kV ISOLATOR CAP 2ES	1
0.54/4358	MED. EQP. SUPP. FND.	2


REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS	
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30			
DATE 25 - 03 - 2021								
CHECKED BY 		132kV ISOLATOR CAP 2ES LAYOUT 3m PHASE SPACING MANUAL						
DATE 25/03/2021								
DRAWN BY A.TIFLOEN								
DATE 8/03/2021		©				SHEET NUMBER		REVISION
SCALE NTS						0.54/8829		5B



ELEVATION
NTS

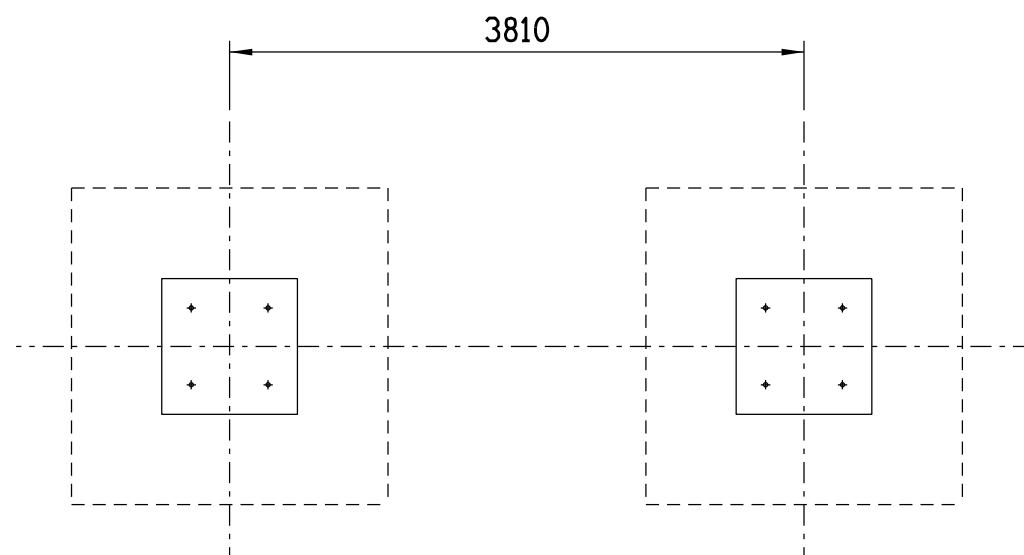

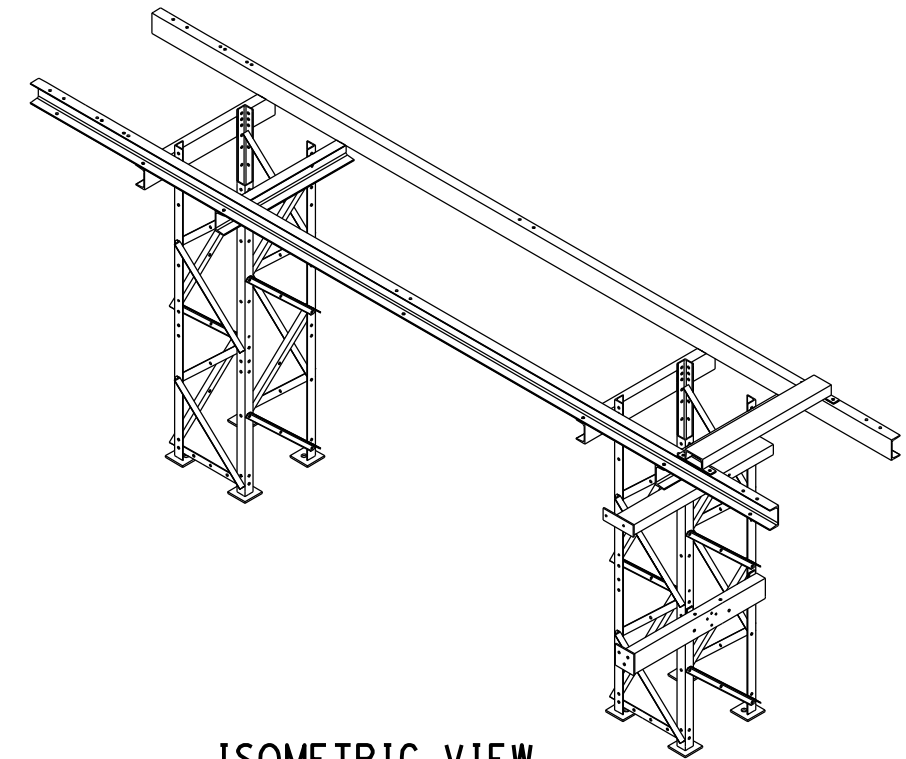


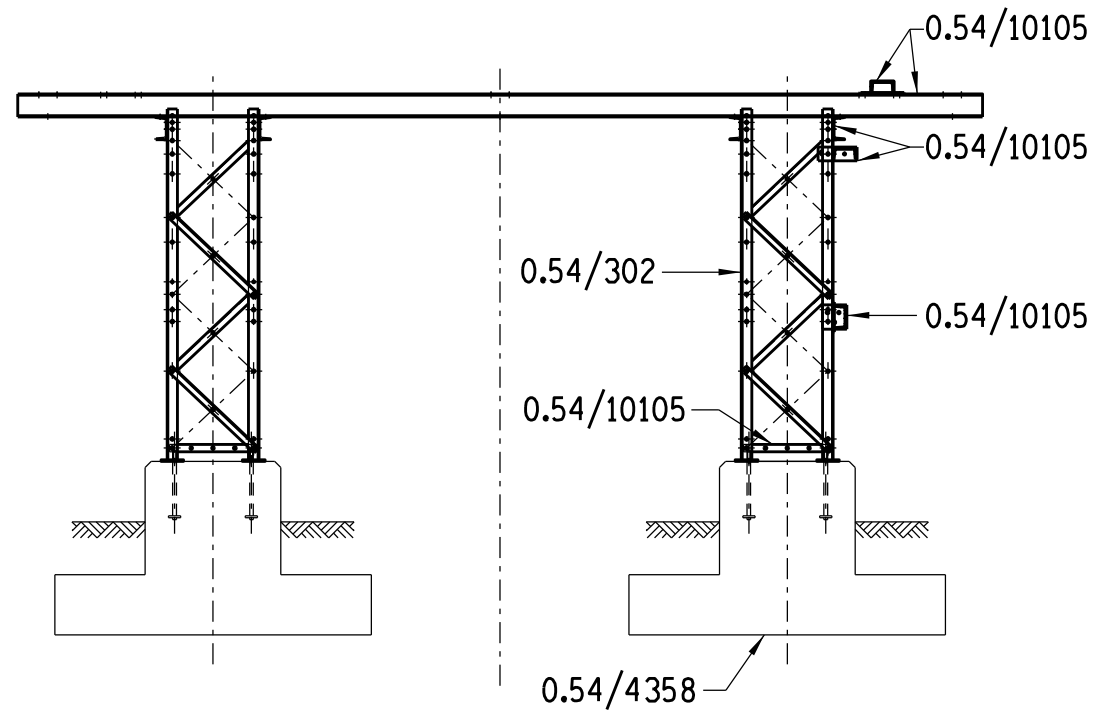
FOUNDATION PLAN VIEW
NTS




ISOMETRIC VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/10104	132kV ISOLATOR CAP LHES	1
0.54/4358	MED. EQP. SUPP. FND.	2


REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 25 - 03 - 2021							
CHECKED BY 		132kV ISOLATOR CAP LHES LAYOUT © 3m PHASE SPACING MANUAL					
DATE 25/03/2021							
DRAWN BY							
A.TIFLOEN							
DATE 8/03/2021		0.54/8829				SHEET NUMBER	REVISION
SCALE NTS						5C	0



ELEVATION
NTS

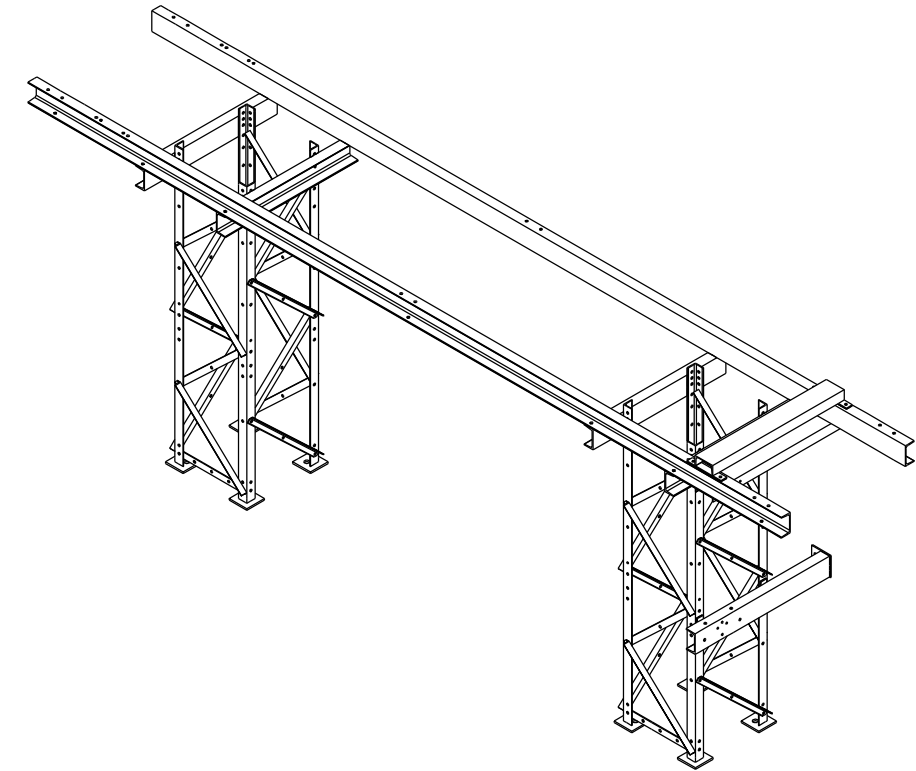

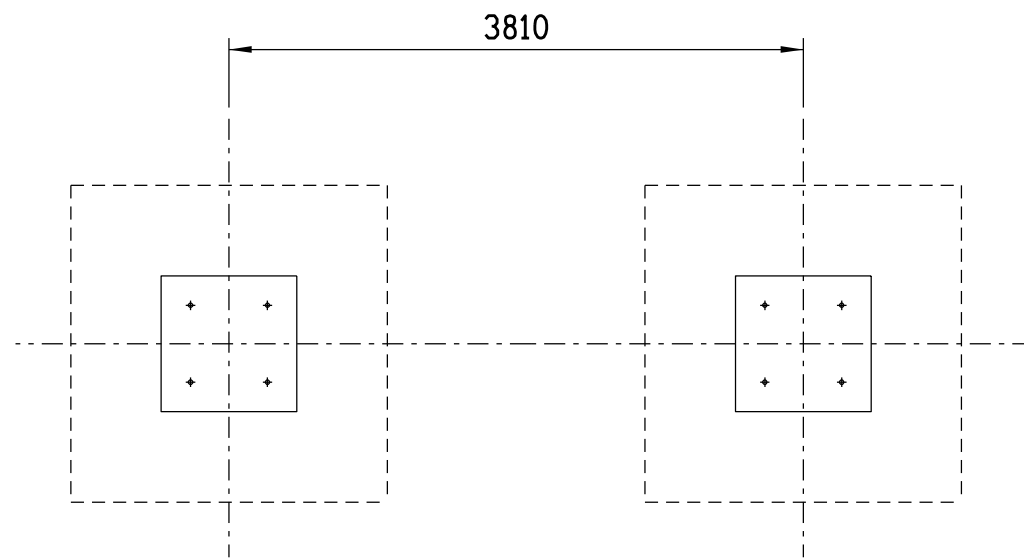


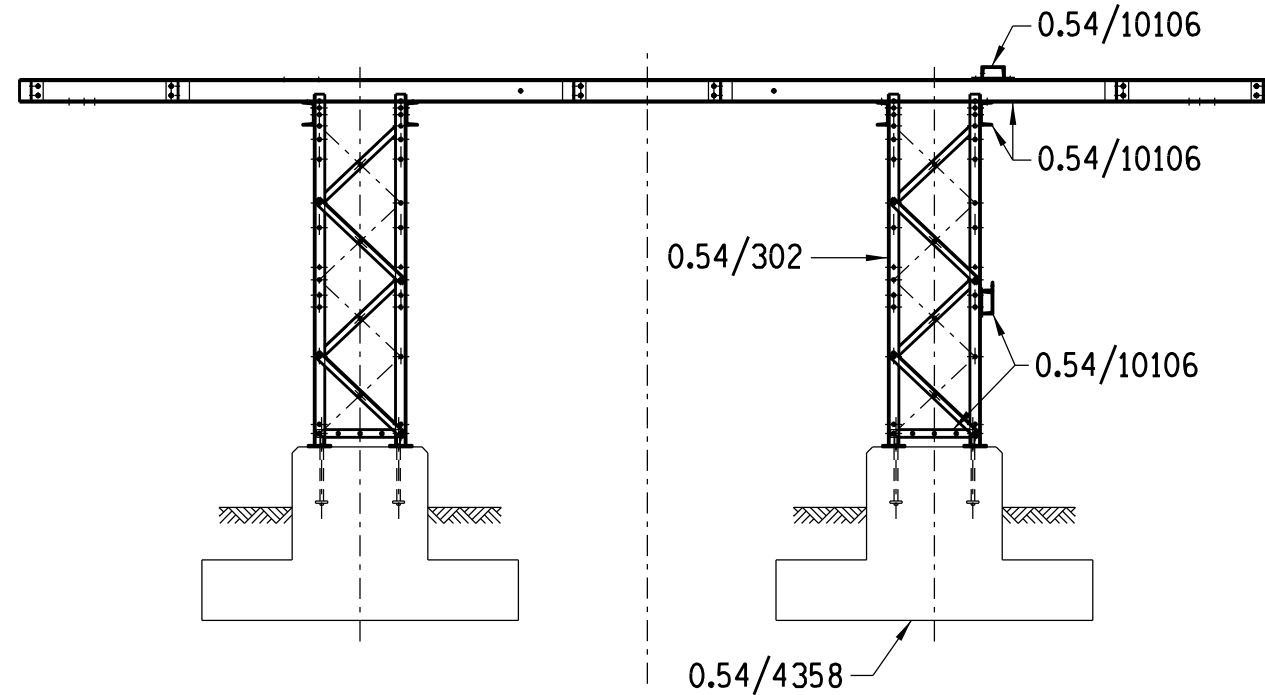
ISOMETRIC VIEW
NTS




FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/10105	132kV ISOLATOR CAP RHES	1
0.54/4358	MED. EQP. SUPP. FND.	2


REV	REVISION DESCRIPTION			DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY		 Eskom				Eskom Holdings SOC Ltd Reg No 2002/015527/30			
									
DATE 25 - 03 - 2021		132kV ISOLATOR CAP RHES LAYOUT 3m PHASE SPACING MANUAL							
CHECKED BY									
									
DATE 25/03/2021									
DRAWN BY									
A.TIFLOEN		©							
DATE 8/03/2021									
SCALE NTS		0.54/8829				SHEET NUMBER		REVISION	
						5D		0	



ELEVATION
NTS

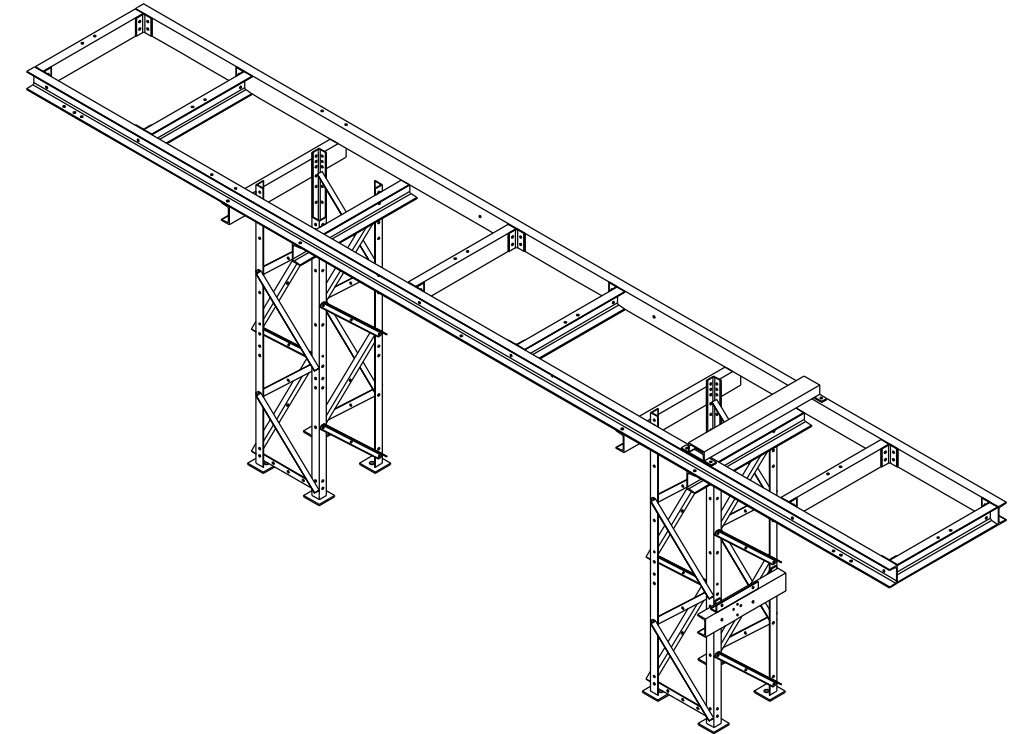


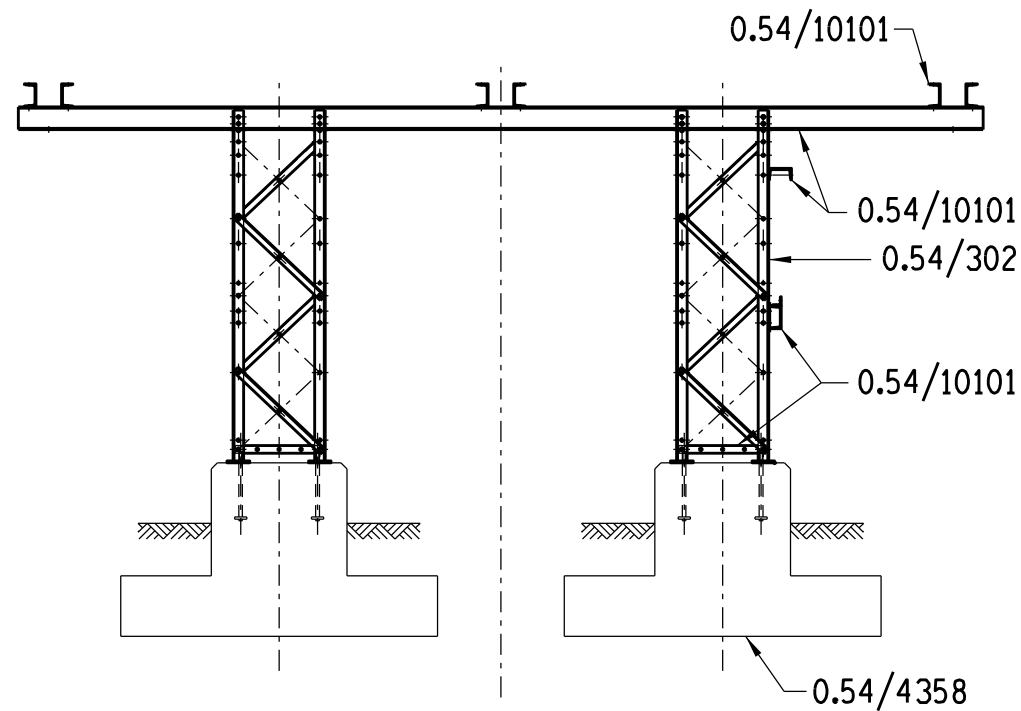
ISOMETRIC VIEW
NTS

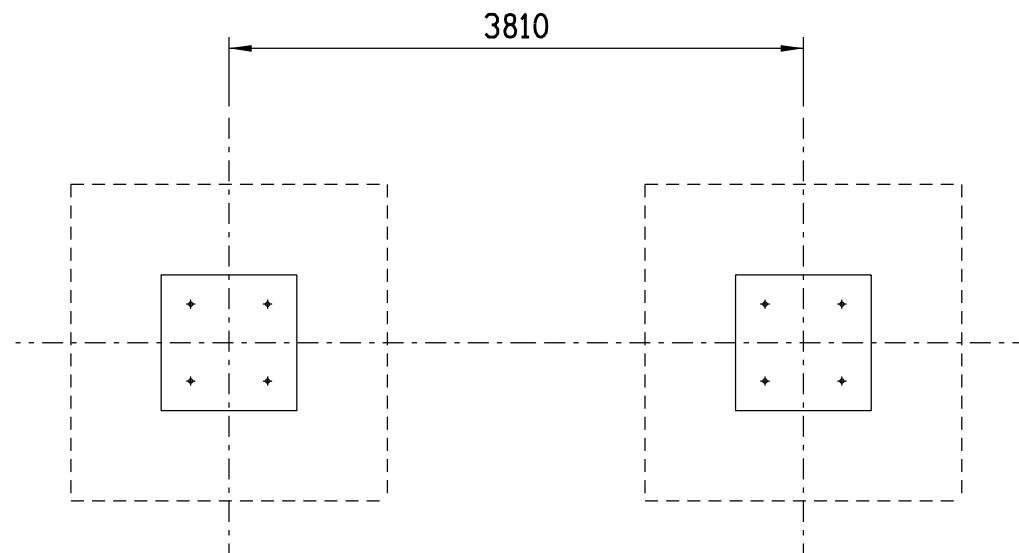


FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/10106	132kV INLINE ISOLATOR CAP	1
0.54/4358	MED. EQP. SUPP. FND.	2


REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	REFERENCE DRAWINGS
APPROVED BY	 Eskom Eskom Holdings SOC Ltd Reg No 2002/015527/30					
DATE 25 - 03 - 2021	132kV INL INE ISOLATOR CAP LAYOUT 3.6m PHASE SPACING					
CHECKED BY						
DATE 25/03/2021						
DRAWN BY						
A.TIFLOEN	© 0.54/8829					SHEET NUMBER
DATE 8/03/2021						5E
SCALE NTS						0



ELEVATION
NTS

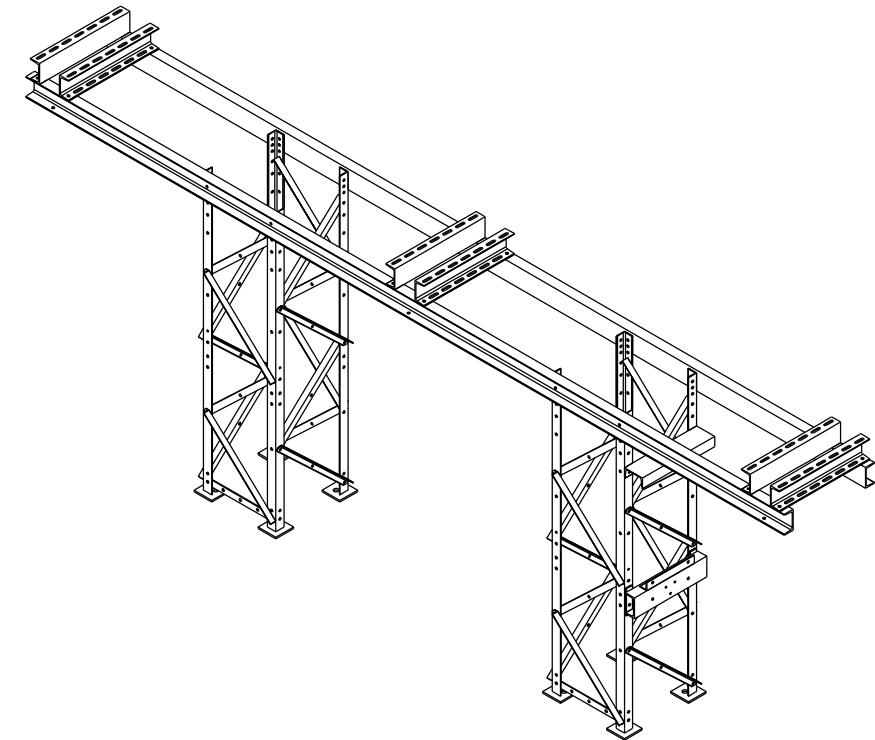

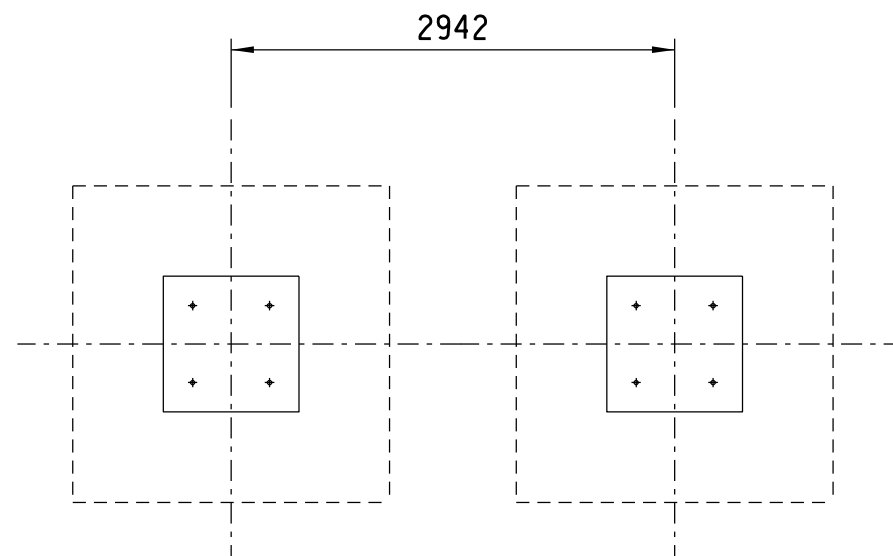





ISOMETRIC VIEW
NTS






FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	2
0.54/10101	132kV EARTH SWITCH CAP	1
0.54/4358	MED. EQP. SUPP. FND.	2

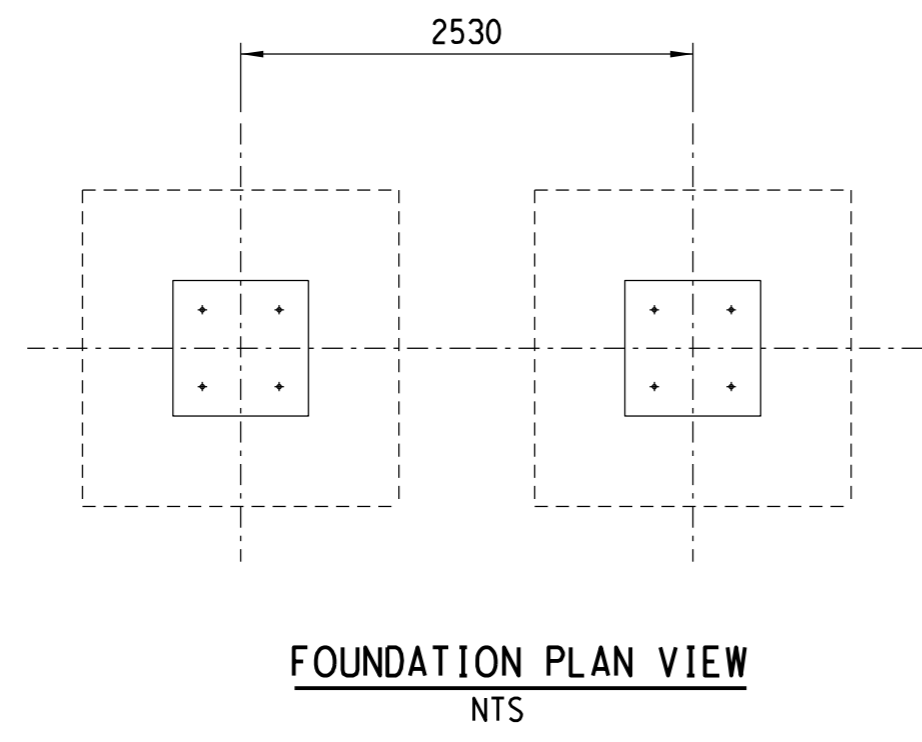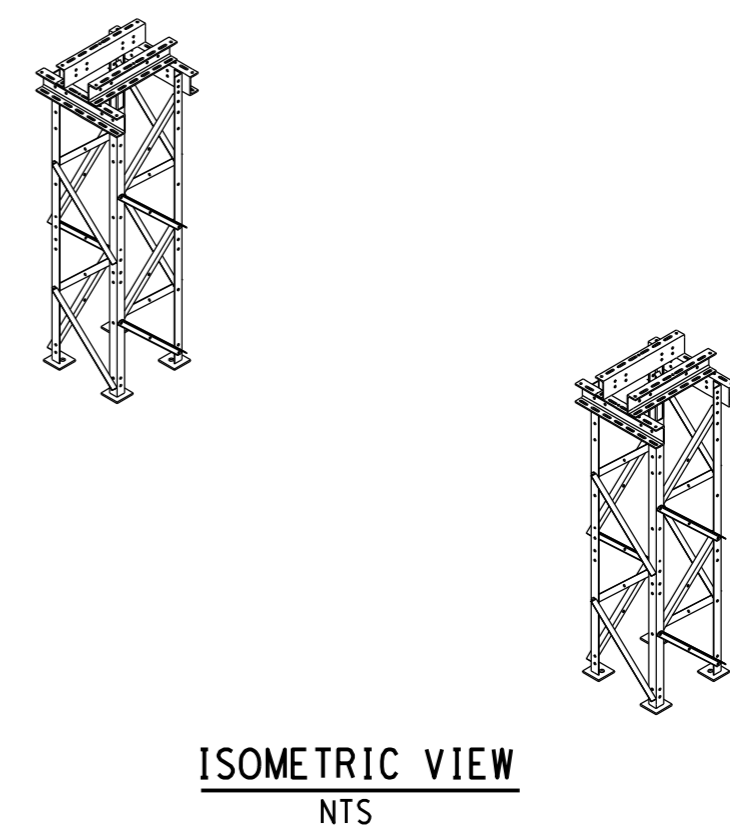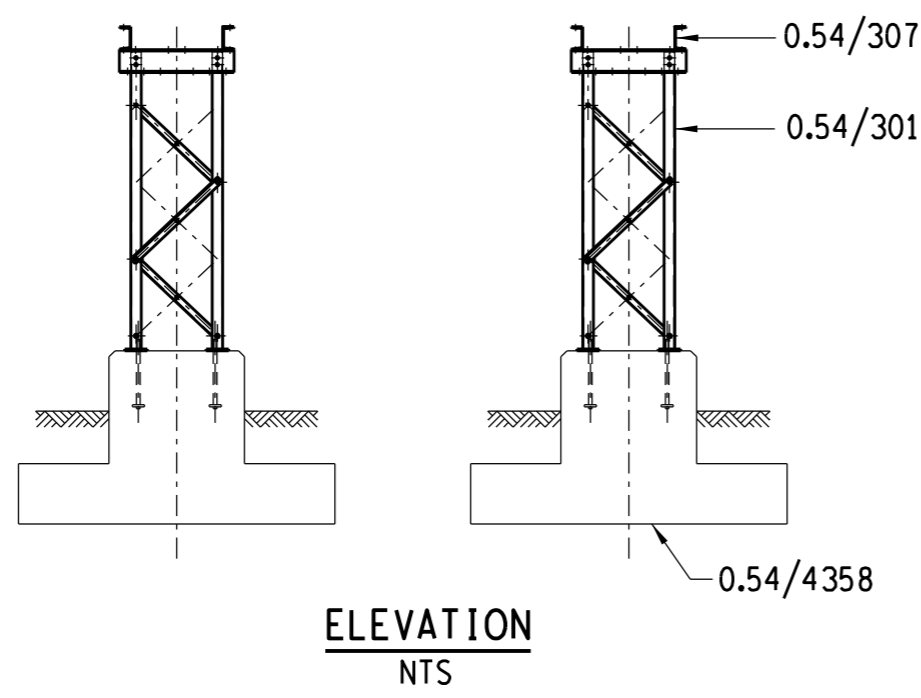REV	REVISION DESCRIPTION			DRAWN	CHKD	AUTH	DATE	/	REFERENCE DRAWINGS
APPROVED BY		 Eskom				Eskom Holdings SOC Ltd Reg No 2002/015527/30			
									
DATE 25 - 03 - 2021		<div>132kV EARTH SWITCH CAP LAYOUT</div> <div>3m PHASE SPACING MANUAL AND MOTORIZED</div> <div>©</div>							
CHECKED BY									
									
DATE 25/03/2021									
DRAWN BY									
A.TIFLOEN		<div>0.54/8829</div>							
DATE 8/03/2021									
SCALE NTS									
						SHEET NUMBER		REVISION	
						5F		0	






DRAWING No.	DESCRIPTION	QTY
0.54/301	MED. EQP. SUPP. 2150mm HIGH	2
0.54/307	ADJUSTABLE TOP CAP	2
0.54/4358	MED. EQP. SUPP. FND.	2

REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS			
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30					
DATE 19 - 11 - 21										
CHECKED BY 		132kV CIRCUIT BREAKER LAYOUT								
DATE 17/11/2021										
DRAWN BY A.TIFLOEN										
DATE 17/05/2021		© 0.54/8829				SHEET NUMBER	REVISION			
SCALE NTS						5G	0			




1 2 3 4 5 6 7 8


A
B
C
D
E
F

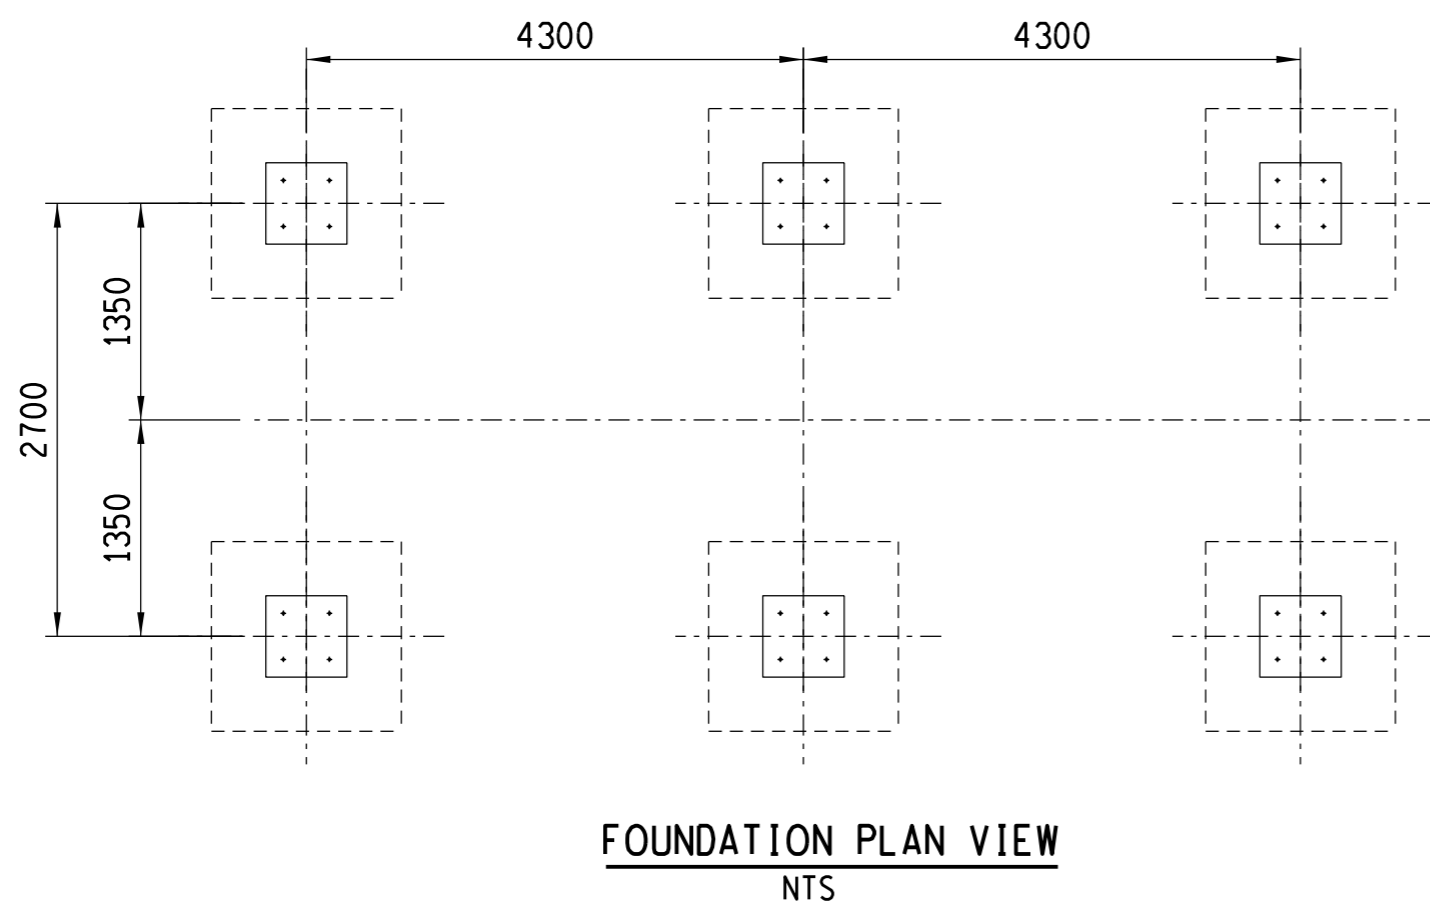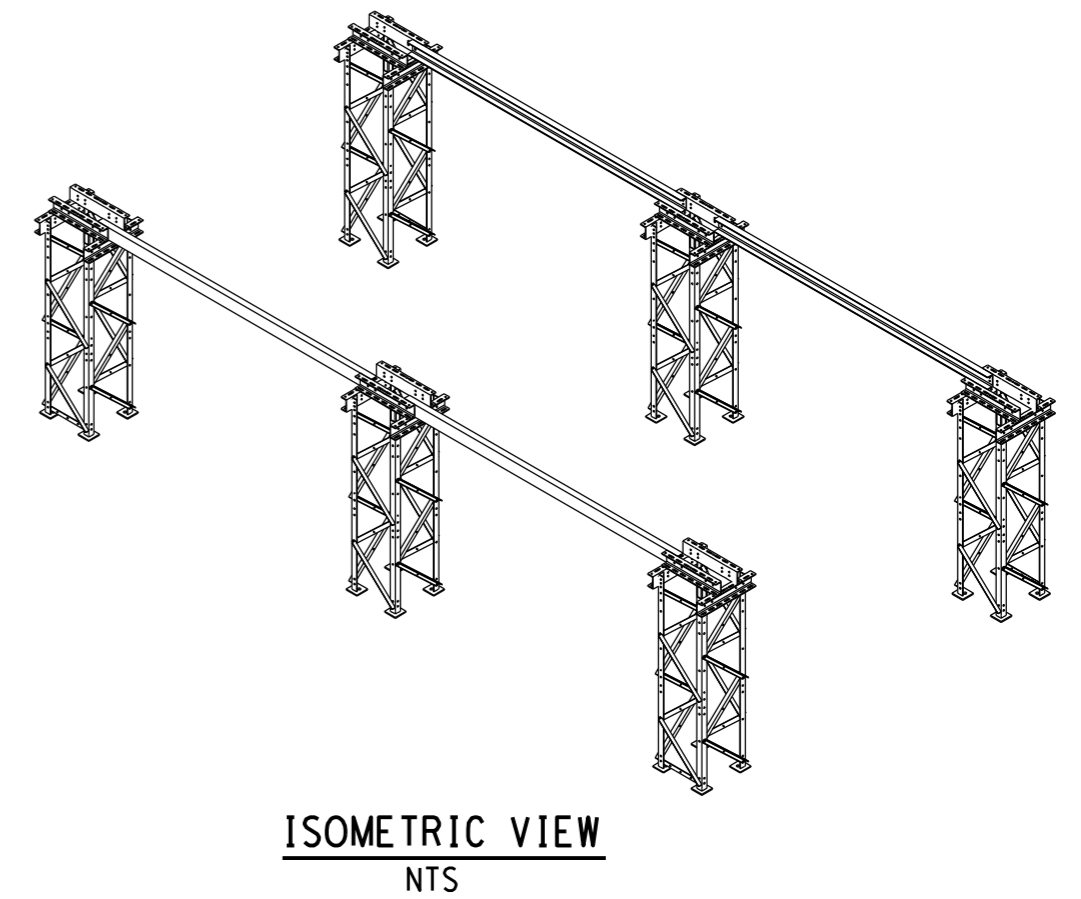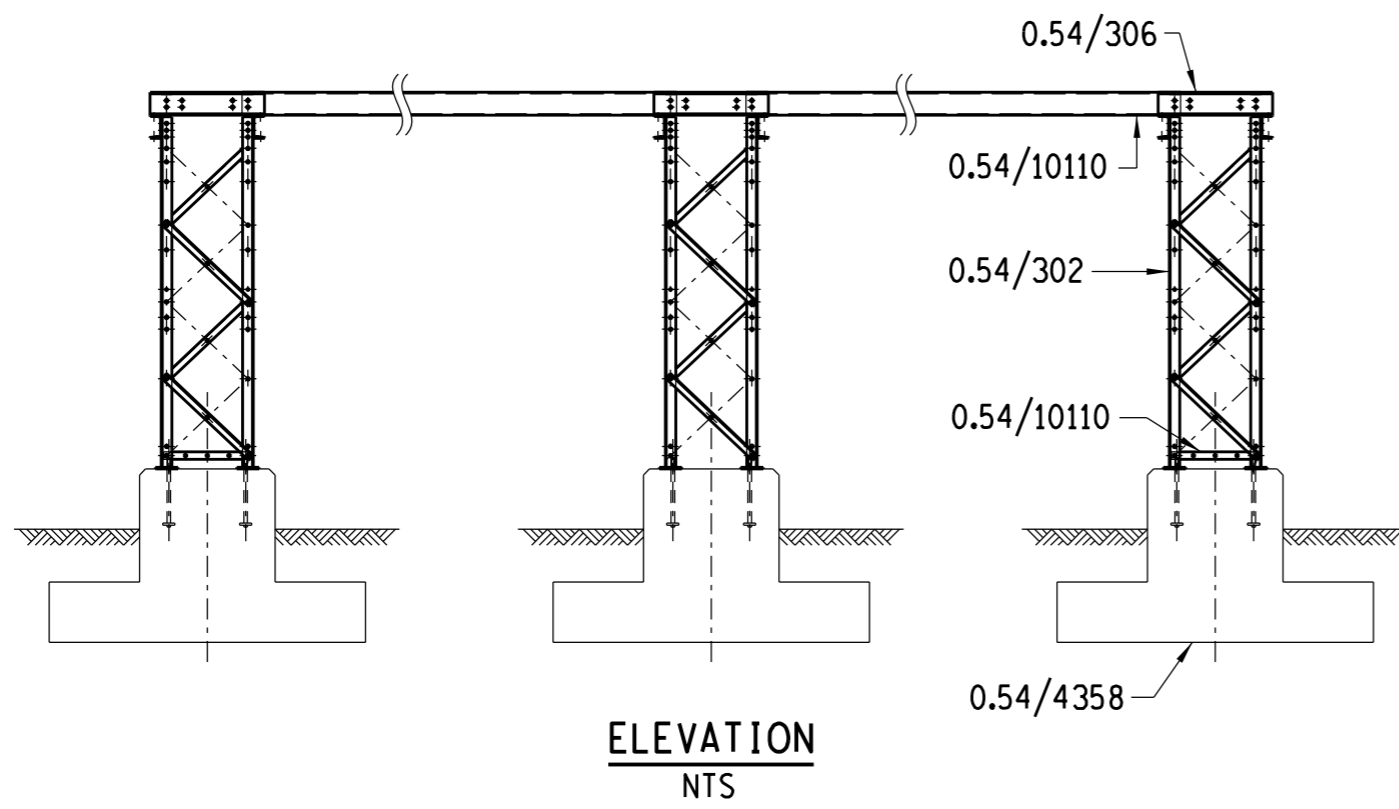A
B
C
D
E
F




DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	6
0.54/306	MED. EQP. SUPP. CAP 'M1'	6
0.54/4358	MED. EQP. SUPP. FND.	6
0.54/10110	CROSSBEAM 4300mm PHASE SPACING	4

REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS
APPROVED BY			<div> Eskom</div>			Eskom Holdings SOC Ltd Reg No 2002/015527/30	
A.MANELI 							
DATE 26/03/2021							
CHECKED BY			220kV ISOLATOR LAYOUT 4300 PHASE SPACING				
B.HAJEE 							
DATE 26/03/2021							
DRAWN BY							
A.TIFLOEN			©				
DATE 23/09/2020							
SCALE NTS							
0.54/8829						SHEET NUMBER	REVISION
						6A	0

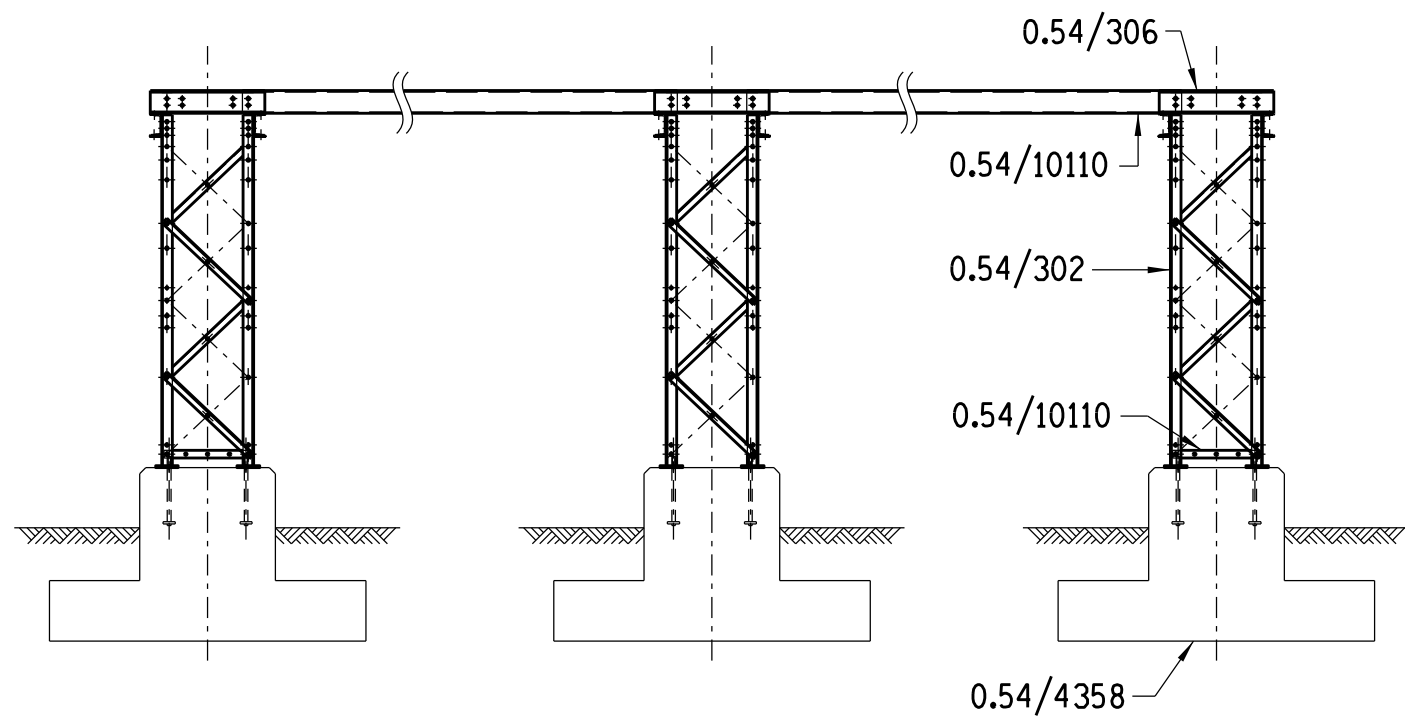


ELEVATION
NTS

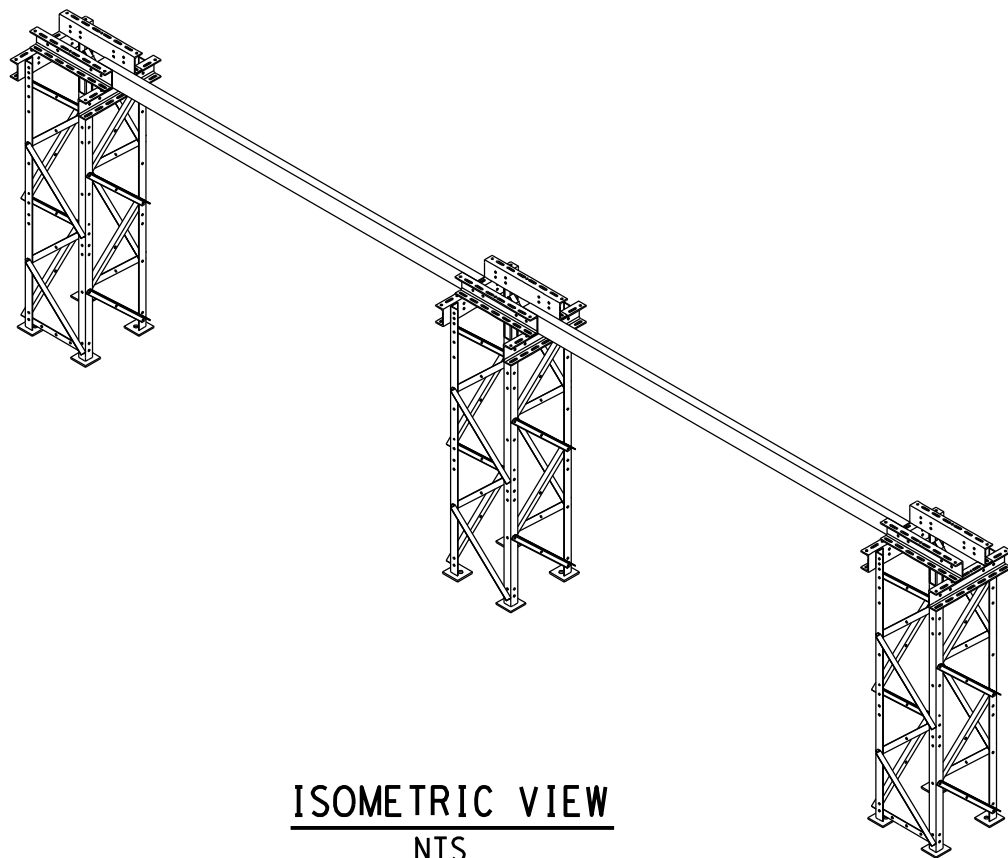




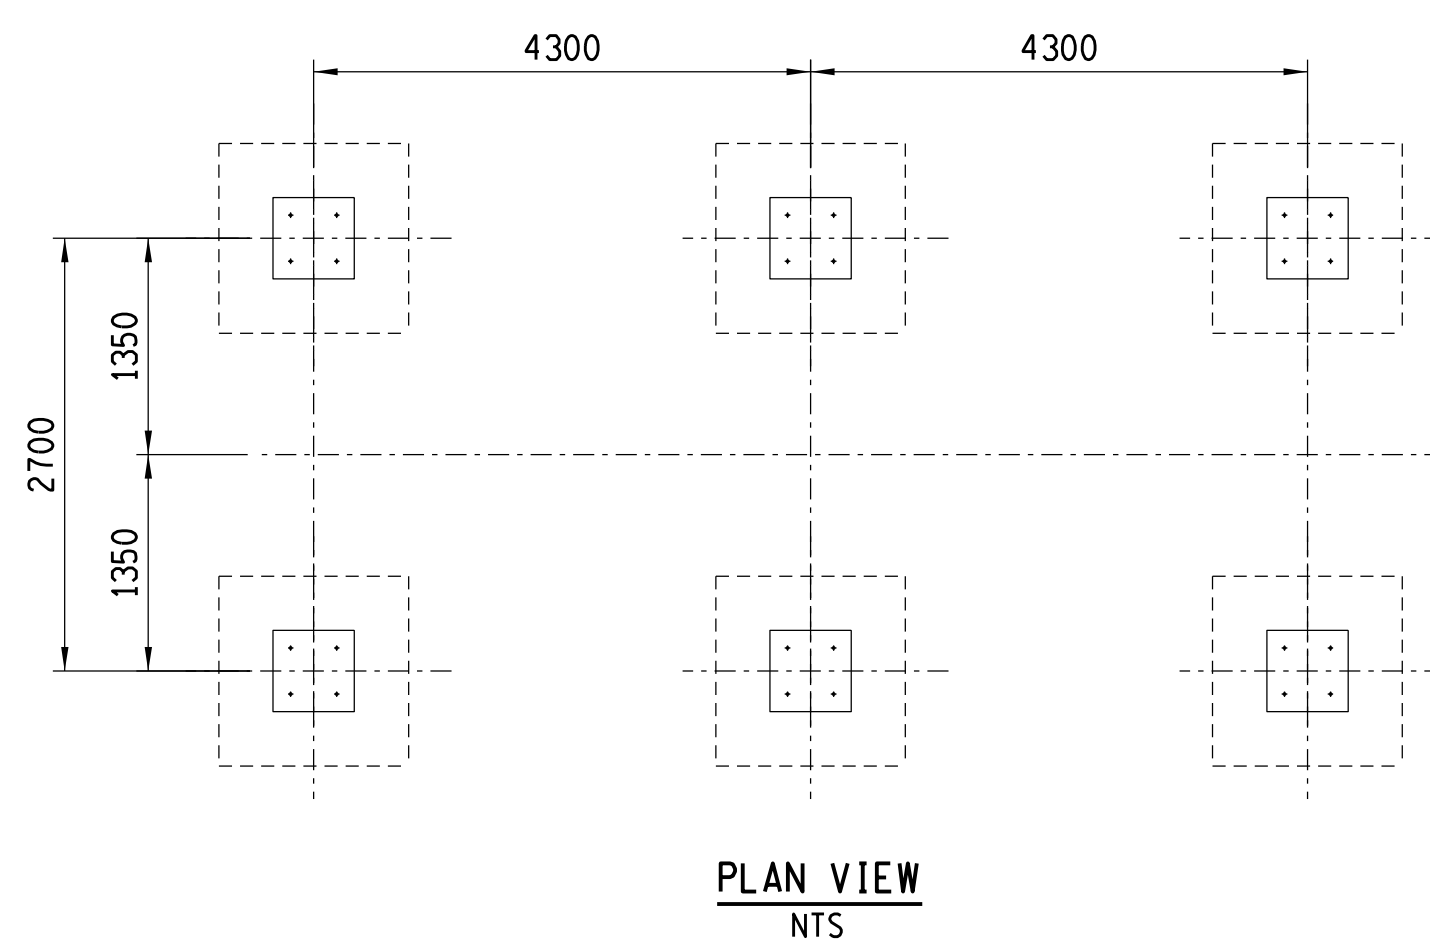
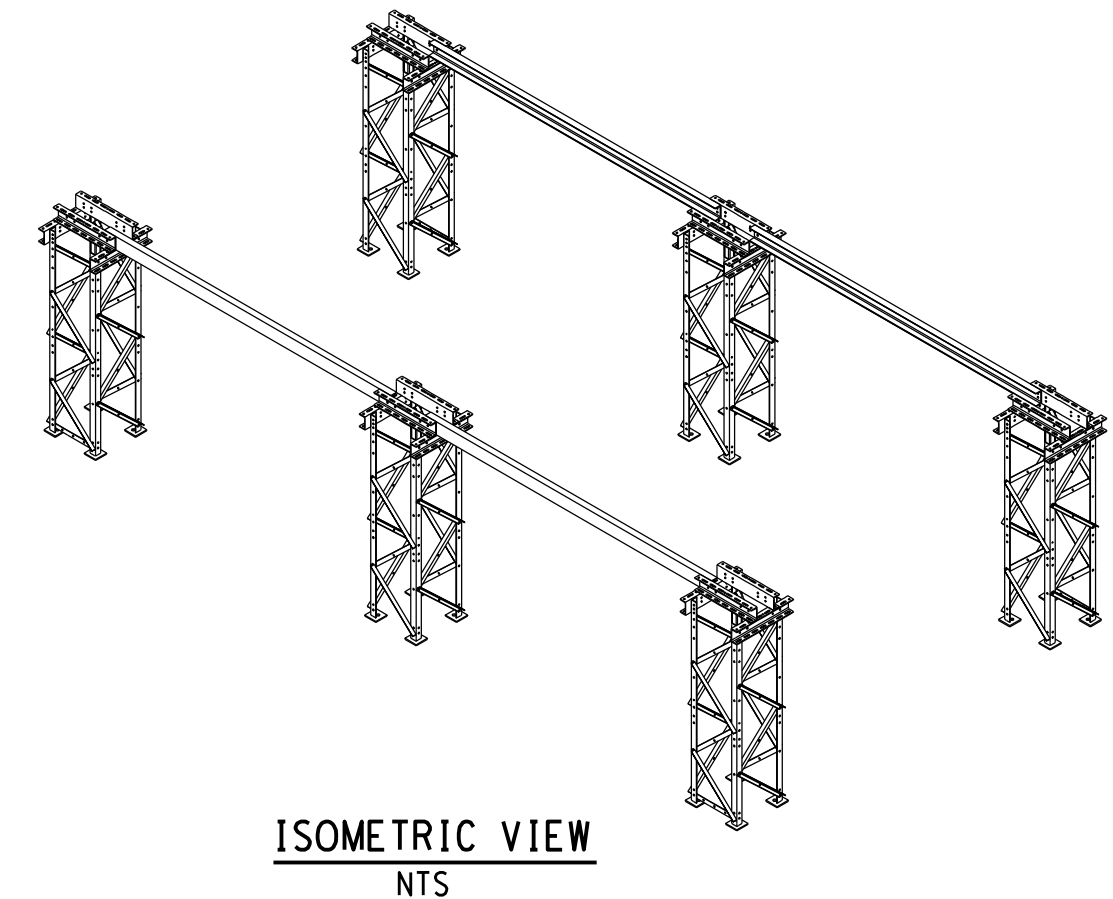
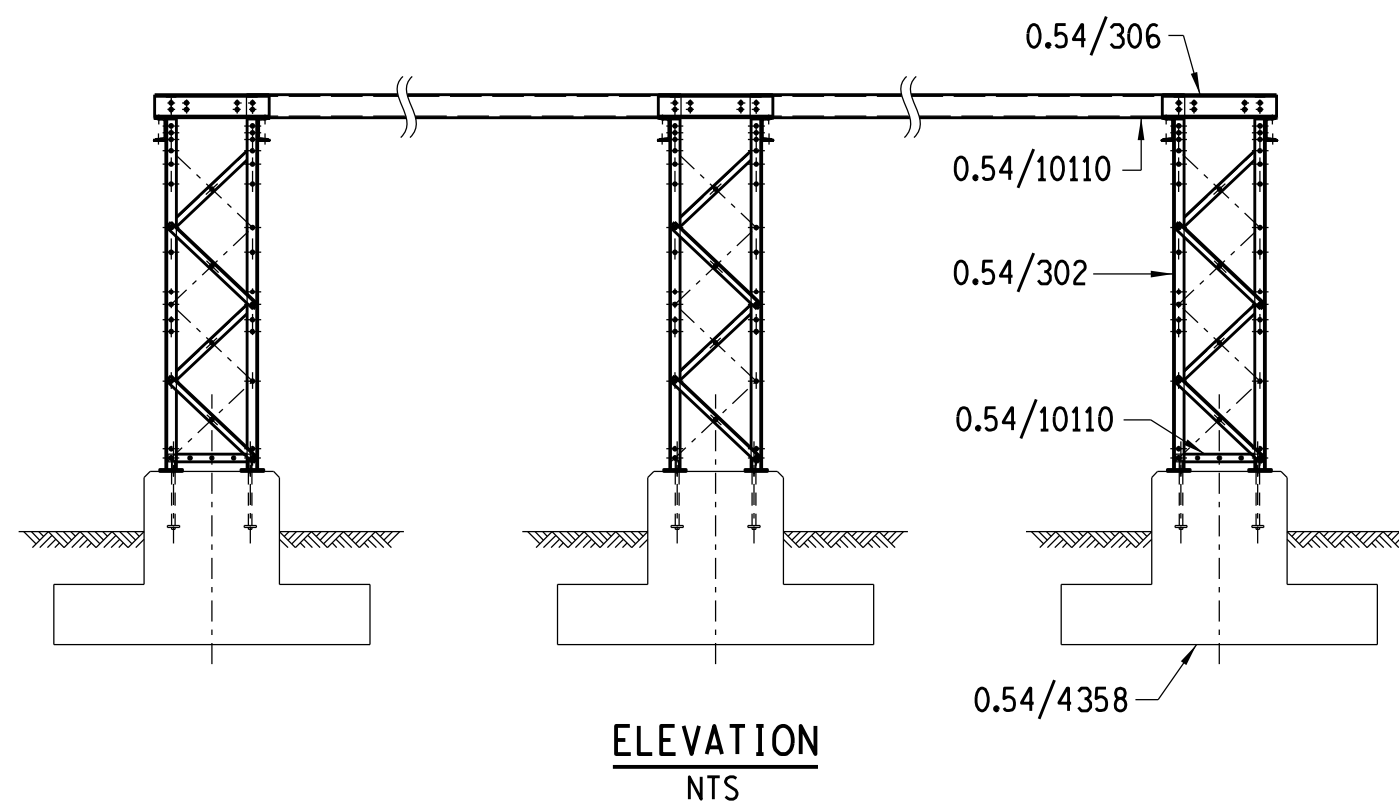
ISOMETRIC VIEW
NTS

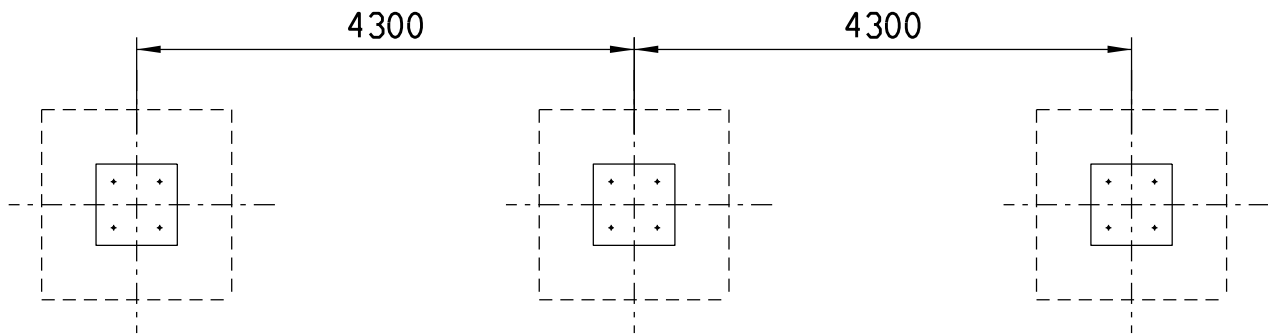DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3
0.54/10110	CROSSBEAM 4300mm PHASE SPACING	2






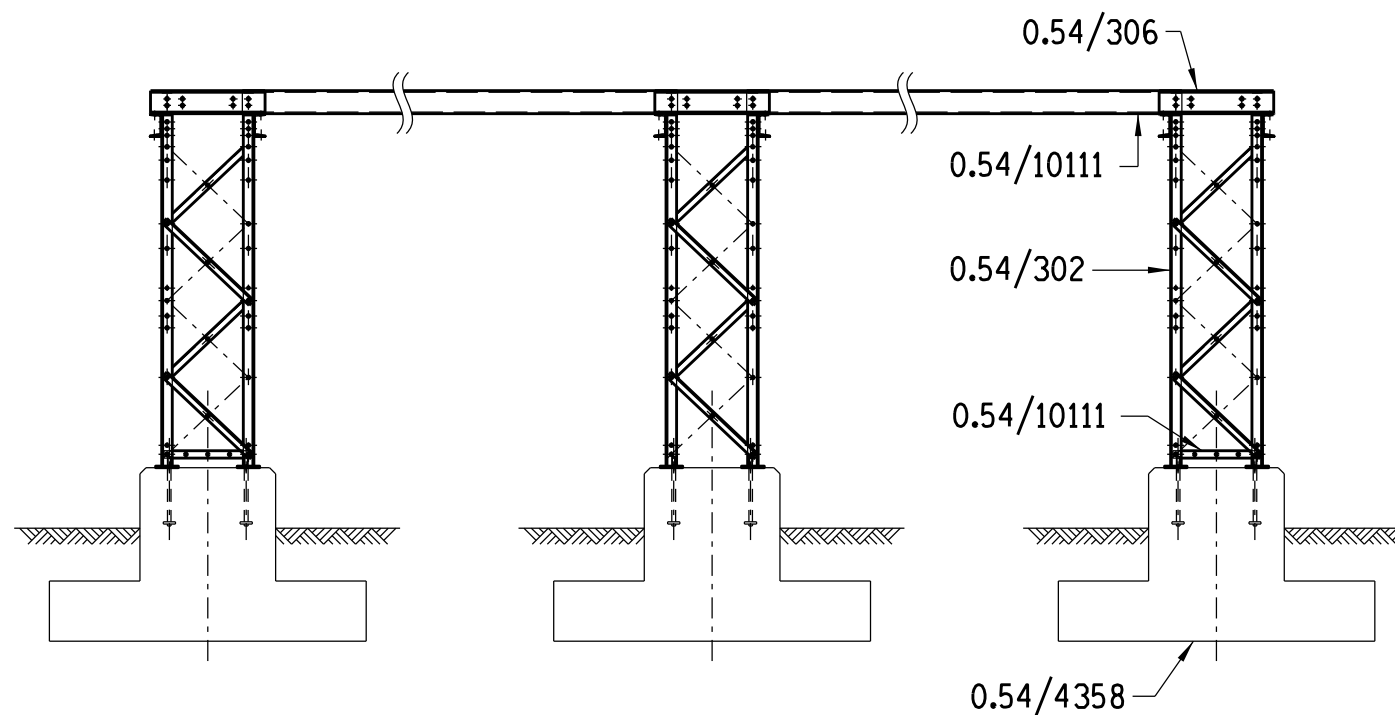
PLAN VIEW
NTS

REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS
APPROVED BY 			 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30	
DATE 26 - 03 - 2021							
CHECKED BY 			220kV EARTH SWITCH LAYOUT 4300 PHASE SPACING				
DATE 26/03/2021							
DRAWN BY A.TIFLOEN							
DATE 05/10/2020			© 0.54/8829			SHEET NUMBER	REVISION
SCALE NTS						6B	0




DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	6
0.54/306	MED. EQP. SUPP. CAP "M1"	6
0.54/4358	MED. EQP. SUPP. FND.	6
0.54/10110	CROSSBEAM 4300mm PHASE SPACING	4


REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY 				Eskom Holdings SOC Ltd Reg No 2002/015527/30			
DATE 26 - 03 - 2021		275kV ISOLATOR LAYOUT 4300 PHASE SPACING					
CHECKED BY 							
DATE 26/03/2021							
DRAWN BY A.TIFLOEN							
DATE 23/09/2020		©				0.54/8829	
SCALE NTS						SHEET NUMBER	REVISION
						7A	0



ELEVATION
NTS

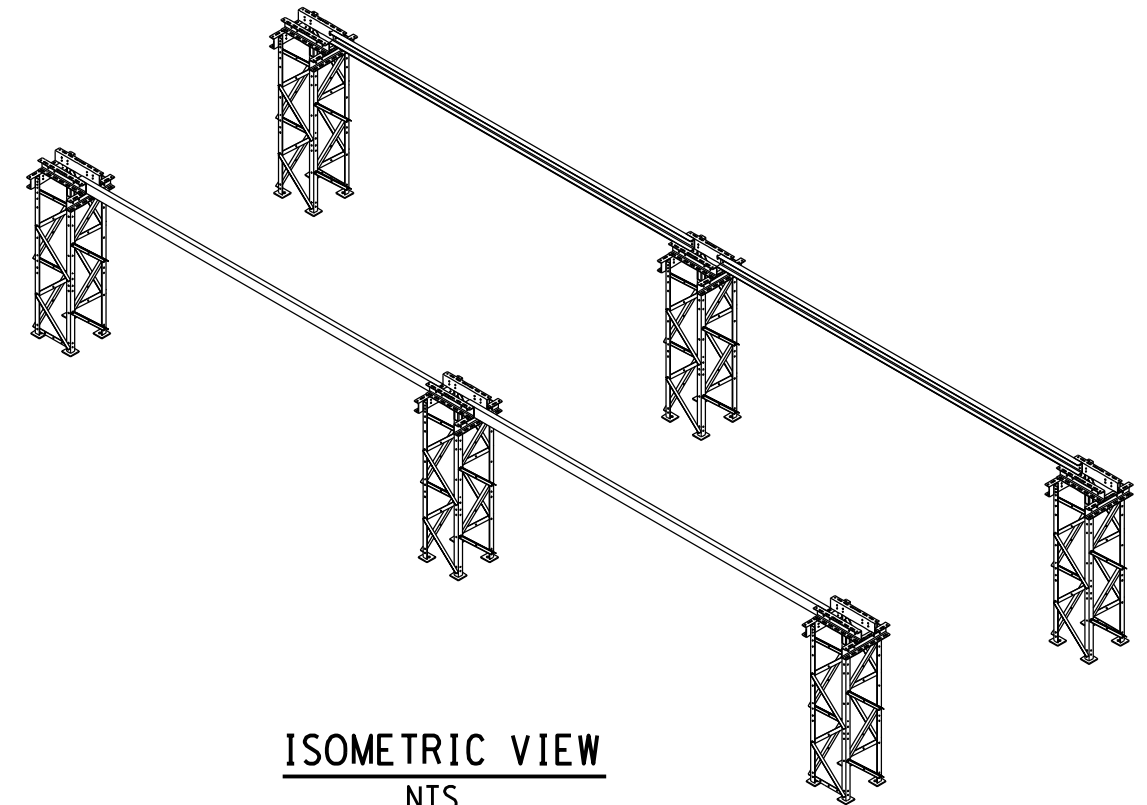

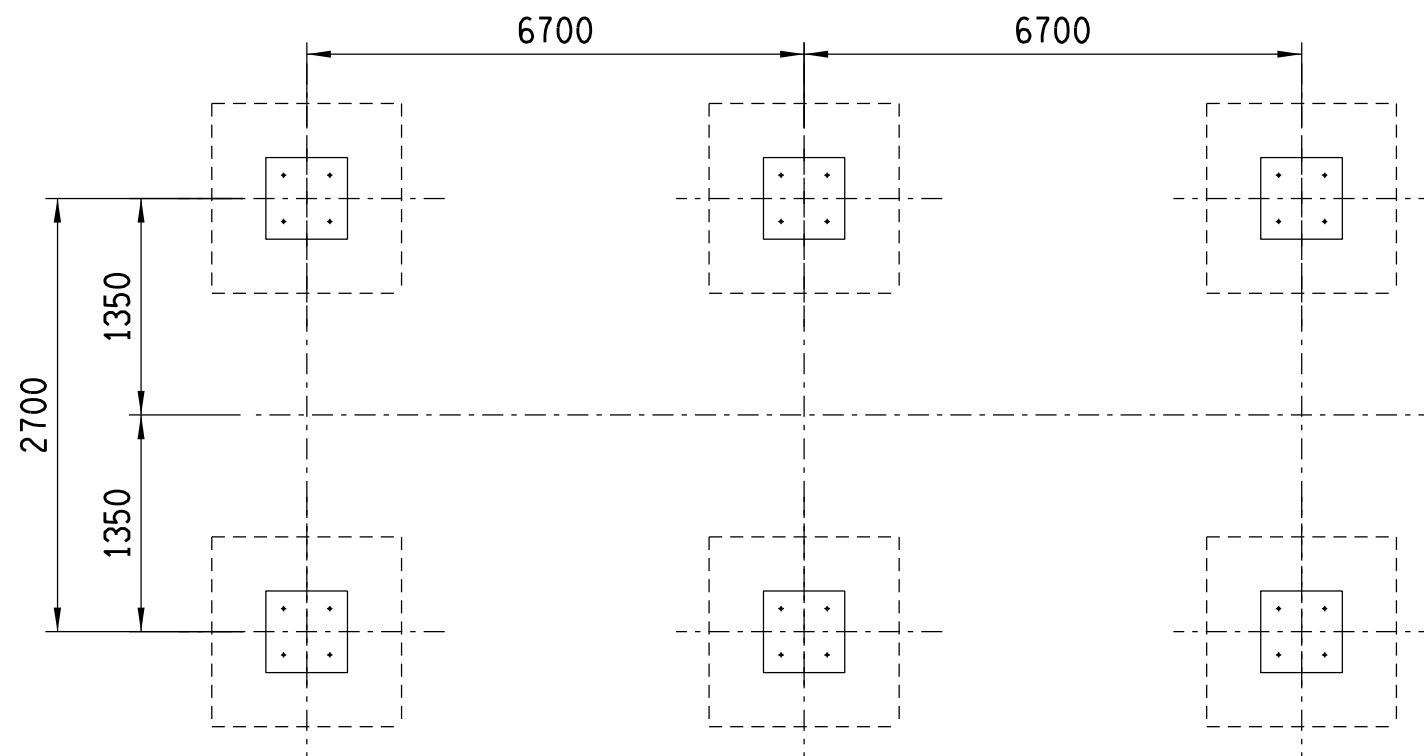


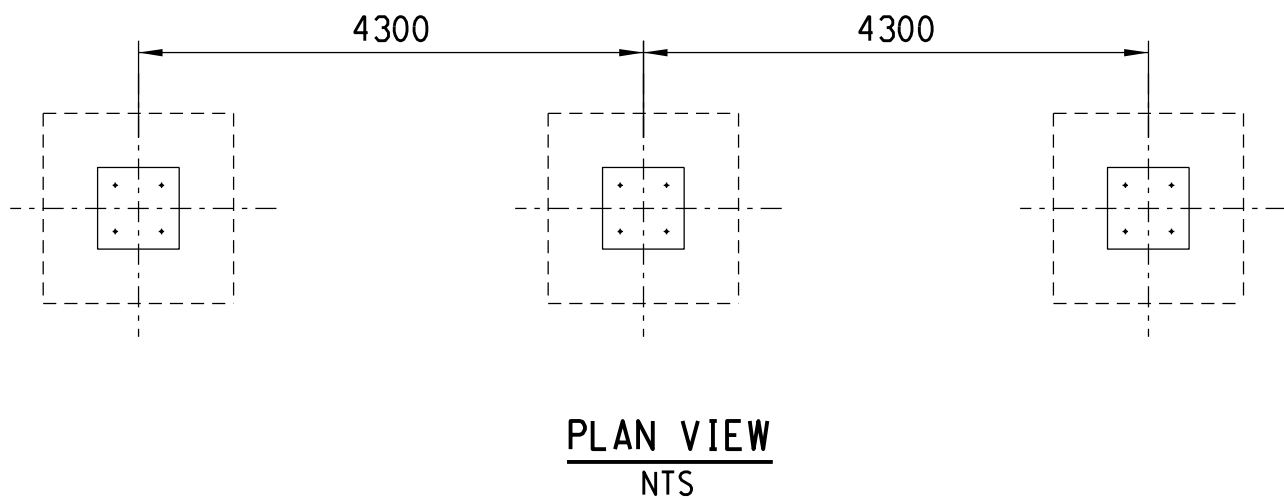
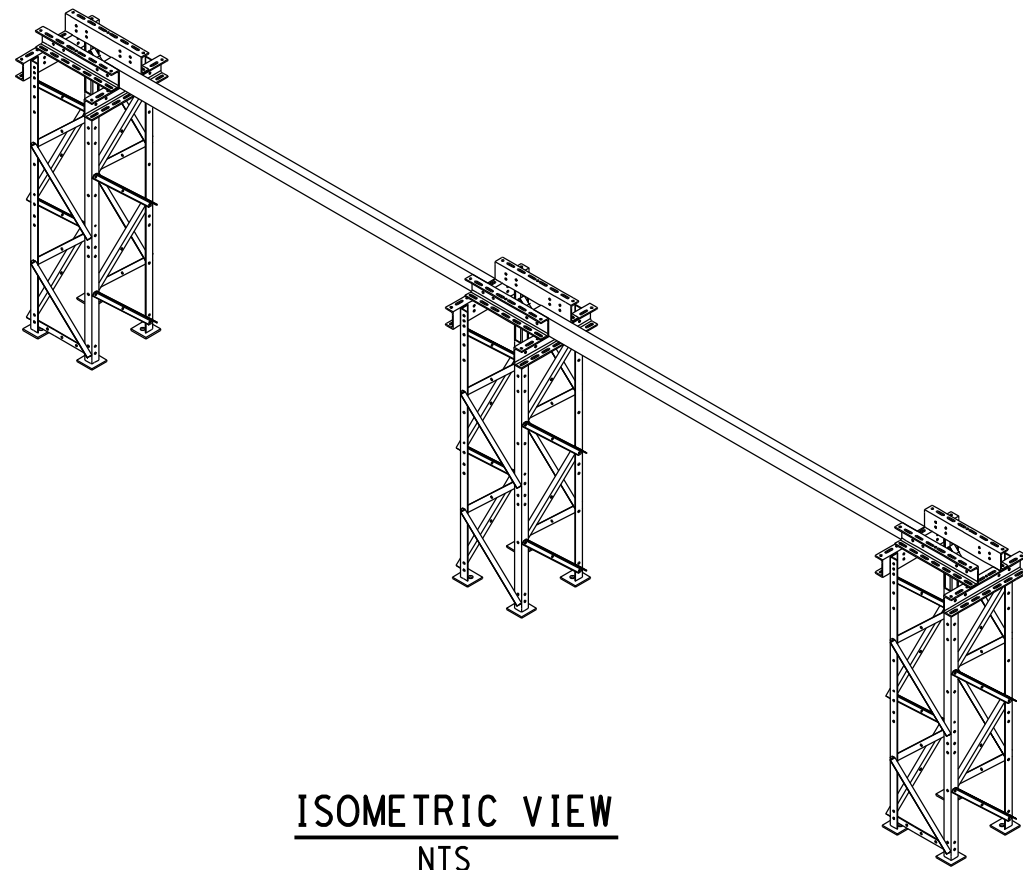
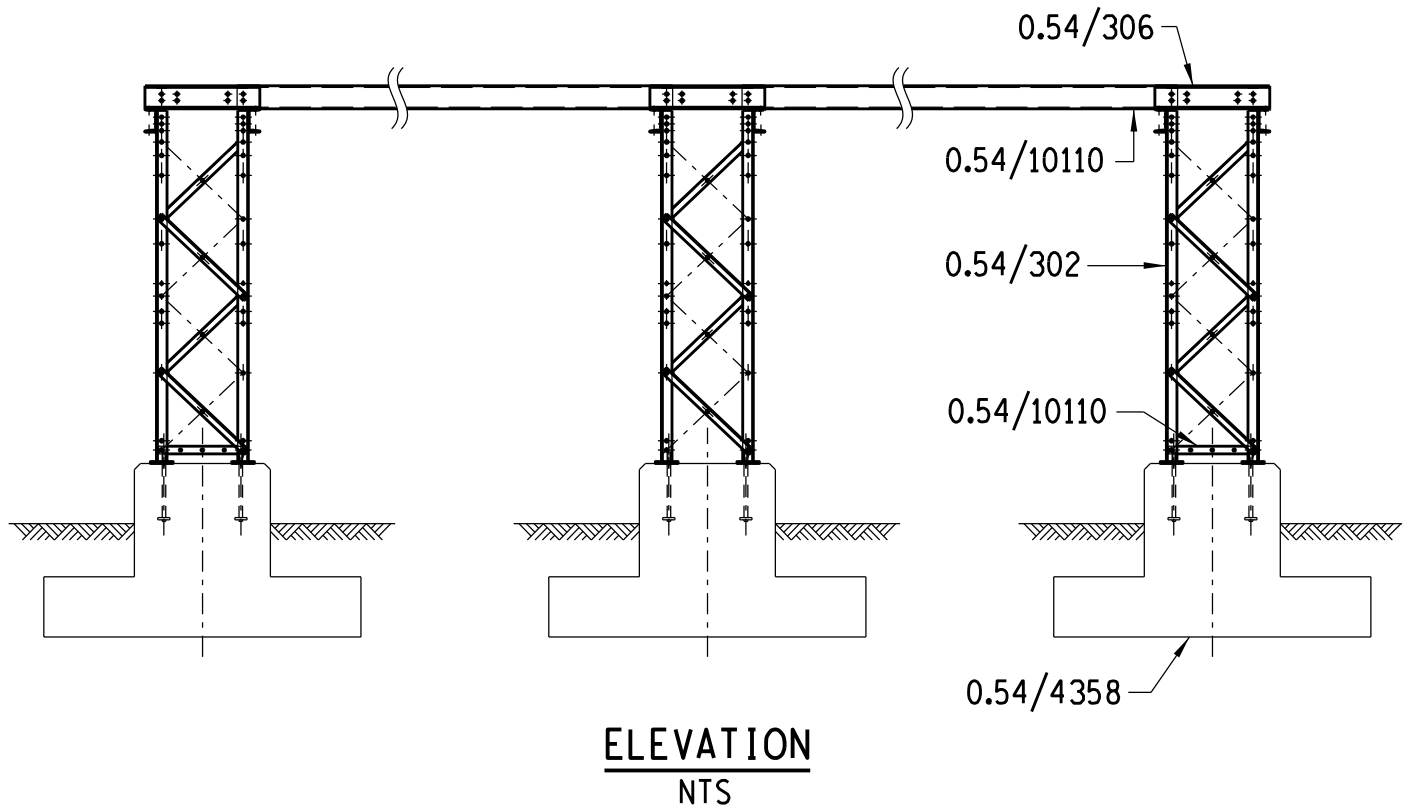
ISOMETRIC VIEW
NTS






PLAN VIEW
NTS




DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	6
0.54/306	MED. EQP. SUPP. CAP "M1"	6
0.54/4358	MED. EQP. SUPP. FND.	6
0.54/10111	CROSSBEAM 6700mm PHASE SPACING	4

REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 26 - 03 - 2021							
CHECKED BY 		275kV ISOLATOR LAYOUT 6700 PHASE SPACING					
DATE 26/03/2021							
DRAWN BY							
A.TIFLOEN							
DATE 23/09/2020		© 0.54/8829				SHEET NUMBER	REVISION
SCALE NTS						7B	0






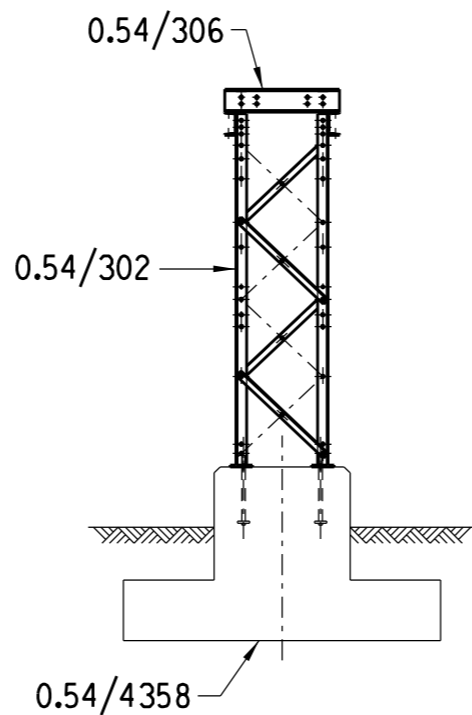
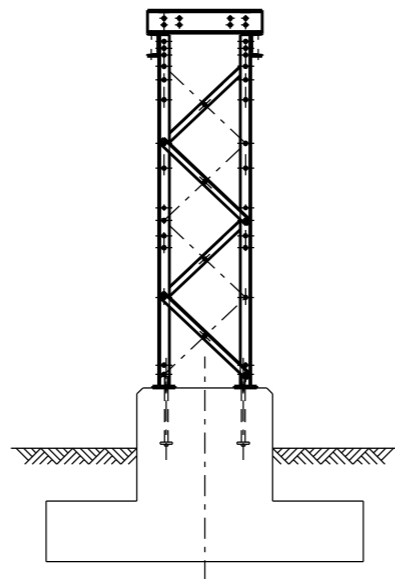
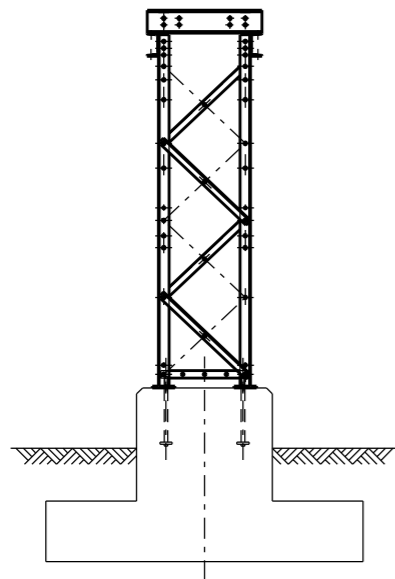
DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP 'M1'	3
0.54/4358	MED. EQP. SUPP. FND.	3
0.54/10110	CROSSBEAM 4300mm PHASE SPACING	2

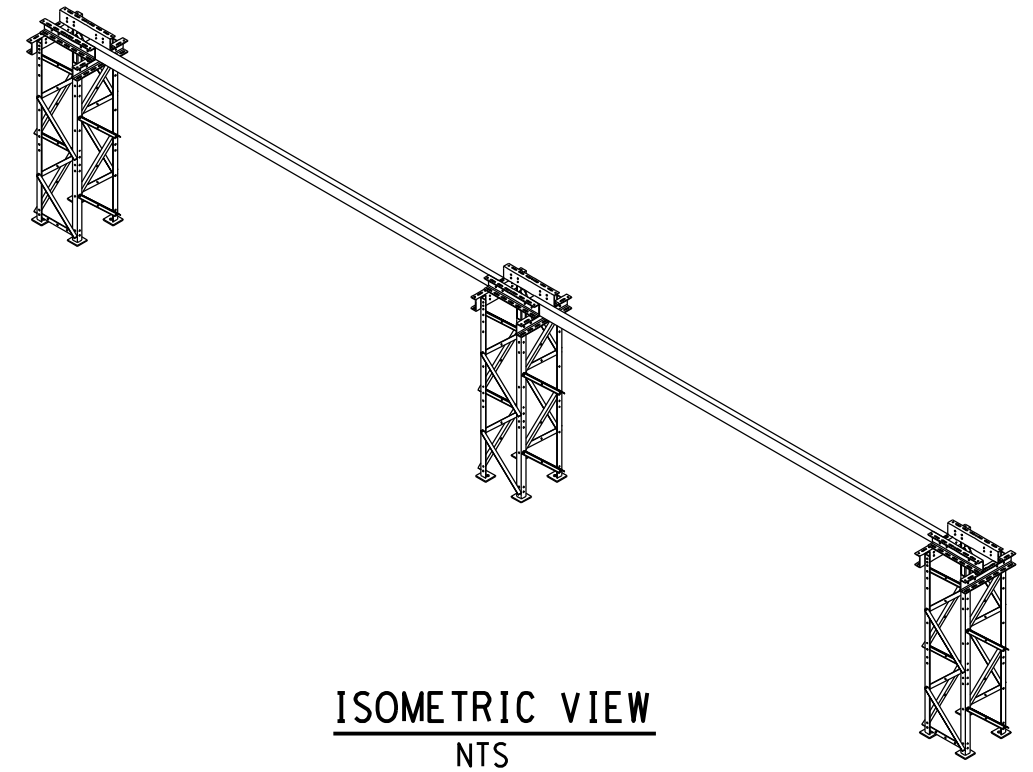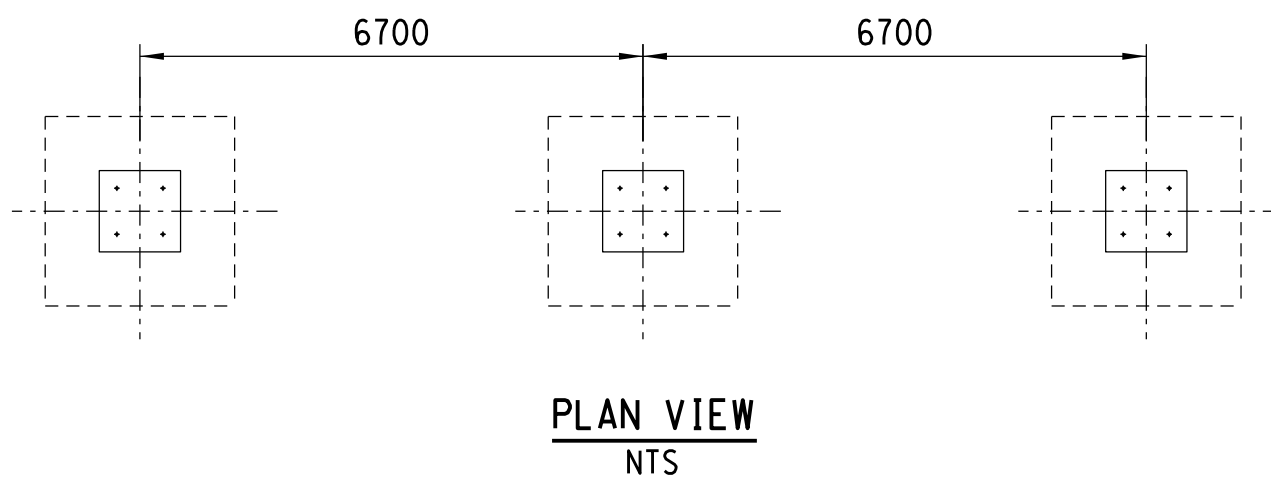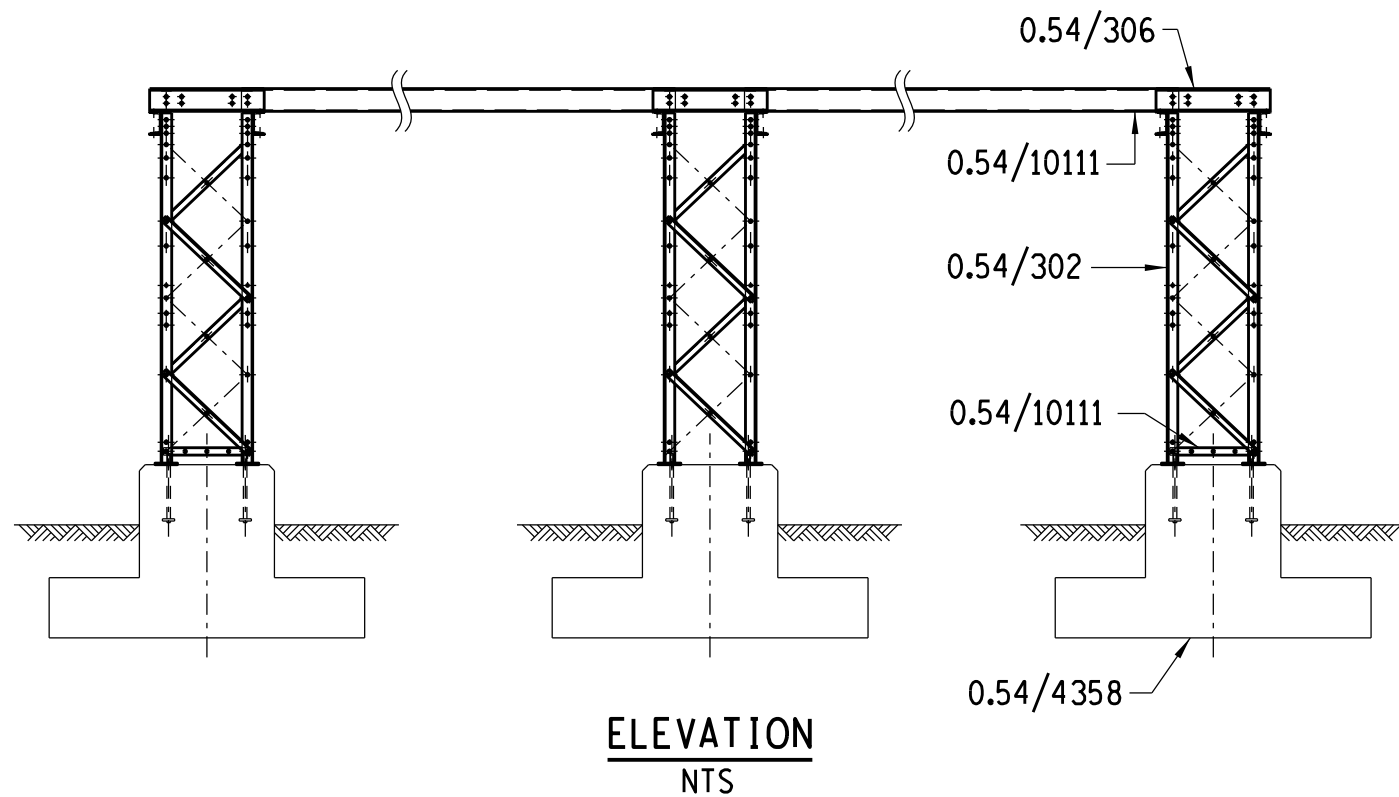REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS	
APPROVED BY 			 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 26 - 03 - 2021								
CHECKED BY 			275kV EARTH SWITCH LAYOUT 4300 PHASE SPACING					
DATE 26/03/2021								
DRAWN BY A.TIFLOEN								
DATE 05/10/2020			© 0.54/8829			SHEET NUMBER	REVISION	
SCALE NTS						7C	0	



DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3
0.54/10111	CROSSBEAM 6700mm PHASE SPACING	2


REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS		
APPROVED BY 					Eskom Holdings SOC Ltd Reg No 2002/015527/30				
DATE 26 - 03 - 2021									
CHECKED BY 		275kV EARTH SWITCH LAYOUT 6700 PHASE SPACING							
DATE 26/03/2021									
DRAWN BY A.TIFLOEN									
DATE 05/10/2020		© 0.54/8829				SHEET NUMBER	REVISION		
SCALE NTS						7D	0		



ELEVATION
NTS



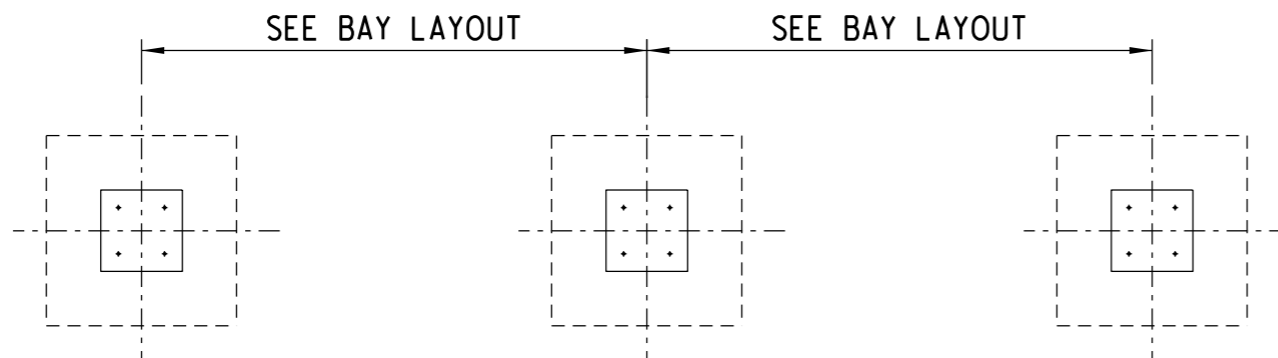



ISOMETRIC VIEW
NTS




PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3


REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS		
APPROVED BY 					Eskom Holdings SOC Ltd Reg No 2002/015527/30				
DATE 19 - 11 - 21									
CHECKED BY 		275kV CIRCUIT BREAKER LAYOUT 4300 AND 6700 PHASE SPACING							
DATE 17/11/2021									
DRAWN BY A.TIFLOEN									
DATE 12/5/2021		© 0.54/8829				SHEET NUMBER	REVISION		
SCALE NTS						7E	0		

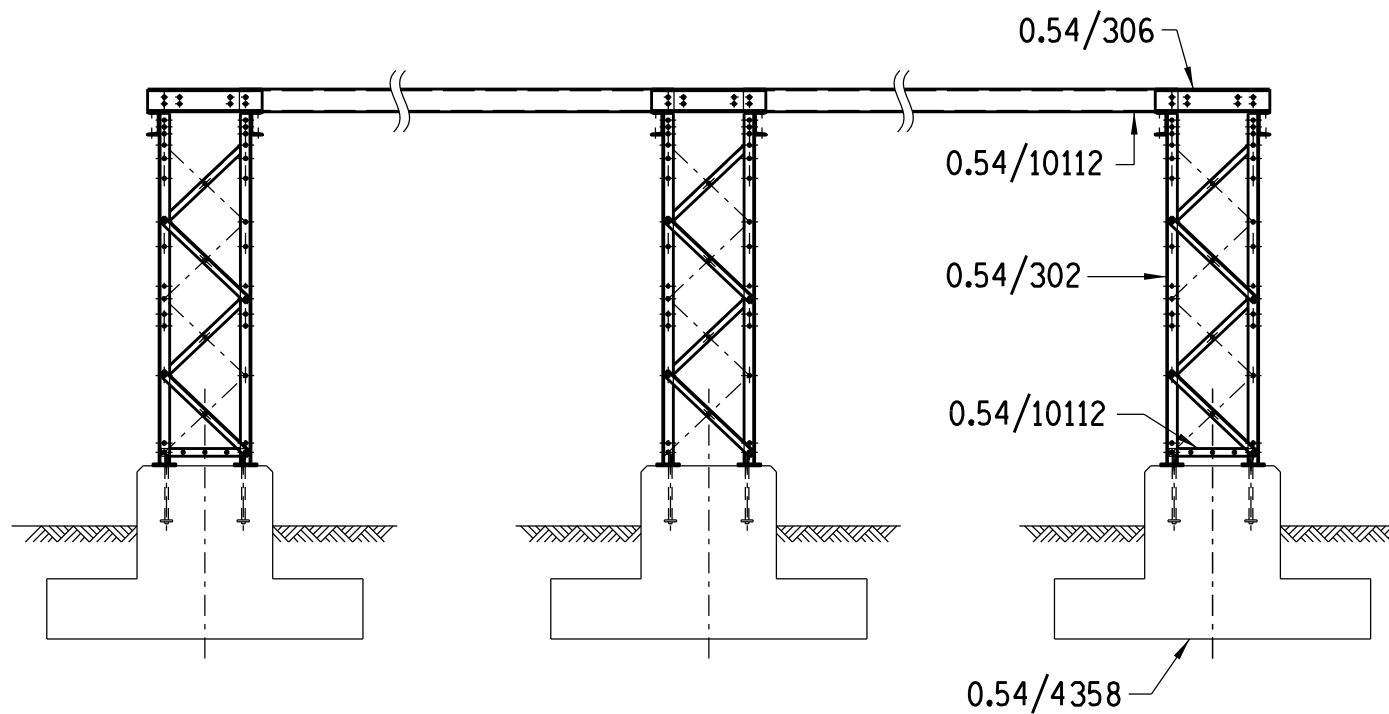

ELEVATION
NTS

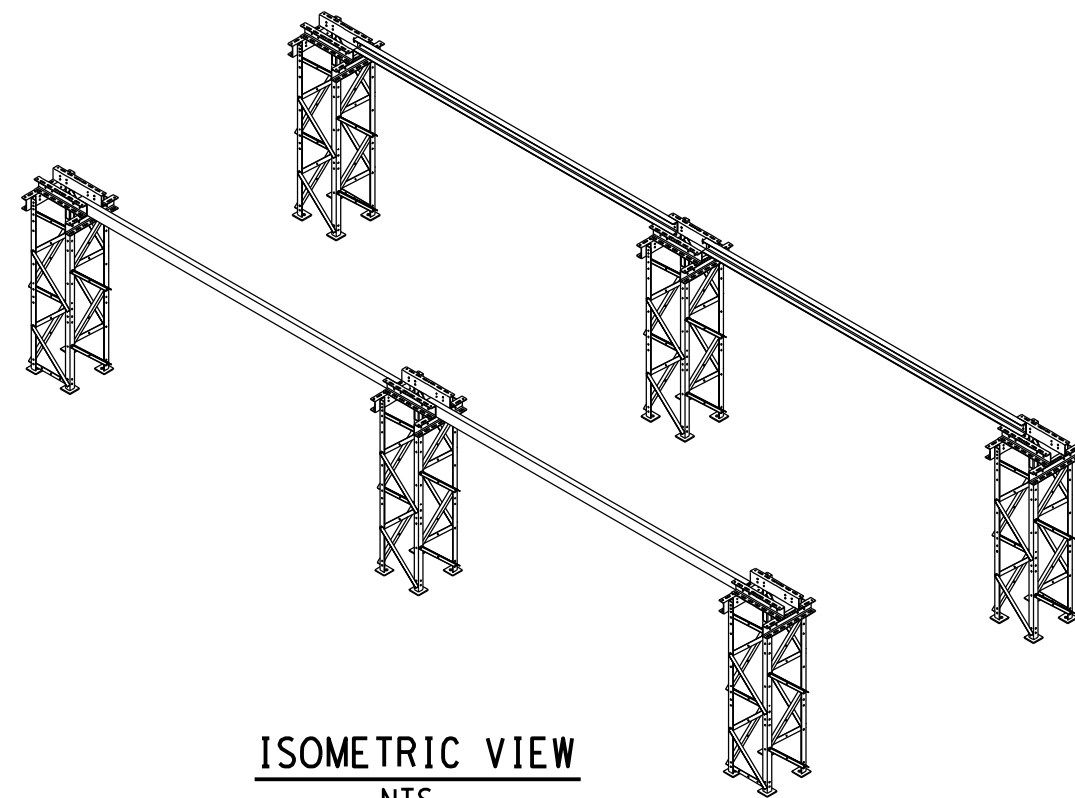

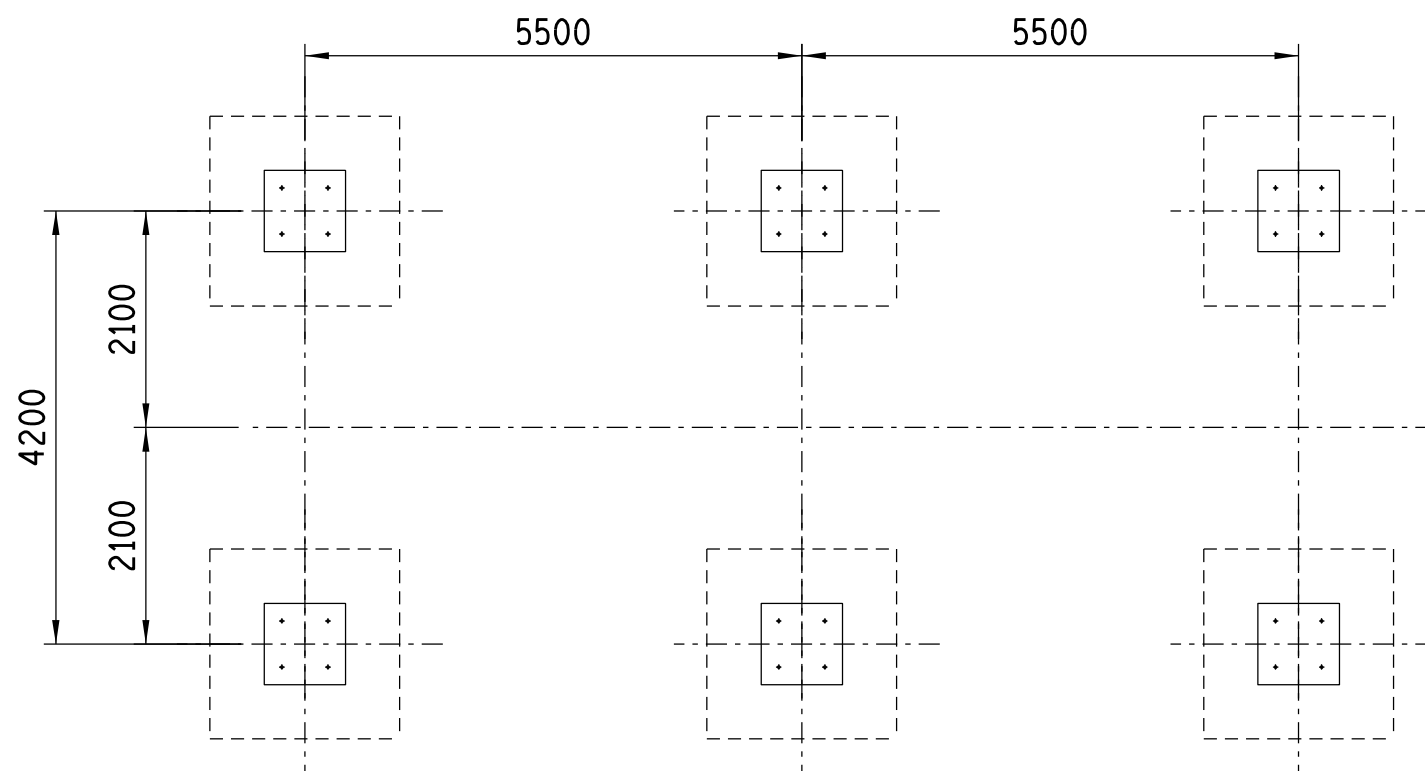


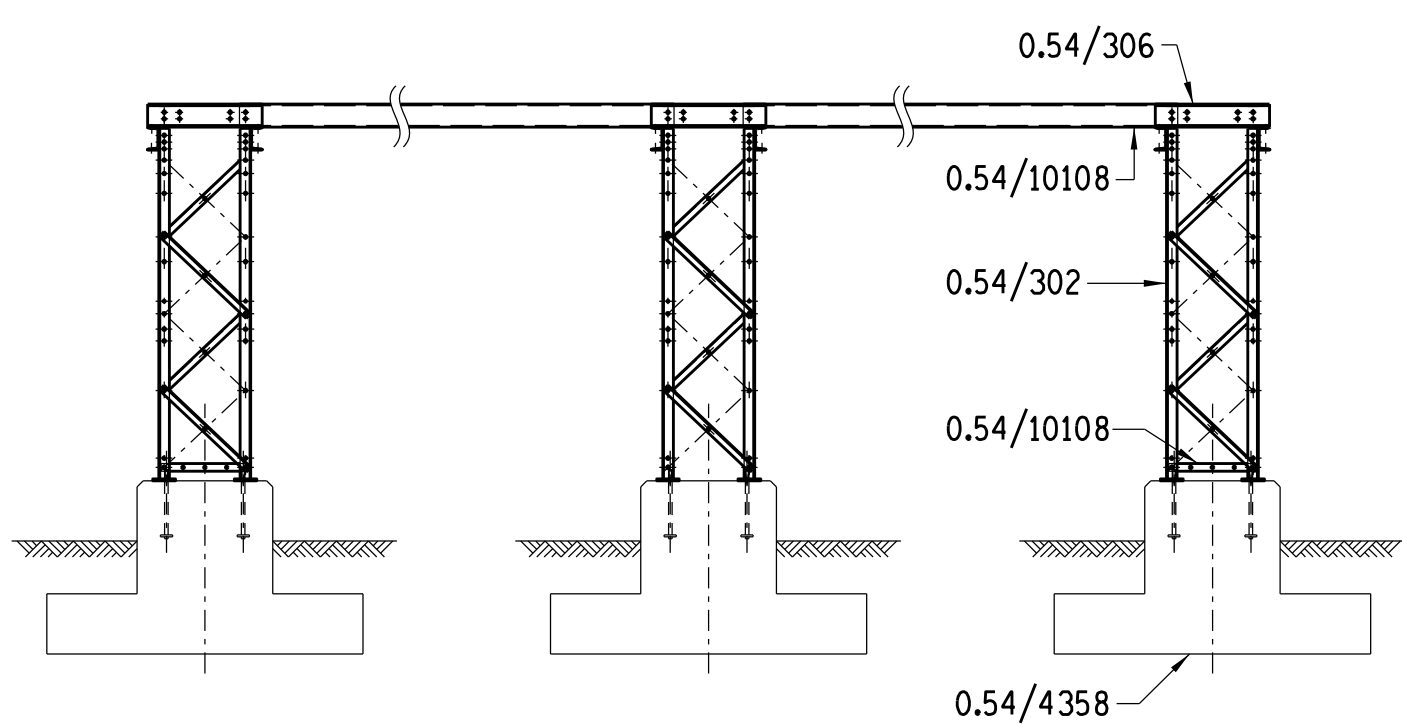
ISOMETRIC VIEW
NTS




FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	6
0.54/306	MED. EQP. SUPP. CAP "M1"	6
0.54/4358	MED. EQP. SUPP. FND.	6
0.54/10112	CROSSBEAM 5500mm PHASE SPACING	4


REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY		 Eskom				Eskom Holdings SOC Ltd Reg No 2002/015527/30		
								
DATE 25 - 03 - 2021								
CHECKED BY		400kV ISOLATOR LAYOUT 5500 PHASE SPACING						
								
DATE 25/03/2021								
DRAWN BY								
A.TIFLOEN		©						
DATE 23/09/2020		0.54/8829					SHEET NUMBER	REVISION
SCALE NTS							8A	0



ELEVATION
NTS

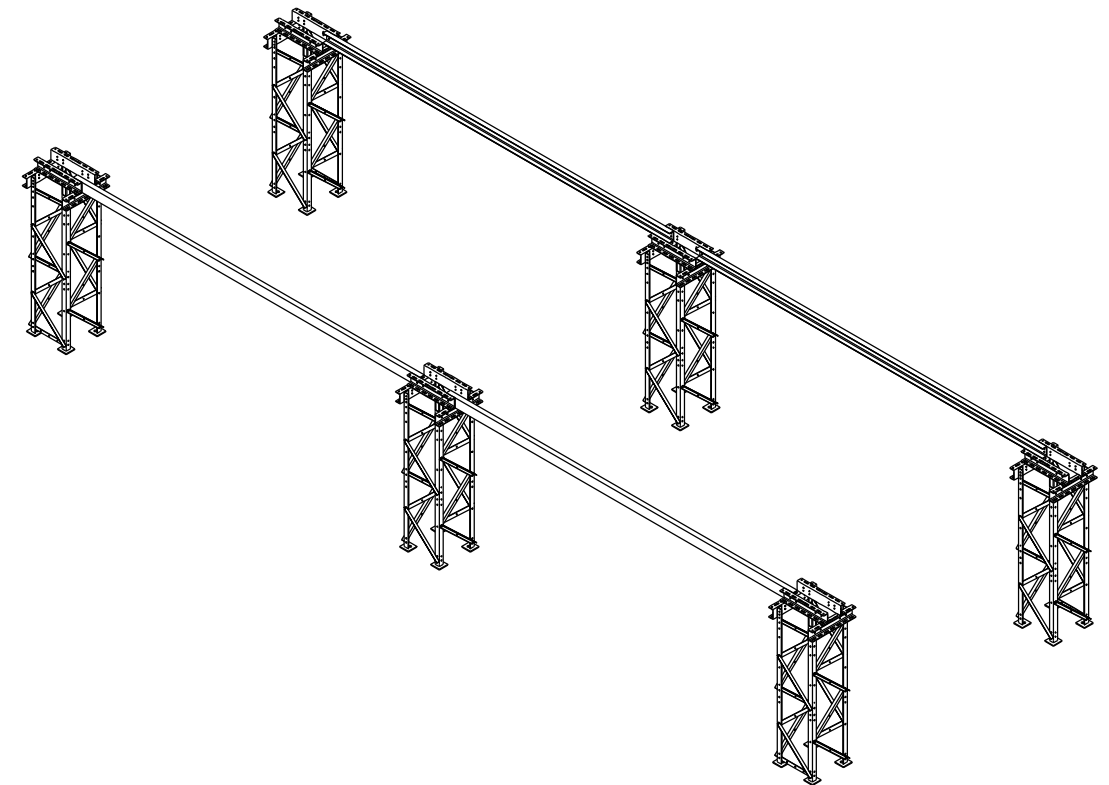

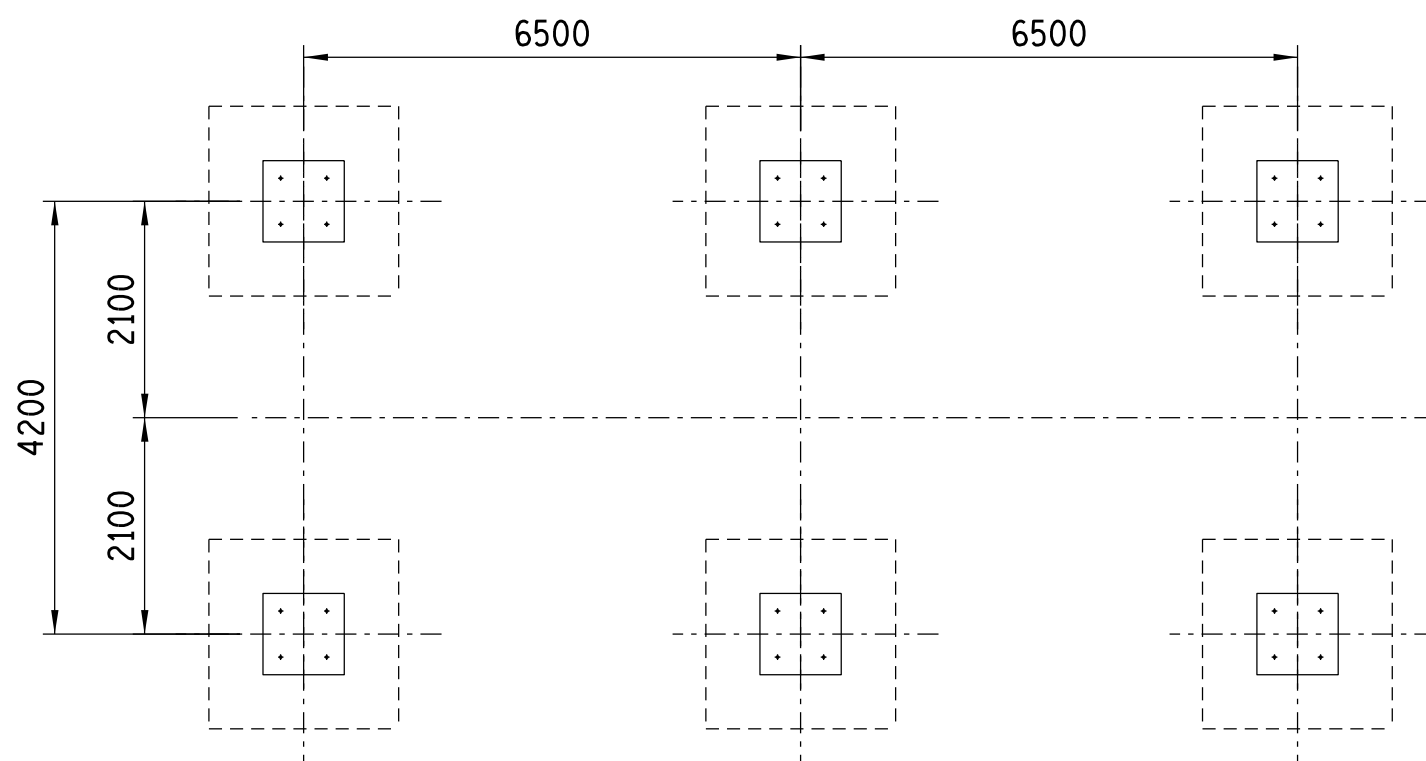


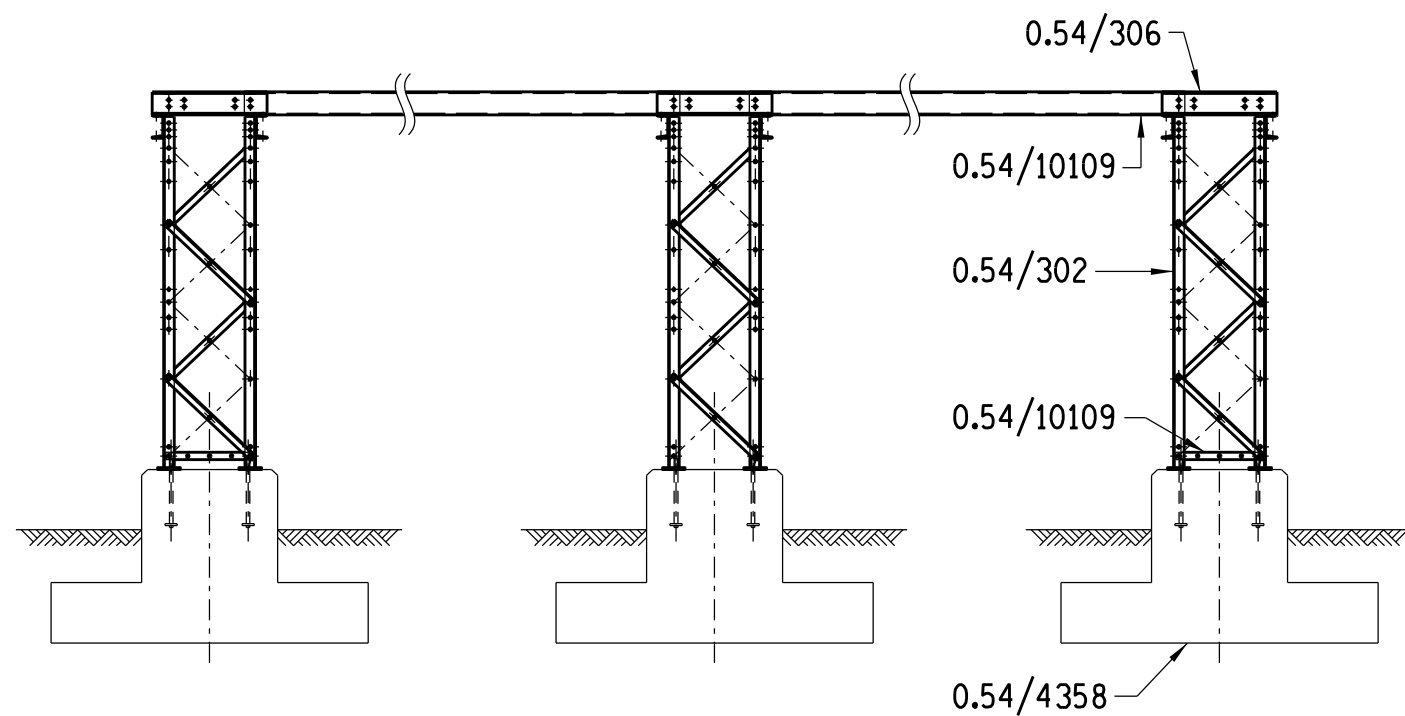
ISOMETRIC VIEW
NTS




FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	6
0.54/306	MED. EQP. SUPP. CAP "M1"	6
0.54/4358	MED. EQP. SUPP. FND.	6
0.54/10108	CROSSBEAM 6500mm PHASE SPACING	4


REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 25 - 03 - 2021							
CHECKED BY 		400kV ISOLATOR LAYOUT 6500 PHASE SPACING					
DATE 25/03/2021							
DRAWN BY							
A.TIFLOEN							
DATE 23/09/2020		© 0.54/8829				SHEET NUMBER	REVISION
SCALE NTS						8B	0



ELEVATION
NTS

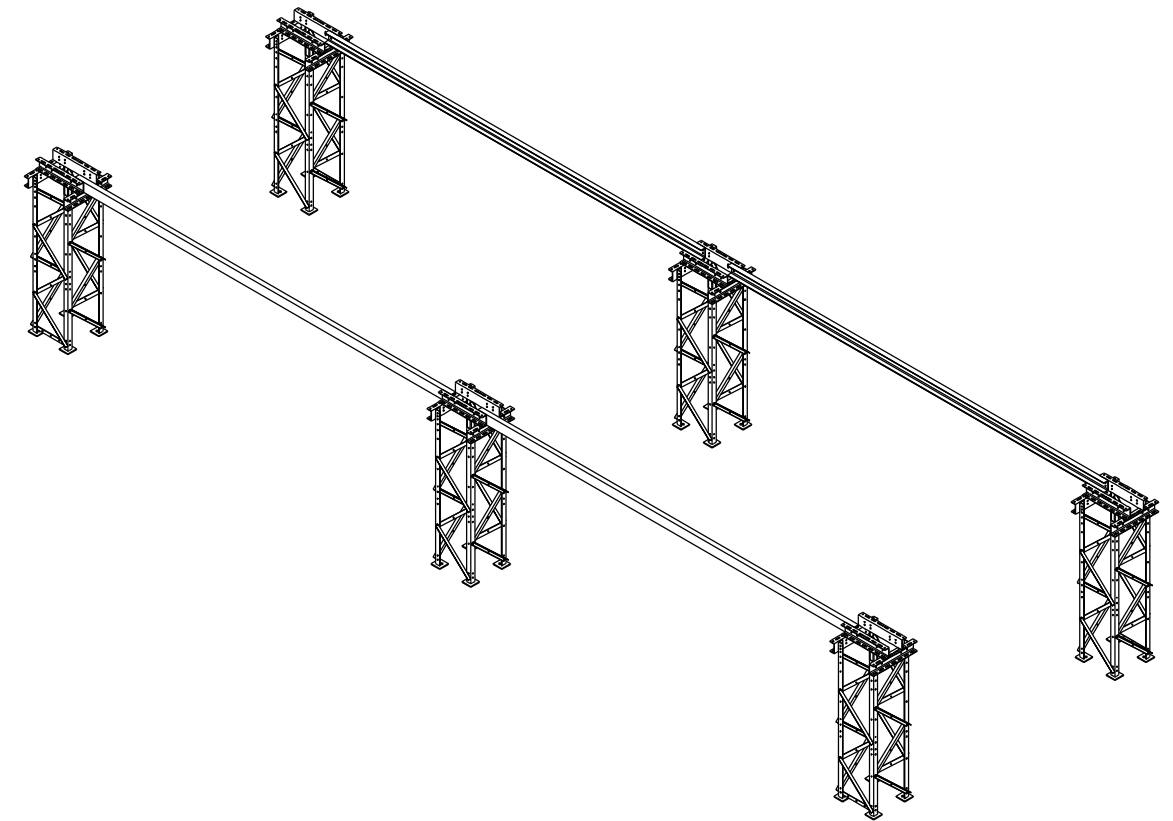

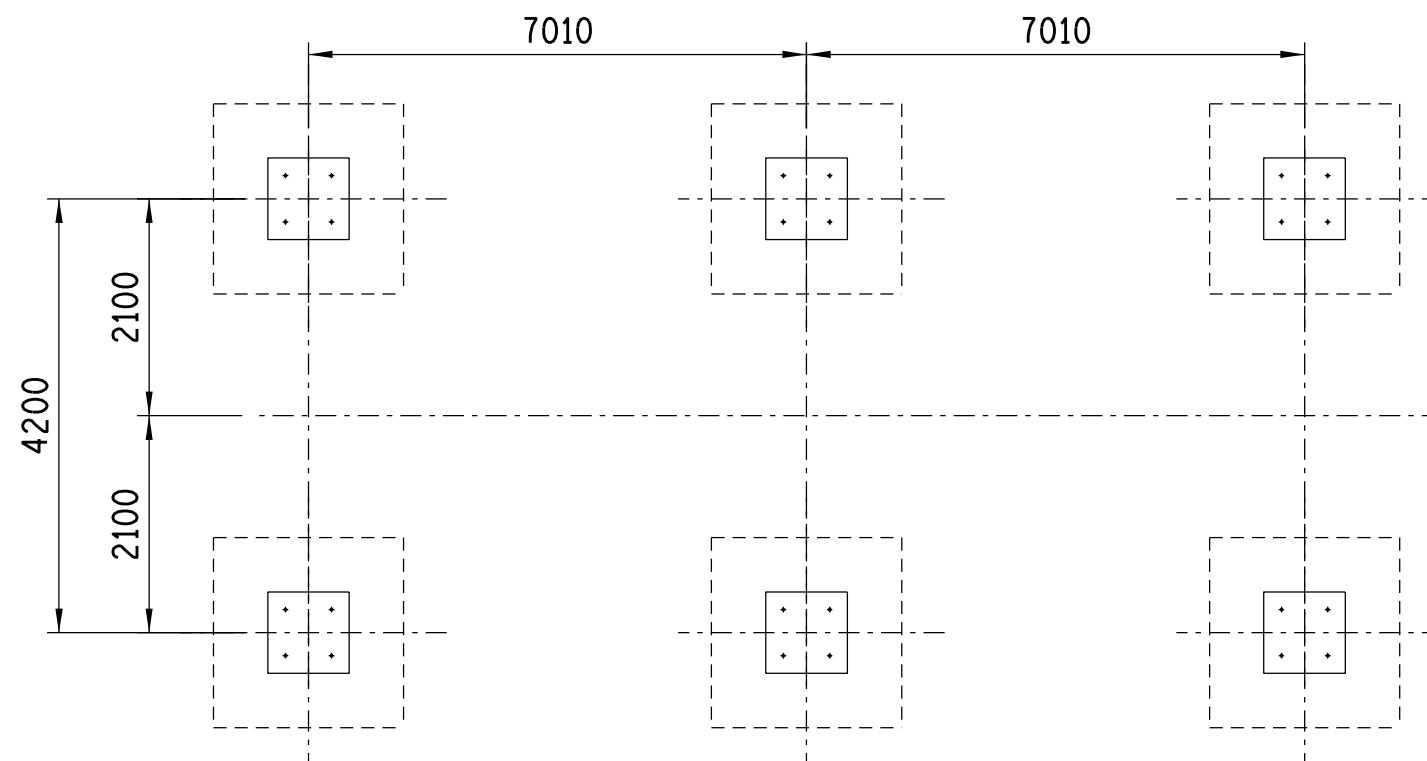


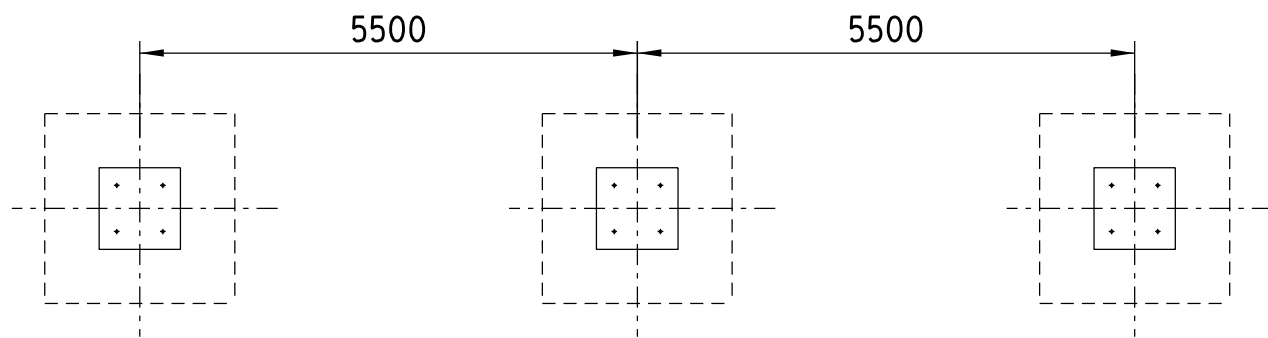
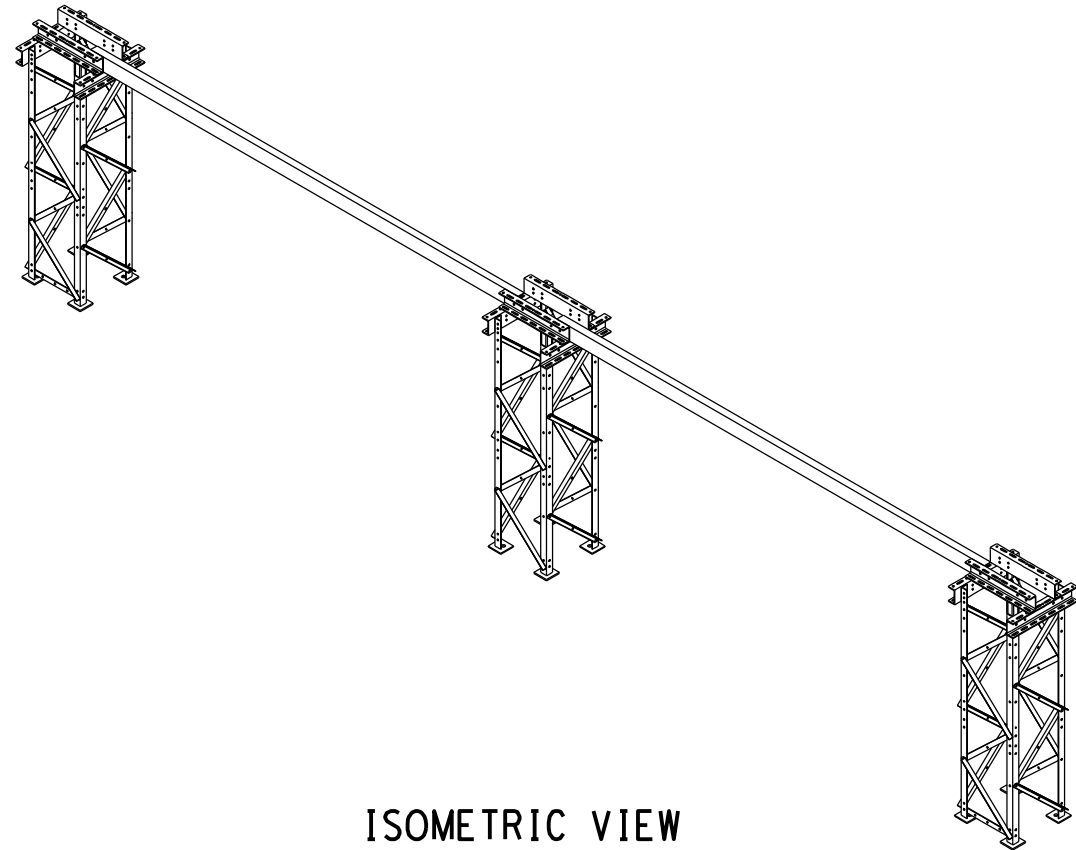
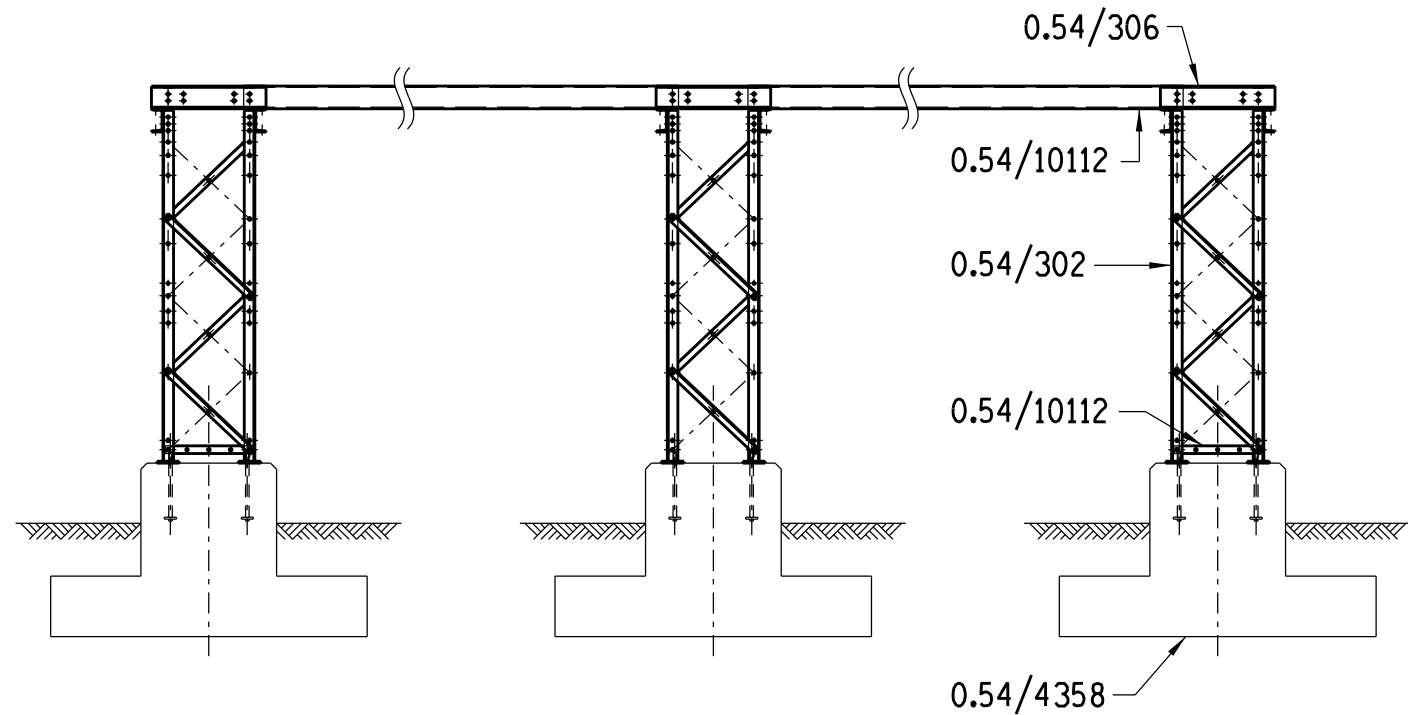
ISOMETRIC VIEW
NTS






FOUNDATION PLAN VIEW
NTS


DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	6
0.54/306	MED. EQP. SUPP. CAP "M1"	6
0.54/4358	MED. EQP. SUPP. FND.	6
0.54/10109	CROSSBEAM 7010mm PHASE SPACING	4

REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 25 - 03 - 2021							
CHECKED BY 		400kV ISOLATOR LAYOUT 7010 PHASE SPACING					
DATE 25/03/2021							
DRAWN BY A.TIFLOEN							
DATE 23/09/2020		© 0.54/8829				SHEET NUMBER	REVISION
SCALE NTS						8C	0




DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3
0.54/10112	CROSSBEAM 5500mm PHASE SPACING	2


REV	REVISION DESCRIPTION			DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS	
APPROVED BY		<div> Eskom</div>				<div>Eskom Holdings SOC Ltd</div> <div>Reg No 2002/015527/30</div>				
A.MANELI 										
DATE 25/03/2021										
CHECKED BY		<div>400kV EARTH SWITCH</div> <div>LAYOUT</div> <div>5500 PHASE SPACING</div>								
B.HAJEE 										
DATE 25/03/2021										
DRAWN BY										
A.TIFLOEN		©								
DATE 05/10/2020										
SCALE NTS		0.54/8829				SHEET NUMBER		REVISION		
						8D		0		

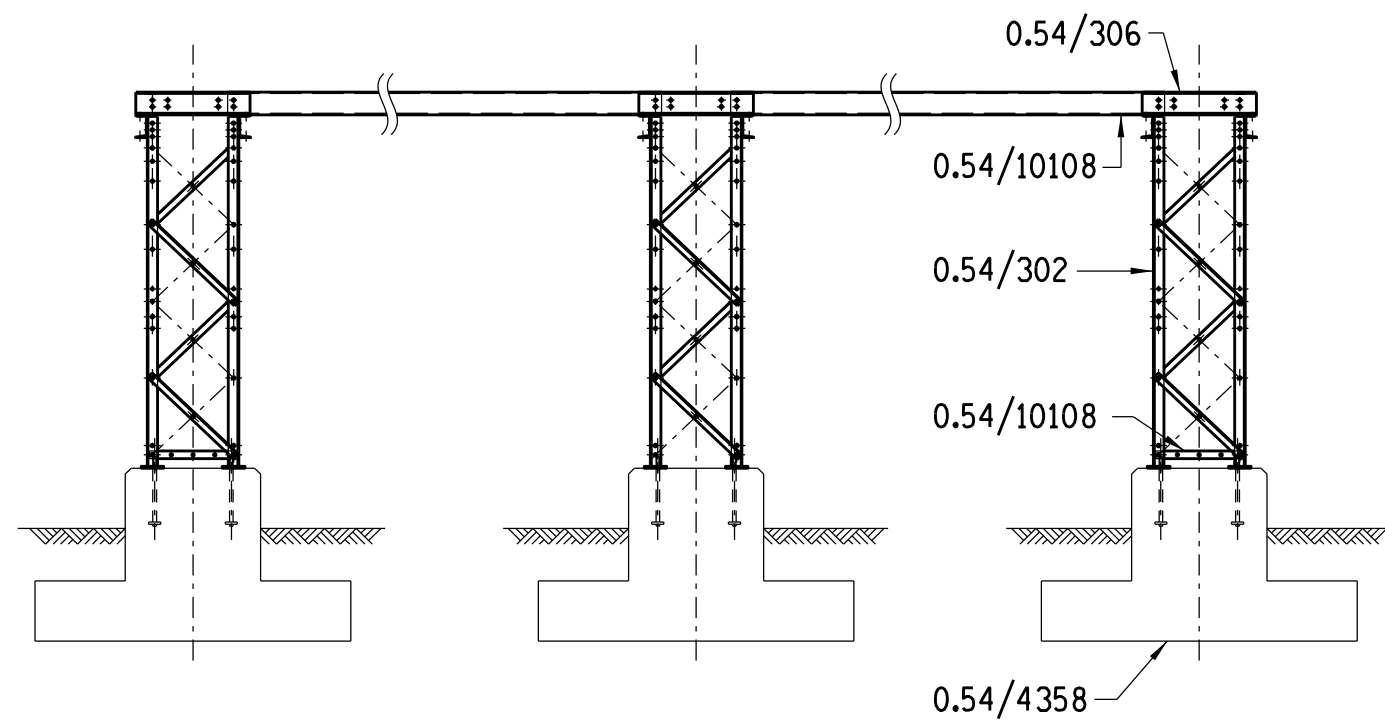

ELEVATION
NTS

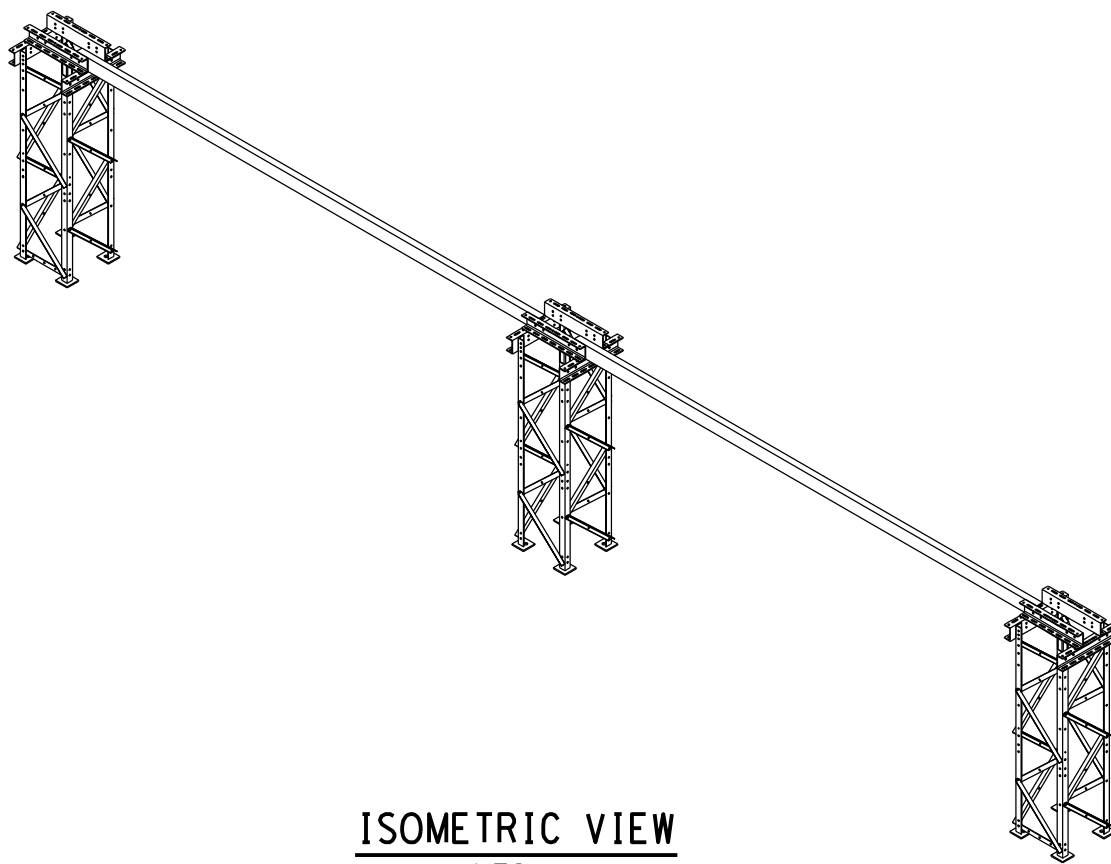


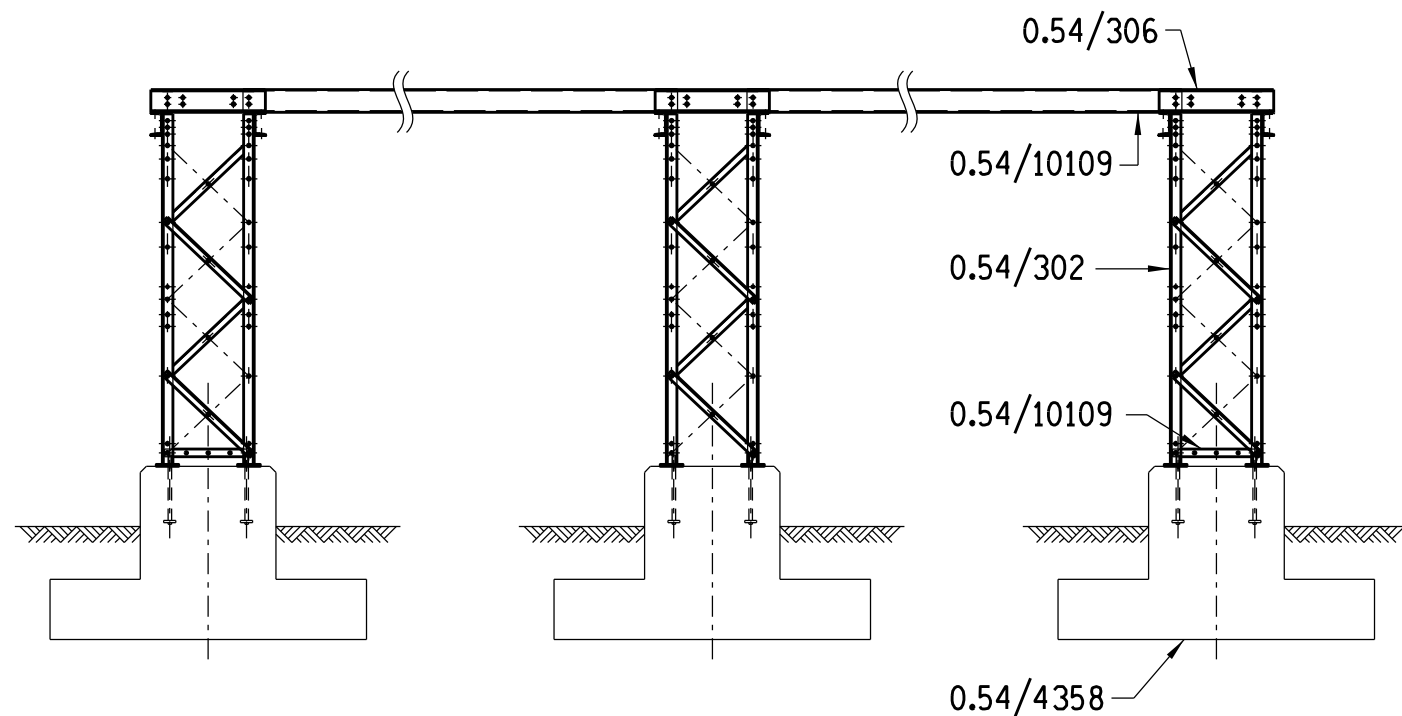
ISOMETRIC VIEW
NTS

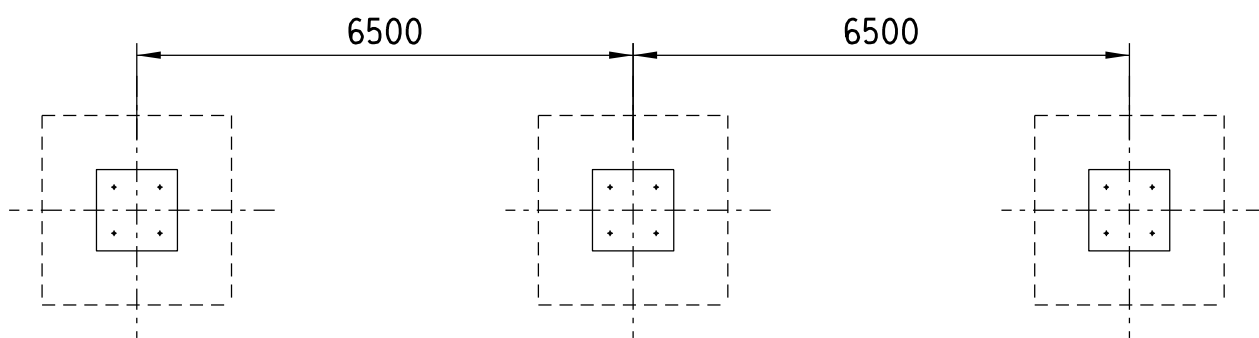


FOUNDATION PLAN VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3
0.54/10108	CROSSBEAM 5500mm PHASE SPACING	2

REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY			Eskom Holdings SOC Ltd Reg No 2002/015527/30				
DATE 25 - 03 - 2021							
CHECKED BY	400kV EARTH SWITCH LAYOUT 6500 PHASE SPACING		©				
DATE 25/03/2021							
DRAWN BY							
A.TIFLOEN							
DATE 05/10/2020	0.54/8829		SHEET NUMBER		REVISION		
SCALE NTS			8E		0		




ELEVATION
NTS

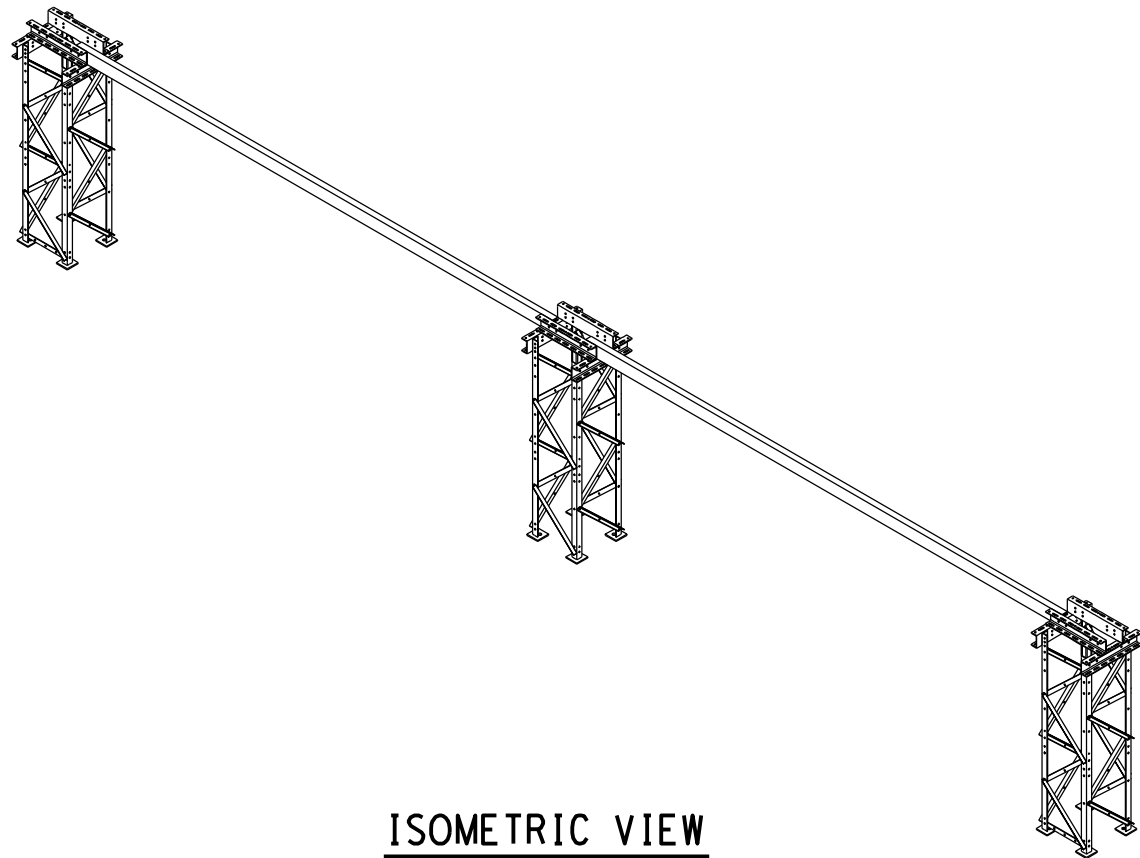




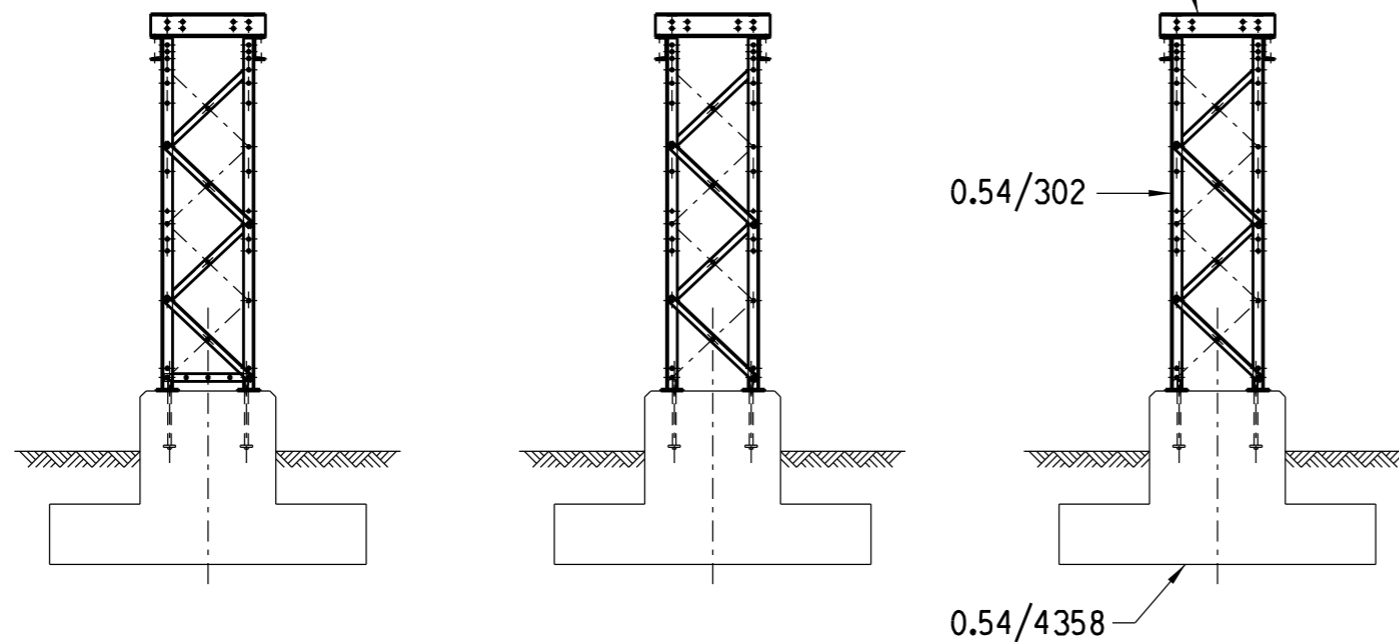
ISOMETRIC VIEW
NTS

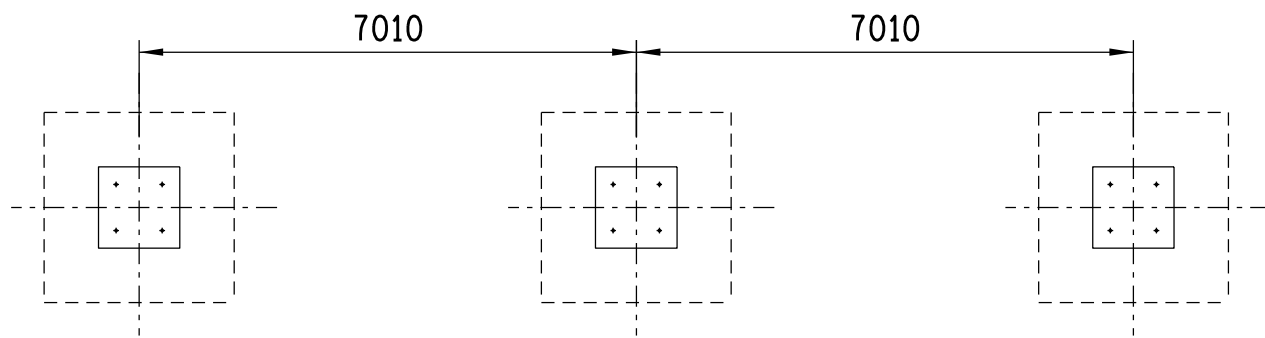DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3
0.54/10109	CROSSBEAM 5500mm PHASE SPACING	2




FOUNDATION PLAN VIEW
NTS

REV	REVISION DESCRIPTION		DRAWN	CHKD	AUTH	DATE	./ REFERENCE DRAWINGS
APPROVED BY 		 Eskom			Eskom Holdings SOC Ltd Reg No 2002/015527/30		
DATE 25 - 03 - 2021							
CHECKED BY 		400kV EARTH SWITCH LAYOUT 7010 PHASE SPACING					
DATE 25/03/2021							
DRAWN BY A.TIFLOEN							
DATE 05/10/2020		© 0.54/8829				SHEET NUMBER	REVISION
SCALE NTS						8F	0




ELEVATION
NTS

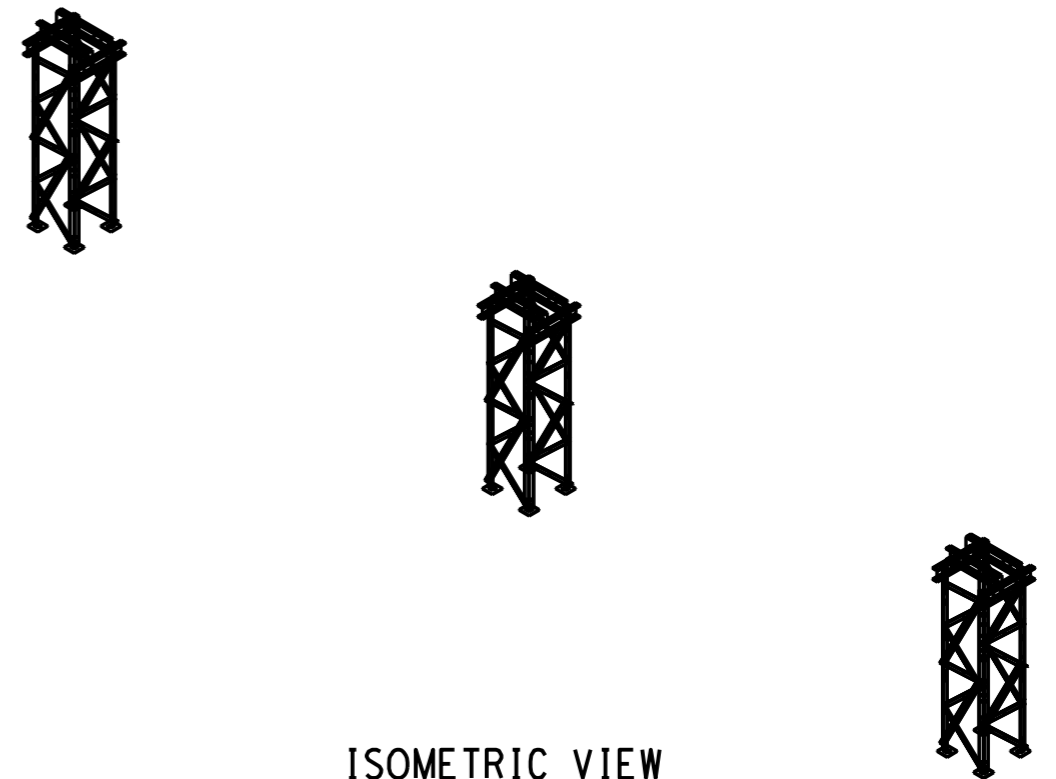


ISOMETRIC VIEW
NTS

DRAWING No.	DESCRIPTION	QTY
0.54/302	MED. EQP. SUPP. 2500mm HIGH	3
0.54/306	MED. EQP. SUPP. CAP "M1"	3
0.54/4358	MED. EQP. SUPP. FND.	3

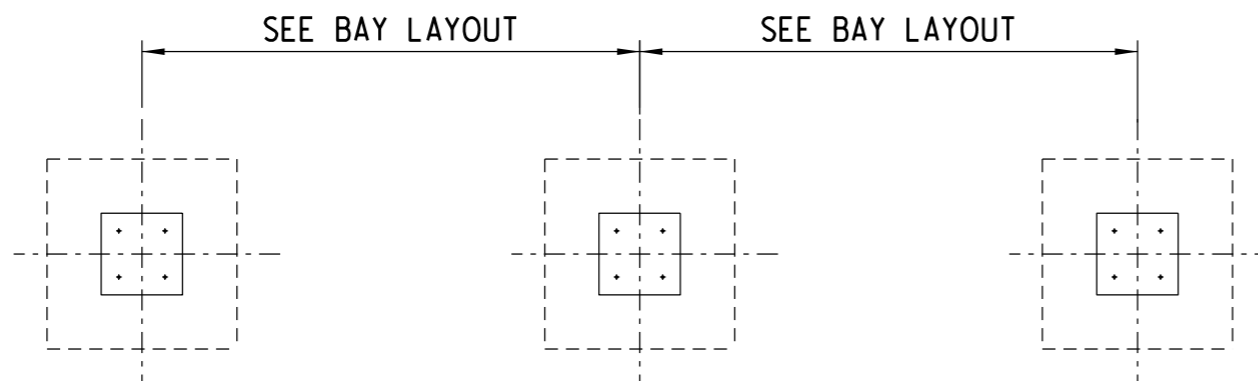

FOUNDATION PLAN VIEW
NTS

REV	REVISION DESCRIPTION	DRAWN	CHKD	AUTH	DATE	./	REFERENCE DRAWINGS
APPROVED BY	 Eskom						Eskom Holdings SOC Ltd Reg No 2002/015527/30
DATE 19-11-21							
CHECKED BY	400kV CIRCUIT BREAKER LAYOUT						5500, 6500 AND 7010 PHASE SPACING
DATE 17/11/2021							
DRAWN BY	0.54/8829						SHEET NUMBER 8G
A.TIFLOEN							
DATE 19/5/2021	0.54/8829						REVISION 0
SCALE NTS							