


CENTLEC (Pty) Ltd

DESCRIPTION

1	FEDER CABLE FROM SUBSTATION
2	NEUTRAL
3	TERMINALS INSIDE METER BOX
4	THREE PHASE CONVENTIONAL METER
5	CIRCUIT BREAKER - 80 AMP, SINGLE POLE
6	PT FUSE AND BASE - 5 AMP
7	SUPPLY CABLE FOR GEYSER
8	RIPPLE GEYSER CONTROL RELAY
9	EARTH CONNECTION TERMINAL
10	SERVICE CONNECTION CABLE PLUS SEPERATE EARTH CONTINUITY CONDUCTOR
11	CONSUMER EARTH TERMINAL
12	MAIN CIRCUIT BREAKER (4-POLE CB OR TRIPLE POLE E.L.)
13	CONSUMER NEUTRAL BAR
14	CIRCUIT BREAKER FOR GEYSER
15	CONSUMER DISTRIBUTION BOARD
16	METERBOX

NOTE :

- NEUTRAL AND EARTH MUST NOT BE BRIDGE INSIDE THE METERBOX
- FEDER CABLE AND CONSUMERS CONNECTION CABLE ARMOURING MUST BE BONDED TO THE METERBOX EARTH TERMINAL

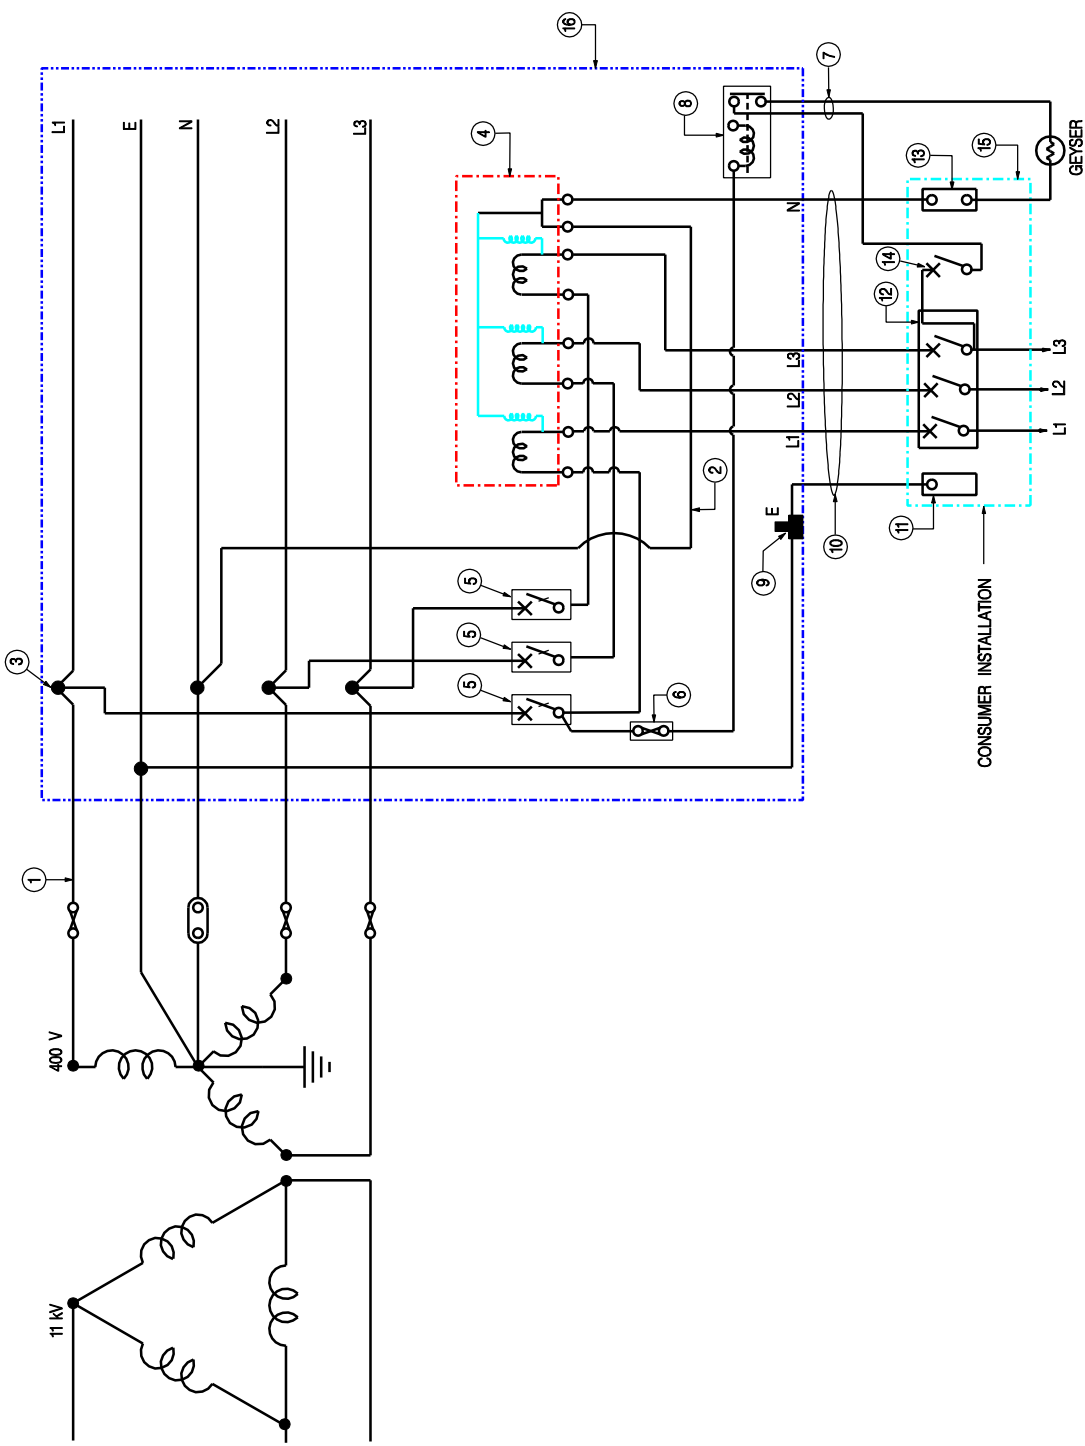

CENTLEC (Pty) Ltd Reg No 2002/082707 PRIVATE BAG X14, BRANDVOR 9224 Tel: 051 - 402238		DESIGNED B. S. TSHABALALA DRAWN	ONTWERP DATE 2002 / 03 / 11	FIRST DRG. MAN A. C. DE WET	CHECKED SKAAL N T S	UTILIZATION BDE JAGER (CUSTOMER SERVICES)	REGIONAL SERVICES X.FAKU (EXECUTIVE MANAGER ENGINEERING)	STREEKS- DIENSTE KLENTEDIENS BESTUURDER INGENIEURSWES	TN-S DISTRIBUTION NETWORK THREE PHASE CONVENTIONAL METER INSIDE THE METER BOX		TITLE
Tel: 051 - 402238		N. VERMEULEN	GE TEKENISCALE	A. C. DE WET	A. C. DE WET	K V/D BERG	L KRITZINGER	INGENIEURSWES	DRAWING Nr., TS - 5 - 25		TEKENING No. REV., 0