


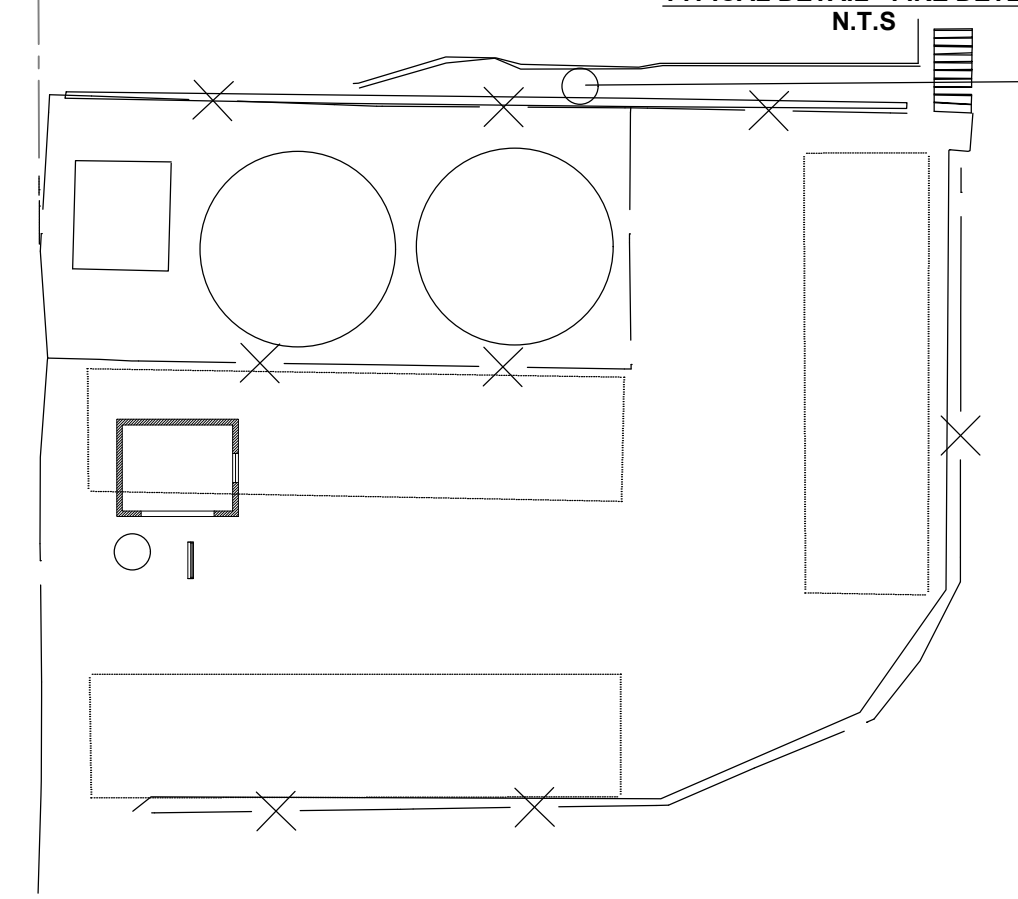

SD 	ADDRESSABLE OPTICAL FIRE ALARM SMOKE DETECTOR (c) denotes -----under ceiling/soffit (f) denotes -----within access/raised floor (v) denotes -----within ceiling/roof void
HD 	ADDRESSABLE FIRE ALARM HEAT DETECTOR
BG 	ADDRESSABLE FIRE ALARM MANUAL CALL POINT (RED BREAKGLASS UNIT)
B 	FIRE ALARM ELECTRONIC SOUNDER/BELL WITH INTEGRAL STROBE LIGHT
GBG 	ADDRESSABLE FIRE ALARM MANUAL CALL POINT (GREEN BREAKGLASS UNIT) TO OVERRIDE ACCESS CONTROLLED DOORS
	BEAM DETECTOR (TRANSMITTER) INSTALLED 1200mm ABOVE THE TOP OF THE CRANE.
	REFLECTOR (RECEIVER) INSTALLED 1200mm ABOVE THE TOP OF THE CRANE.