


NOTES

- (1) ALL NUTS & BOLTS TO BE BRASS OR STAINLESS STEEL. FLAT & SPRING WASHERS TO BE INCLUDED.
- (2) MCB'S TO BE CURVE 1 ORANGE TOGGLE COMPLETE WITH SHROUDS AND CLIPS.
- (3) KIOSKS TO BE WIRED AS FOLLOWS –
- A) – METERS WILL NOT BE SUPPLIED WITH KIOSKS.
- B) – METERS WILL NOT BE SUPPLIED WITH KIOSKS.
- (4) THE THREE POINT LOCKING MECHANISM SHALL FINALLY SECURE THE DOOR AND NOT ALLOW LEVERAGE FOR VANDALISM.
- (5) THE THREE POINT LOCKING MECHANISM BOLT SHALL NOT INTERFERE WITH THE MCB'S. i.e THE BOLT MUST BE OF A SHORTER LENGTH.

MANUFACTURING DRAWING

THE COPYRIGHT OF THIS PLAN AND DESIGN RESIDES WITH THE CITY OF CAPE TOWN AND MAY NOT BE REPRODUCED OR USED FOR ANY PURPOSES OTHER THAN IT WAS INTENDED FOR ORIGINALLY




CITY OF CAPE TOWN  
ISIXEKO SASSEKAPA  
STAD KAAPSTAD

C.C.I ELECTRICITY  
SERVICES

DRAWING & RECORD CENTRE  
ARCHITECTURAL/MECHANICAL SECTION  
HEAD OFFICE BLOEMHOF ROAD  
BELLEVUE PRIVATE BAG 444 7535

|                                  |  |
|----------------------------------|--|
| DIRECTOR: ELECTRICITY            | D. L. RENCONTRE  |
| HEAD: ENGINEERING                | E. CARPS   |
| MANAGER: DRAWING & RECORD CENTRE | A. M. VAN ZYL  |
| PROJECT TITLE                    | METER KIOSK - 6 WAY<br>DUAL DOOR (STEEL)<br>(SAP: 200020415) |

|                     |                  |                 |
|---------------------|------------------|-----------------|
| APPROVED BY: .....  | CHECKED          |                 |
| COMPILED: A. HALL   |                  |                 |
| SCALE: AS SHOWN     | DATE: 13/04/2016 |                 |
| DRAWING NO: DR 3362 | SHEET 1 OF 2     | REVISION NO: A1 |

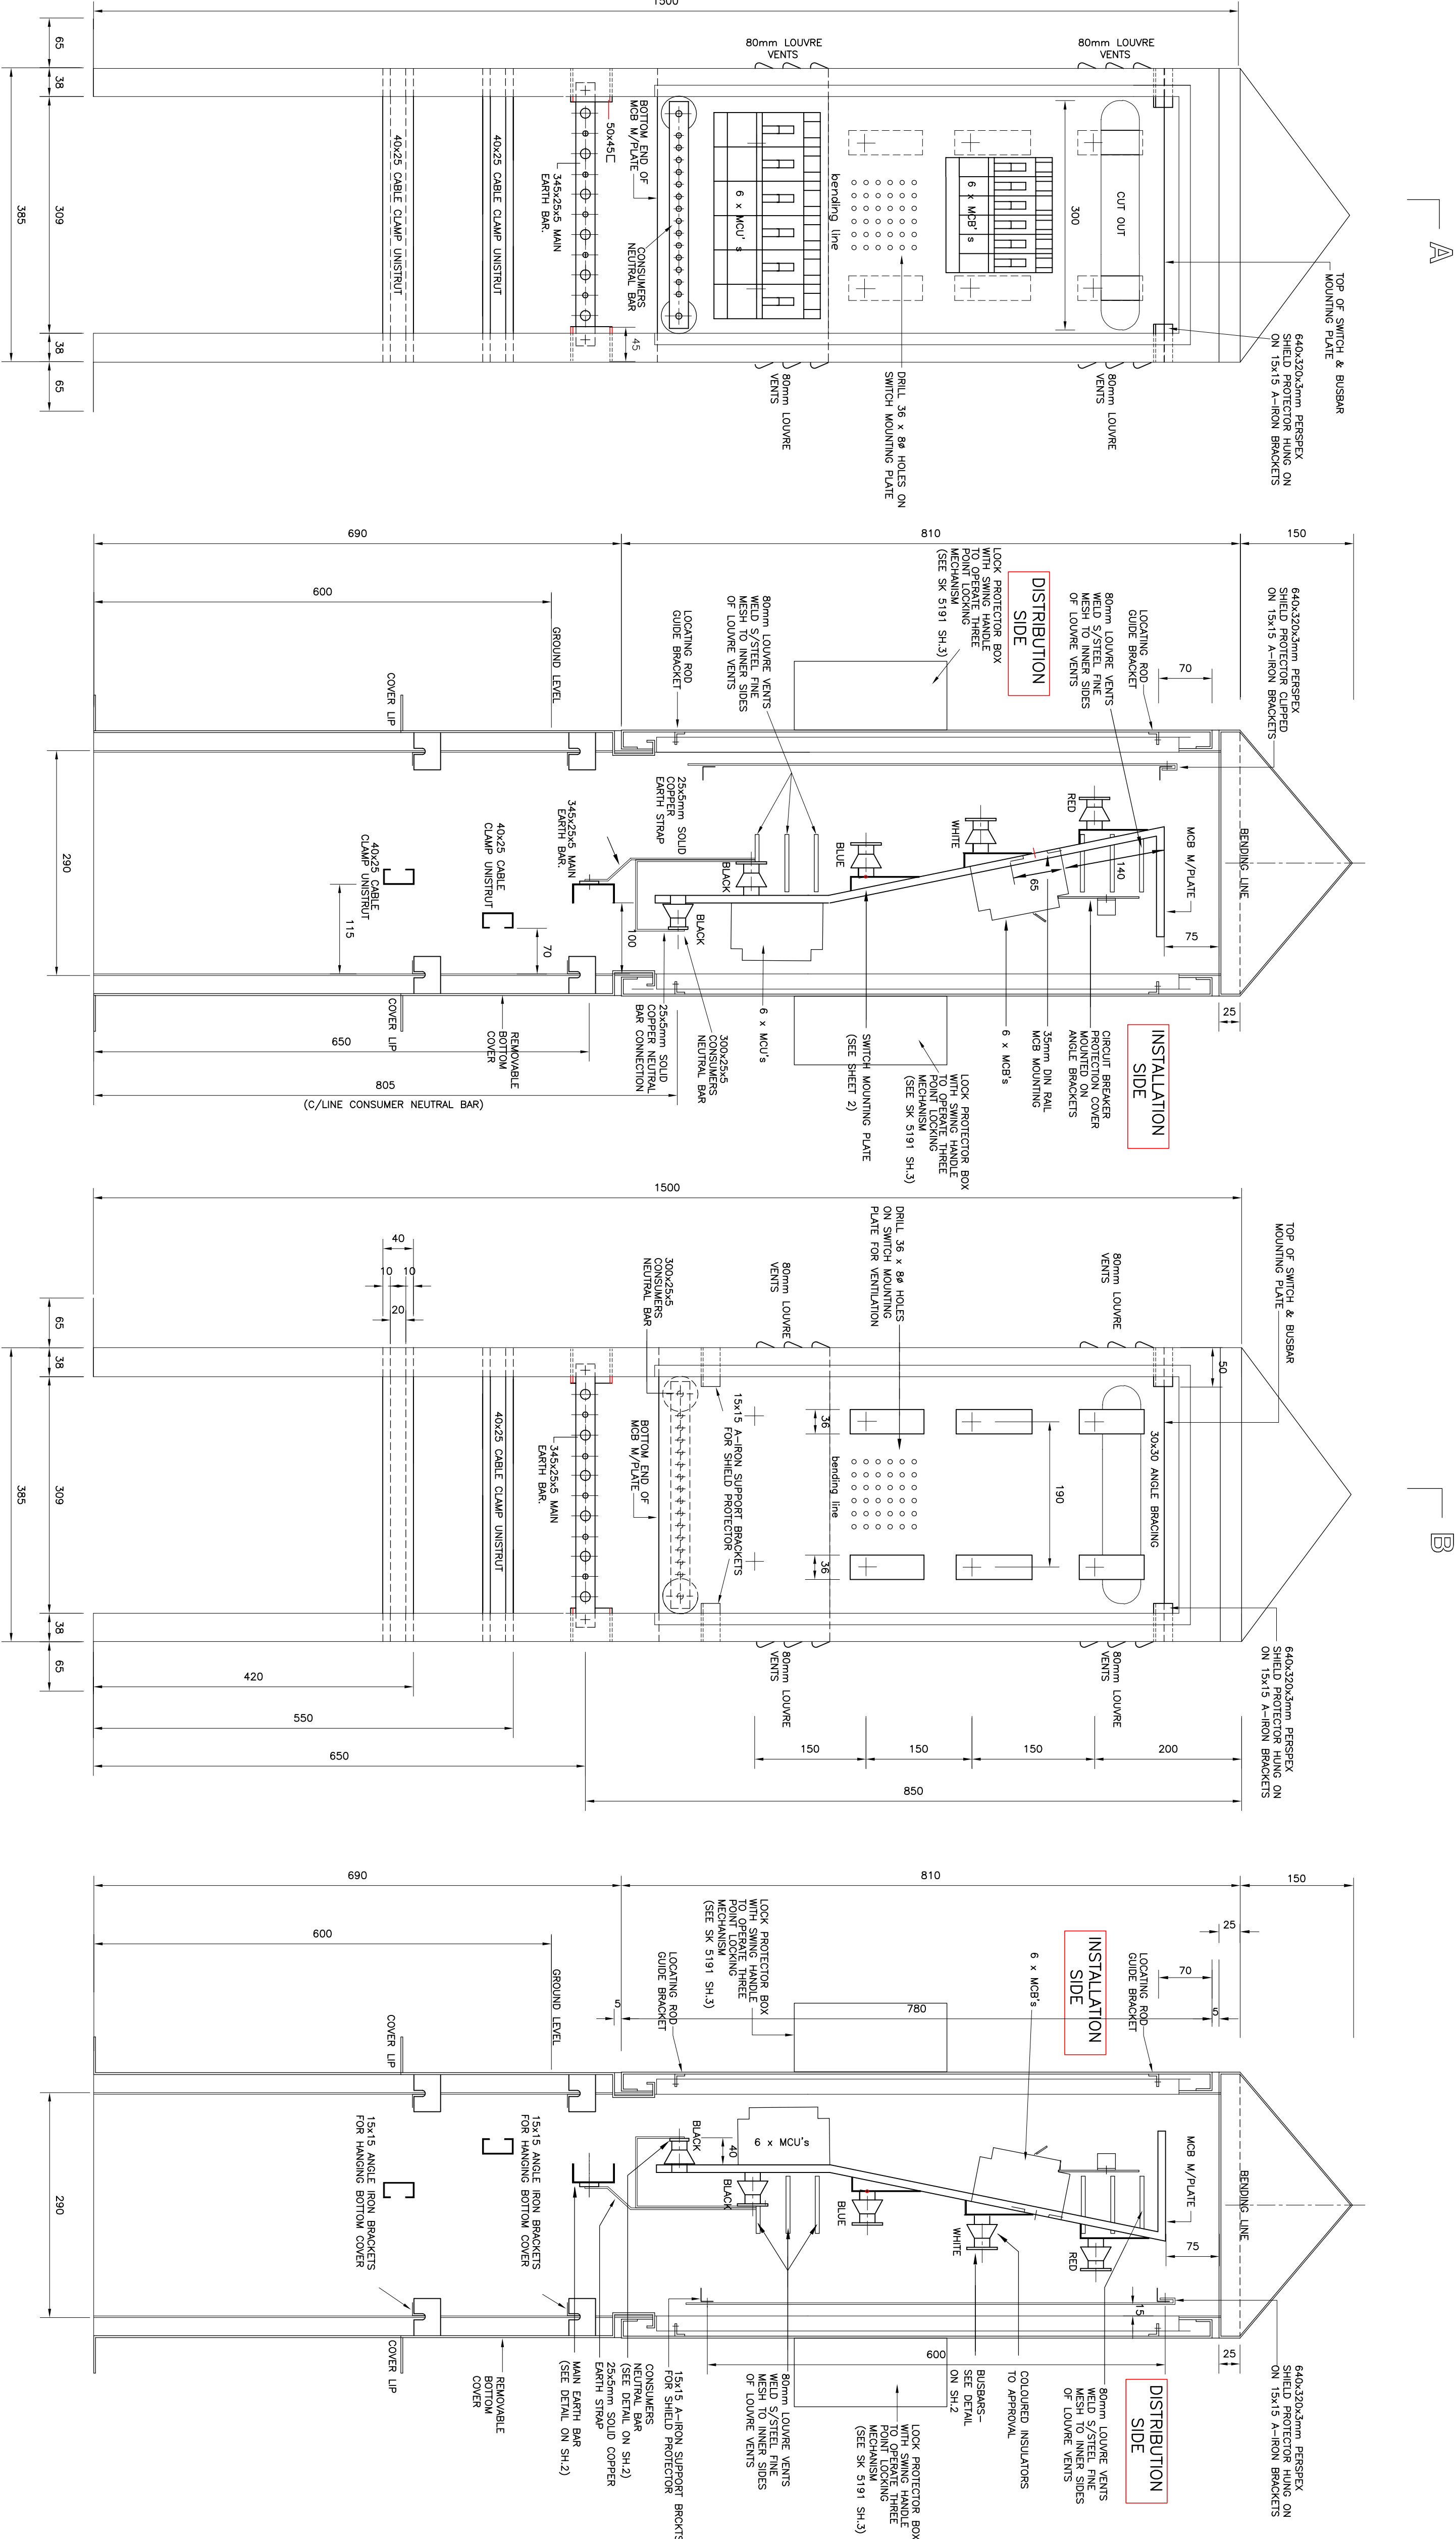

FRONT VIEW  
SCALE 1:5  
(AS VIEWED FROM INSTALLATION SIDE  
WITH DOOR AND COVER REMOVED)  
(BUSBARS NOT SHOWN)

SECTION A-A  
SCALE 1:5

REAR VIEW  
SCALE 1:5  
(AS VIEWED FROM DISTRIBUTION SIDE  
WITH DOOR AND COVER REMOVED)  
(BUSBARS NOT SHOWN)

SECTION B-B  
SCALE 1:5

- NOTE:--
1. MATERIAL TO BE 3CR12 OR EQUIVALENT STAINLESS STEEL OF A MINIMUM THICKNESS OF 1,6mm.
  2. ALL STEEL PARTS TO BE HOT DIPPED GALVANISED
  3. COPPER BUSBARS TO BE TINNED.
  4. ALL SCREWS & BOLTS COMPLETE WITH NUTS & FLAT SPRING WASHERS SHALL BE BRASS OR STAINLESS STEEL.
  5. BOLTS SUPPLIED WITH BUSBARS TO BE MIN. 40 LONG.
  6. M6 & M8 BOLTS TO BE 25mm LONG.
  7. FINE MESH S/STEEL EXPANDED METAL TO BE WELDED TO INNER SIDES OF LOUVER VENTS.