



**FRONT VIEW**  
SCALE : N.T.S

SEE DETAIL 'B'

9

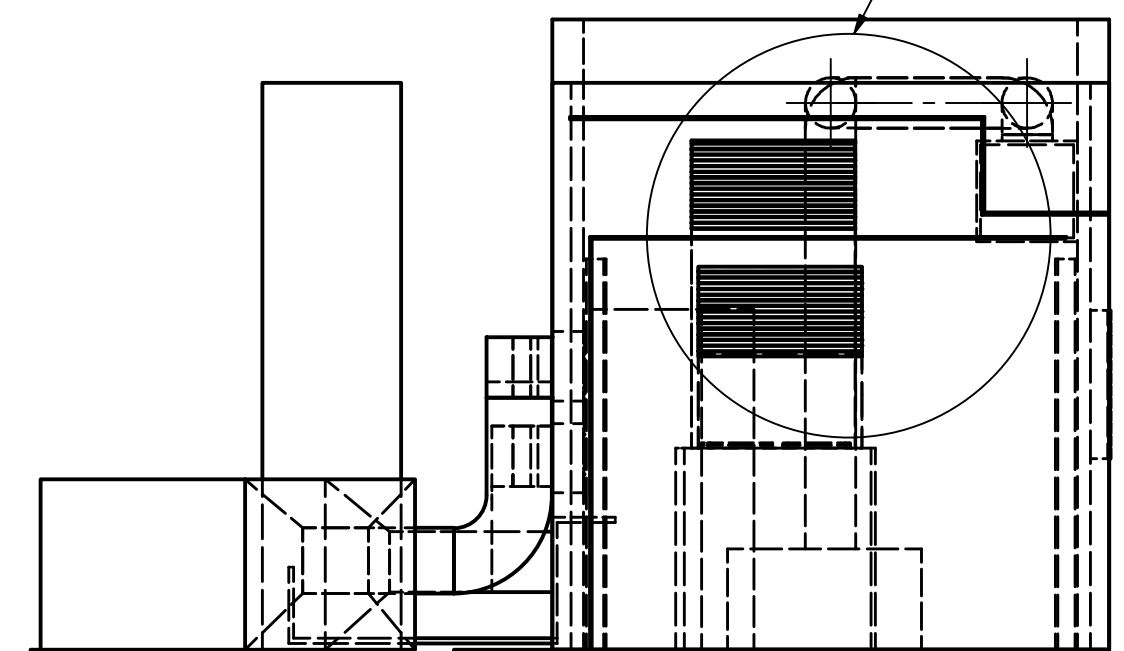


**SIDE VIEW**  
SCALE : N.T.S

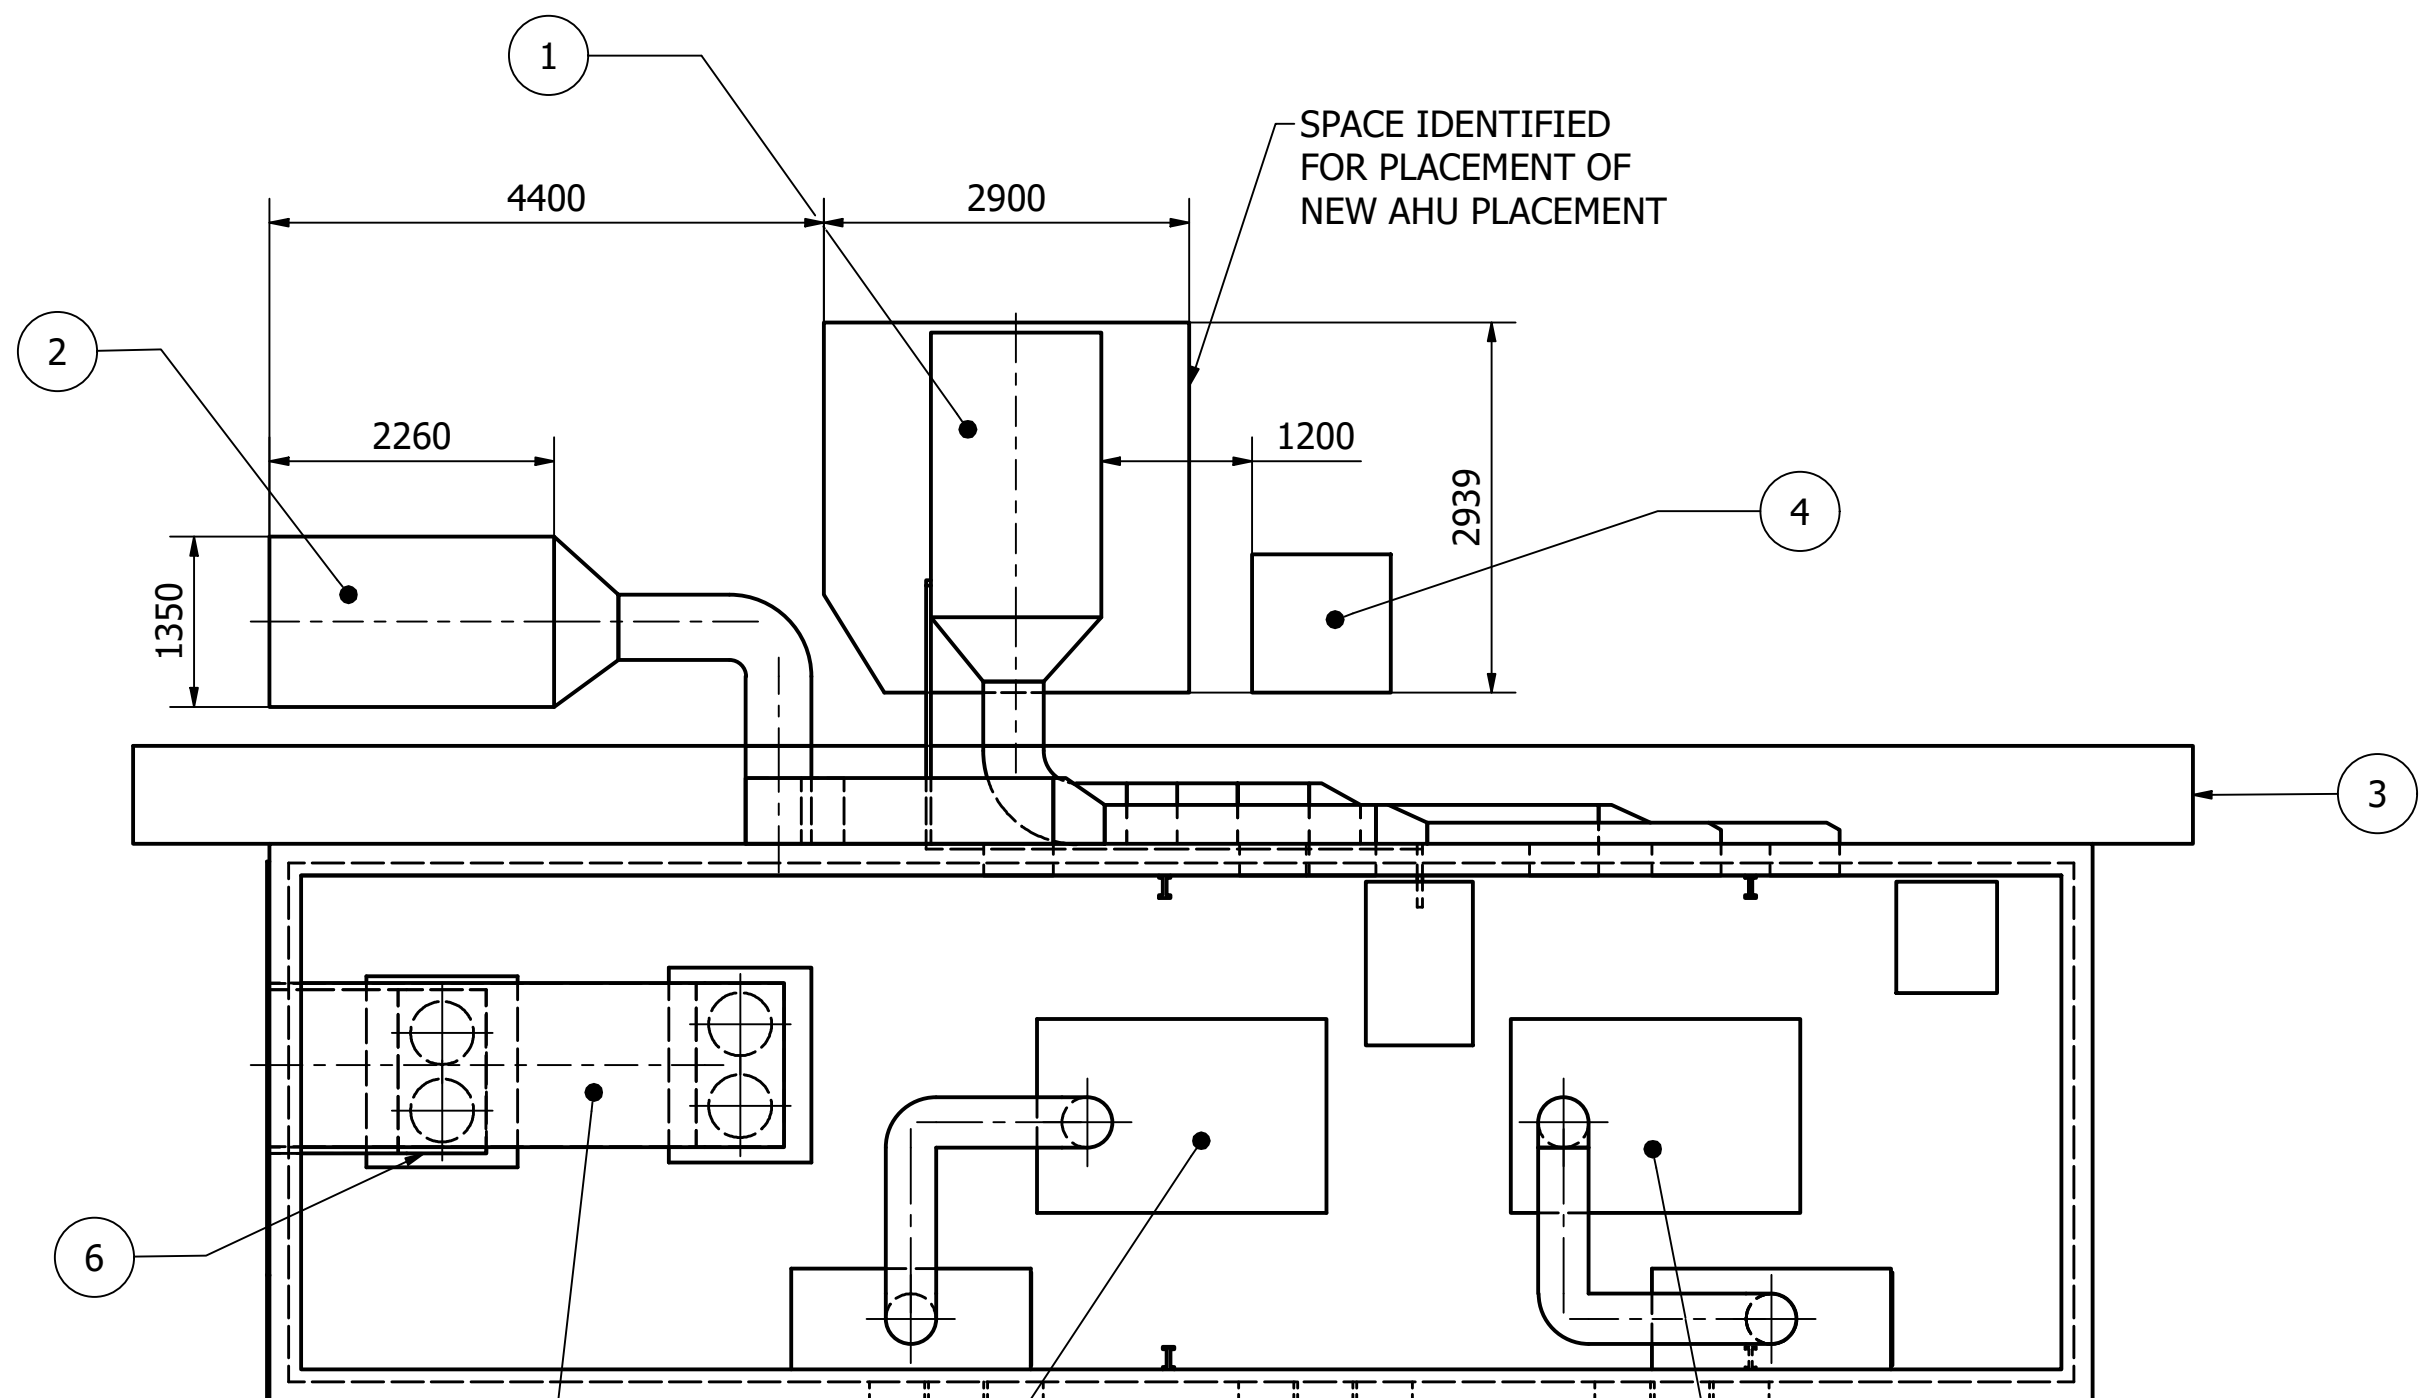


**TOP VIEW**  
SCALE : N.T.S

SPACE IDENTIFIED  
FOR PLACEMENT OF  
NEW AHU PLACEMENT

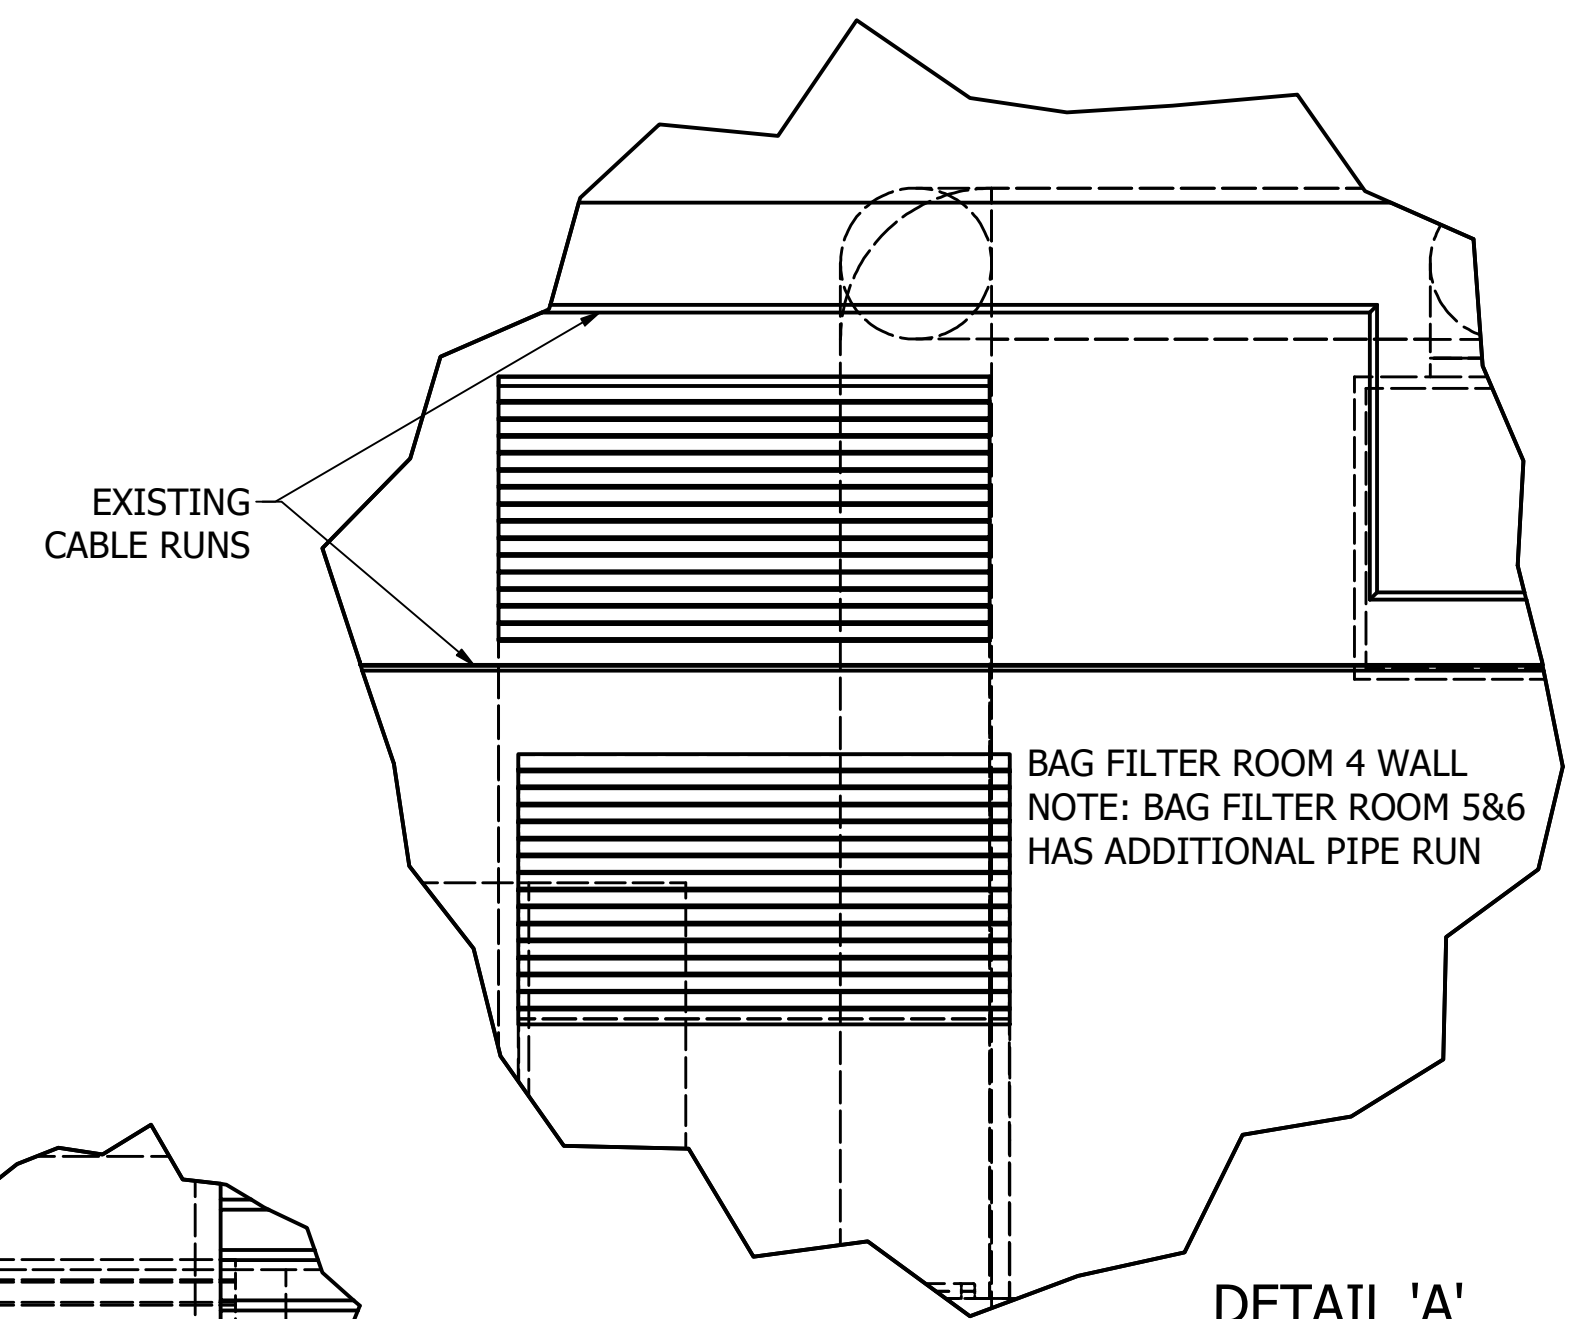

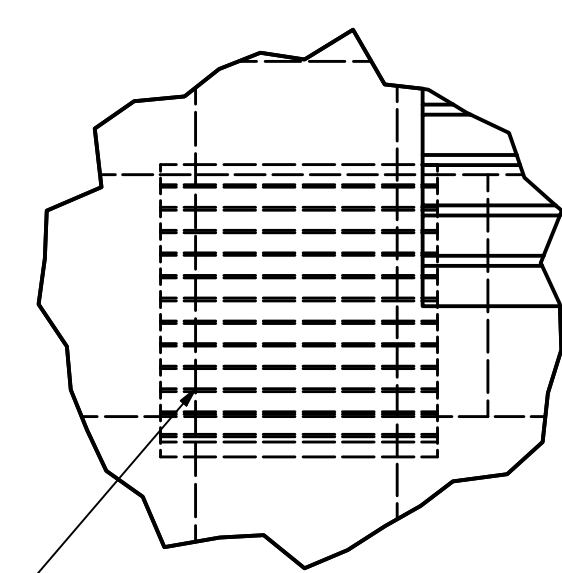

**DETAIL 'A'**  
SCALE 1:20



**DETAIL 'B'**  
SCALE 1:15

3-OFF 550mm x 550mm  
FRESHAIR INLETHOLES  
IN WALLFROM NEW AHU

26	--	--										
26	0	--	FIRST ISSUE									
D.O.	REV	DATE	** REVISION **				REV BY	CHKD BY	AUTH BY	KKS APP	REFERENCE DRAWINGS	
AUTHORISED BY :			APPROVED BY :				ARNOT POWER STATION GENERAL ARRANGEMENT OF BAG FILTER ROOM VENTILATION IMPROVEMENT COMPONENTS SHEET 1 OF 6					
KKS APP	--		ESKOM HOLDINGS LTD.									
CHKD BY	06 06 21	C.C.	REG. No. 2002/015527/06									
DRAWN BY	22 07 21	T.W.H					26.41/57037					
SCALE	SHWN											
												
							00					