



TYP. SECTIONAL ELEVATION


NOTE:
ALL CONDUITS WITH CABLES
MUST BE ENCASED IN CONCRETE
SEE TYP. TRENCH DRAWING
2684358-C-PLD-CP-DD-010




SECTION A-A

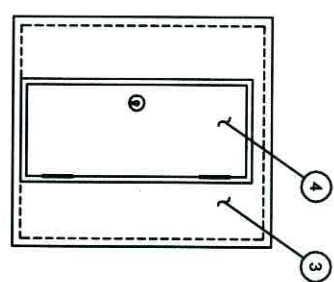

ELEVATION B-B

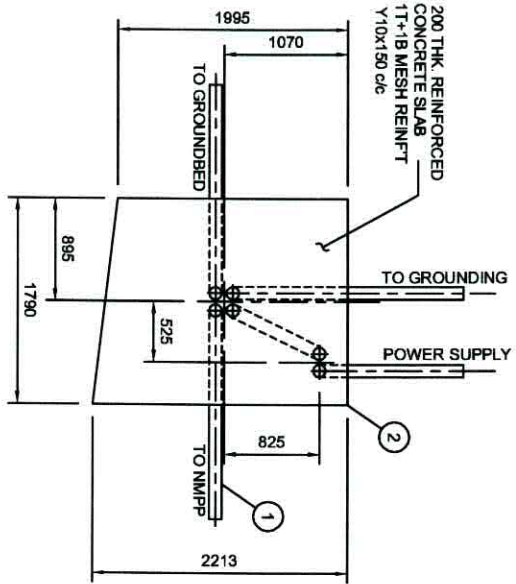

PLAN ON SLAB

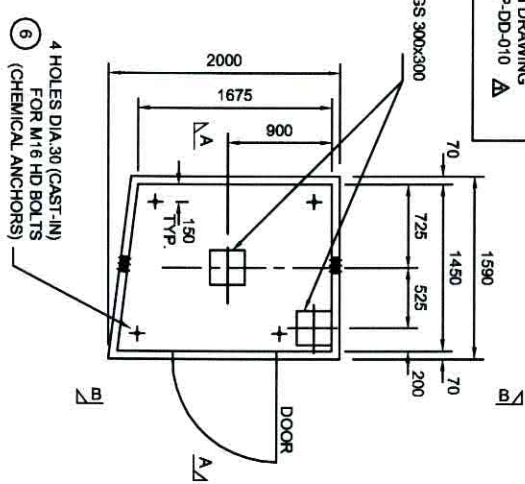

ENCLOSURE PLAN VIEW

NOTE:
1. SEE TYP. CABLE TRENCH DETAILS DRG. 2684358-C-PLD-CP-DD-010
FOR INSTALLATION OF CONDUITS.
3. CONCRETE COVER TO REINFORCING TYPICALLY 30mm

ITEM	QTY.	DESCRIPTION	MATERIAL
1	14m	RIPPLEFLEX CONDUIT 110Ø	PVC
2	0.72m ³	CONCRETE SLAB - REINFORCED	30 MPa CONCRETE
3	1	ROCLA CUBICLE	PRE-CAST CONCRETE
4	1	STANDARD SAFE DOOR	STEEL
5	1 m ³	MASS CONCRETE	20 MPa CONCRETE
6	4	M16 HD BOLTS CW 2650 WASHER	S/S CHEMICAL ANCHOR

Stalled 10-06-2009

REV	DATE	STATION	REVISION DESCRIPTION
0	10.06.09		ISSUED FOR CONSTRUCTION
1	31.10.09		REVISED WIRE NOTED



ITEM	QTY.	DESCRIPTION	MATERIAL
1	1	TRU ENCLOSURE DETAIL	

