




LEGEND

—x—x—x— 1.61Km SAFETY FENCE

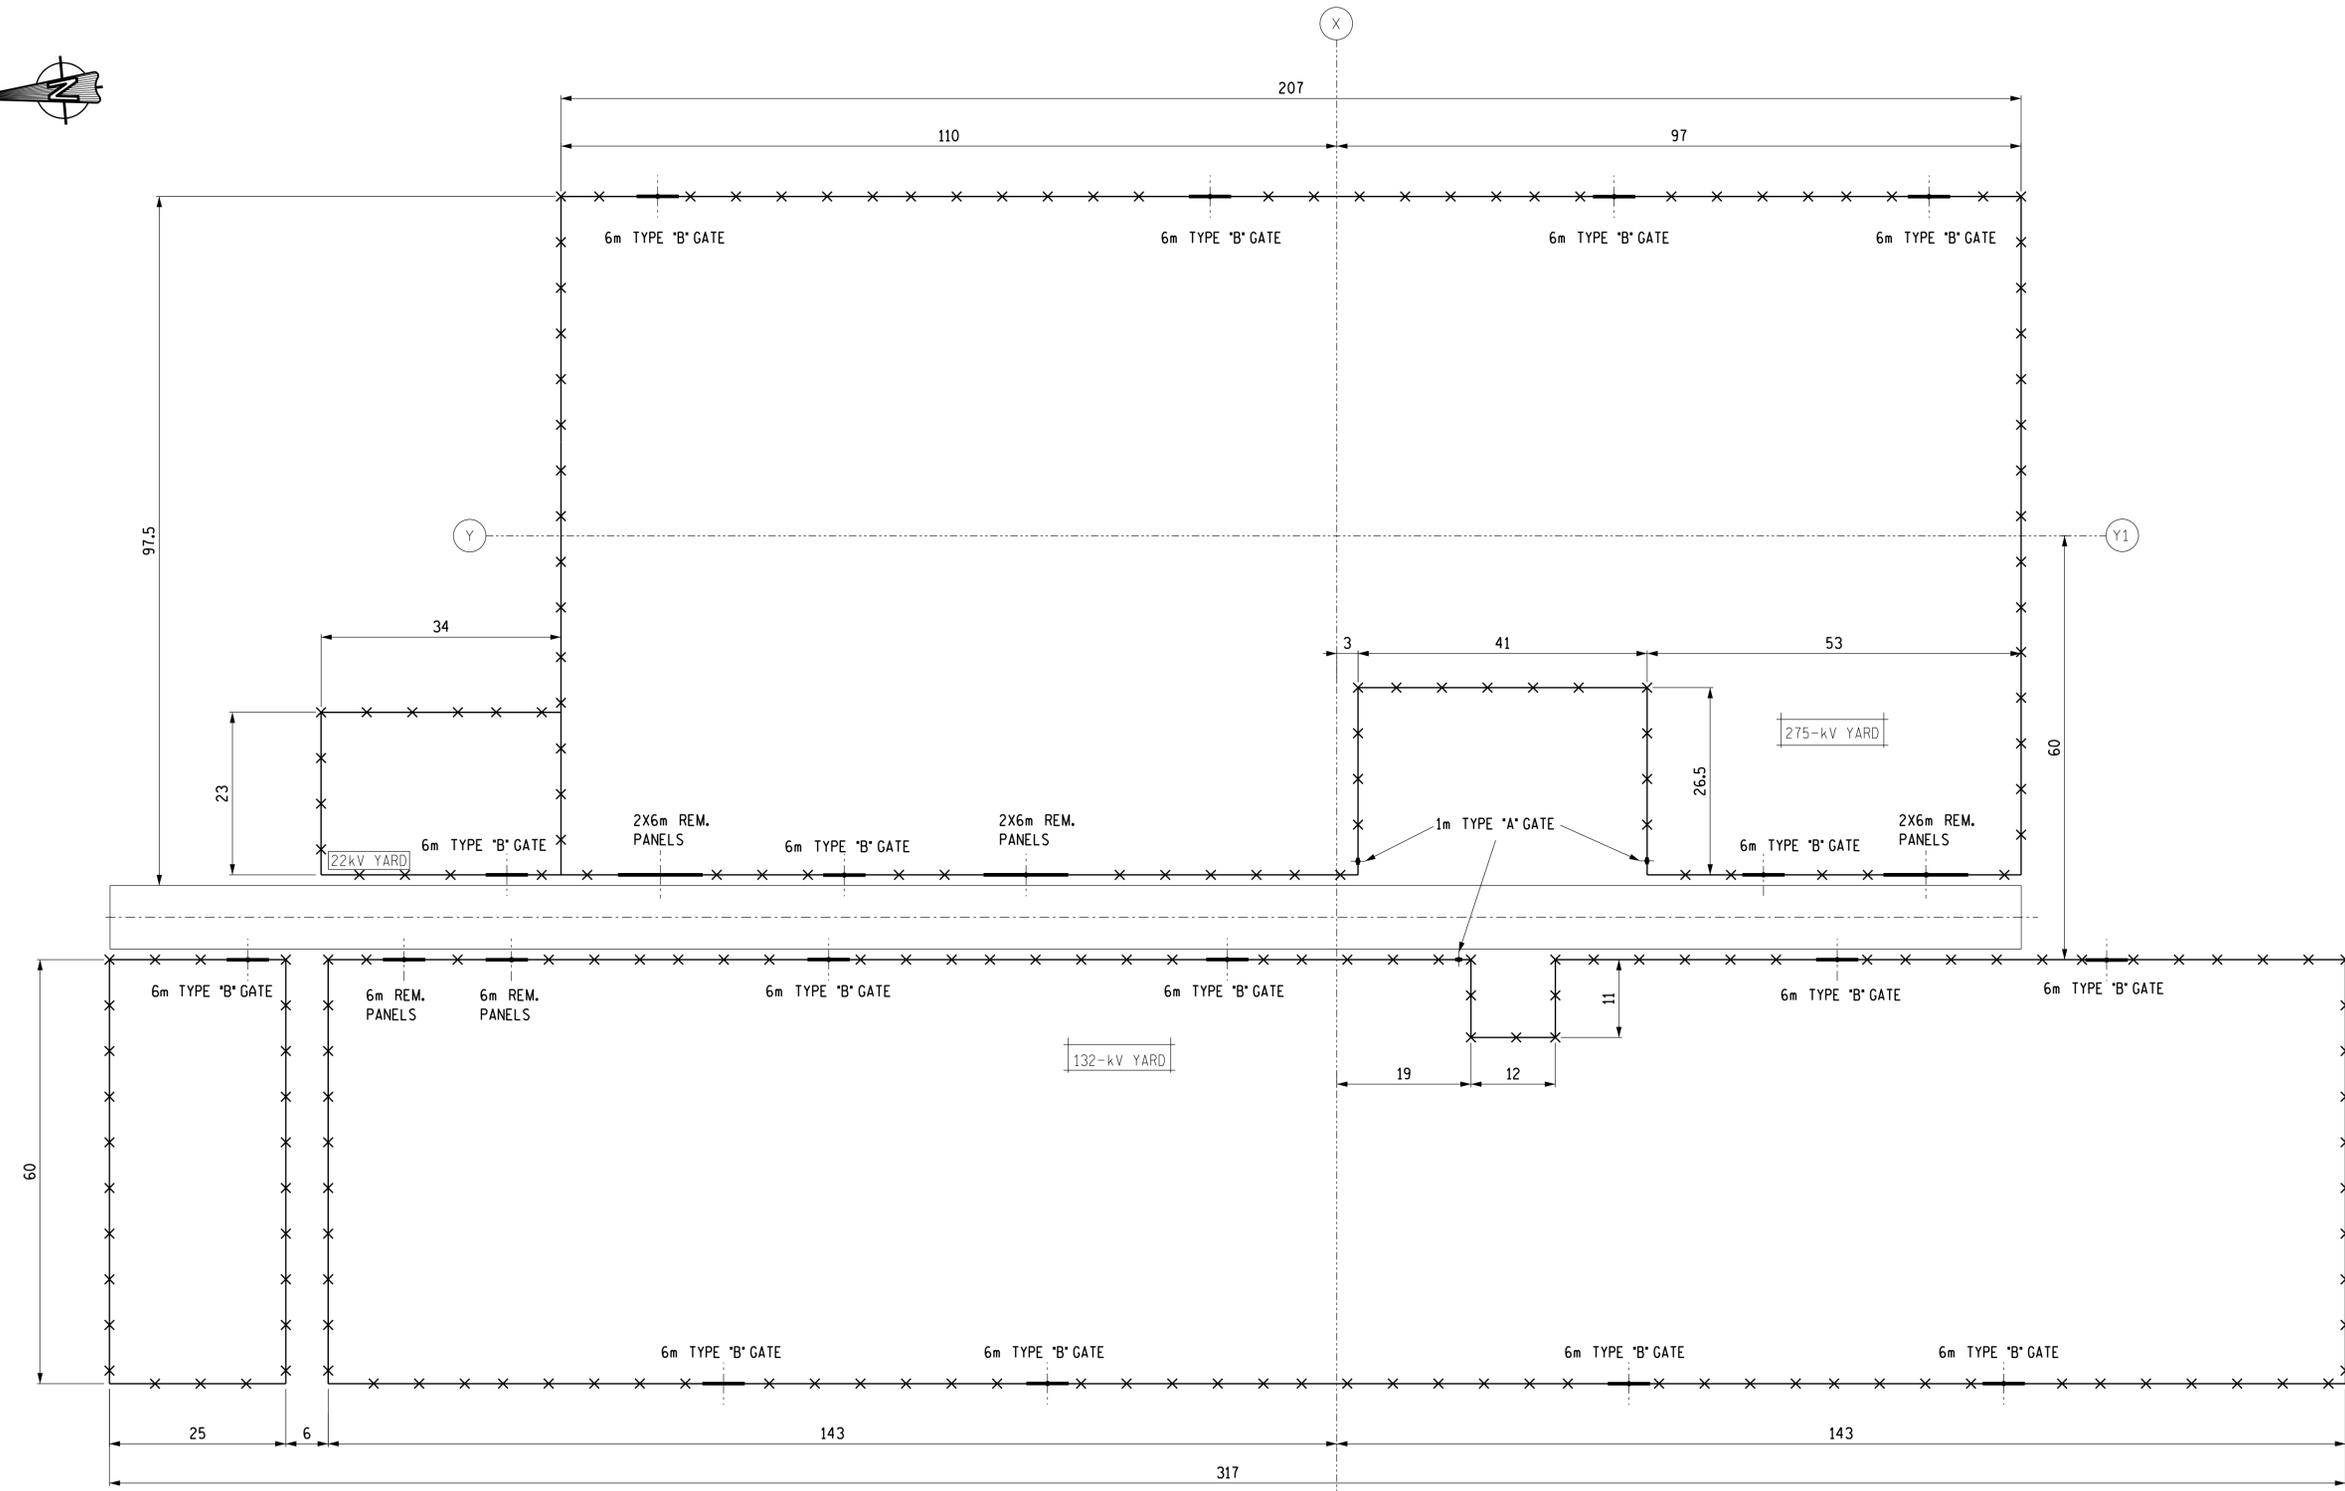

SCOPE OF WORK

1. REMOVE ALL STRANDS OF BARBED WIRE ON THE SINGLE OVERHANG AND REPLACE WITH NEW.
2. ALL MESHWIRE MUST BE REMOVED TO SPOIL AND REPLACED WITH NEW.
3. ALL THE POSTS, STAYS AND OVERHANG MEMBERS MUST BE PAINTED.
4. SURFACE PREPARATION, COATING APPLICATION PROCEDURES AND GUARENTEES MUST BE IN ACCORDANCE WITH ESKOM SPECIFICATION 240-75883230 PAGES 12 TO 16.
5. THE POST OR STAY MUST BE OPENED UNTIL THE CONCRETE IS EXPOSED.
6. REMOVE THE RUST STAINS WITH STEEL WOOL. CARE MUST BE TAKEN NOT TO DAMAGE THE GALVANISING.
7. IF PART OF A POST OR STAY IS FOUND TO BE RUSTED TO MORE THAN HALVE THE ORIGINAL THICKNESS, IT MUST BE REPLACED AS DETAILED IN DRAWING 0.54/4693.
8. AFTER SURFACE PREPARATION CLEAN MEMBER WITH PLASCON METALCARE GALVANISED IRON CLEANER.
9. APPLY ONE COAT PLASCON METALCARE GALVANISED IRON PRIMER, APPLY TWO COATS PLASCON METALCARE SILVERSHINE ALUMINIUM
10. ALL GATES (16 OFF 6m, 3 OFF 12m, 3 OFF 1m, 8 OFF 6m REMOVABLE PANELS) MUST BE REMOVED TO SPOIL AND REPLACED WITH NEW.
11. ALL GATES REQUIRE EARTH STRAPS.

**FINAL DESIGN
FOR CONSTRUCTION**

0	FIRST ISSUE	DB	END, TRENCH & E/MAT
REV	REVISION DESCRIPTION	DRAWN	CHKD
APPROVED BY		AUTH	DATE
DATE	07/06/2024	DATE	07
CHECKED BY	A. Mayer	DATE	07/06/2024
DRAWN BY	SAM TP	SCALE	1:500
DATE	27/05/2024	SHEET NUMBER	0
ESKOM		Eskom Holdings SOC Ltd Reg No 2002/015527/30	
PELLY		SAFETY FENCE LAYOUT	
PEL24P09-SE-E11		REVISION	0