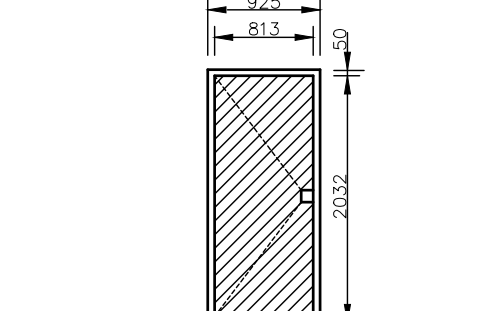


ENTRANCE DOOR	
FRAME TYPE	SINGLE REBATE STEEL FRAME TO FIT 220mm WALL (D1)
FRAME FINISH	PRIME AND PAINT UNDERCOAT AND 2nd FINISHING COATS IN GLOSS ENAMEL COLOUR TO ORDER
DOOR LEAF	14mm FRAMED LEDGED AND BRACED DOOR 9' 813x2032mm INCLUDING EXTERNAL WEATHER BAR
LEAF FINISH	UNDER COAT AND MINIMUM 2 COATS GLOSS ENAMEL - COLOUR TO ORDER
LOCK	3 LEVER MORTICE LOCK SET
IRONMONGERY	100mm BRACE CABIN HOOK

BUGLAR DOOR	
	
TYPE G1	2 OFF
POSITION	EXTERNAL TOILET BLOCK
DOOR TYPE	PURPOSE MADE SQUARE HOLLOW SECTION MILD STEEL SECURITY GATE
DOOR FINISH	1xCOAT ZINC CHROMATE PRIMER MINIMUM 1 x COATS GLOSS ENAMEL (EXTERNAL QUALITY)
FRAME	PO38x16mm M.S. RECTANGULAR HOLLOW SECTION FRAME
FRAME FINISH	1xCOAT ZINC CHROMATE PRIMER MINIMUM 2 x COATS GLOSS ENAMEL (EXTERIOR QUALITY)
DOOR	38x28x16mm RECTANGULAR HOLLOW SECTION FRAME WITH 28x28x16 INTERMEDIATES AT 100 CENTERS AT A 45° ANGLE COLOUR TBC
IRONMONGERY	SECURITY DOUBLE THROW DEAD LOCK (NO LATCH)

**NOTES AND SPECIFICATIONS:**

**GENERAL**

- 1. All dimensions provided and do not allow drawing.
- 2. All work to comply with SABS, PWS371 and SABS.
- 3. All dimensions, levels and positions to be verified on site prior to construction.
- 4. All concrete work to be to as per Engineer's details and specifications.
- 5. All pits to face North.
- 6. All concrete works to have a minimum of two concrete courses in pit lining and 3rd course in superstructure.

**PIT EXCAVATION**

- 1. All stages of pit excavation to be inspected and approved by Engineer and signed off.
- 2. All pit lining to be inspected by EnviroLoo Services before slab casting.

**COMPACTATION OF SURFACES**

- 1. All ground surfaces including concrete floors / slab should be compacted to 150mm dryers 93% MoistAridito density before casting concrete.

**CONCRETE WORKS**

- 1. All concrete to be as per Engineer's details and specifications.
- 2. 25 MPa strength concrete to be used throughout construction:

**Triax Concrete Mixes: Properties**

Concrete Strength at 28 Days 25Mpa:
1 : 2 : 1 (mix proportion by volume)
1 bag cement : 0.68m <sup>3</sup> Sand : 0.29m <sup>3</sup> Stone (Volume/Bag)
385 kg cement : 820 kg sand : 360 kg stone (Mass/m <sup>3</sup> )

- 1. Pre-cast concrete lintels to be used as support under top slab of pit.
- 4. All concrete aprons to be 1000mm wide.

**MORTAR**

Mix proportions to be:

1 cement : 3 sand
(i.e.1 bag cement : 3 wheelbarrows (37 litres) sand)

**BRICKWORK**

**Sub-structure**

- 1. All pit lining / foundation brickwork to be solid NFY brick.
- 2. All internal surface of pit lining to be plastered with two coats black epoxy paint.

**Super-structure**

- 1. All external walls / portions to be of clay face brick to SABS quality.
- 2. All cubic partition wall to be 3 courses above door height.
- 3. All brickwork above door openings should have brickwork on every course at least 3 courses.

**As per spec: Standard 230X125mm terra-cotta vermin proofed louvered air grating to be used above all window openings.**

**ROOF SHEETING**

- 1. 0.6mm kilplock chromadek roof sheeting.

**ROOF TIMBER / CEILING**

- 1. All roof timbers to be machined SABS treated wood with three coats of approved wood preservative.
- 2. All roof connections (Hurricane Clips) are required all interconnections between rafters and putins.
- 3. Sitation is to be applied interval under all roof surfaces.

**METALWORK**

- 1. All metalwork should be primed before installation.
- 2. All steel window should have 6x20mm flat bar burglar proofing.

**PLUMBING**

- 1. Double concrete wash trough to be used.
- 2. All wash troughs should be connected to the school's water supply system and the waste water should be piped to a soakaway.
- 3. The soakaway should be as per Engineer's detail and position to be determined on site.
- 4. Only 20mm and galvanised pipework should be used as connection from wall to the discharge points.

**GLAZING**

- 1. 6.28mm obscure safety glass

**PAINTING**

- 1. All paintwork to comply with SABS and PWS371 specification.
- 2. All steel window and door frames including doors and fascia / barge boards to be discharge points.

Project number: -	Drawing number: 102	Project Stage: Constr	Drawing Revision: 0
Scale: AS SHOWN		Drawn: TM	Checked: RM
First issue date: 2022/06/30		Latest issue date: 2022/08/16	