

170 PVD SKIRTING SCHEDULE			
Legend	Type Mark	Description	Length
	EPS 1	POWER SKIRTING TO BE AT FLOOR HEIGHT UNLESS OTHERWISE SPECIFIED ON PLAN. MODULES REQUIRED AS PER PLAN. COLOUR: WHITE	3.96 m

160 SPECIALTY EQUIPMENT SCHEDULE		
Type Mark	Description	Count
EQ1	600W x 650D x 1850mm H METALLIC SATIN 350L UPRIGHT FRIDGE FREEZER	2
EQ4	500W x 476D x 830mm H BLACK 98L UNDERCOUNTER BEVERAGE COOLER	1
EQ6	311W x 553D x 540mm H SILVER CONVECTION MICROWAVE	2
EQ7	598W x 600D x 850mm H SILVER 15PLACE DISHWASHER	2

EXISTING CAMERA POSITIONS TO BE RETAINED AND NEW FITTINGS INSTALLED.

CONTRACTOR NOTES:	
CORING & CHASING NOTES <ul style="list-style-type: none">- ALLOW TO CORE FOR FLOOR BOXES AND CHASE POWER SUPPLY IN BRICK WALLS.- CLIENT AND ENGINEER TO CONFIRM BEFORE CORING TAKES PLACE. ELECTRICIAN TO RUN 2X25MM CONDUITS, 1X 40MM CONDUIT FROM FLOOR BOX UP TO CEILING AND ALL POINTS.- ALLOW TO CHASE AND REPAIR WHERE SHOWN.- CONTRACTOR TO CONFIRM THE POSITION OF THE RUN.- ALL CHASING OR CORING TO BE APPROVED BY ENGINEER.- SCANNING TO HAPPEN PRIOR TO ANY CUTTING. CONSTRUCTION: <ul style="list-style-type: none">- ALLOW TO MAKE GOOD WALLS WHERE NEEDED. ELECTRICIAN: <ul style="list-style-type: none">- ALLOW TO CHASE AND REPAIR WHERE NECESSARY.- ALL POWER IN CEILING MUST TAKE PLACE BEFORE CEILINGS ARE COMPLETED.- CONFIGURATION OF CORPORATE CONNECTORS, POPUP, FLOOR BOXES AND SKIRTING TBC. CORPORATE CONNECTORS TO RECEIVE A LONGER INPUT CABLE.- ALLOW FOR POWER TO SCREENS WHERE INDICATED.- ENGINEER TO PROVIDE ALL WIRERAYS REQUIRED. DATA: <ul style="list-style-type: none">- ALLOW FOR 2 NETWORK POINTS PER USER.- ALL NETWORK CABLE TO BE CAT 6A TYPE UNLESS OTHERWISE SPECIFIED.- CABLE COLOURS TBC BY CLIENT. ACCESS CONTROL: <ul style="list-style-type: none">- ACCESS CONTROL AS PER ICT REQUIREMENTS. DATA SPECIALIST TO CONFIRM ALL REQUIREMENTS WITH ELECTRICAL ENGINEER AND ELECTRICIAN.	

REFER TO SPECIFICATION DOCUMENT FOR FULL SPECIFICATION ON SPECIALTY EQUIPMENT

CHASING NOTES

ALLOW TO CHASE AND REPAIR WHERE REQUIRED

GENERAL NOTES

1. COPYRIGHT

- 1.1 Copyright exists in terms of the Copyright Act, Act No. 98 of 1978.
- 1.2 Copyright in these drawings and in the designs which they depict vests in MHSC. Any unauthorised copying of the drawing or use of the design constitutes infringement of copyright and is a criminal offence.
- 1.3 In addition to criminal prosecution, the owner is entitled to sue for damages and claim delivery of the infringing copies.
- 1.4 Copyright infringement includes the sale or distribution of the copy and 'COPY' includes the adaptation thereof.

2. DRAWINGS

- Shop drawings must be approved by the designer prior to the manufacture of any shopfitting or furniture items.
- Detail drawings must be preferred to arrangement drawings.
- One set of drawings are to be kept on site at all times.
- All superseded drawings are to be clearly marked 'SUPERSEDED' and a copy of the superseded drawing is to be handed to the contractor.

3. DIMENSIONS

- Contractors and subcontractors are to check and verify dimensions and detail levels before commencing with work.
- Figured dimensions are to be taken in preference to scaled dimensions.

4. VARIATIONS AND AMENDMENTS

- The designer is to be notified of any variation by the Project Manager.

- All relevant detail, levels and dimensions of any work done, must be checked on site by all contractors. Any discrepancies are to be reported to the relevant designer at Turnkey Interiors' immediately.

5. CONTRACTORS, SUBCONTRACTORS AND ARTISANS

- Contractors must ensure the structural stability of all components of their work, and ascertain that the main structure is capable of supporting all loads applied thereto.
- All electrical and drainage work is to be executed by the registered artisans.

6. SHOPFITTED ITEMS

- Shopfitted items are to be measured on site and shop drawings are to be approved by the relevant designer and client PRIOR to material order and manufacture.

7. PARTITIONS


- All partitions on outside walls are set out from center lines of columns or window mullions. Any dimensional errors should be accommodated within these parameters.
- All partitions to be rodent proofed and have a minimum of 30 minute fire rating.

ISSUED
2025.09.02
TENDER DWG ONLY

REVISION SCHEDULE

NO	DESCRIPTION	DATE
J	ISSUED FOR COSTING	2025.07.14
K	ISSUED FOR APPROVAL	2025.07.17
L	REVISED AS PER CLIENT REQUIREMENTS	2025.07.23
M	REVISED AS PER ICT	2025.07.23
N	ISSUED FOR TENDER	2025.07.25
O	REVISED FOR COORDINATION	2025.08.18
P	ISSUED FOR TENDER	2025.09.02

REFER TO ALL RELEVANT LAYOUTS BEFORE COSTING AND CONSTRUCTION

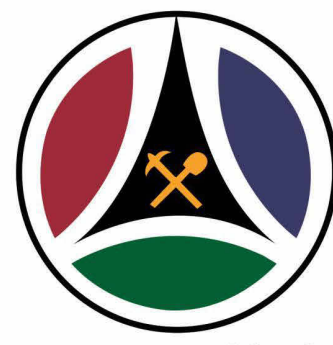

MHSC
Mine Health and Safety Council

APPROVAL SIGNATURES:

A1

APPROVAL DATE:

DATE DRAWN:

DRAWN BY/CHECKED BY
KK

PROJECT No.
MHSC

SCALE
1 : 100

MHSC OFFICE RENOVATION
TUSCANY OFFICE PARK

DRAWING TITLE:

UPPER LEVELS PVD LAYOUT

DWG No.


170.01

P

ISSUED FOR: TENDER

170.01 1F PVD LAYOUT

1 : 100

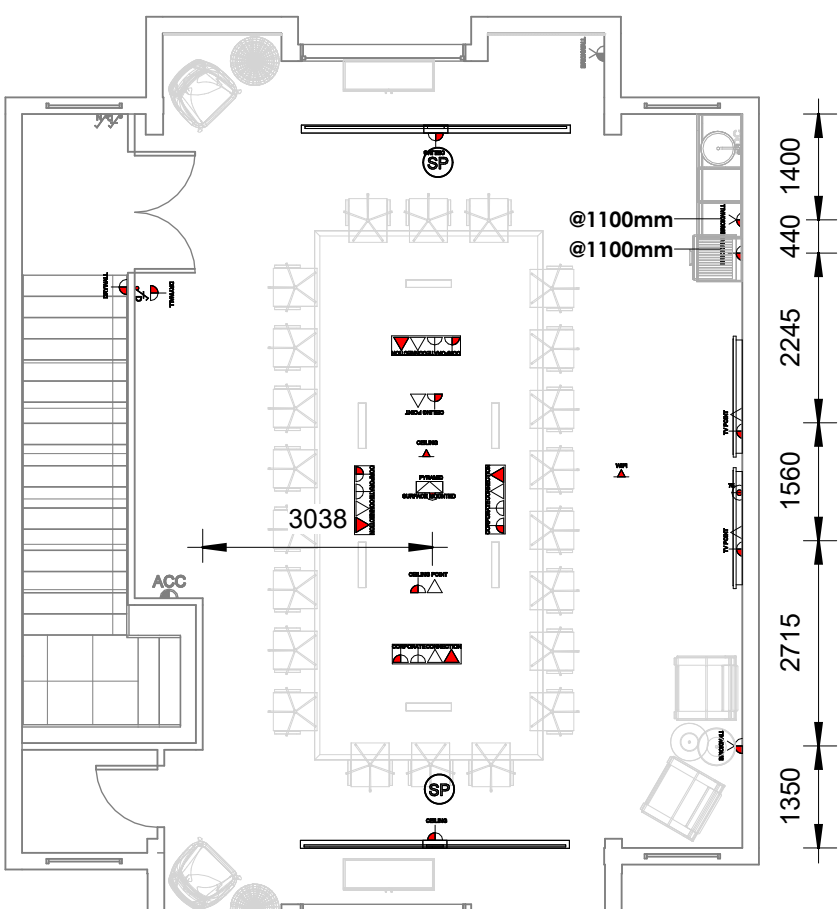

170.02 2F PVD LAYOUT

1 : 100

170 PVD SCHEDULE				
Legend	Type Mark	Description	Standard Installation Height	QTY
AC	EL AC	ACCESS CONTROL POINT-ALLOW FOR DATA (CAT 6A) AND POWER POINT (OLD SA 3 PIN).	1100mm AFFL	10
BRICK WALL	EL B1	SINGLE NORMAL POWER POINT TO BE INSTALLED IN BRICK WALL. TO BE CHASED. FITTING: SINGLE SOCKET WITH 4X4 COVERPLATE. COLOUR: BLACK MODULES ON GRAPHITE COVER. MODULE: BLACK MODULE -1 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	12
BRICK WALL	EL B2	DOUBLE NORMAL POWER POINT INSTALLED IN BRICK WALL. TO BE CHASED. FITTING: DOUBLE SOCKET WITH 4X4 COVERPLATE. COLOUR: BLACK MODULES ON GRAPHITE COVER. MODULE: BLACK MODULE -2 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	11
BRICK WALL	EL B3	SINGLE DEDICATED POWER POINT INSTALLED IN BRICK WALL. TO BE CHASED. FITTING: SINGLE DEDICATED SOCKET WITH 4X4 COVERPLATE. COLOUR: RED MODULES ON GRAPHITE COVER. MODULE: 1 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	1
BRICK WALL	EL B4	DOUBLE DEDICATED POWER POINT INSTALLED IN BRICK WALL. TO BE CHASED. FITTING: DOUBLE DEDICATED SOCKET WITH 4X4 COVERPLATE. COLOUR: RED MODULES ON GRAPHITE COVER. MODULE: 2 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	6
CEILING	EL C1	SINGLE 16A POWER SOCKET TO BE INSTALLED IN CEILING VOID. STANDARD WHITE FITTING TO BE INSTALLED. MODULE: 1X OLD SA 3 PIN NOT SWITCHED	IN CEILING VOID	3
CEILING	EL C2	DOUBLE 16A POWER SOCKET TO BE INSTALLED IN CEILING VOID. STANDARD WHITE FITTING TO BE INSTALLED. MODULE: 2X OLD SA 3 PIN NOT SWITCHED	IN CEILING VOID	4

170 PVD SCHEDULE				
Legend	Type Mark	Description	Standard Installation Height	QTY
BRICK WALL	EL CC1	IN DESK CORPORATE CONNECTOR. MODULES: 1X OLD SA 3 PIN, 1X NEW SA 3 PIN, 1X DEDICATED RED OLD SA 3 PIN, 1X DEDICATED RED NEW SA 3 PIN, 1X USB A, 1X USB C, 1X HDMI, 1X DATA PASS THROUGH. COLOUR: GRAPHITE. (BODY AND MODULES) MOUNTING: FLUSH IN DESK SURFACE -CUTOUTS TO BE MADE PRIOR TO INSTALLATION. TECHNICAL SPECIFICATIONS: BODY MATERIAL: ANODISED ALUMINIUM MAX CURRENT: 16Amp OPERATING VOLTAGE: 220-240V AC 50/60Hz; USB CONNECTOR STRENGTH: 30W SHARED CORD LENGTH: 4m STANDARD	TOP - FLUSH	4
BRICK WALL	EL CC2	IN DESK CORPORATE CONNECTOR. MODULES: 1X OLD SA 3 PIN, 1X NEW SA 3 PIN, 1X USB A, 1X HDMI, 1X DATA PASS THROUGH. COLOUR: GRAPHITE. (BODY AND MODULES) MOUNTING: FLUSH IN DESK SURFACE -CUTOUTS TO BE MADE PRIOR TO INSTALLATION. TECHNICAL SPECIFICATIONS: BODY MATERIAL: ANODISED ALUMINIUM MAX CURRENT: 16Amp OPERATING VOLTAGE: 220-240V AC 50/60Hz; USB CONNECTOR STRENGTH: 30W SHARED CORD LENGTH: 4m STANDARD	TOP - FLUSH	1
BRICK WALL	EL CC3	IN DESK CORPORATE CONNECTOR. MODULES: 1X OLD SA 3 PIN, 1X NEW SA 3 PIN, 1X DEDICATED RED OLD SA 3 PIN, 1X DEDICATED RED NEW SA 3 PIN, 1X USB A, 1X USB C, 1X DATA PASS THROUGH. COLOUR: GRAPHITE. (BODY AND MODULES) MOUNTING: FLUSH IN DESK SURFACE -CUTOUTS TO BE MADE PRIOR TO INSTALLATION. TECHNICAL SPECIFICATIONS: BODY MATERIAL: ANODISED ALUMINIUM MAX CURRENT: 16Amp OPERATING VOLTAGE: 220-240V AC 50/60Hz; USB CONNECTOR STRENGTH: 30W SHARED CORD LENGTH: 4m STANDARD	TOP - FLUSH	4
BRICK WALL	EL CD1	UNDER DESK DAISY CHAIN POWER UNIT. INCLUDE MODULES: 1X DEDICATED 3 PIN, 1X NORMAL 3 PIN, 1X NEW SA 3 PIN, DATA TO BE RETICULATED TO DESK THROUGH UNDER DESK CABLE TRAYS.		20
CEILING/SOFFIT	EL CW	WIFI POINT TO BE INSTALLED IN CEILING	CEILING/SOFFIT	7

170 PVD SCHEDULE				
Legend	Type Mark	Description	Standard Installation Height	QTY
DRYWALL	EL D1	SINGLE NORMAL POWER POINT TO BE INSTALLED IN DRYWALL. FITTING: SINGLE SOCKET WITH 4X4 COVERPLATE. COLOUR: BLACK MODULES ON GRAPHITE COVER. MODULE: BLACK MODULE -1 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	57
DRYWALL	EL D2	DOUBLE NORMAL POWER POINT TO BE INSTALLED IN DRYWALL. FITTING: DOUBLE SOCKET WITH 4X4 COVERPLATE. COLOUR: BLACK MODULES ON GRAPHITE COVER. MODULE: BLACK MODULE -2 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	9
DRYWALL	EL D4	DOUBLE DEDICATED POWER POINT TO BE INSTALLED IN DRYWALL. FITTING: DOUBLE DEDICATED SOCKET WITH 4X4 COVERPLATE. COLOUR: RED MODULES ON GRAPHITE COVER. MODULE: 2 X 16A OLD SA 3 PIN -SWITCHED	300mm AFFL	44
DRYWALL	EL DP	DATA POINT. MINIMUM REQUIREMENT FOR CABLING: CAT-6A	300mm AFFL	61
ISOLATOR	EL IS	60AMP ISOLATOR SWITCH - FITTING: ONESTO MATRIX 60A ISOLATOR SWITCH MODULE WITH 4X4 COVERPLATE. COLOUR: BLACK MODULES ON GRAPHITE COVER.	AS PER PLAN	2
NO TOUCH ACCESS CONTROL	EL NT	NO TOUCH ACCESS CONTROL - ALLOW FOR DATA AND NORMAL POINT	1100mm AFFL	9
POP UP FLOOR BOX	EL PC	POP UP BOX TO BE INSTALLED IN FLOOR. 145X146mm SOFT POP UP STYLE FLOOR BOX. MATERIAL: ALUMINIUM ALLOY. COLOUR: SILVER. MOUNTING: TO BE CHASED INTO SLAB (SUBJECT TO APPROVAL BY STRUCTURAL ENGINEER). MODULES: TO INCLUDE 1X OLD RSA 3 PIN, 1X DEDICATED RED OLD RSA 3 PIN, 2X DATA, 1X COMBINATION TRIPLE SLIMLINE NEW RSA 3 PIN.	FLUSH WITH FLOOR FINISH	1

INSTALLATION HEIGHT TO BE USED UNLESS OTHERWISE SPECIFIED ON DRAWING