



Notes


- 1) All dimensions in meters (m) unless specified
- 2) All light poles to be spaced 30m apart
- 3) Photocell will be installed on the first light pole of each run
- 4) Manholes are located at significant corners and end of runs
- 5) Trench specifications A & B to be used for the full lighting runs
- 6) Red Line indicates 95mm² cable
- 7) Pink Line indicates 16mm² cable

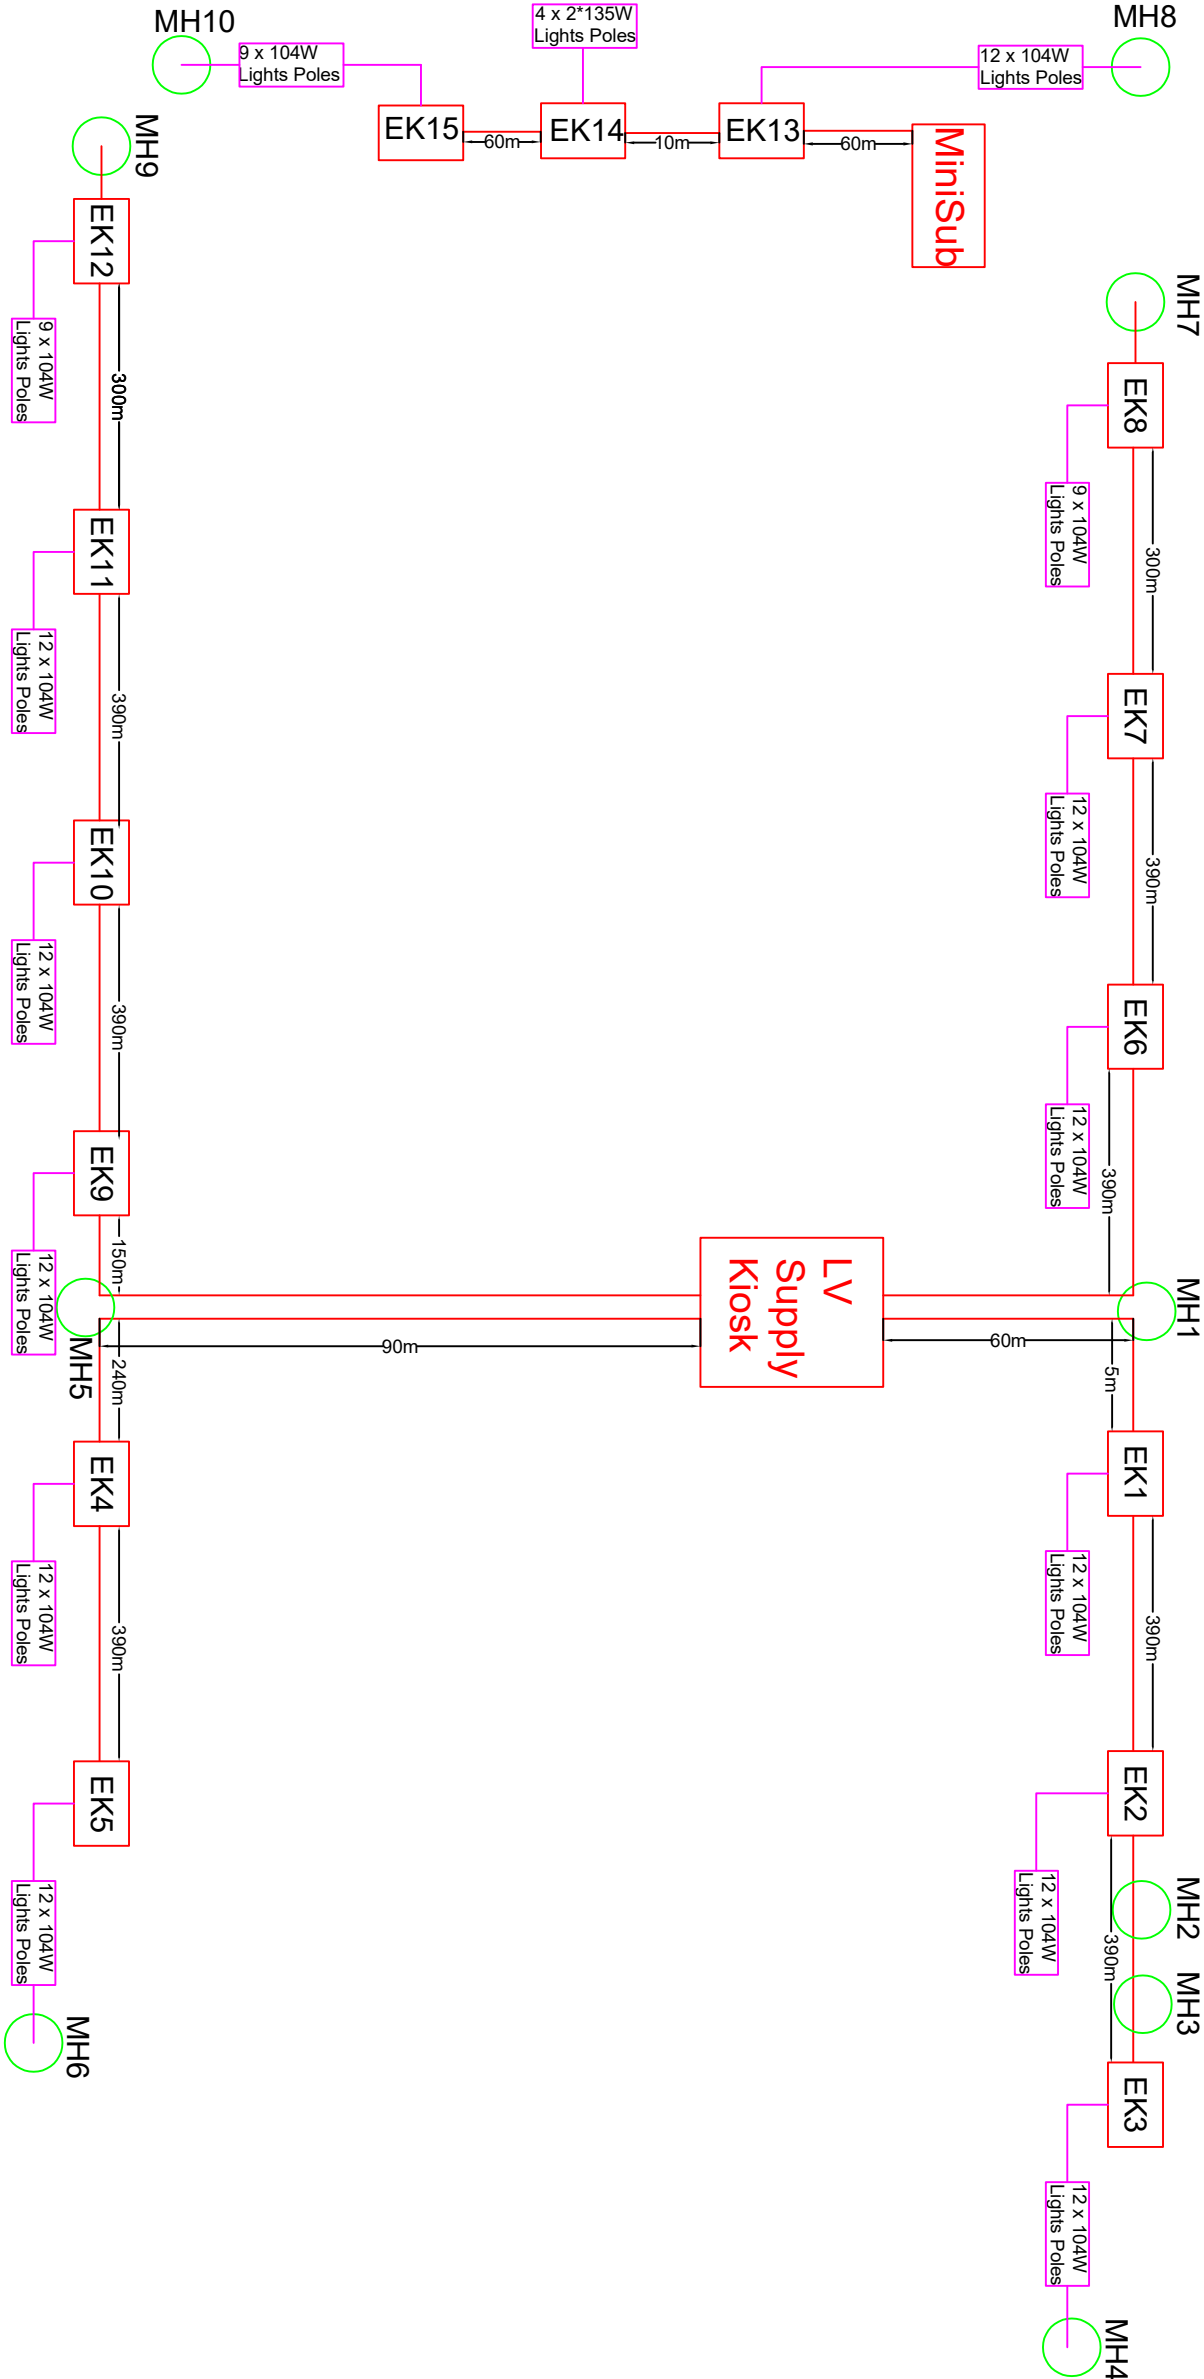

TRENCHING
SPECIFICATION A
(Dimensions in mm)

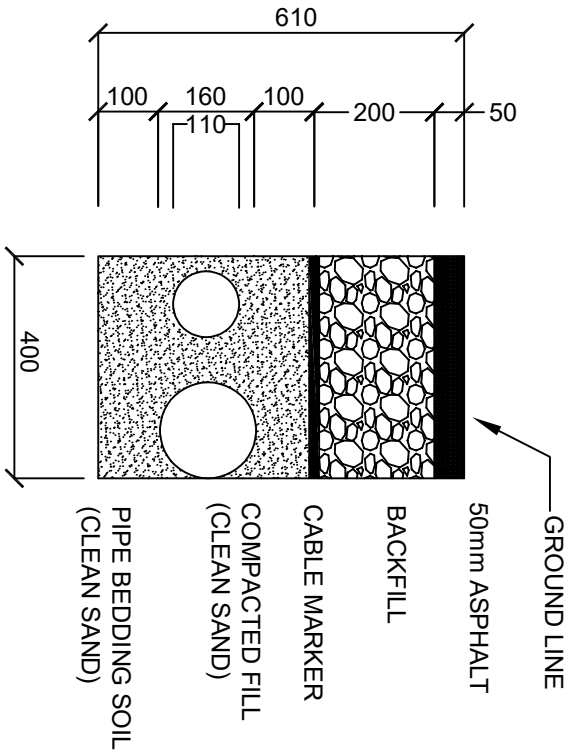

TRENCHING
SPECIFICATION B
(Dimensions in mm)

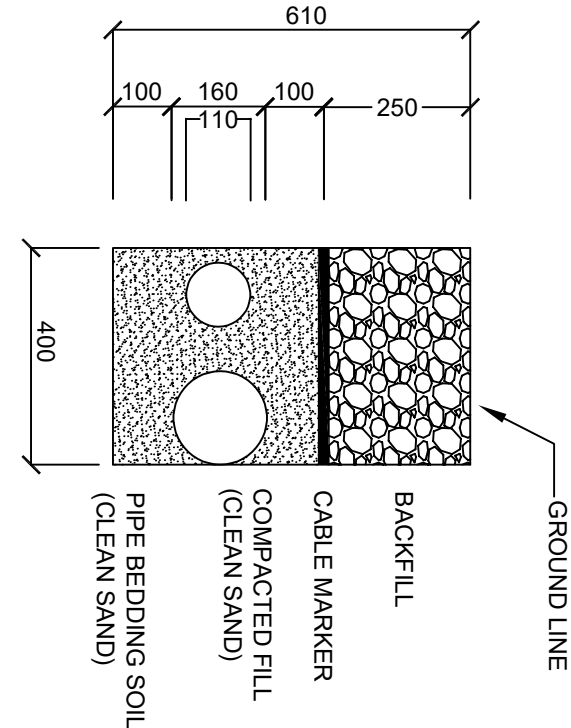

Notes

1) All dimensions in meters (m) unless specified

2) All light poles to be spaced 30m apart

3) Photocell will be installed on the first light pole of each run

4) Manholes are located at significant corners and end of runs

5) Trench specifications A & B to be used for the full lighting runs

6) Red Line indicates 95mm² cable

7) Pink Line indicates 16mm² cable

No.

TBH.106 R9-1

DATE

03/11/2023

SHEET

01

CAD. REF.

AMENDMENT

FILE REF.

DRAWN

G Dawood

CHECKED

M Raven

SCALE

NTS

PAGE SIZE

A3

PORT ENGINEER

ROOM 705

NPA HOUSE

PORT OF CAPE TOWN

P.O.BOX 4245

TEL. 021 449 6173

FAX. 021 449 6171

delivering on our commitment to you

TRANSNET

national ports authority

PORT OF CAPE TOWN

Culemborg

Perimeter Lighting

Electrical Layout &

Trenching Specification