


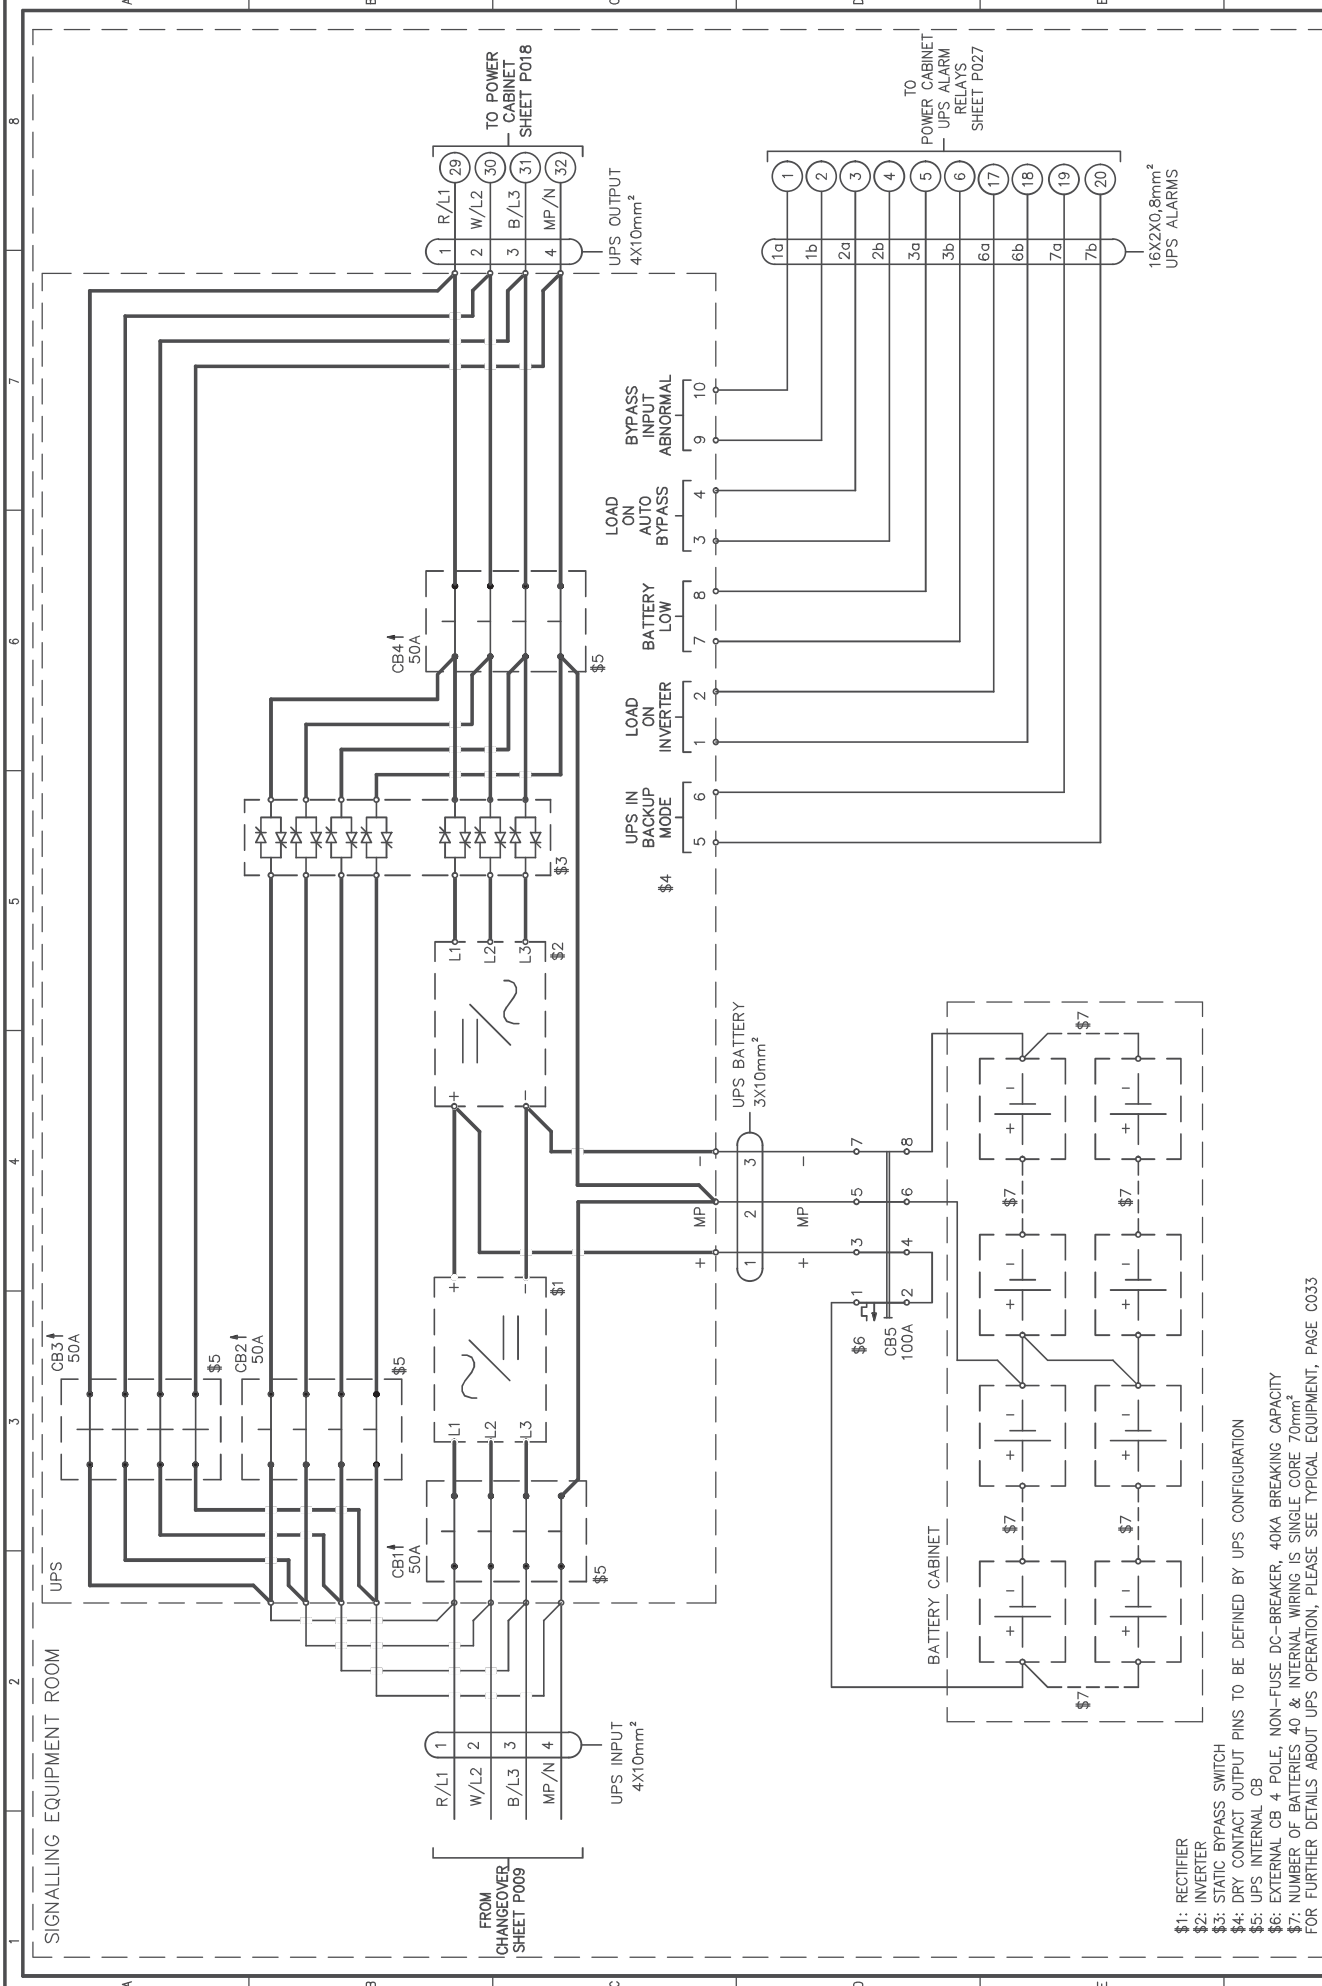

- \$1: RECTIFIER
- \$2: INVERTER
- \$3: STATIC BYPASS SWITCH
- \$4: DRY CONTACT OUTPUT PINS TO BE DEFINED BY UPS CONFIGURATION
- \$5: UPS INTERNAL CB
- \$6: EXTERNAL CB 4 POLE, NON-FUSE DC-BREAKER, 40KA BREAKING CAPACITY
- \$7: NUMBER OF BATTERIES 40 & INTERNAL WIRING IS SINGLE CORE 70mm²

FOR FURTHER DETAILS ABOUT UPS OPERATION, PLEASE SEE TYPICAL EQUIPMENT, PAGE C033

THALES
WCRP TMC SIG BMD 1.2 DWG 00004

Maya
ENGINEERING

prasa
AF SOUTH AFRANCE

RETREAT (RET)

SCALE	NTS
DRAWN	CHECKED
DATE	DATE
AMENDED	AMENDED
FILE	FILE

PRASA HQ	PRASA REGION	PRASA REGION	Technical Advisor	External Checker	Internal Checker	Producer
APPROVED	APPROVED	APPROVED	REVIEWED	CHECKED	REVIEWED	CHECKED
Date	Date	Date	Date	Date	Date	Date

CSE	1C	122
Amend. No.	-	0.3
Sheet		P014